



(11) **EP 1 515 095 B1**

(12) **EUROPEAN PATENT SPECIFICATION**

(45) Date of publication and mention of the grant of the patent:
26.10.2011 Bulletin 2011/43

(21) Application number: **03721034.1**

(22) Date of filing: **06.05.2003**

(51) Int Cl.:
F24F 1/00 (2011.01)

(86) International application number:
PCT/JP2003/005671

(87) International publication number:
WO 2003/098119 (27.11.2003 Gazette 2003/48)

(54) **INDOOR UNIT FOR AIR CONDITIONER**

INNENRAUMEINHEIT FÜR KLIMAAANLAGE

SECTION INTERIEURE POUR CONDITIONNEUR D'AIR

(84) Designated Contracting States:
AT BE BG CH CY CZ DE DK EE ES FI FR GB GR HU IE IT LI LU MC NL PT RO SE SI SK TR

(30) Priority: **15.05.2002 JP 2002139745**

(43) Date of publication of application:
16.03.2005 Bulletin 2005/11

(73) Proprietor: **DAIKIN INDUSTRIES, LIMITED**
Kita-ku, 530-8323 Osaka (JP)

(72) Inventors:
• **NAKANISHI, Junichi,**
DAIKIN INDUSTRIES,LTD.
Kusatsu-shi, Shiga 525-0044 (JP)

- **INOUE, Kiyoshi,**
DAIKIN INDUSTRIES,LTD.,Shiga Plant
Kusatsu-shi,Shig a 525-0044 (JP)
- **SONOMOTO, Hidehiro,**
DAIKIN INDUSTRIES,LTD.
Kusatsu-shi, Shiga 525-0044 (JP)

(74) Representative: **HOFFMANN EITLÉ**
Patent- und Rechtsanwälte
Arabellastraße 4
81925 München (DE)

(56) References cited:
JP-A- 9 280 597 JP-A- 10 205 877
JP-A- 2001 082 795

EP 1 515 095 B1

Note: Within nine months of the publication of the mention of the grant of the European patent in the European Patent Bulletin, any person may give notice to the European Patent Office of opposition to that patent, in accordance with the Implementing Regulations. Notice of opposition shall not be deemed to have been filed until the opposition fee has been paid. (Art. 99(1) European Patent Convention).

Description

SPECIFICATION

(FIELD OF THE INVENTION)

[0001] The present invention relates to an indoor unit of an air conditioner, and more particularly relates to an indoor unit of an air conditioner comprising a heat exchanger and refrigerant circuit parts, and that air conditions by condensation and expansion of the refrigerant.

(RELATED ART)

[0002] Among separate-type air conditioners that are divided into an indoor unit and an outdoor unit, there are a pair type air conditioner that connects just one indoor unit to one outdoor unit, and a multi-split type air conditioner that connects a plurality of indoor units in parallel to one outdoor unit.

[0003] FIG. 1 shows an exterior view of a pair type air conditioner. In an air conditioner 81 shown therein, there is a correspondence of one indoor unit 83 for one outdoor unit 82, and both 82, 83 are connected by a connecting part 89 comprising refrigerant piping, a transmission line, and the like.

[0004] As shown in FIG. 2, the indoor unit of the pair type air conditioner comprises a fan rotor 3, a heat exchanger 4, an electrical equipment box 30, and the like. These constituent parts are arranged inside a casing comprising a front surface grille assembly 10, a front surface panel 11, a bottom frame 12, and the like. The bottom frame 12 is fixed to an indoor wall and the like by mounting it to a mounting plate 15 fixed to an indoor wall surface. An upper inlet 10a having slits is provided in the upper surface of the front surface grille assembly 10, and a front surface inlet 11a is also provided at the top and sides of the front surface panel 11. Air cleaning air filters 17 are arranged on the inside of these inlets 10a, 11 a. In addition, an outlet for blowing out the airflow generated by the fan rotor 3 is formed at the front bottom part of the front surface grille assembly 10.

[0005] The fan rotor 3 is arranged in a fan housing part 12a formed in the bottom frame 12, with one end being attached to the bottom frame 12 via a bearing 13, and the other end being coupled to the rotational shaft of a motor 14. This motor 14 is fixed to the bottom frame 12 by a motor fixed member 16.

[0006] The heat exchanger 4 is provided so that it surrounds the front, upper, and rear upper parts of the fan rotor 3, and is also split into a front side heat exchanger 141 and a rear side heat exchanger 142, each having an effective length L. In each of the heat exchangers 141, 142, numerous heat radiating fins are attached to a heat transfer pipe bent a plurality of times at both the left and right ends, the air sucked in from the upper inlet 10a and the front surface inlet 11 a by the drive of the fan rotor 3 is made to pass through to the fan rotor 3 side, and heat

is exchanged between the air and the refrigerant that passes through the inside of the heat transfer pipe. The heat exchanger 4 is connected via the refrigerant piping to the refrigerant piping from the outdoor unit. In addition, below the front side heat exchanger 141 is arranged a drain pan assembly 18 that includes a front drain pan, a vane for adjusting the direction of the blown out air, and the like.

[0007] Furthermore, the effective length of a front side heat exchanger and a rear side heat exchanger of a heat exchanger may not necessarily be the same. For example, as disclosed in JP-A-2001-82795 forming the basis for the preamble of claim 1, it is also possible to make the effective length of the front side heat exchanger and the rear side heat exchanger of a heat exchanger different.

[0008] The indoor unit of the above pair type air conditioner as shown in FIG. 1 and FIG. 2, and the indoor unit employed by a multi-split type air conditioner that connects a plurality of indoor units in parallel to one outdoor unit were conventionally designed separately. Given this situation, attempts are recently being made to standardize parts between pair type indoor units and multi-split type indoor units. Although the specifications for the heat exchanger often differ between a pair type and a multi-split type, the standardization of the casing parts and the like is conceivable.

[0009] However, unlike a pair type, the indoor unit of a multi-split type air conditioner is often internally provided with a motor operated valve because the plurality of indoor units are separately started and stopped, and controlled. This motor operated valve serves the role of adjusting the amount of refrigerant flowing in the heat exchanger of the indoor unit, and generates a relatively loud noise, such as when the refrigerant expands in the liquid-gas mixture state.

[0010] If a noise source of the motor operated valve and the like, which are parts inherent to the multi-split type indoor unit, is arranged inside a regular pair type casing, then the refrigerant piping bank in the pair type indoor unit is arranged in the space on the side of the centrally disposed heat exchanger. In this case, if the same casing is used, then the abnormal noise will cease if it is a pair type indoor unit, although it is assumed that abnormal noise from the motor operated valve and the like will leak out into the room if it is a multi-split type indoor unit. Thus, it is difficult to standardize parts like the casing between a pair type indoor unit and a multi-split type indoor unit.

[0011] Further, JP-A-09-280597 discloses to cover refrigerant circuit parts with a sound proofing plate fixed to a heat exchanger and a water pan.

(DISCLOSURE OF THE INVENTION)

[0012] It is an object of the present invention to provide an indoor unit of an air conditioner wherein noise does not tend to leak out of the indoor unit, even if refrigerant

circuit parts such as a motor operated valve, which constitutes a noise source, are arranged in the indoor unit.

[0013] An indoor unit of an air conditioner according to the invention comprises the features of claims 1.

[0014] First, the present invention herein is constituted so that the effective length of the rear side heat exchanger is less than the effective length of the front side heat exchanger, and a prescribed space is created on the backside of the indoor unit. Furthermore, refrigerant circuit parts, such as the motor operated valve and the distributor that generate relatively loud sounds when changing the flow of the refrigerant, are arranged in that space. Thus, because the refrigerant circuit parts that constitute noise sources herein are arranged in the space on the backside inside the indoor unit, the amount of sound leaking out to the front side of the indoor unit is reduced, thus suppressing discomfort to people in the room.

[0015] Second, if the indoor unit is constituted so that the effective length of the rear side heat exchanger is less than the effective length of the front side heat exchanger, then the length of the fan rotor is matched to the front side heat exchanger, whose effective length would normally be thought to be long. Consequently, the abovementioned space (space created by the difference in the effective lengths of the front side heat exchanger and the rear side heat exchanger) is contiguous to a part of the fan rotor. In this case, even if nothing is provided between that space and the fan rotor, there is a risk that air will flow from the abovementioned space directly into the fan rotor without passing through the heat exchanger.

[0016] In contrast, in the indoor unit according to the invention, because the partition plates (windbreaking members) are arranged between the space, wherein the refrigerant circuit parts are arranged, and the fan rotor, the problem of air flowing into the fan rotor without passing by the indoor heat exchanger is suppressed.

[0017] Embodiments of the invention are named in the dependent claims.

[0018] The indoor unit of the air conditioner may be the indoor unit of an air conditioner comprising an outdoor unit and a plurality of indoor units. Further, the refrigerant circuit parts arranged in the space, created because the effective length of the rear side heat exchanger is less than the front side heat exchanger, includes at least a motor-operated valve. The motor operated valve is provided for adjusting the amount of refrigerant flowing to the plurality of indoor units.

[0019] Herein, the motor operated valve, which is usually built into the indoor unit of a multi-split type air conditioner, is arranged in the space on the backside inside the indoor unit, which easily confines noise. The motor operated valve sometimes generates a relatively loud abnormal sound when adjusting the amount of refrigerant; however, because it is arranged herein in the abovementioned space, which tends not to leak sound out of the indoor unit, a loud abnormal sound is no longer heard by people in the room.

[0020] The indoor unit may further comprise a metal

member that covers the space wherein the refrigerant circuit parts are arranged.

[0021] Herein, not only is the amount of noise that leaks out to the front side of the indoor unit suppressed by arranging the refrigerant circuit parts in the space on the back side inside the indoor unit, but the space is further covered by a metal member. Accordingly, even in a case where a loud abnormal noise generated from the refrigerant circuit parts passes through the casing, which is usually made of resin, and leaks out of the indoor unit, the leakage of that abnormal noise out of the indoor unit can be suppressed by the noise insulating effect of the metal member.

[0022] The indoor unit may further comprise a drain pan that receives drain water falling from the heat exchanger. Further, the lower ends of the (partition plates) windbreaking members extend to the drain pan.

[0023] This drain pan is arranged below the lower end of the front side heat exchanger and below the lower end of the rear side heat exchanger, and receives the drain water; it is also widely used in conventional indoor units.

[0024] Herein, because the lower ends of the windbreaking members extend to the drain pan, water that drips down from the heat exchanger and the like to the windbreaking members flows to the drain pan, which has been available conventionally. Thereby, the problem of the water dropping down from the windbreaking members to the fan rotor is suppressed.

(BRIEF EXPLANATION OF THE DRAWINGS)

[0025]

FIG. 1 is an exterior perspective view of a conventional pair type air conditioner.

FIG. 2 is an assembly exploded view of a conventional indoor unit.

FIG. 3 is a schematic of a multi-split type air conditioner that includes the indoor unit according to one embodiment of the present invention.

FIG. 4 is a view that depicts a refrigerant circuit of the multi-split type air conditioner.

FIG. 5 is an internal perspective view of the side portion of a motor of the indoor unit.

FIG. 6 is a cross-sectional schematic of the indoor unit.

(PREFERRED EMBODIMENTS)

<OVERVIEW OF A MULTI-SPLIT TYPE AIR CONDITIONER>

[0026] An indoor unit of an air conditioner according to one embodiment of the present invention is used in a multi-split type air conditioner, as shown in FIG. 3. In this multi-split type air conditioner 91, a plurality of indoor units 93 - 96 are connected to one outdoor unit 92. The outdoor unit 92 and the indoor units 93 - 96 are connected

by connecting parts 99a - 99d comprising refrigerant piping and a transmission line. Four indoor units 93 - 96 are respectively arranged in separate rooms in, for example, a home, a building, or a store.

<THE REFRIGERANT CIRCUIT OF A MULTI-SPLIT TYPE AIR CONDITIONER>

[0027] FIG. 4 depicts a refrigerant circuit 190 of the multi-split type air conditioner 91. The refrigerant circuit 190 comprises one outdoor unit 92, four indoor units 93 - 96 connected in parallel to the outdoor unit 92, and refrigerant piping.

[0028] The outdoor unit 92 comprises a compressor 20, a four-way switching valve 21, an outdoor heat exchanger 22, an accumulator 23, and the like. A discharge pipe thermistor 24 is attached to the discharge side of the compressor 20 for detecting the discharge pipe temperature on the discharge side of the compressor 20. In addition, the outdoor unit 92 is provided with an outside air thermistor 25 for detecting the outside air temperature, and an outdoor heat exchange thermistor 26 for detecting the temperature of the outdoor heat exchanger 22.

[0029] Each of the indoor units 93 - 96 has the same constitution. The following explains the indoor units 93 - 96 using the indoor unit 93 as an example.

[0030] The indoor unit 93 comprises an indoor heat exchanger 4a and a motor-operated valve (expansion valve) 33a mutually connected in series. The motor-operated valve 33a is provided on the refrigerant exit side of the indoor heat exchanger 4a and adjusts the amount of refrigerant flowing to the indoor heat exchanger 4a. In addition, the indoor unit 93 respectively comprises a room temperature thermistor 31 a for detecting the indoor temperature, and an indoor heat exchange thermistor 32a for detecting the temperature of the indoor heat exchanger 4a. A liquid pipe thermistor 34a for detecting the liquid pipe temperature between the indoor heat exchanger 4a and the motor-operated valve 33a is provided in the piping between the indoor heat exchanger 4a and the motor-operated valve 33a. A gas pipe thermistor 35a is provided on the gas pipe side (refrigerant entrance side) of the indoor heat exchanger 4a for detecting the refrigerant temperature passing therethrough internally.

[0031] The other indoor units 94, 95, 96 are likewise constituted the same as the indoor unit 93, and their indoor heat exchangers, motor operated valves, and various thermistors are assigned equivalent symbols in FIG. 4.

<THE CONSTITUENT PARTS OF THE INDOOR UNIT, AND THEIR

ARRANGEMENT>

[0032] As described above, the indoor units 93 - 96 used in the multi-split type air conditioner 91 have built-in motor-operated valves 33a - 33d. The following ex-

plains the indoor unit used in the multi-split type air conditioner, using the indoor unit 93 as an example, and focusing on the arrangement of the parts.

[0033] In the indoor unit 93, the indoor heat exchanger 4a that partially covers the front, upper, and rear parts of a fan rotor 3 principally comprises a front side heat exchanger 41 and a rear side heat exchanger 42, as shown in FIG. 5 and FIG. 6. The rear side heat exchanger 42 has an effective length that is less than the front side heat exchanger 41, and an end part 42b on a motor 14 side thereof is positioned closer to the central portion in the latitudinal direction of the indoor unit 93 than an end part 41b of the front side heat exchanger 41 (refer to FIG. 5). Thereby, a relatively large space SP is ensured on the outer side of the rear side heat exchanger 42 (the side on the motor 14 side). The width dimension of this space SP is substantially the same dimension as the difference in the effective lengths of the front side heat exchanger 41 and the rear side heat exchanger 42, and is 100 - 150 mm.

[0034] In addition, a structure is employed in the indoor unit 93 wherein an upper end 41 a of the front side heat exchanger 41 is slightly spaced apart from an upper end 42a of the rear side heat exchanger 42, and a connecting plate 43 extends therebetween. This connecting plate 43 integrates the front side heat exchanger 41 and the rear side heat exchanger 42 as the indoor heat exchanger 4a, and serves the role of preventing the unfortunate passage of the air from above the indoor heat exchanger 4a to the fan rotor 3 below without passing through the front side heat exchanger 41, the rear side heat exchanger 42, and the like.

[0035] Further, in the indoor unit 93, the motor-operated valve 33a, refrigerant piping 133 that connects to the motor-operated valve 33a, and a distributor 39 that divides the flow of refrigerant exiting the motor-operated valve 33a to each of the heat transfer passageways of the indoor heat exchanger 4a, and the like, are arranged in the space SP created by the difference in the effective lengths of the front side heat exchanger 41 and the rear side heat exchanger 42. As shown in FIG. 5, the motor-operated valve 33a is arranged laterally to improve maintainability.

[0036] Furthermore, in the indoor unit 93, the space SP, wherein the motor-operated valve 33a and the like is arranged, is enclosed by a metal cover 50, a vertical partition plate 44, and a lateral partition plate 45. The metal cover 50 is a plate member integrally formed from a first cover part 51 that covers the upper part of the space SP, a second cover part 52 that extends downward diagonally from the front end of the first cover part 51 along the front surface of the front side heat exchanger 41, and a third cover part 53 that extends downward diagonally from the rear end of the first cover part 51 and covers the rear of the space SP. This metal cover 50 is provided principally for the purpose of isolating noise. However, the vertical partition plate 44 and the lateral partition plate 45 are plate-shaped members made of

metal and provided to prevent the leakage of air that flows into the space SP out to the fan rotor side. The vertical partition plate 44 is positioned above the fan rotor 3, and partitions the space surrounding the fan rotor 3 and the space SP wherein the motor-operated valve 33a and the like are arranged. The lateral partition plate 45 is a substantially triangular member that extends perpendicularly frontward from the end part 42b on the space SP side of the rear side heat exchanger 42, and the sides abut orthogonally with the end part 42b of the rear side heat exchanger 42, the end part on the space SP side of the connecting plate 43, and the end part of the vertical partition plate 44.

[0037] In addition, a front drain pan 61 is arranged below the lower end of the front side heat exchanger 41, and a rear drain pan 62 is arranged below the lower end of the rear side heat exchanger 42, respectively. These drain pans 61, 62 form a bottom frame and a drain pan assembly having a constitution the same as the conventional bottom frame 12 and drain pan assembly 18 in FIG. 2, and serve the role of receiving the drain water that drips downward from the indoor heat exchanger 4a and the like. Further, in the indoor unit 93, a drain route 63 is formed below the portion where the abovementioned vertical partition plate 44, the lateral partition plate 45, and the end part 42b on the space SP side of the rear side heat exchanger 42, which surround the space SP, intersect so that the drain water from that portion does not drip down to the fan rotor 3. This drain route 63 is structured so that a metal plate is bent at the intersecting portion of the vertical partition plate 44 and the lateral partition plate 45 (a part of the vertical partition plate 44, a part of the lateral partition plate 45, or separate members mounted to these partition plates 44, 45), and so that its cross-section is pocket-shaped. Thereby, the drain water that drops from the end part 42b of the rear side heat exchanger 42 along the lateral partition plate 45, and the drain water that sweats out from the intersecting portion of the vertical partition plate 44 and the lateral partition plate 45 to the fan rotor 3 side along a gap from the space SP due to the pressure differential are guided to the drain route 63 and flow into the rear drain pan 62 (refer to FIG. 6).

<FEATURES OF THE INDOOR UNIT>

[0038]

[1] First, the indoor unit 93 is constituted so that the effective length of the rear side heat exchanger 42 is less than the effective length of the front side heat exchanger 41, and a prescribed space SP is created on the rear side of the indoor unit 93. Furthermore, refrigerant circuit parts, such as the motor operated valve 33a and the distributor 39 that generate comparatively loud sounds when changing the flow of the refrigerant, are arranged in that space SP. Thus, because noise sources such as the motor-operated

valve 33a can be arranged on the rear side of the indoor unit 93, the noise level that can be heard by people in the room, judging from the directionality of the noise, can be kept low.

[2] In the indoor unit 93, not only is the amount of noise that leaks out to the front side of the indoor unit 93 suppressed by arranging the refrigerant circuit parts that form the noise sources, such as the motor-operated valve 33a, in the space SP on the back side of the indoor unit 93, but the space SP is further covered by a metal cover 50. Accordingly, even in a case where a loud abnormal noise generated by the motor-operated valve 33a and the like passes through the casing, which is usually made of resin, and leaks out of the indoor unit 93, the leakage of that abnormal noise out of the indoor unit 93 will be suppressed by the noise insulating effect of the metal cover 50.

Furthermore, it is preferable to take conventional sound insulating measures in parallel by covering the motor-operated valve 33a with putty, rubber, and the like.

[3] Because the indoor unit 93 is constituted so that the effective length of the rear side heat exchanger 42 is less than the effective length of the front side heat exchanger 41, the length of the fan rotor 3 corresponding to the effective length of the front side heat exchanger 41 is greater than the rear side heat exchanger 42. Thereby, the space SP is positioned above a portion of the motor 14 side of the fan rotor 3. In this case, even if nothing is provided between the space SP and the fan rotor 3, there is a risk that air will flow from the space SP directly into the fan rotor 3 without passing through either of the heat exchangers 41, 42 of the indoor heat exchanger 4a.

In contrast, in the indoor unit 93, because the vertical partition plate 44 and the lateral partition plate 45 are arranged between the space SP, wherein the motor operated valve 33a and the like are arranged, and the fan rotor 3, the problem of air flowing into the fan rotor 3 without passing by the indoor heat exchanger 4a is suppressed.

[4] In the indoor unit 93, the vertical partition plate 44 prevents air from flowing down from the space SP to the fan rotor 3, and the lateral partition plate 45 prevents the air from flowing from the space SP to the fan rotor 3 through the space between the front side heat exchanger 41 and the end part 42b of the rear side heat exchanger 42. Further, as shown in FIG. 6, because the lower ends of the vertical partition plate 44 and the lateral partition plate 45 are positioned above the rear drain pan 62, even when water droplets flow to the partition plates 44, 45 from the end part 42b of the rear side heat exchanger 42 and the like, that water flows into the rear drain pan 62.

In addition, the drain water that exits from the intersecting portion of the end part 42b of the rear side

heat exchanger 42, which is shorter than the fan rotor 3, and both partition plates 44, 45 to the fan rotor 3 side via the gap due to the pressure differential and the like is guided to the rear drain pan 62 by the drain route 63. Consequently, the problem of the drain water dripping down to the fan rotor 3 is suppressed even if the space SP is provided as described above and the space SP is enclosed by the partition plates 44, 45.

[5] The indoor unit 93 comprises the motor-operated valve 33a, and it is difficult to conceive of also using it as is in a pair type air conditioner, such as a room air conditioner. However, it is possible to design a structure so that the indoor heat exchanger 4a of the indoor unit 93 is replaced with an indoor heat exchanger for a pair type air conditioner, thereby standardizing the casing portion for both multi-split types and pair types.

For example, in standardizing the casing, it is possible to design so that, in a multi-split type indoor unit that is often used for business, an indoor heat exchanger is installed wherein the effective lengths of a front side heat exchanger and a rear side heat exchanger differ as in the abovementioned indoor unit 93, and, in a pair type indoor unit, an indoor heat exchanger is installed wherein the effective lengths of the front side heat exchanger and the rear side heat exchanger are the same.

(INDUSTRIAL FIELD OF APPLICATION)

[0039] Using the heat exchanger unit according to the present invention reduces the amount of noise leaking out to the front side of the indoor unit and suppresses discomfort to people in the room because the effective length of the rear side heat exchanger is less than the effective length of the front side heat exchanger, a prescribed space is created on the back side of the indoor unit, and the refrigerant circuit parts, such as the motor operated valve and the distributor, which generate a relatively loud sound when changing the flow of the refrigerant, are arranged in that space.

Claims

1. An indoor unit of an air conditioner that air-conditions by the condensation and expansion of a refrigerant, comprising:

a heat exchanger (4a) comprising a front side heat exchanger (41) and a rear side heat exchanger (42), and that exchanges heat between a refrigerant and air; and
refrigerant circuit parts (33a, 39) that change the flow of said refrigerant;
a fan rotor (3) for sending air conditioned air indoors;

wherein,

said rear side heat exchanger (42) has an effective length less than said front side heat exchanger (41); and

said refrigerant circuit parts (33a, 39) are arranged in a space (SP) created by the difference in the effective lengths of said front side heat exchanger (41) and said rear side heat exchanger (42), **characterized by** partition plates (44, 45) arranged between said space (SP) and said fan rotor (3), suppressing air flowing from said space (SP) directly into said fan rotor (3) without passing through the heat exchanger (4).

2. The indoor unit of the air conditioner as recited in Claim 1, further comprising:

a metal member (50) that covers said space (SP).

3. The indoor unit of the air conditioner as recited in Claim 1 or Claim 2, wherein said partition plates include a vertical partition plate (44) positioned above the fan rotor (3) and a lateral partition plate (45) being a substantially triangular member extending perpendicularly frontward from an end part (42b) on said space (SP) side of said rear side heat exchanger (42).

4. The indoor unit of the air conditioner as recited in any one of the preceding Claims, further comprising:

a drain pan (62) that receives drain water falling from said heat exchanger (4a);

wherein,

lower ends of said partition plates (44, 45) extend to said drain pan (62).

5. Air conditioner comprising an outdoor unit (92) and a plurality of indoor units (93 - 96) according to any one of the preceding Claims, wherein said refrigerant circuit parts arranged in said space (SP) include at least a motor-operated valve (33a) for adjusting the amount of refrigerant flowing to said plurality of indoor units (93 - 96).

Patentansprüche

1. Inneneinheit einer Klimaanlage, die eine Klimatisierung über die Kondensation und Expansion eines Kühlmittels ausführt, mit:

einem Wärmetauscher (4a), der einen Vorderseitenwärmetauscher (41) und einen Rückseitenwärmetauscher (42) aufweist und der Wärme zwischen einem Kühlmittel und Luft austauscht; und

- Kühlkreislaufkomponenten (33a, 39), die den Fluss des Kühlmittels verändern;
 einem Gebläserotor (3) zum Senden von klimatisierter Luft in den Innenraum,
 wobei der Rückseitenwärmetauscher (42) eine kürzere effektive Länge aufweist als der Vorderseitenwärmetauscher (41); und
 die Kühlkreislaufkomponenten (33a, 39) in einem Raum (SP) angeordnet sind, der durch den Unterschied in den effektiven Längen des Vorderseitenwärmetauschers (41) und des Rückseitenwärmetauschers (42) verursacht wird, **gekennzeichnet durch** Abtrennplatten (44, 45), die zwischen dem Raum (SP) und dem Gebläserotor (3) angeordnet sind und die eine Luftströmung von dem Raum (SP) direkt in den Gebläserotor (3), ohne **durch** den Wärmetauscher (4) zu treten, unterbinden.
2. Inneneinheit der Klimaanlage nach Anspruch 1, ferner mit:
- einem Metallelement (50), das den Raum (SP) abdeckt.
3. Inneneinheit der Klimaanlage nach Anspruch 1 oder 2, bei der die Abtrennplatten eine vertikale Abtrennplatte (44), die oberhalb des Gebläserotors (3) angeordnet ist, und eine seitliche Abtrennplatte (45) aufweisen, die ein im Wesentlichen dreieckiges Element ist, das sich senkrecht vorderseitig von einem Endteil (42b) auf der Seite des Raums (SP) des Rückseitenwärmetauschers (42) erstreckt.
4. Inneneinheit der Klimaanlage nach einem der vorherigen Ansprüche, ferner mit:
- einer Ablaufwanne (62), die Ablaufwasser aufnimmt, das von dem Wärmetauscher (4a) her untertropft;
 wobei sich untere Enden der Abtrennplatten (44, 45) zu der Ablaufwanne (62) hin erstrecken.
5. Klimaanlage mit einer Außeneinheit (92) und mehreren Inneneinheiten (93-96) nach einem der vorherigen Ansprüche,
 wobei die Kühlkreislaufkomponenten, die in dem Raum (SP) angeordnet sind, wenigstens ein motorbetriebenes Ventil (33a) zum Einstellen der Kühlmittelmenge, die zu den mehreren Inneneinheiten (93-96) strömt, aufweisen.
- Revendications**
1. Unité intérieure d'un climatiseur qui conditionne l'air par condensation et expansion d'un réfrigérant, comprenant :
- un échangeur de chaleur (4a) comprenant un côté avant d'échangeur de chaleur (41) et un côté arrière échangeur de chaleur (42), et qui échange de la chaleur entre un réfrigérant et l'air ; et
 des parties de circuit de réfrigérant (33a, 39) qui modifient le débit dudit réfrigérant :
- un rotor de ventilateur (3) pour envoyer l'air conditionné à l'intérieur ;
 dans lequel,
 ledit côté arrière d'échangeur de chaleur (42) a une longueur efficace plus faible que ledit côté avant d'échangeur de chaleur (41) ; et
 lesdites parties de circuit de réfrigérant (33a, 39) sont agencées dans un espace (SP) créé par la différence de longueur efficace entre ledit côté avant d'échangeur de chaleur (41) et ledit côté arrière d'échangeur de chaleur (42), **caractérisée par** des plaques de séparation (44, 45) agencées entre ledit espace (SP) et ledit rotor de ventilateur (3), supprimant l'écoulement d'air depuis ledit espace (SP) directement dans ledit rotor de ventilateur (3) sans traverser l'échangeur de chaleur (4).
2. Unité intérieure de climatiseur selon la revendication 1, comprenant en outre :
- un élément métallique (50) qui couvre ledit espace (SP).
3. Unité intérieure de climatiseur selon la revendication 1 ou la revendication 2, dans laquelle lesdites plaques de séparation comprennent une plaque de séparation verticale (44) positionnée au-dessus du rotor de ventilateur (3) et une plaque de séparation latérale (45) étant un élément sensiblement triangulaire s'étendant perpendiculairement vers l'avant depuis une partie d'extrémité (42b) dudit espace (SP) à côté dudit côté arrière d'échangeur de chaleur (42).
4. Unité intérieure du climatiseur selon l'une quelconque des revendications précédentes, comprenant en outre :
- un plateau de drainage (62) qui reçoit l'eau de drainage tombant dudit échangeur de chaleur (4a) ;
 dans lequel,
 les extrémités inférieures desdites plaques de séparation (44, 45) s'étendent audit plateau de drainage (62).
5. Climatiseur comprenant une unité extérieure (92) et une pluralité d'unités intérieures (93 - 96) selon l'une

quelconque des revendications précédentes, dans lequel
lesdites parties de circuit de réfrigérant agencées dans ledit espace (SP) comprennent au moins une vanne motorisée (33a) pour ajuster la quantité de réfrigérant s'écoulant vers ladite pluralité d'unités intérieures (93 - 96).

5

10

15

20

25

30

35

40

45

50

55

Fig. 1

[PRIOR ART]

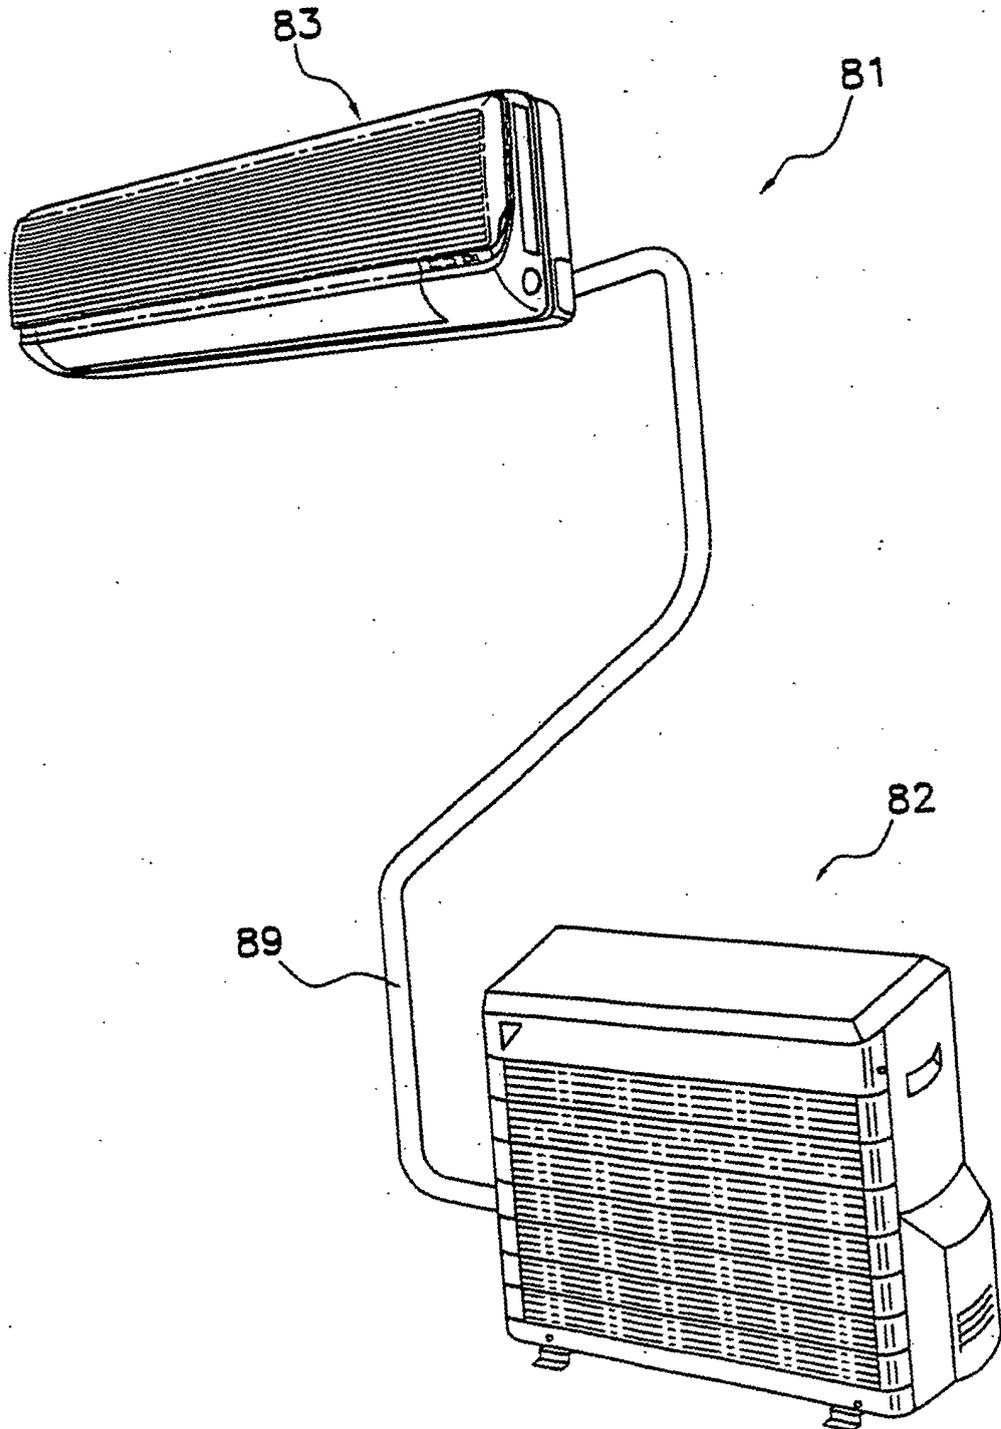


Fig. 2

[PRIOR ART]

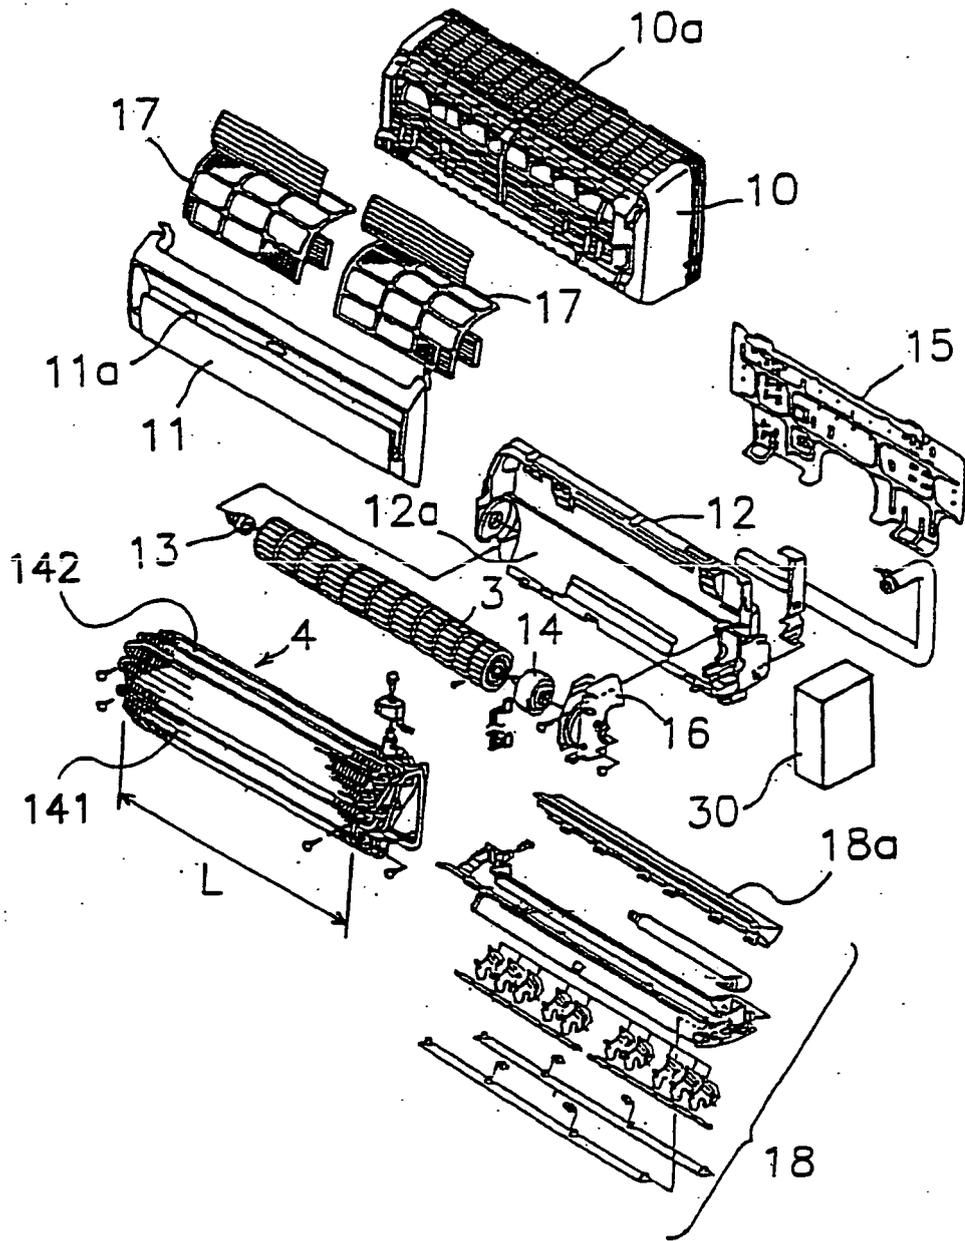


Fig. 3

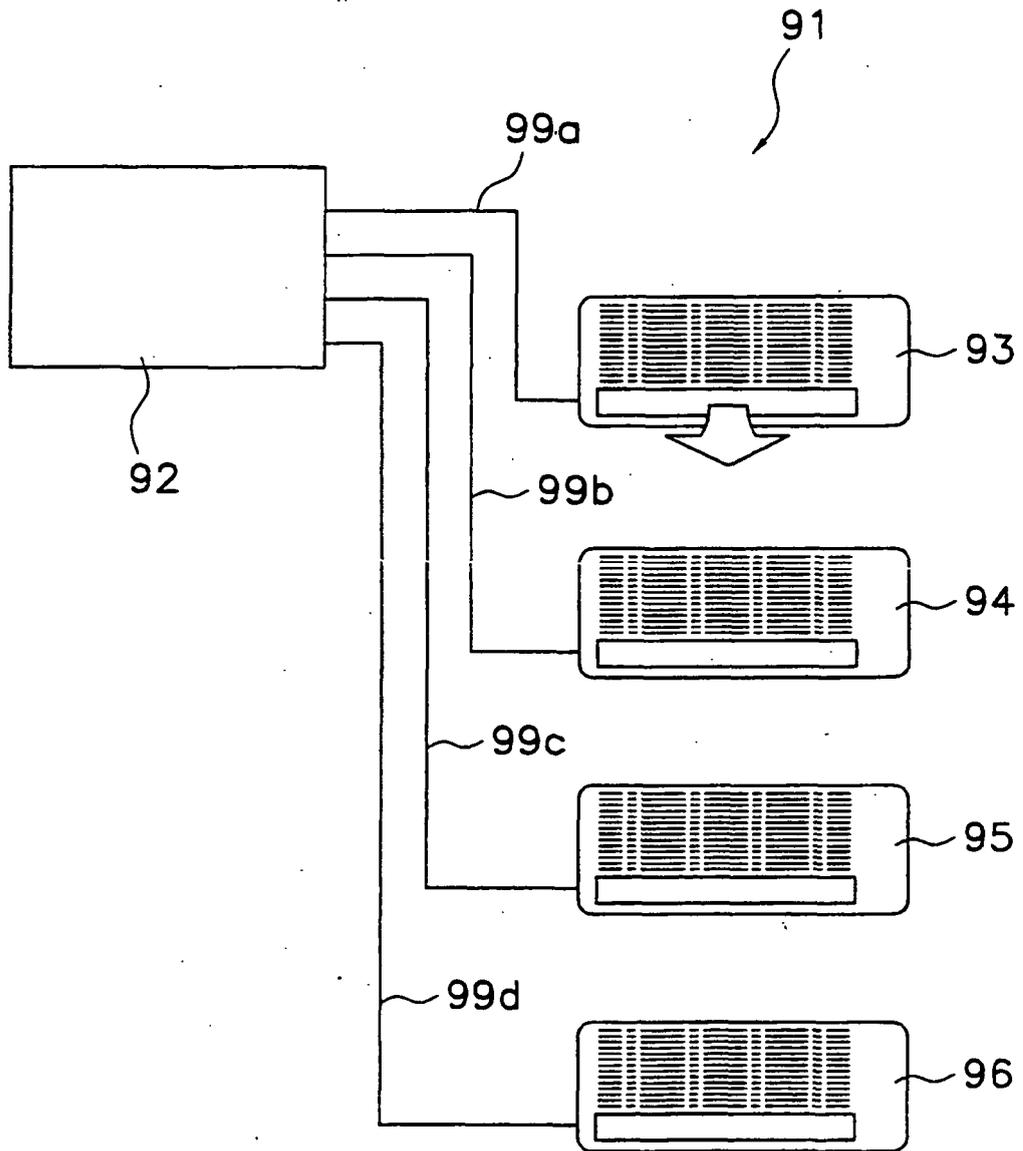


Fig. 4

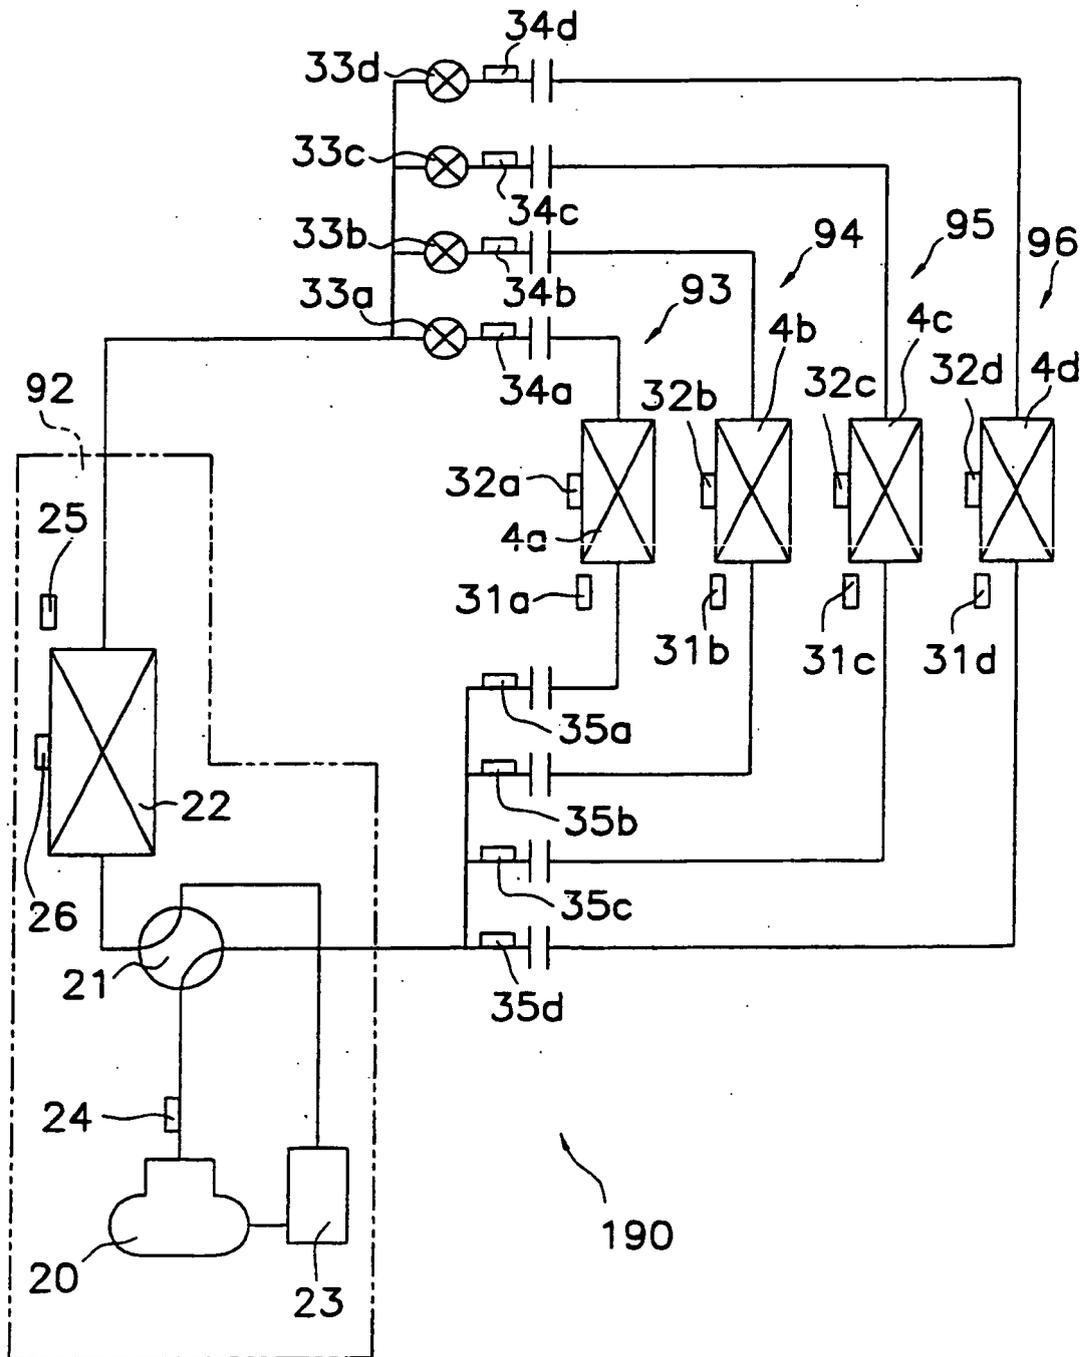


Fig. 5


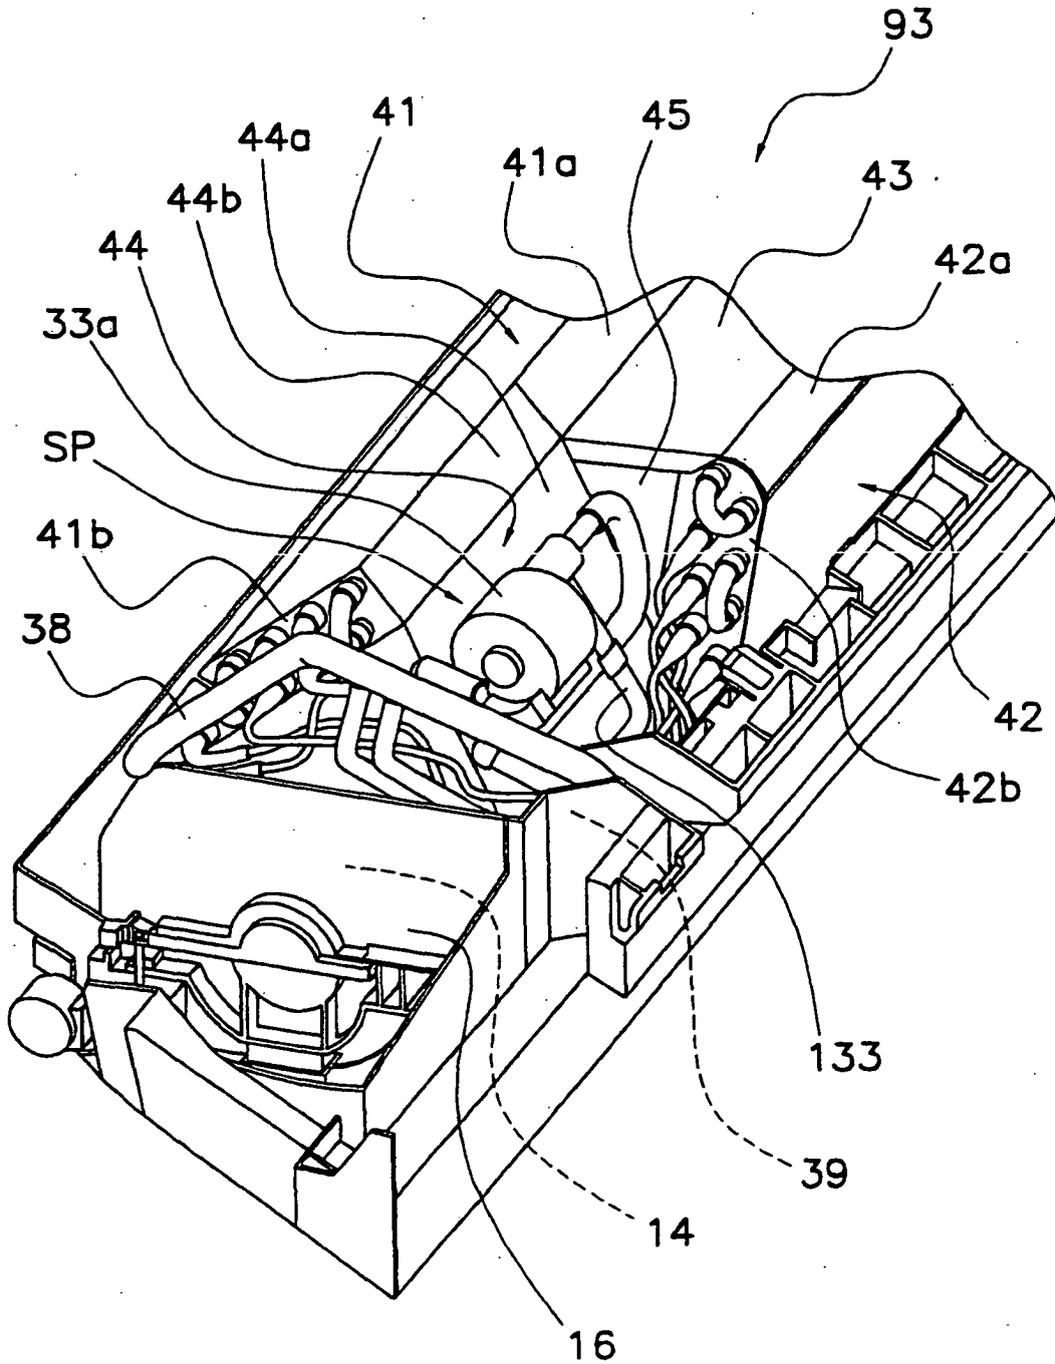


Fig. 6

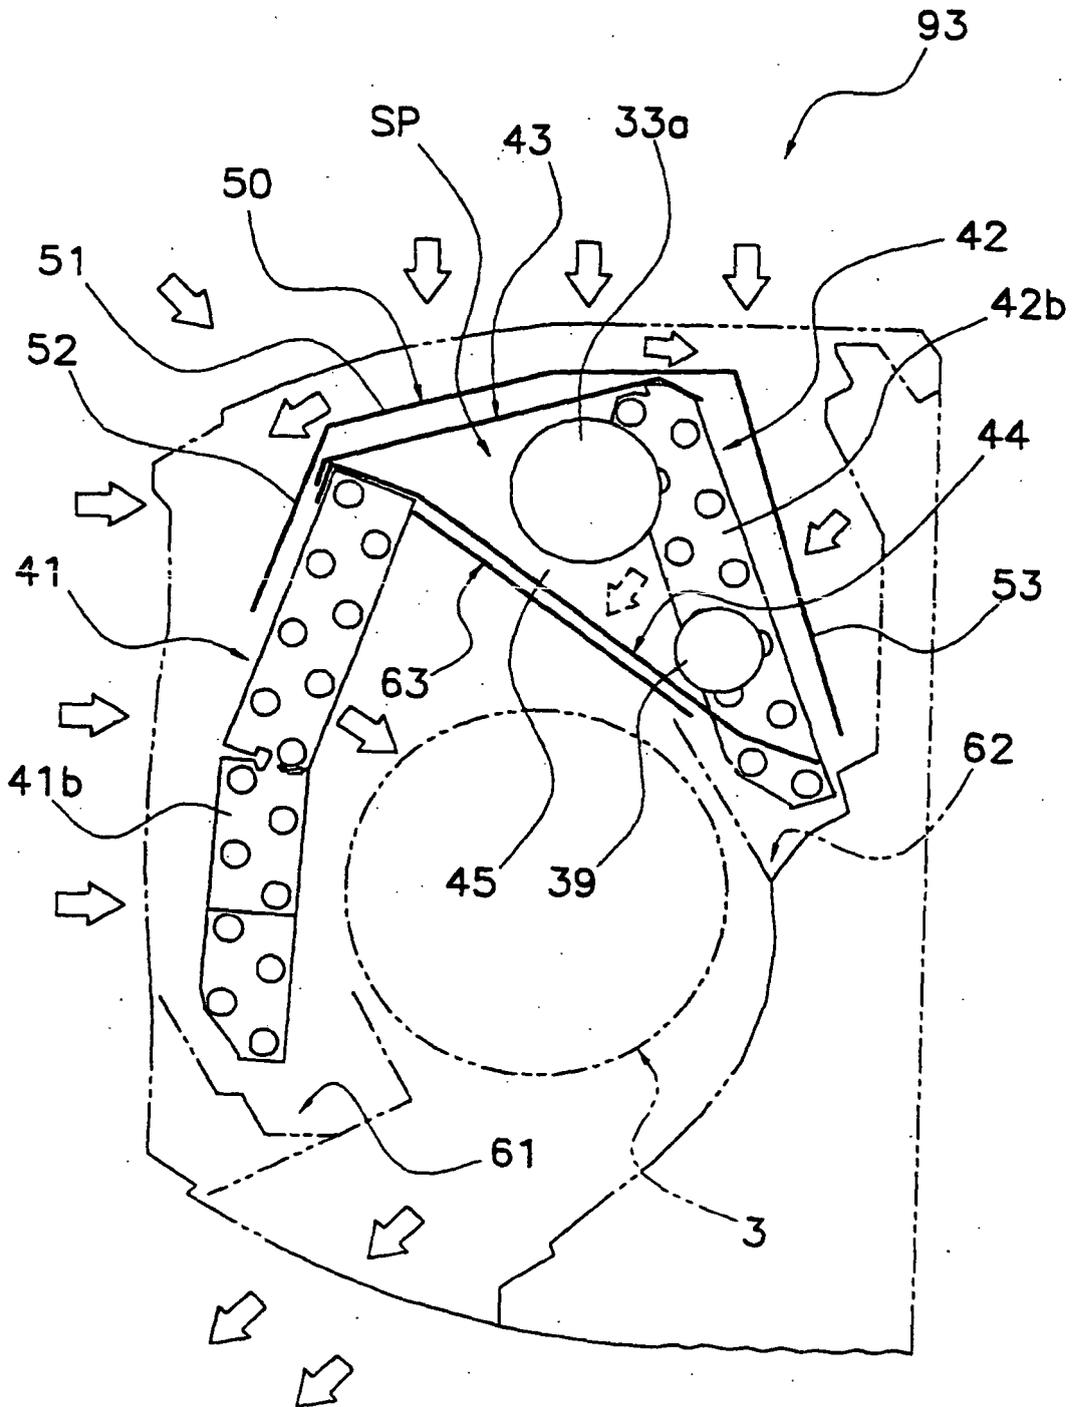

REFERENCES CITED IN THE DESCRIPTION

This list of references cited by the applicant is for the reader's convenience only. It does not form part of the European patent document. Even though great care has been taken in compiling the references, errors or omissions cannot be excluded and the EPO disclaims all liability in this regard.

Patent documents cited in the description

- JP 2001082795 A [0007]
- JP 9280597 A [0011]