



(22) Date de dépôt/Filing Date: 1991/05/03

(41) Mise à la disp. pub./Open to Public Insp.: 1992/02/01

(45) Date de délivrance/Issue Date: 2003/04/29

(30) Priorité/Priority: 1990/07/31 (560,687) US

(51) Cl.Int.⁵/Int.Cl.⁵ G01N 17/00, G01N 21/31, G01N 33/20

(72) Inventeurs/Inventors:

PIERCE, CLAUDIA C., US;

FOWEE, ROGER W., US;

BANKS, RODNEY H., US

(73) Propriétaire/Owner:


NALCO CHEMICAL COMPANY, US

(74) Agent: SMART & BIGGAR

(54) Titre : CONTROLE EN CONTINU DE LA TENEUR EN FER DES EAUX DE CHAUDIERE

(54) Title: ON-LINE IRON (II) CONCENTRATION MONITORING TO CONTINUOUSLY DETERMINE CORROSION IN BOILER SYSTEMS

Absorbance of Ferrous- Ferrozine complex as a function of ferrous ion concentration

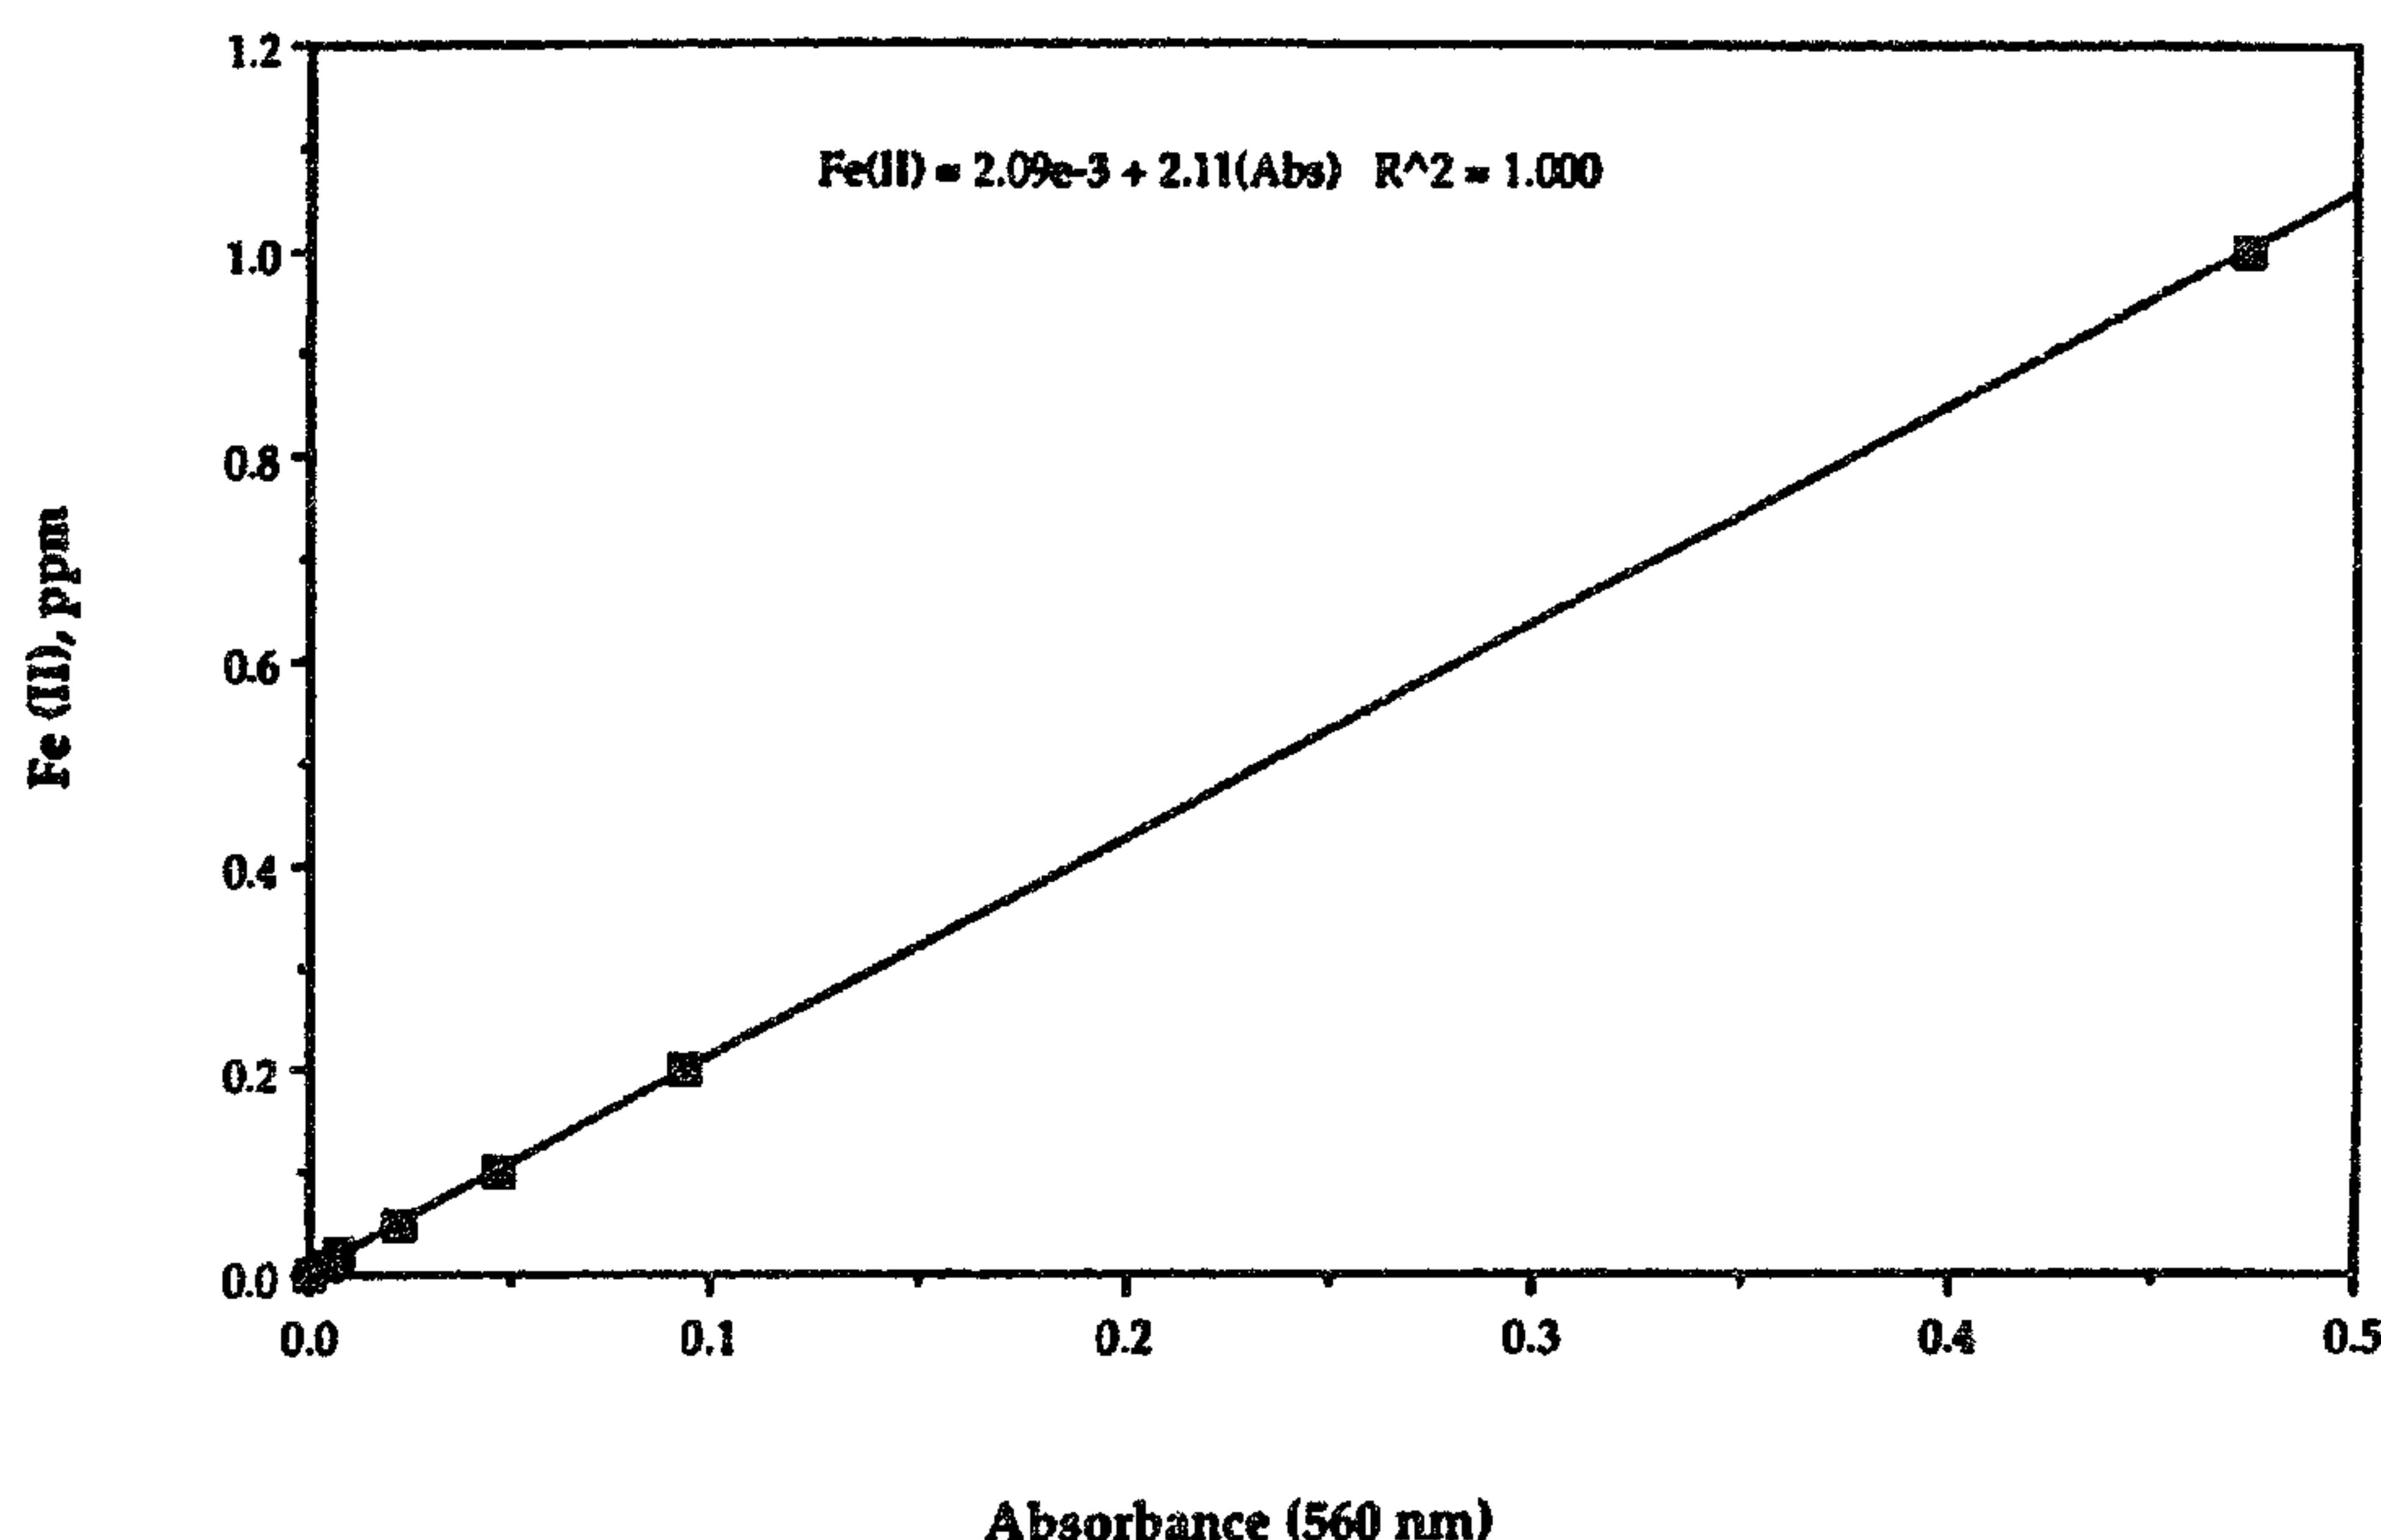

(57) Abrégé/Abstract:

A method for determining the presence of ferrous ion in boiler waters is described. The method can be used to directly measure the rate of corrosion occurring in boiler waters, and can measure the corrosion rates in the presence of boiler water treatment chemicals. The method uses a complex formed between only ferrous ion and a chemical 3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid monohydrate reagent.

ABSTRACT OF THE INVENTION

A method for determining the presence of ferrous ion in boiler waters is described.

- The method can be used to directly measure the rate of corrosion occurring in boiler waters, and can measure the corrosion rates in the presence of boiler water treatment chemicals. The method uses a complex formed between only ferrous ion and a chemical 3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid monohydrate reagent.

INTRODUCTION

Potential corrosion problems in boiler systems have presented the boiler operator with many unanswered questions over the past histories of operating these boiler systems. These problems have increased as the boiler systems themselves have become more sophisticated. Boiler systems that are operating at extremely high pressures and temperatures particularly require pretreatment of waters being used to feed the boilers to eliminate such contaminants as calcium and magnesium hardness, other inorganic salts such as ferrous and ferric salts, silicates, and the like.

Corrosion reactions in all of these boiler systems have been demonstrated by many previous researchers to be affected by many parameters such as oxygen content, water pH, temperature, pressure, water flow velocity, the formation of certain types of salts and scales, for example hardness scales, iron scales, particularly magnetite, and treatment with boiler water treatment chemicals which are designed to protect the boiler from corrosion, hardness scale deposits, oxygen induced corrosion, pH excursions, and the like.

Recently, it has been determined that ferrometals making up the boiler system units, which ferrometals can include a number of different types of iron containing steels, iron alloys, and the like, are faced with particularly difficult detection of corrosion problems from the point of view of determining when these boiler system units are experiencing corrosion and determining the reasons for the corrosion occurring.

As a result, our invention is related to the detection and determination of corrosion and of corrosion rates of boiler system ferrometals in contact with boiler waters, particularly those boiler waters containing boiler treatment chemicals purposely added to boiler waters, and boiler feed waters.

HISTORY

The chemistry of iron and its corrosion products in boiler systems has been summarized by W.E. Bornak in an article published in Corrosion (NACE), Volume 44, No. 3, March, 1988. Bornak describes measurement of different types of corrosion of ferrometals in contact with waters internal to boilers, particularly reviewing investigations of magnetite formation and corrosion related thereto in boilers. Bornak's article primarily summarizes the difficulties corrosion causes and presents several mechanisms to explain why corrosion is occurring. For example, he speaks of oxygen corrosion, the formation of magnetite and its protective characteristics when formed on a ferrometal surface in contact with boiler waters, and the breakdown of this magnetite layer under certain circumstances.

Bornak also talks generally in terms of the difficulties encountered by the production of hydrogen which is a byproduct of corrosion and which has been traditionally used to measure corrosion rates occurring in a operating boiler. According to Bornak, hydrogen atoms produced through corrosion or through some other side mechanism, can diffuse into the metal and be lost either by direct diffusion or by reactions with various forms of metal oxides encountered by the hydrogen. Hydrogen lost in any of these ways is therefore not available for measurement and the detection based on hydrogen of actual corrosion in an operating boiler is therefore limited.

In the text published by Wiley Interscience Publications, John Wiley and Sons, entitled "Corrosion and Corrosion Control, An Introduction To Corrosion Science and Engineering", Third Edition, edited by H.H. Uhlig and R.W. Revie, basic electrochemical theory of corrosion is described in general for iron and steel corrosion in the presence of aqueous media. In anaerobic solutions, the cathodic reaction is presented as the formation of hydrogen. Since well operated boilers are operated in essentially oxygen free environments, thereby qualifying as anaerobic solutions, the cathodic reaction is primarily that reaction producing hydrogen. However, because of the difficulties mentioned above

in measuring hydrogen, particularly accurately measuring hydrogen in an operating boiler in the field, other techniques for accurately measuring real time corrosion phenomena are required.

In an article entitled "Dissolved Hydrogen Analyzer - A Tool for Boiler Corrosion Studies", by Jacklin and Wiltsey, published in Materials Protection and Performance, May 1971, the authors explain attempts to provide for a dissolved hydrogen analyzer which for the most part, though improved from these disclosures, is essentially the best analysis existing today for monitoring corrosion in an operating boiler system. However, again because of the difficulties earlier mentioned, dissolved hydrogen is not a preferred method, although it has been the workhorse of the industry over the years.

Another article entitled "Hydrogen Analysis as a Method of Corrosion Monitoring in Boilers", by Joneson, published in Combustion, August, 1979, points out some of the difficulty in interpreting dissolved hydrogen data and distinguishing from hydrogen formed by generalized and localized corrosion reactions and hydrogen, for example, which might be generated from chemical decompositions of boiler water treatment chemicals or from some unknown interference.

Also in Corrosion, April 1984, Paper No. 57 entitled "Application of Dissolved Hydrogen Measurement Technique for Monitoring of Corrosion in High Pressure Boilers", by Mayer, et al, the authors state that detection and recognition of conditions leading to accelerated corrosion are essential in reducing short and long term metal loss. The authors emphasize hydrogen measurements be used frequently, but state that the results of the hydrogen measurements would be no more than a summary indication of many processes which may take place within the system and suggest combination of hydrogen tests with other analytical and operational parameters. However their techniques are primarily in monitoring hydrogen values as well as monitoring operational controls in an operating boiler.

In Corrosion, 1990, Paper No. 184 presented April 23-27, 1990 by Bane, et al, the authors speak again of internal boiler corrosion leading to the formation of magnetite and hydrogen. The paper again emphasizes hydrogen studies that can be useful in determining corrosion in boilers. As a result, even in 1990, hydrogen analysis was being presented as the primary way of determining boiler corrosion. However, as earlier stated, hydrogen evolution as a means of measuring corrosion suffers for the complications earlier cited, that is hydrogen atom reactions with iron oxides, hydrogen gas diffusion into metal substrates and problems of determining the source of the hydrogen measured as being from corrosion, breakdown of chemical additives, or similar sources as mentioned above or as mentioned in the articles cited above.

In attempting to determine what other techniques might be available to measure iron in boiler waters, the following articles and/or patents have come to our attention:

1. An article in Analytical Chemistry, Volume 34 (3) March 1962, pages 348-352, which article teaches the use of 4,7-diphenyl-1,10-phenanthroline for the purpose of determining ferrous ion in the presence of ferric ion. This phenanthroline reagent apparently specifically forms complexes with ferrous ion which complexes have a different absorption spectra than the complexes formed by ferric ion. Although iron corrosion is mentioned in general, there is no mention of boiler waters in this reference.
2. In Analyst, August, 1975 (Volume 100), pages 549-554, Fadrus, et al, teaches a method for determining ferrous ion in water in the presence of ferric ion again using 1,10-phenanthroline. Fadrus teaches that ferric ion complexation does provide interferences and he masks this interference with what he terms "complexones". His recommended complexone is nitrilotriacetic acid. Again, Fadrus, et al, are concerned primarily with the analytical chemistry of ferrous

66530-493

and ferric phenanthroline complexes and does not use or teach the use of this chemistry in boiler waters.

3. In U.S. Patent 3,836,331, Stookey teaches the use of 3-(2-pyridyl)-5,6-bis(4-phenylsulfonic acid)-1,2,4-triazine and certain salts thereof, particularly the sodium salts, as useful reagents for spectrophotometric determinations of iron in water and in other solutions. Stookey, in column 1, does speak of the necessity to analyse for iron content in boiler waters because the iron oxide content of the water is an index of the rate of corrosion taking place in the boiler. He then however teaches that conventional methods for analysis of iron normally involve collecting iron compounds, solubilizing these compounds by adding for example hydrochloric acid and allowing sufficient time for dissolution, and then adding a reducing agent such as hydroxylamine or hydroxylamine hydrochloride to reduce the iron to the ferrous form. He then specifies the use of FZ (later defined) as a specific complexing agent for ferrous ion. This FZ reagent acts as a complexing agent for ferrous ion, ferric ion, cobalt salts, copper salts, and the like. His remaining teachings emphasize the use of FZ as a ferrous ion chromogen. His teachings include, however, procedures for monitoring total iron in the standard procedures he outlines. These procedures involve collecting samples, dissolving samples, reducing samples specifically by the addition of reducing agents such as hydroxyl ammonium chloride, adding reagents suitably buffered, and measuring iron content by colorimetric means.

4. U.S. Patent 3,770,735, Stookey, again describes the FZ compounds but primarily emphasizes the synthesis of these compounds. No mention of actual use in boiler waters is made except by hypothesis that boiler water iron content may be an example where such an analysis might be necessary.

However, Stookey speaks of the iron oxide content of the water as an index to the rate of corrosion taking place in the boiler and this iron oxide content can include both forms of ferrous and ferric ion and can include as indicated in some of the earlier references cited, quite complex admixtures of various types of iron oxides, such that the measurement of iron oxides is not a measure of corrosion occurring in real time in boilers.

5. In Talanta, Volume 31, No. 10A, pages 844-845, 1984, Li Shi-Yu et al, described the use of ion exchange colorimetry to determine microamounts of iron in water with FZ reagent. The solution studied came from drinking water supplies.
6. In Analytical Chemistry, Volume 42 (7) June 1970, the advantages of using the FZ chemical reagent in combination with a digestion procedure for the determination of total iron in various waters is taught. The waters studied were well waters obtained in Ames, Iowa. No mention of boilers is made.
7. Finally, an article appearing in Analytical Chemistry, Volume 48 (8) July 1976, pages 1197-1201, provides for characterization and application of the FZ iron reagent as a ferrous ion indicator. In this paper a number of references are given to the use of the reagent and the combination of the reagent in a number of automated analyzers and in a test kit for determination of ferrous ion, primarily in blood serum. In a list of references cited by the author, Gibbs, the use of the FZ reagent in potable water, sea water, plant nutrients solutions, plant materials, high purity reagent chemicals, bathocuproine sulfonate analysis, as well as in the use to determine cobalt, ruthenium, osmium and other metals are listed. These various analytical uses take advantage of the fact that the ferrous ion complex with FZ is colored and the ferric ion-FZ complex is not colored. Using this characteristic, the FZ

reagent has also been used to indirectly detect the presence of ascorbic acid in fruit juices, in blood serum and urine, to detect the presence of sulfur dioxide in various liquid samples, and after absorption from various gases, and various enzymatic activities in the NADH/NAD redox systems. No use in boilers is summarized therein.

OBJECTS OF THE INVENTION

It is an object of our invention to provide for a method of determining the presence of actual corrosion of boiler system ferrometals in contact with boiler waters.

It is another object of the invention to determine actual corrosion rates of boiler system ferrometals i.e., carbon steels, stainless steels, iron, or other iron alloys, in contact with boiler waters containing boiler water treatment chemicals such chemicals including, but not necessarily limited to, oxygen scavengers such as bisulfite, hydrazine, carbohydrazide, erythorbic salts, and the like; and such other chemical treatments such as hardness transporting chemicals including EDTA, HEDTA, NTA, and certain polymeric complexes, as well as other boiler water treatment chemicals such as the precipitating treatments for hardness, that is phosphates, phosphonates, and the like.

It is a further object of the invention to determine actual corrosion rates in various boiler system units containing ferrometals in contact with boiler waters, either containing boiler water treatment chemicals or not containing boiler water treatment chemicals (such as in the condensate systems) by obtaining a known aliquot volume of a boiler water sample in a manner which protects this sample from oxygen or any oxidizing species, then adds this aliquot sample to a solution of FZ reagent to form a soluble complex with FZ, i.e. 3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid, or its salts. This reagent is called the FZ reagent. After formation of the ferrous ion/FZ complex, this complex is relatively stable to oxidation, however, the presence of the complex should be measured

spectrophotometrically by measuring, within a reasonable time period of from about 1 minute to about 48 hours, the absorbance of a known standard containing this complex and comparing that with a concentration of an unknown sample having known aliquot relationships at a wave length of about 560 ± 30 nanometers.

It is an object of this invention to then calculate the amount of ferrous ion present in the boiler waters by making such a comparison of absorbance of known samples and to continuously measure this concentration by repeating the sampling steps, the formation of the complex steps, the spectrophotometrically measuring steps, and the calculating steps in a manner to provide for the measurement of actual corrosion rates of boiler system ferrometals in contact with boiler waters.

THE DRAWINGS

The invention will be further described with reference to the accompanying drawings in which:

Figure 1 is a graph showing absorbance of Ferrous-Ferrozine complex as a function of ferrous ion concentration;

Figure 2 is a graph showing interference of all-polymer treatment on Fe(II);

Figure 3 is a graph showing interference of EDTA on Fe(II);

Figure 4 is a graph showing absorbance of Ferrous-Ferrozine complex as a function of time; and

Figure 5 is a bar graph illustrating the iron pickup, as measured by ferrous ion/FZ complexation, when an EDTA based treatment program is compared to an all-polymer treatment program for scale control.

THE INVENTION

Our invention is a method of determining actual corrosion rates of boiler system ferrometals in contact with

66530-493

boiler system waters containing boiler water treatment chemicals, which method comprises the steps of: obtaining a known aliquot volume of a boiler water sample; adding the known volume of the sample to a known volume of an acetate solution, buffered at pH from 2.0 to 6.0, the acetate solution including an effective concentration of 3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid monosodium salt monohydrate reagent, wherein no reducing agents are added prior to the step of adding the known volume of sample to the known volume of the buffered acetate solution; mixing the sample and acetate solution to form a soluble ferrous ion/3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid complex solution; generating a standard ferrous ion/3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid absorbance curve for a standard solution containing a known value of 3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid; measuring spectrophotometrically the absorbance of the ferrous ion/3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid complex solution at a wavelength of about 560 ± 30 nanometers; calculating the amount of ferrous ion present by comparing the absorbance of the ferrous ion/3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic complex solution acid to the standard absorbance curve; repeating the steps of obtaining, adding, mixing, generating, measuring and calculating so as to determine an actual corrosion rate.


A standard ferrous ion/FZ absorbance curve can be generated using known concentrations of ferrous ion from 1 to about 1000 parts per billion.

In a preferred embodiment after the measurement of absorbance of ferrous ion/FZ complex in the boiler water sample is completed, a known amount of a strong reducing

66530-493

agent selected from the group consisting of hydroxylamine hydrochloride, thioglycolic acid or its salts, erythorbic acid or its salts, hydrazine, carbonylhydrazide, sodium bisulfite and mixtures thereof is added to the ferrous ion/FZ complex solution, mixed and reacted for a sufficient time to reduce any ferric ion species present to ferrous ion, which ferrous ion reacts with residual FZ reagent forming additional ferrous ion/FZ complex solution, then remeasuring the absorbance of this additional FE(II)-FZ solution, thereby measuring total iron content, and then obtaining ferric ion content by subtracting the original ferrous ion content from total iron content. More preferably the strong reducing agent is thioglycolic acid.

The monosodium salt monohydrate form of the FZ complexing agent has the following formula:

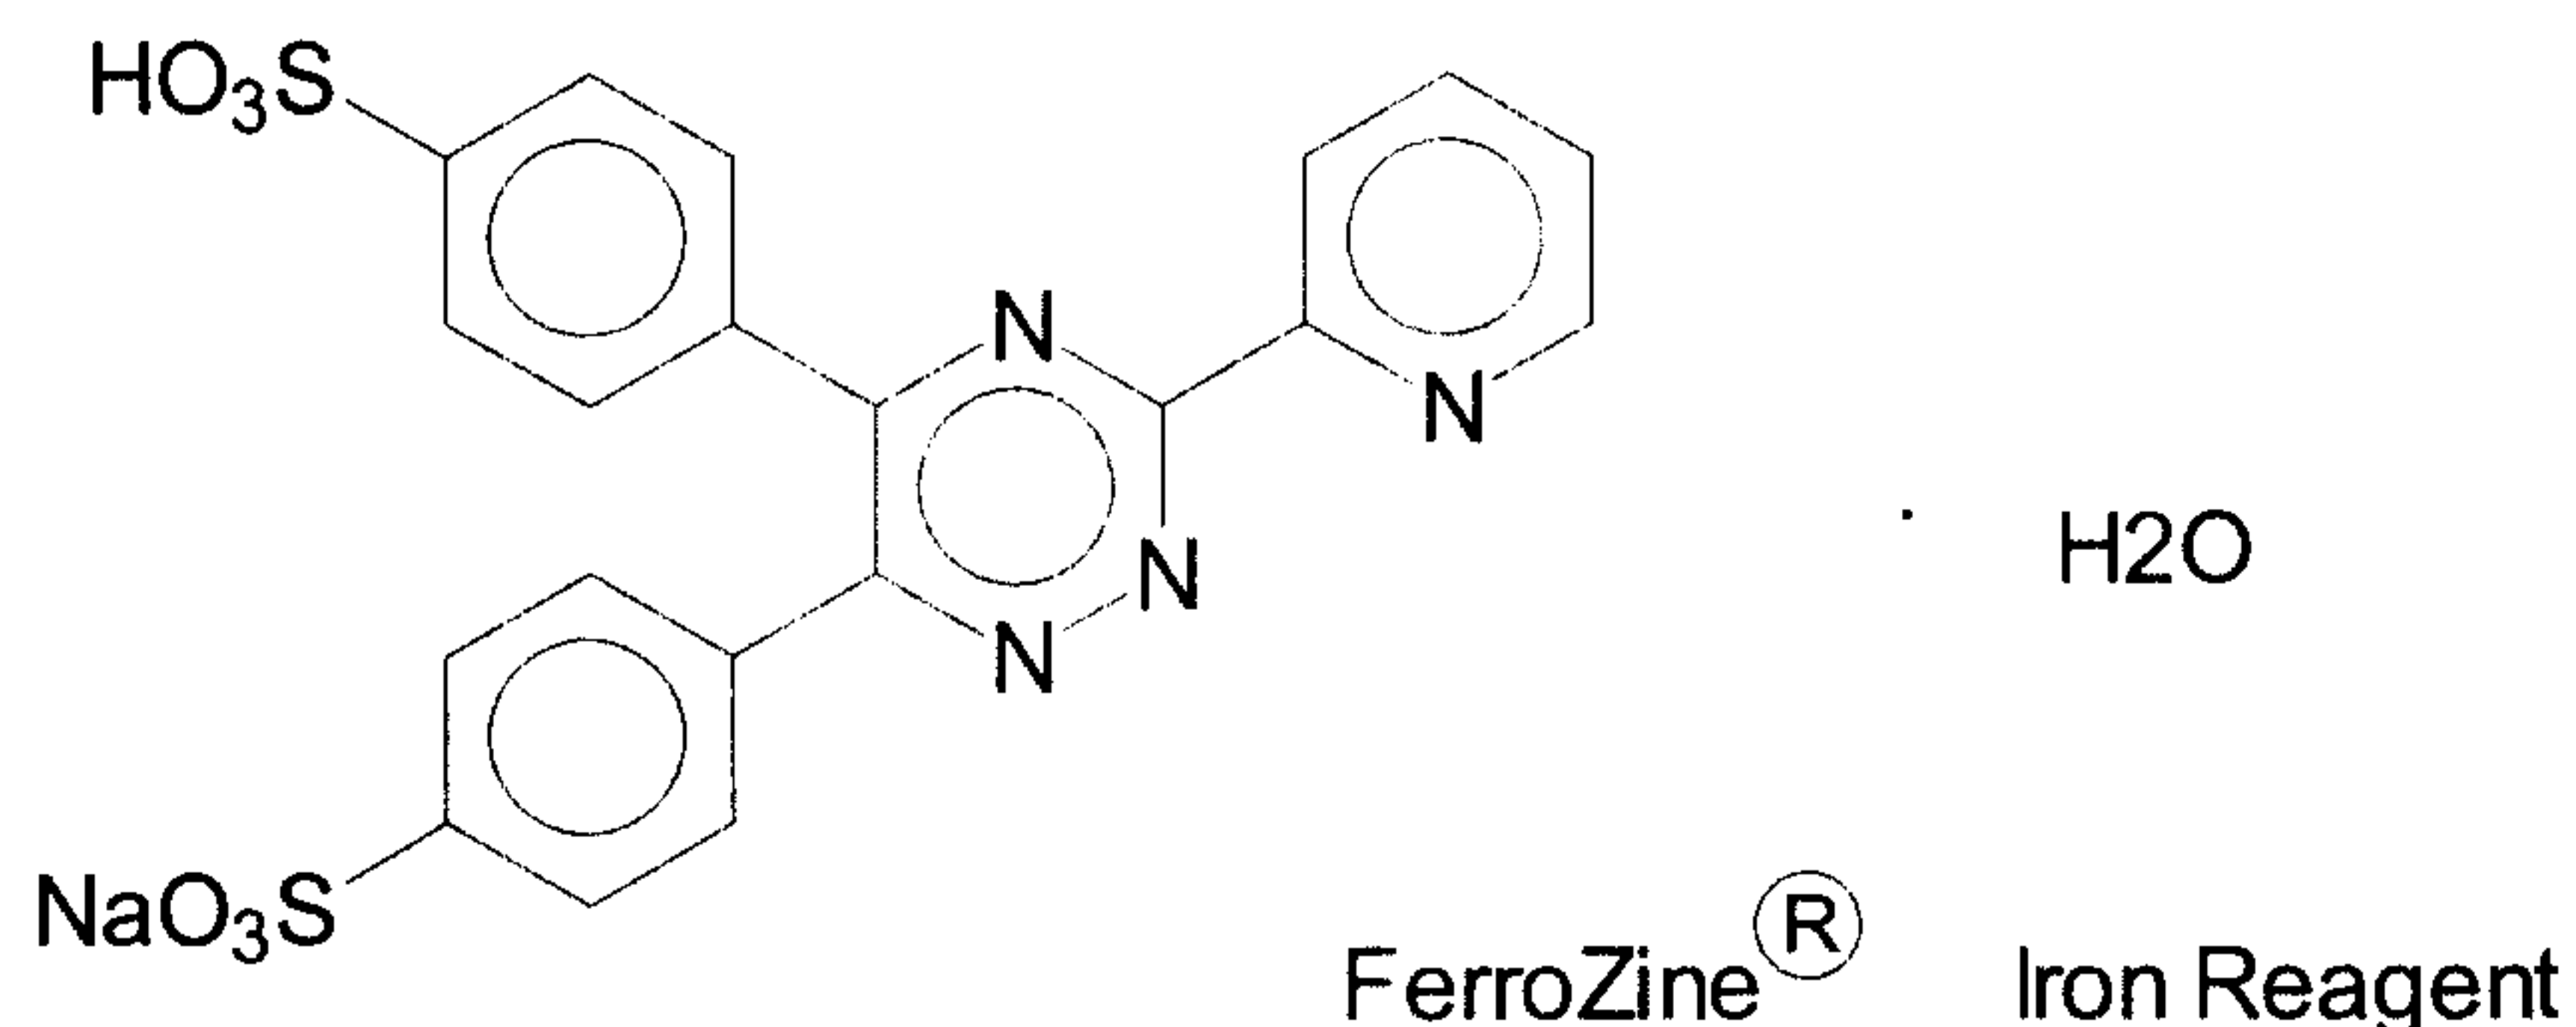

3-(2-Pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid monosodium salt monohydrate (FZ)

This complexing reagent is primarily used as the monosodium salt but may also be made up in other salt forms. The complex is primarily present as a monosodium salt having one water of hydration related thereto and can be commercially purchased from the Hach Company. The complexing agent should be used at a known pH of from about 2 to about 6, preferably from between about 3 and about 5

66530-493

and most preferably at a pH of approximately 3.6 ± 0.2 . The standardized solution of the FZ reagent primarily is a solution of this above FZ complexing agent that preferably contains an acetate buffer such that the pH ranges between
5 3.6 ± 0.2 , although other buffering systems besides the acetate buffering system may be used.

As stated above, it is critical to obtain and protect the boiler water sample from oxygen or any oxidizing media. This is because the initial reactions involving
10 corrosion of ferrometals in contact with boiler waters creates ferrous ions. Subsequent reactions of ferrous ion with oxygen or other chemicals provide for quite complicated forms of other iron salts some of which or all of which are insoluble in water and either form as scales or as
15 precipitates in the boiler water. Therefore the initial samples taken from each boiler system

unit must be taken carefully in a manner to protect the sample once taken from the system from oxygen or from oxidizing species.

The known volume, or aliquot, sample is immediately added to a known volume of the FZ reagent solution, buffered as above. Preferably an acetate buffer solution as described above is used. Although an acetate buffer is used primarily in our technique, any other buffer in the range between about 2.0 and 6.0 would be sufficient. Buffering ingredients which might form precipitates with boiler chemicals or contaminants should be avoided. Again, it is preferable that during the collection of the initial boiler water sample, protected from oxygen or oxidizing chemicals as above described, with the FZ reagents, which reagents should also preferably be oxygen free, the complex solutions formed be protected from oxygen, although these complexes are considerably more stable against oxygenation than are the original ferrous containing solutions. It is advisable to maintain some protection against exposure to air or oxygen during the entire process of our invention.

The reaction between ferrous ions in the boiler water samples as taken and described above and the FZ reagent solutions as described above are nearly instantaneous. However, it is advisable to provide some mixing and some reaction time to assure oneself that a homogeneous solution of the water soluble ferrous ion/FZ complex has been obtained prior to measurement of its concentration spectrophotometrically.

The spectrophotometric measurement is fairly straightforward and can use any equipment available which has the capability of presenting a light source having a wave length of about 560 ± 30 nanometers through a controlled length cell path into which the ferrous ion/FZ complex solution has been added, and which equipment includes means for measuring light absorbance, light transmission and the like, of this wave length, through the spectrophotometric cell containing the ferrous ion/FZ complex solution.

After measuring absorbance of the ferrous ions/FZ complex at the appropriate wave length taught above, it is easy to calculate the amount of ferrous ion present in the boiler

66530-493

water sample by comparing this absorbance with a standard absorbance obtained by a standard absorbance/concentration curve obtained by measuring different concentrations of ferrous ion solutions and the Fe(II)/FZ complex. Such a
5 standard curve is presented below as Figure 1 and describes the absorbance at 560 nanometers of ferrous ion FZ complex as measured according to the techniques of this invention.

To measure the corrosion rates of boiler system ferrometals in contact with boiler waters, particularly
10 those boiler waters containing treatment chemicals, it is advisable that the FZ complex be present in the standardized solution to which the boiler water sample is added in sufficient concentration to overwhelm any additional complexes or reactions that might be occurring or which
15 might have already occurred between ferrous ion as generated by the corrosion reactions, and whatever treatment chemicals are present. For example, it is known that ethylene diamine tetraacetic acid, i.e. EDTA, a known boiler water treatment chemical can form complexes with ferrous ion. It has been
20 shown that these complexes can interfere with the reaction with the FZ reagent. However, by increasing the concentration of the FZ reagent to a sufficiently high concentration, this interference is overwhelmed and the equilibrium forming the ferrous ion EDTA complex is no
25 longer controlling. Since boiler waters may be treated with EDTA, and such other complexing reagents as nitrilotriacetic acid, for the purpose of controlling hardness formation and hardness scales, it is unlikely that EDTA or NTA or like complexing agents are going to be present in the boiler
30 waters sampled in concentrations much above from about 0.5 to about 50 parts per million, even though those boiler waters are being treated specifically by formulations containing these strong complexing agents. As a result, it

66530-493

has been found that the reagent containing the FZ complexing agents should provide for essentially quantitative formation of ferrous ion FZ complexes in the presence of concentrations of the FZ complexing agent ranging from
5 approximately 0.005 to about 0.20 molar concentration of FZ complexing agent in the acetate buffer solution. A preferred concentration of the FZ complexing agent in this

buffered solution, in the absence of EDTA/NTA, or like chemical complexing agents, is at about 0.025 molar, although higher concentrations are permitted. Higher concentrations of FZ reagent is needed in the presence of EDTA, for example, see Table II.

The acid buffer, as earlier stated, should control the pH in a range from between about 2 to about 6, preferably from between about 3 to about 5, and most preferably at a pH of between about 3.6 ± 0.2 .

The boiler system can contain a number of different boiler system units, each unit subject to corrosion according to the reactions cited in the references incorporated herein by reference and presented above. The primary reaction for corrosion is the reaction of iron metal with water to form ferrous ion, and a similar reaction of the protons in water to form hydrogen gas, the reactions occurring at the anodic and/or cathodic sites respectively. If samples are taken of the boiler waters immediately within the boiler water system being monitored, and the samples are protected from oxygen or oxidizing species, and the samples are added immediately to the FZ reagent solutions as described above, the complex formed is sufficiently stable to permit its spectrophotometric measurement. Therefore the direct measurement of instantaneous corrosion occurring with the boiler system or the boiler system unit being monitored is now available, with no drawbacks as in hydrogen measurement.

These boiler system units can include but are not necessarily limited to the inlet and/or outlet of an economizer, the inlet and/or outlet of the pre-heaters, the inlet and/or outlet of each steam condensers, the actual feed water to the boiler, the actual blow down from the boiler, the inlet and/or outlet samples obtained from any storage vessel or any holding tank or any aqueous condensate receiver, any steam receiver which is undergoing condensation to provide a liquid sample therein, any heat exchanger, any working unit being driven by the steam generation such as a turbine, a piston and the like. Also, samples from the water wall header and outlet of the deaerator, inlet and outlet of the water treatment

system providing for low hardness water, such treatment facilities including ion exchange and the like may be monitored for corrosion. Also, water samples in any line, any pump, any vessel, and the like, which devices are contained in a boiler system may be so monitored.

Although total iron analysis has been run and hydrogen analysis has been run in an attempt to detect direct corrosion, these procedures have fallen by the wayside either because of complications in measuring corrosion rates in the field or because of the unsureness that the corrosion rates that were measured depended in fact upon the chemicals species being measured. By direct measurement of ferrous ion in boiler water samples which samples are being collected directly from boiler water units within an operating boiler, this unsureness is eliminated.

To provide for better understanding of our invention, the following examples are given.

EXAMPLES

To better exemplify our invention the following tests are presented.

Reagents were made as follows:

- A. Into a one liter volumetric flask, 72.12 grams of sodium acetate, as the trihydrates, and 274.29 milliliters of glacial acetic acid were added with sufficient distilled water to bring to volume. The resulting solution is buffered at a pH of 3.6 ± 0.2 .
- B. 50 milliliters of the above buffer solution was added to a 100 milliliter volumetric flask to which was added 1.28 grams of FerroZine^{®1} reagent. FerroZine[®] is an analytical quantitative reagent obtained from the Hach Chemical Company, Ames, Iowa. The FerroZine[®] reagent is the monosodium salt, as a monohydrate, of 3-(2-pyridyl)-5,6-bis(4-phenylsulfonic)-1,2,4-triazine.

¹FerroZine[®] is a registered trademark of Hach Chemical Company.

The flask is then brought to volume with the buffer solution. This FZ/reagent solution contains 0.025 molar concentration of the FZ complexing agent and is buffered at a pH of 3.6 ± 0.2 .

- C. A 100 part per million standard solution of ferric ion was prepared by adding 0.860 grams of ferric ammonium sulfate, 12 hydrates, to a small beaker to which was also added 4 milliliters of analytically pure nitric acid and approximately 50 milliliters of distilled water. The solution was heated to a gentle boil until all of the solids had dissolved. The solution was cooled and another 6 milliliters of ultrapure nitric acid was added. The contents of the beaker were analytically transferred to a one liter volumetric flask and made up to volume with distilled water. The solution so prepared is 100 parts per million in ferric ion concentration.
- D. A standard solution containing 100 parts per million ferrous ion was made up by adding 0.701 grams of ferrous ammonium sulfate, 6 hydrates, to a 1 liter volumetric flask and adding sufficient distilled water to bring to volume. This resulting solution contains 100 ppm ferrous ion concentration and is protected from oxygen or oxidizing chemicals and used as soon as it is prepared.

Using the above solutions, a standard absorbance - concentration curve was generated for the determination of ferrous ion in solution. A series of 50 milliliter volumetric test tubes had 1 milliliter of the FZ reagent added thereto. A blank solution was prepared by diluting with distilled water to the 50 milliliter mark and various standard concentrations of ferrous ion were made by adding different concentrations of the ferrous ion standard solution to these test tubes and bringing to volume with the standard FZ reagent solution. Color development of the ferrous ion/FZ complex occurred over a period of from about 1-10 minutes and then the absorbance of each of these solutions contained in a photometric cell of known rate were measured at a wavelength of 560 nanometers. The

standard absorbance curve is presented in Figure 1. This standard absorbance curve is essentially unchanged, even in the presence of ferric ion, since the ferric ion - FZ complex does not absorb light of this general 560 ± 30 nanometer wavelength. (See the results in Table I.)

Samples of boiler waters were obtained from various operating boiler system units by taking the water sample in a manner that guaranteed the sample was protected from exposure to oxygen or oxidizing systems. Samples were taken in such a manner so as to provide a known volume of the boiler water samples and the sample was added immediately to the standard solution of FZ reagent as prepared above. This was also done in a manner to protect both the FZ solution and the boiler samples from exposure to air, any oxygen sources, or any oxidizing chemicals.

For each of these samples, the color development is completed within one minute, or earlier, at temperatures ranging from about 60 to about 80°F. The complex is stable to air oxidation for at least 48 hours. In spite of the oxygen stability for the ferrous/FZ complex, it is suggested that all measurements and sampling be made in an oxygen protected or free environment. It is important that the sample to be analyzed from the boiler system unit be collected in a testing apparatus such that the sample is mixed with a solution of the FZ reagent, both sample, and preferably the reagent also, being protected from oxygen exposure, air exposure and the like.

Prior to presenting the results of actual boiler unit tests, it was determined that ferrous ion in solution may be affected by the presence of certain internal boiler water chemical treatments. Towards this end, various water samples containing calculated amounts equaling 370 parts per billion ferrous ions, were spiked with these boiler water chemicals prior to admixture with the FZ reagent solution. A polymeric transport chemical provided by Nalco Chemical Company was spiked at a concentration up to 300 ppm based on total product. Also, a solution of ethylene diamine tetraacetic acid, as partial sodium

66530-493

salt, were also spiked into the solution containing ferrous ions. Figure 2 and Figure 3 provide the results of these tests.

In the presence of the polymeric transport
5 chemical obtained from Nalco Chemical Company, and sold
under the trade name "Transport Plus"^{®2}, no negative effect
was obtained for the determination of ferrous ion in
solution. However, in the case of
ethylenediaminetetraacetic acid, even at a concentration
10 equal only to 1 ppm EDTA, calculated as calcium carbonate,
ferrous ion determinations were drastically affected. At an
EDTA dosage of 30 ppm, as calcium carbonate, ferrous ion
concentration detected by FZ reagent was below the detection
limit.

15 This interference can be eliminated by increasing
the concentration of the FZ reagent as is shown in Table II,
so that when the concentration of the FZ reagent is high
enough compensation for the interference cause by the
ethylenediaminetetraacetic acid chelant is achieved.

20 Therefore, a key to monitoring for the presence of
corrosion products, as measured by the presence of ferrous
ion in boiler waters, particularly when those boiler waters
are treated with certain boiler water treatment chemicals,
is to have sufficient and effective concentrations of the FZ
25 reagent present to overwhelm and compensate for any
interferences caused by the boiler chemical treatment
chemicals.

²Transport Plus[®] is a registered trademark of Nalco Chemical Company.

The required concentration of FZ reagent to compensate for the presence of ethylenediaminetetraacetic acid is presented in Table II.

5 The time for development of the ferrous ion FZ complex is given in Figure 4. As can be seen from this Figure, the color development is complete within 1-10 minutes and is remarkably stable for a period of at least 48 hours.

10 Using the above tests, and sufficient FZ reagent to overwhelm any complexation with boiler treatment chemicals such as EDTA, boiler feed water ferrous ion pick up studies

66530-493

Table I

Fe(II)/Fe(III) determination									
Sample No	Fe(II), ppm Theoretical	Fe(III), ppm Theoretical	Fe (total), ppm Measured	Fe(II), ppm Measured	Fe(III), ppm [Fe(tot) - Fe(II)]	Δ Fe(II)	% Error [Fe(II)]	Δ Fe(III)	% Error [Fe(III)]
1	0.05	1.00	1.08	0.07	1.01	0.02	46	0.01	1
2	0.10	0.50	0.63	0.12	0.51	0.02	22	0.01	2
3	0.20	0.20	0.45	0.23	0.22	0.03	15	0.02	10
4	0.50	0.10	0.66	0.54	0.12	0.04	8	0.02	22
5	1.00	0.05	1.12	1.06	0.06	0.06	6	0.01	20

66530-493

Table II

**Required concentration of ferrozine reagent to compensate for EDTA
interference
(Fe(II) = 300 ppb)**

EDTA Concentration (as CaCO_3)	Ferrozine [M]

0	0.025
2	0.071
20	0.141

were made across various boiler system units operating in a steel manufacturing plant. Samples across an economizer operating within this boiler were analyzed using the proprietary ferrous iron FZ sampling and analysis procedures above. Chemical treatment programs containing ethylenediaminetetraacetic acid as well as chemical treatment programs containing nitrilotriacetic acid and another chemical treatment program containing an all polymer transport treatment chemical were evaluated.

Tests confirmed that corrosion across the economizer boiler unit was a direct function of the dosage of strong chelant chemical treating agents.

With no feed of boiler treatment chemical containing EDTA, or NTA, but with boiler treatment chemicals containing oxygen scavengers such as carbohydrazide and erythorbic acid salts, the ferrous ion pickup levels were 0 parts per billion. However, when operating with boiler treatment chemicals used primarily for the purpose of transporting and controlling hardness scales and hardness scale creating chemicals such as magnesium, calcium, silicates, and the like, ferrous ion determinations were directly increased as the dosage of the chemical chelant was increased. Ferrous ion levels were reported as high as 162 parts per billion when an EDTA containing formulation was added so as to retain 0.2 ppm residual of the EDTA containing formulation. Ferrous ion levels were detected (with treatment at a 0.1 ppm EDTA residual dosage) at concentrations ranging from 78-85 parts per billion with or without the presence of the above mentioned oxygen scavengers. Iron pickup levels using a program of boiler treatment chemicals presented as the Betz Company's B1986 program, which program led to dosages of a 0.1 ppm formula weight (B1986) residual, equalled 101 parts per billion ferrous ion, in the absence of either carbohydrazide or erythorbate. In the presence of a chemical treatment program in which the hardness complexing agent was nitrilotriacetic acid (NTA), ferrous ion was detected at 42 parts per billion when the NTA was added to the boiler system at a residual of 0.1 ppm.

During the above tests, dissolved oxygen levels in the feed water were consistently controlled at 0 parts per billion.

Since corrosion is a direct function and is
5 demonstrated directly by the presence of freshly generated ferrous ion, it is believed that this technique of monitoring boiler waters, particularly in the presence of boiler water treatment chemicals, using the techniques which provide for adequate concentrations of FZ reagent so as to
10 compensate and overwhelm any complexes formed by chelating agents present in the treating chemicals, such chelating agents demonstrated to include EDTA and NTA. At least under the conditions of these tests, polymeric transport agents such as the Transport Plus[®] chemical supplied by Nalco
15 Chemical Company do not cause corrosion.

Also, based on the results recited above, the formulations containing nitrilotriacetic acid were not nearly as aggressive in terms of creating corrosion of iron across this economizer as were the formulations containing
20 ethylenediaminetetraacetic acid.

In another series of tests, chemical treatment programs used typically to treat boiler waters, which programs contained ethylenediaminetetraacetic acid and various polymers used as dispersants also were demonstrated
25 to show iron pickup in these boiler samples in the form of ferrous ion which could be monitored using the ferrous ion/FZ proportional monitoring techniques of this invention. Again, corrosion potential, as measured by the concentrations of ferrous ion determined in boiler waters
30 being treated with these chemical treatments, appeared to increase directly as the concentration of the ethylenediaminetetraacetic acid increased. Earlier tests

using polymers indicated that the polymers had no essential effect under these test conditions.

Table III presents the results obtained when this operating economizer was monitored using the techniques of this invention for iron pickup.

Table III
Economizer Iron Pickup Study

Chelant	FW Chelant Dosage (ppm) as CaCO ₃	FW Chelant Residual (ppm) as CaCO ₃	Economizer Δ Fe(II) ppb	Economizer Δ Fe(Total) ppb
EDTA	0.35	0.30	152	159
EDTA	0.14	0.09	85	85
EDTA	0.14	0.09	78	84
EDTA	0.35	0.30	120	136
EDTA	0.30	0.25	151	138
none	0.00	0.00	0	4
NTA	0.30	0.25	96	93
NTA	0.15	0.10	42	43
EDTA	0.25	0.20	128	125
none	0.00	0.00	1	-
EDTA	0.24	0.00	85	-
EDTA	0.24	0.16	133	-
EDTA	0.24	0.19	156	163
EDTA	0.24	0.19	162	-
EDTA	0.24	0.19	149	-
EDTA	0.07	0.02	48	48
EDTA	0.15	0.10	101	102

1. Δ Fe(II) or Δ Fe(Total) = Fe(II) or (Total) at the economizer outlet - (minus

Fe(II) or (Total) at the economizer inlet

2. $Fe_{(Total)} = Fe_{II} + Fe_{(III)}$

As can be observed, the data in Table III also presents the total iron found in the economizer boiler samples. This total iron was remarkably close to the ferrous ion in

Table III

Economizer Iron Pickup Study

Chelant	FW Chelant Dosage (ppm) as CaCO ₃	FW Chelant Residual (ppm) as CaCO ₃	Economizer $\Delta\text{Fe(II)}$ ppb	Economizer $\Delta\text{Fe(Total)}$ ppb
EDTA	0.35	0.30	152	150
EDTA	0.14	0.09	85	85
EDTA	0.14	0.09	78	84
EDTA	0.35	0.30	120	136
EDTA	0.30	0.25	151	138
none	0.00	0.00	0	4
NTA	0.30	0.25	96	93
NTA	0.15	0.10	42	43
EDTA	0.25	0.20	128	125
none	0.00	0.00	1	.
EDTA	0.24	0.00	85	.
EDTA	0.24	0.16	133	.
EDTA	0.24	0.19	156	163
EDTA	0.24	0.19	162	.
EDTA	0.24	0.19	149	.
EDTA	0.07	0.02	48	48
EDTA	0.15	0.10	101	102

1. $\Delta\text{Fe(II)}$ or $\Delta\text{Fe(Total)}$ = Fe(II) or (Total) at the economizer outlet - (minus
Fe(II) or (Total) at the economizer inlet

2. $\text{Fe(Total)} = \text{Fe}_{\text{II}} + \text{Fe}_{\text{(III)}}$

practically all cases and demonstrates that the iron presence in the economizer boiler waters was not present because of contamination, scaling, or residual iron but in fact was present almost exclusively from the formation of ferrous ion in a corrosive mechanism.

Further tests were completed on line at various treatment levels for each of the EDTA containing, NTA containing, or all-polymer treatment programs normally found in the industry. Table IV presents the data obtained when this boiler system was operated with the listed percentages of recommended dosages for various formulations which contained, as the primary hardness treatment reagents, EDTA, NTA, or all-polymer treatment formulations. The data for EDTA, #1, was obtained from a treatment program suggested by one water treatment chemical company, EDTA #2, was from a treatment program suggested by that same company but having a slightly different formulation, EDTA, #3 was obtained from a second water treatment chemical company and the NTA and all polymer programs were also commercially available products.

It is to be noted that the dosages recommended by each of these companies, when used at less than 100 percent of the recommended level, can result in boiler scale problems derived from hardness scales. Therefore, it is clear that one would want to eliminate not only the scale problems but also to provide an anti-scaling program which would not be corrosive to a boiler ferrometals.

Figure 5 presents the iron pickup, as measured by ferrous ion/FZ complexation, when an EDTA based treatment program is compared to an all polymer treatment program for scale control. The recommended dosages for hardness control using EDTA are averages of treatment systems recommended by two separate boiler treatment chemical companies. By measuring ferrous ion according to the techniques described and claimed herein, it is clear that the all polymer program can provide both corrosion free environments and hardness scale transport and hardness scale minimization.

2041800

Table IV
Economizer Iron Pickup Study

<u>% Recommended Dosage for Hardness Control*</u>	<u>Fe-II Economizer Pickup</u>
---	------------------------------------

EDTA #1 100%	152
-----------------	-----

30	85
----	----

30	78
----	----

100	120
-----	-----

83	151
----	-----

67	128
----	-----

EDTA #2 53	133
---------------	-----

63	156
----	-----

63	162
----	-----

63	149
----	-----

EDTA #1	30
---------	----

8	45
---	----

BASELINE (with Erythorbate Oxygen Scavenger)	0
--	---

0	1
---	---

EDTA #3 7	48
--------------	----

33	101
----	-----

NTA 83	96
-----------	----

33	42
----	----

ALL-POLYMER 100	2
--------------------	---

200	2
-----	---

AUTOMATED ANALYSIS, USING FZ-FERROUS COMPLEX

An automatic system has been constructed that provides samples from any sampling point within a boiler operating unit or within any boiler system operating unit. These boiler operating units can include those listed previously, including the boiler itself, the down comer tubes, the overhead condensation system, or any condenser therein, the economizers, the pre-heaters, the ion exchange water preparation units or any line, water or steam vessels, tanks, pumps, or the like. This automatic monitoring system includes mechanical and electronic devices which will allow the operation, automatically under the control of a microprocessor, of all functions required to perform our tests. The functions provided by this device and controlled by this device include sample manipulation, such manipulation including the taking and transporting of samples in an oxygen free environment to a reaction chamber where the samples are reacted with the FZ reagent, appropriate time permitted for formation of the ferrous ion FZ/complex, then transport of this solution containing that ferrous ion/FZ complex into a photometric cell. The automatic device also provides for the generation of a light source wavelength of approximately 560 nanometers, the measurement of absorption of this light when passed through the optical cell containing the ferrous ion/FZ complex, the automated reading of this absorbance signal, and

the data processing necessary to provide for read outs which are measurable and proportional to the concentration of ferrous ions in the sample taken. This microprocessor also would control signal generation, data processing, and would control component failure detection. This system is capable of being programmed, calibrated, and data acquisition can be implemented easily using this system both in the laboratory and in field installed devices. Data generated can be downloaded onto any computer having appropriate interface with the microprocessor, which is part of the analyzer. This proposed

66530-493

CLAIMS:

1. A method of determining actual corrosion rates of boiler system ferrometals in contact with boiler system waters containing boiler water treatment chemicals, which method
5 comprises the steps of:

obtaining a known aliquot volume of a boiler water sample;

adding the known volume of the sample to a known volume of
10 an acetate solution, buffered at pH from 2.0 to 6.0, the acetate solution including an effective concentration of 3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid monosodium salt monohydrate reagent, wherein no reducing agents are added prior to the step of adding the known
15 volume of sample to the known volume of the buffered acetate solution;

mixing the sample and acetate solution to form a soluble ferrous ion/3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-
20 disulfonic acid complex solution;

generating a standard ferrous ion/3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid absorbance curve for a standard solution containing a known value of 3-
25 (2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid;

measuring spectrophotometrically the absorbance of the ferrous ion/3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-
30 disulfonic acid complex solution at a wavelength of about 560 ± 30 nanometers;

calculating the amount of ferrous ion present by comparing

66530-493

the absorbance of the ferrous ion/3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic complex solution acid to the standard absorbance curve;

- 5 repeating the steps of obtaining, adding, mixing, generating, measuring and calculating so as to determine an actual corrosion rate.

2. The method of claim 1 wherein the standard solution of 3-
10 (2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid reagent contains an effective amount of the reagent to form the ferrous ion/3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid complex in essentially quantitative amounts.

15

3. The method of claim 2 wherein the steps of obtaining said boiler water sample, adding said boiler water sample to the 3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid reagent, measuring the absorbance of ferrous ion/3-(2-
20 pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid complex and comparing the absorbance to said standard curve are performed in an anaerobic environment.

4. The method of claim 2 wherein the boiler water sample is
25 taken from boiler system units selected from the group consisting of inlets and outlets of an economizer, a pre-heater, a condensate system, any holding tank or vessel, a turbine, any piston driven device, a water wall header, boiler inlet lines, boiler blowdown lines, a deaerator, or
30 any combination thereof.

5. The method of claim 2 wherein the boiler water sample is taken from boiler system units selected from the group consisting of inlets and outlets of steam condensers, boiler

66530-493

feedwater, boiler blowdown, storage vessels, holding tanks, receivers, heat exchangers, turbines, pistons, and water wall headers.

5 6. The method of claim 5 wherein the steps of obtaining said boiler water sample, adding said boiler water sample to the 3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid reagent, measuring the absorbance of ferrous ion/3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid
10 complex and comparing the absorbance to said standard curve are performed automatically and continuously.

7. The method of claim 5 wherein the standard 3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid reagent
15 solution has a pH of from 3.4 to about 3.8 and contains at least 0.005 moles per liter of 3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid.

8. The method of claim 5 comprising the additional steps of:
20

adding a known amount of a strong reducing agent chosen from the group consisting of hydroxylamine hydrochloride, thioglycolic acid or its salts, erythorbic acid or its salts, hydrazine, carbonylhydrazide, sodium bisulfite and
25 mixtures thereof to the ferrous ion/3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid complex solution;

mixing and reacting the reducing agent and complex solution
30 for a sufficient time to reduce any ferric ion species present to ferrous ion, which ferrous ion reacts with residual 3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid reagent, forming additional ferrous ion/3-(2-pyridyl)-5,6-diphenyl-1,2,4-triazine-p,p'-disulfonic acid


66530-493

complexes in the mixed and reacted solution;

remeasuring the absorbance of the mixed and reacted
solution; and calculating total iron content by subtracting
5 the original ferrous ion content from total iron content
after the step of remeasuring.


9. The method of claim 8, wherein the strong reducing agent
is thioglycolic acid.

Figure 1 - Absorbance of Ferrous- Ferrozine complex
as a function of ferrous ion concentration

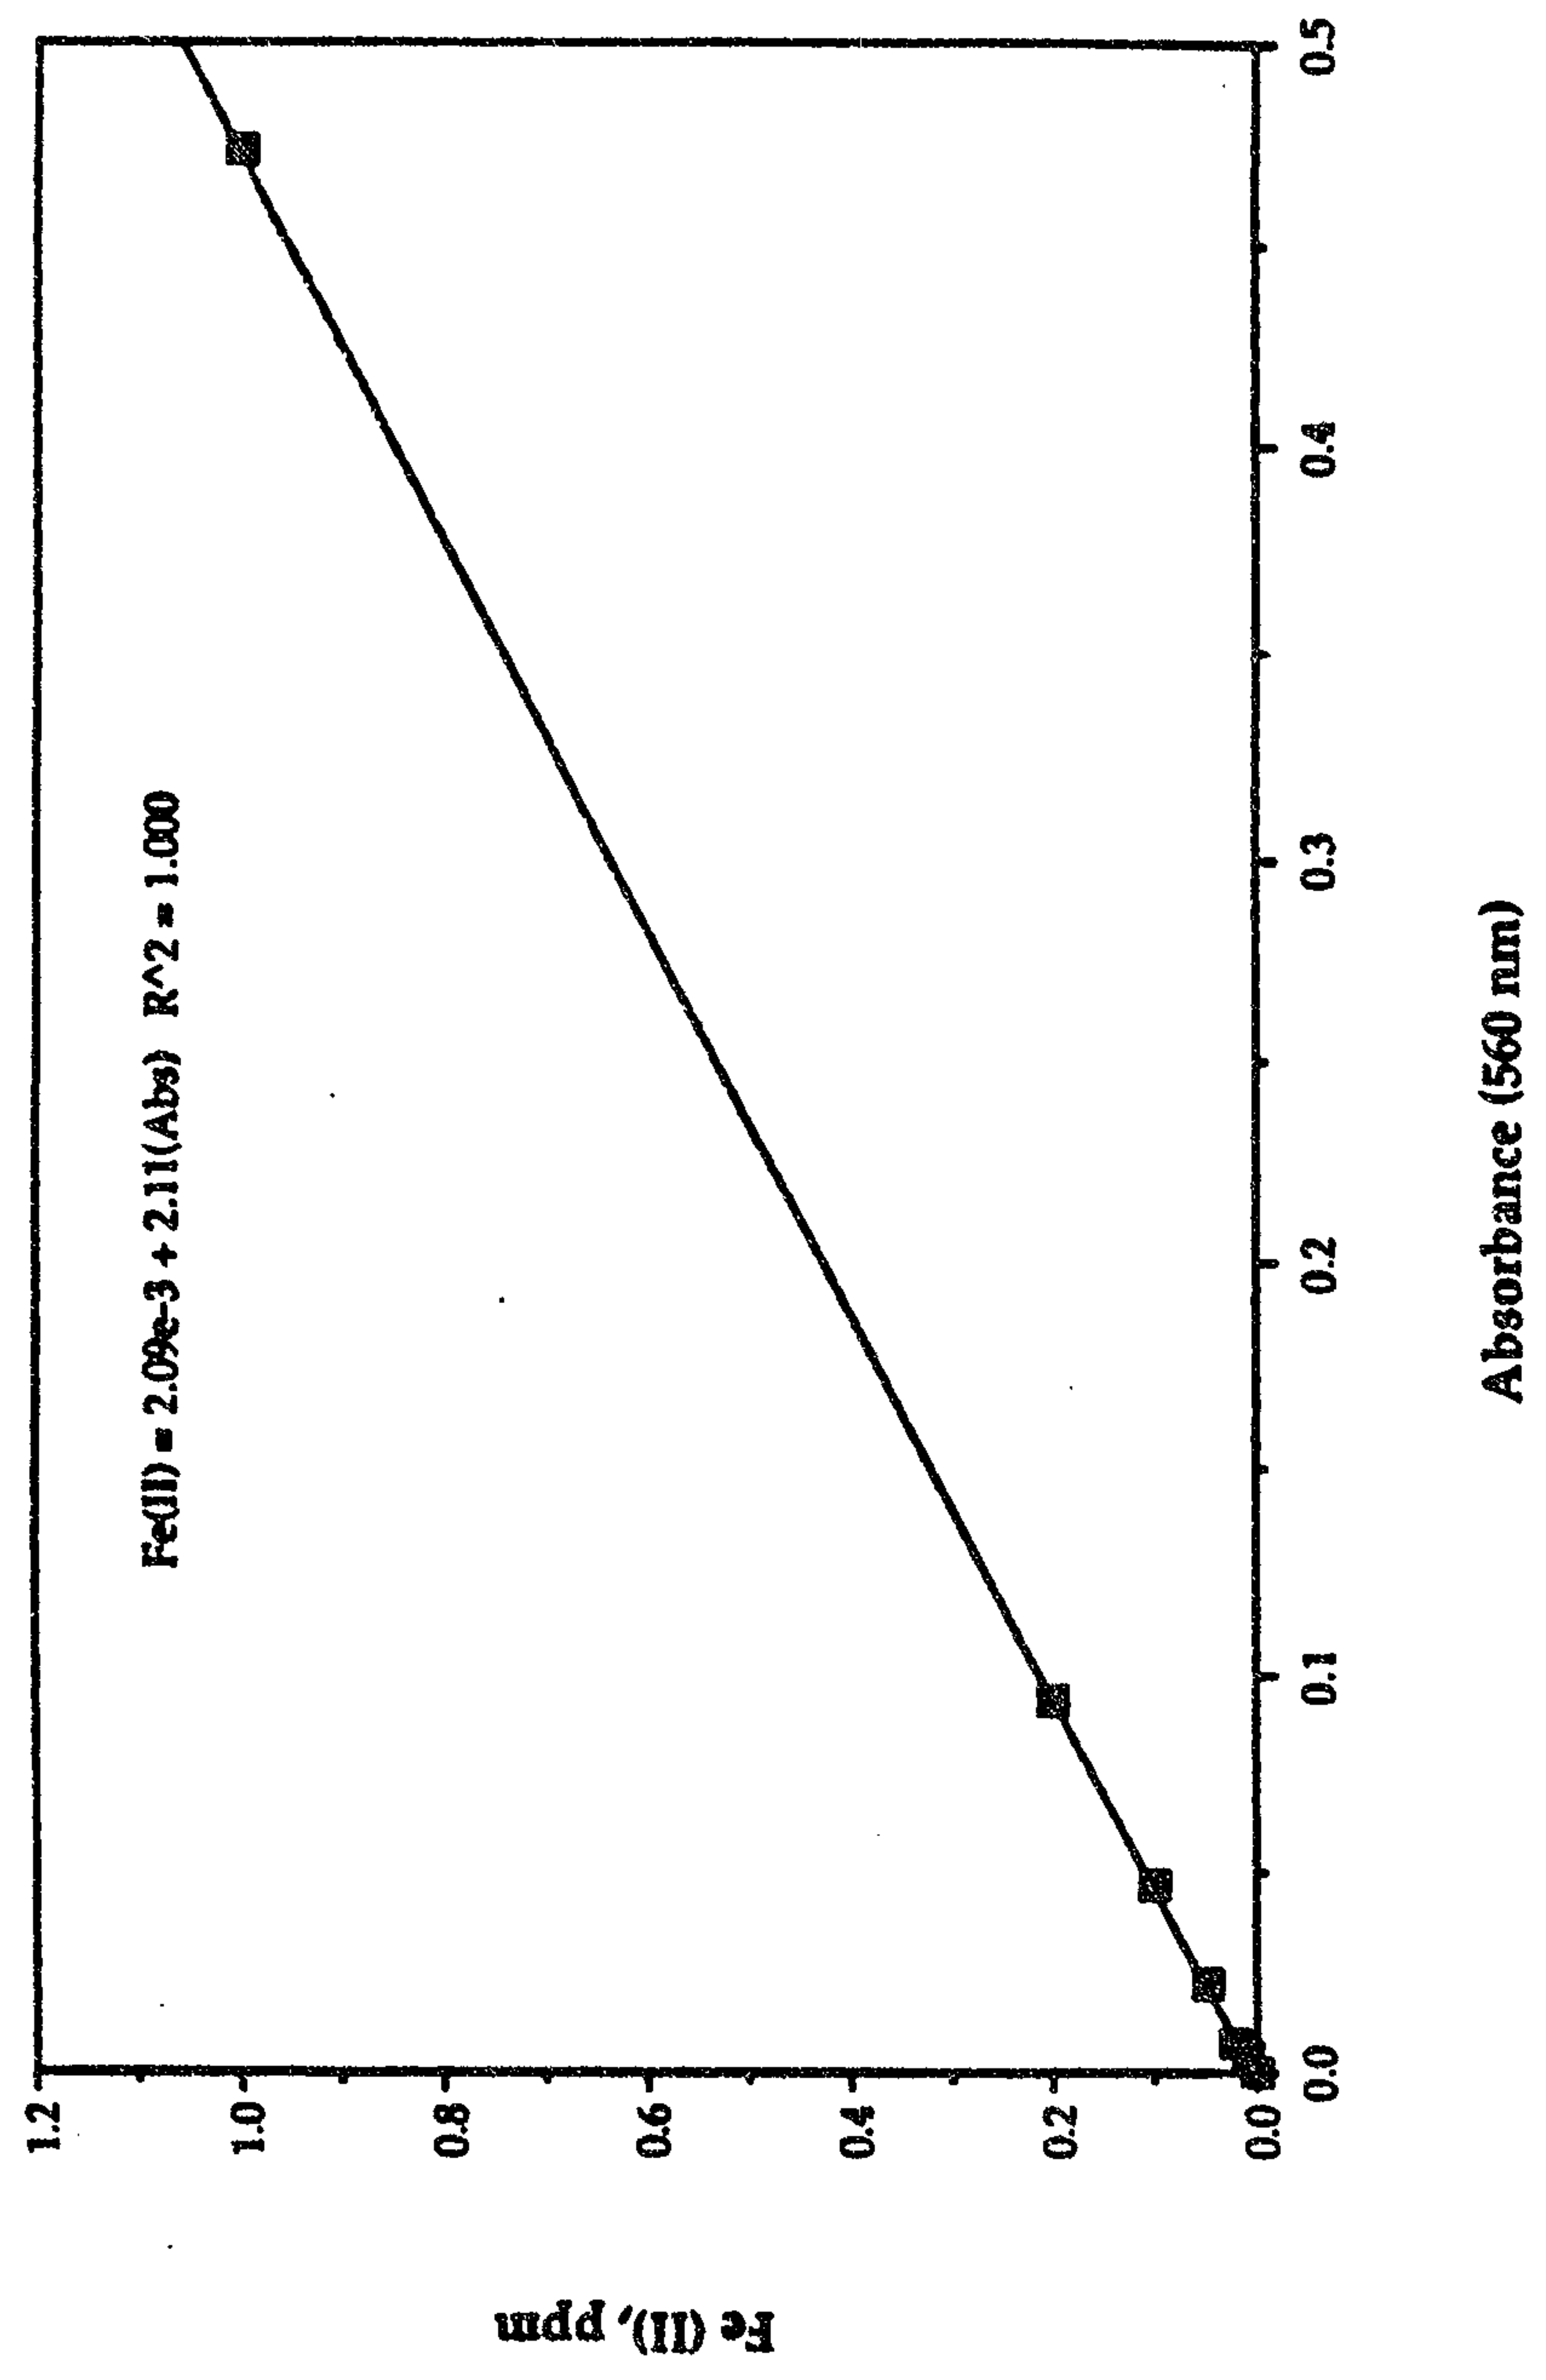


Patent Agent
Smart & Biggar

Figure 2- Interference of All-polymer Treatment on FE(II)

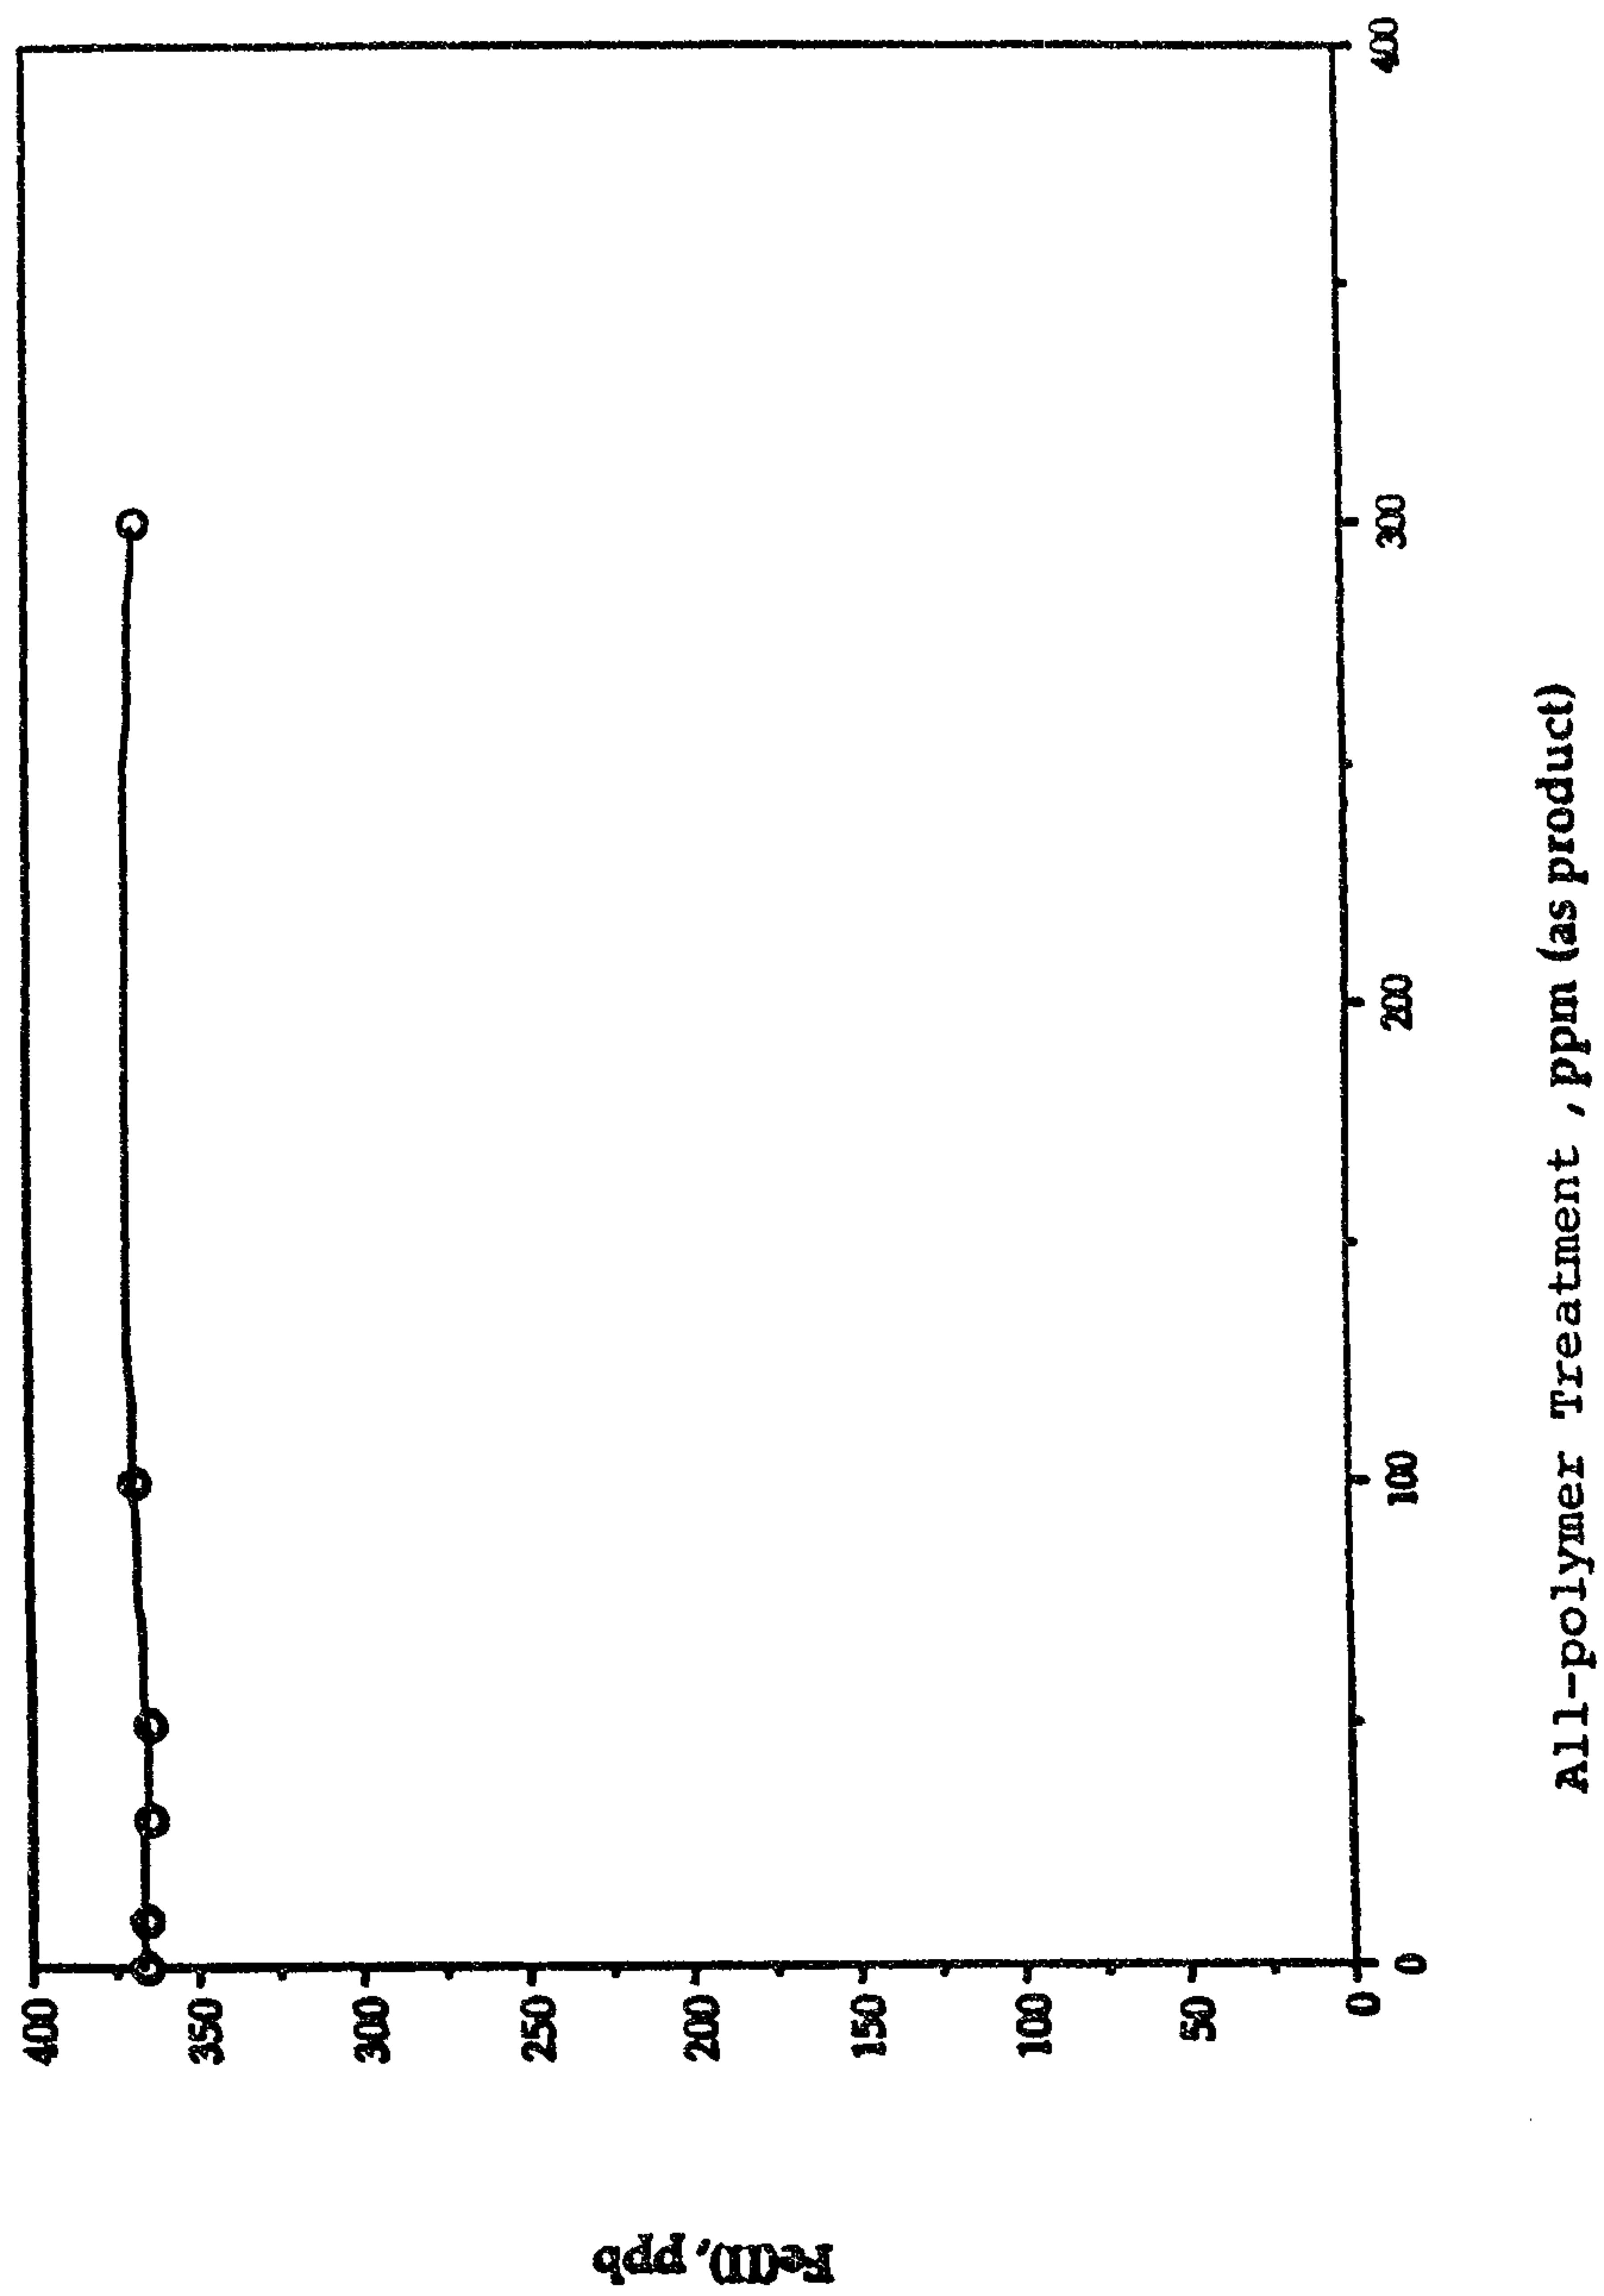


Patent Agents
Smart & Biggar

Figure 3- Interference of EDTA on Fe(II)

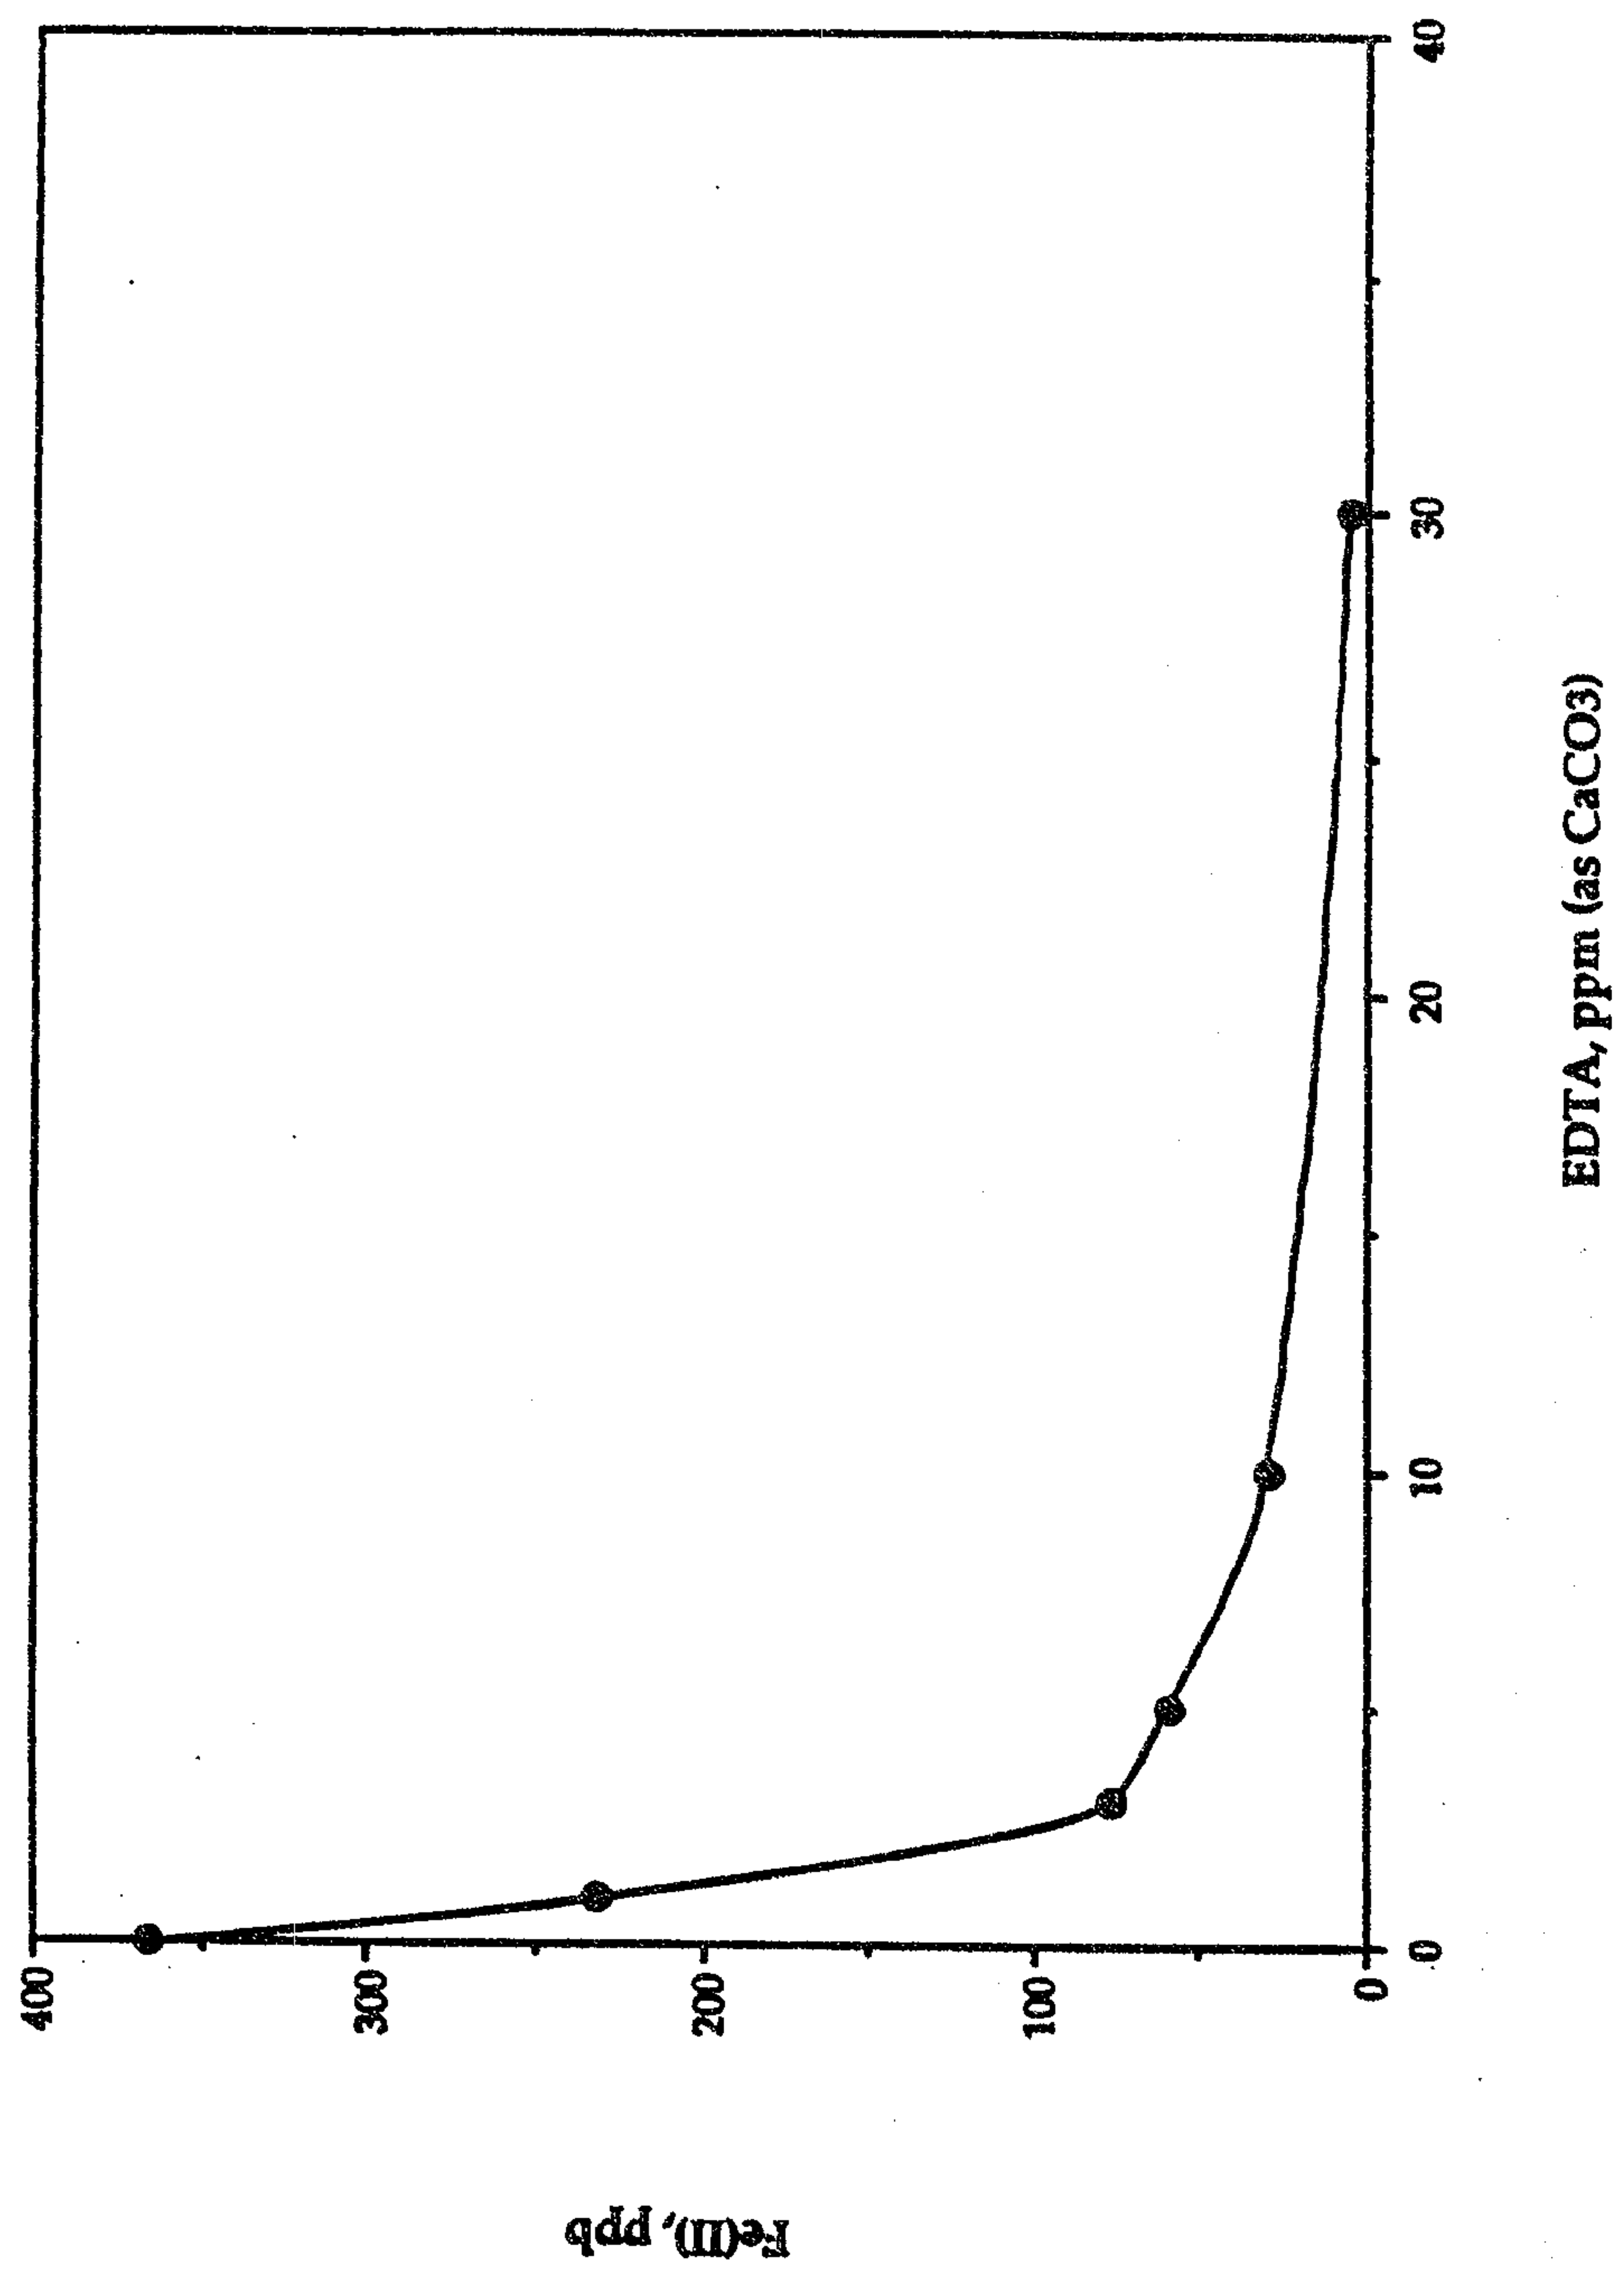


Patent Agents
Smart & Biggar

Figure 4 - Absorbance of Ferrous- Ferrozine complex
as a function of time

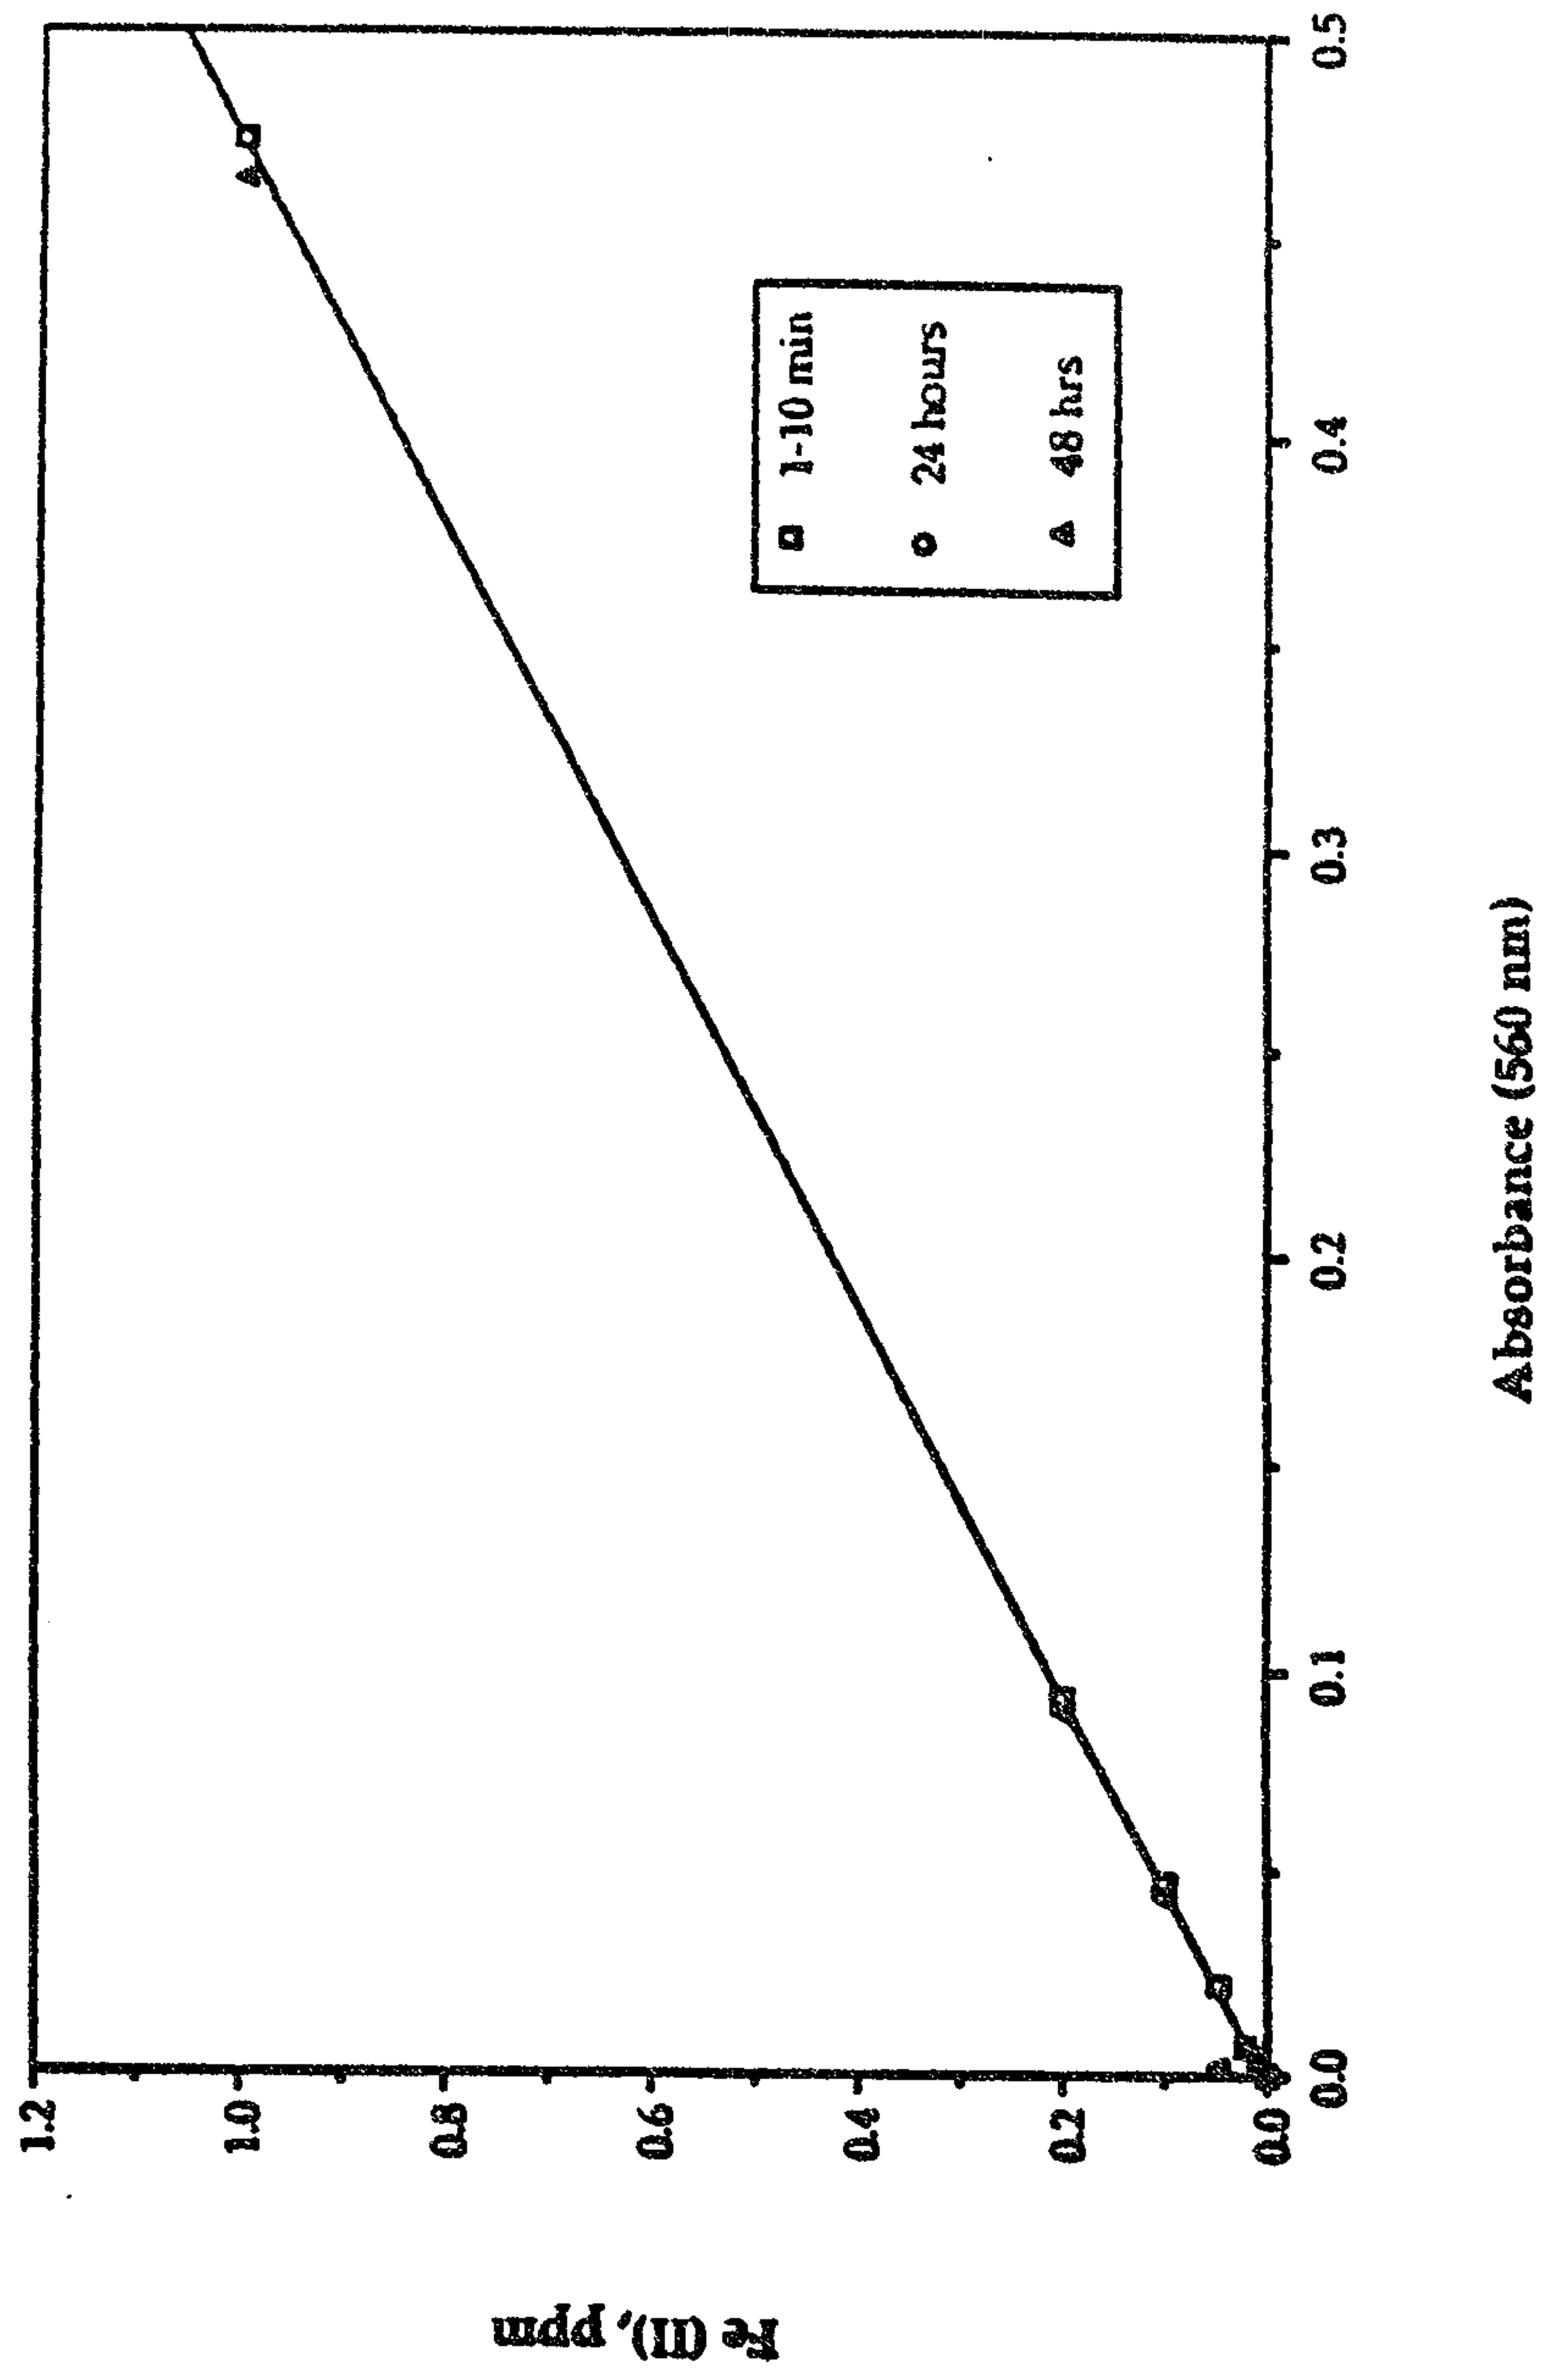

Patent Agent
S. M. B. J. J.

FIGURE 5

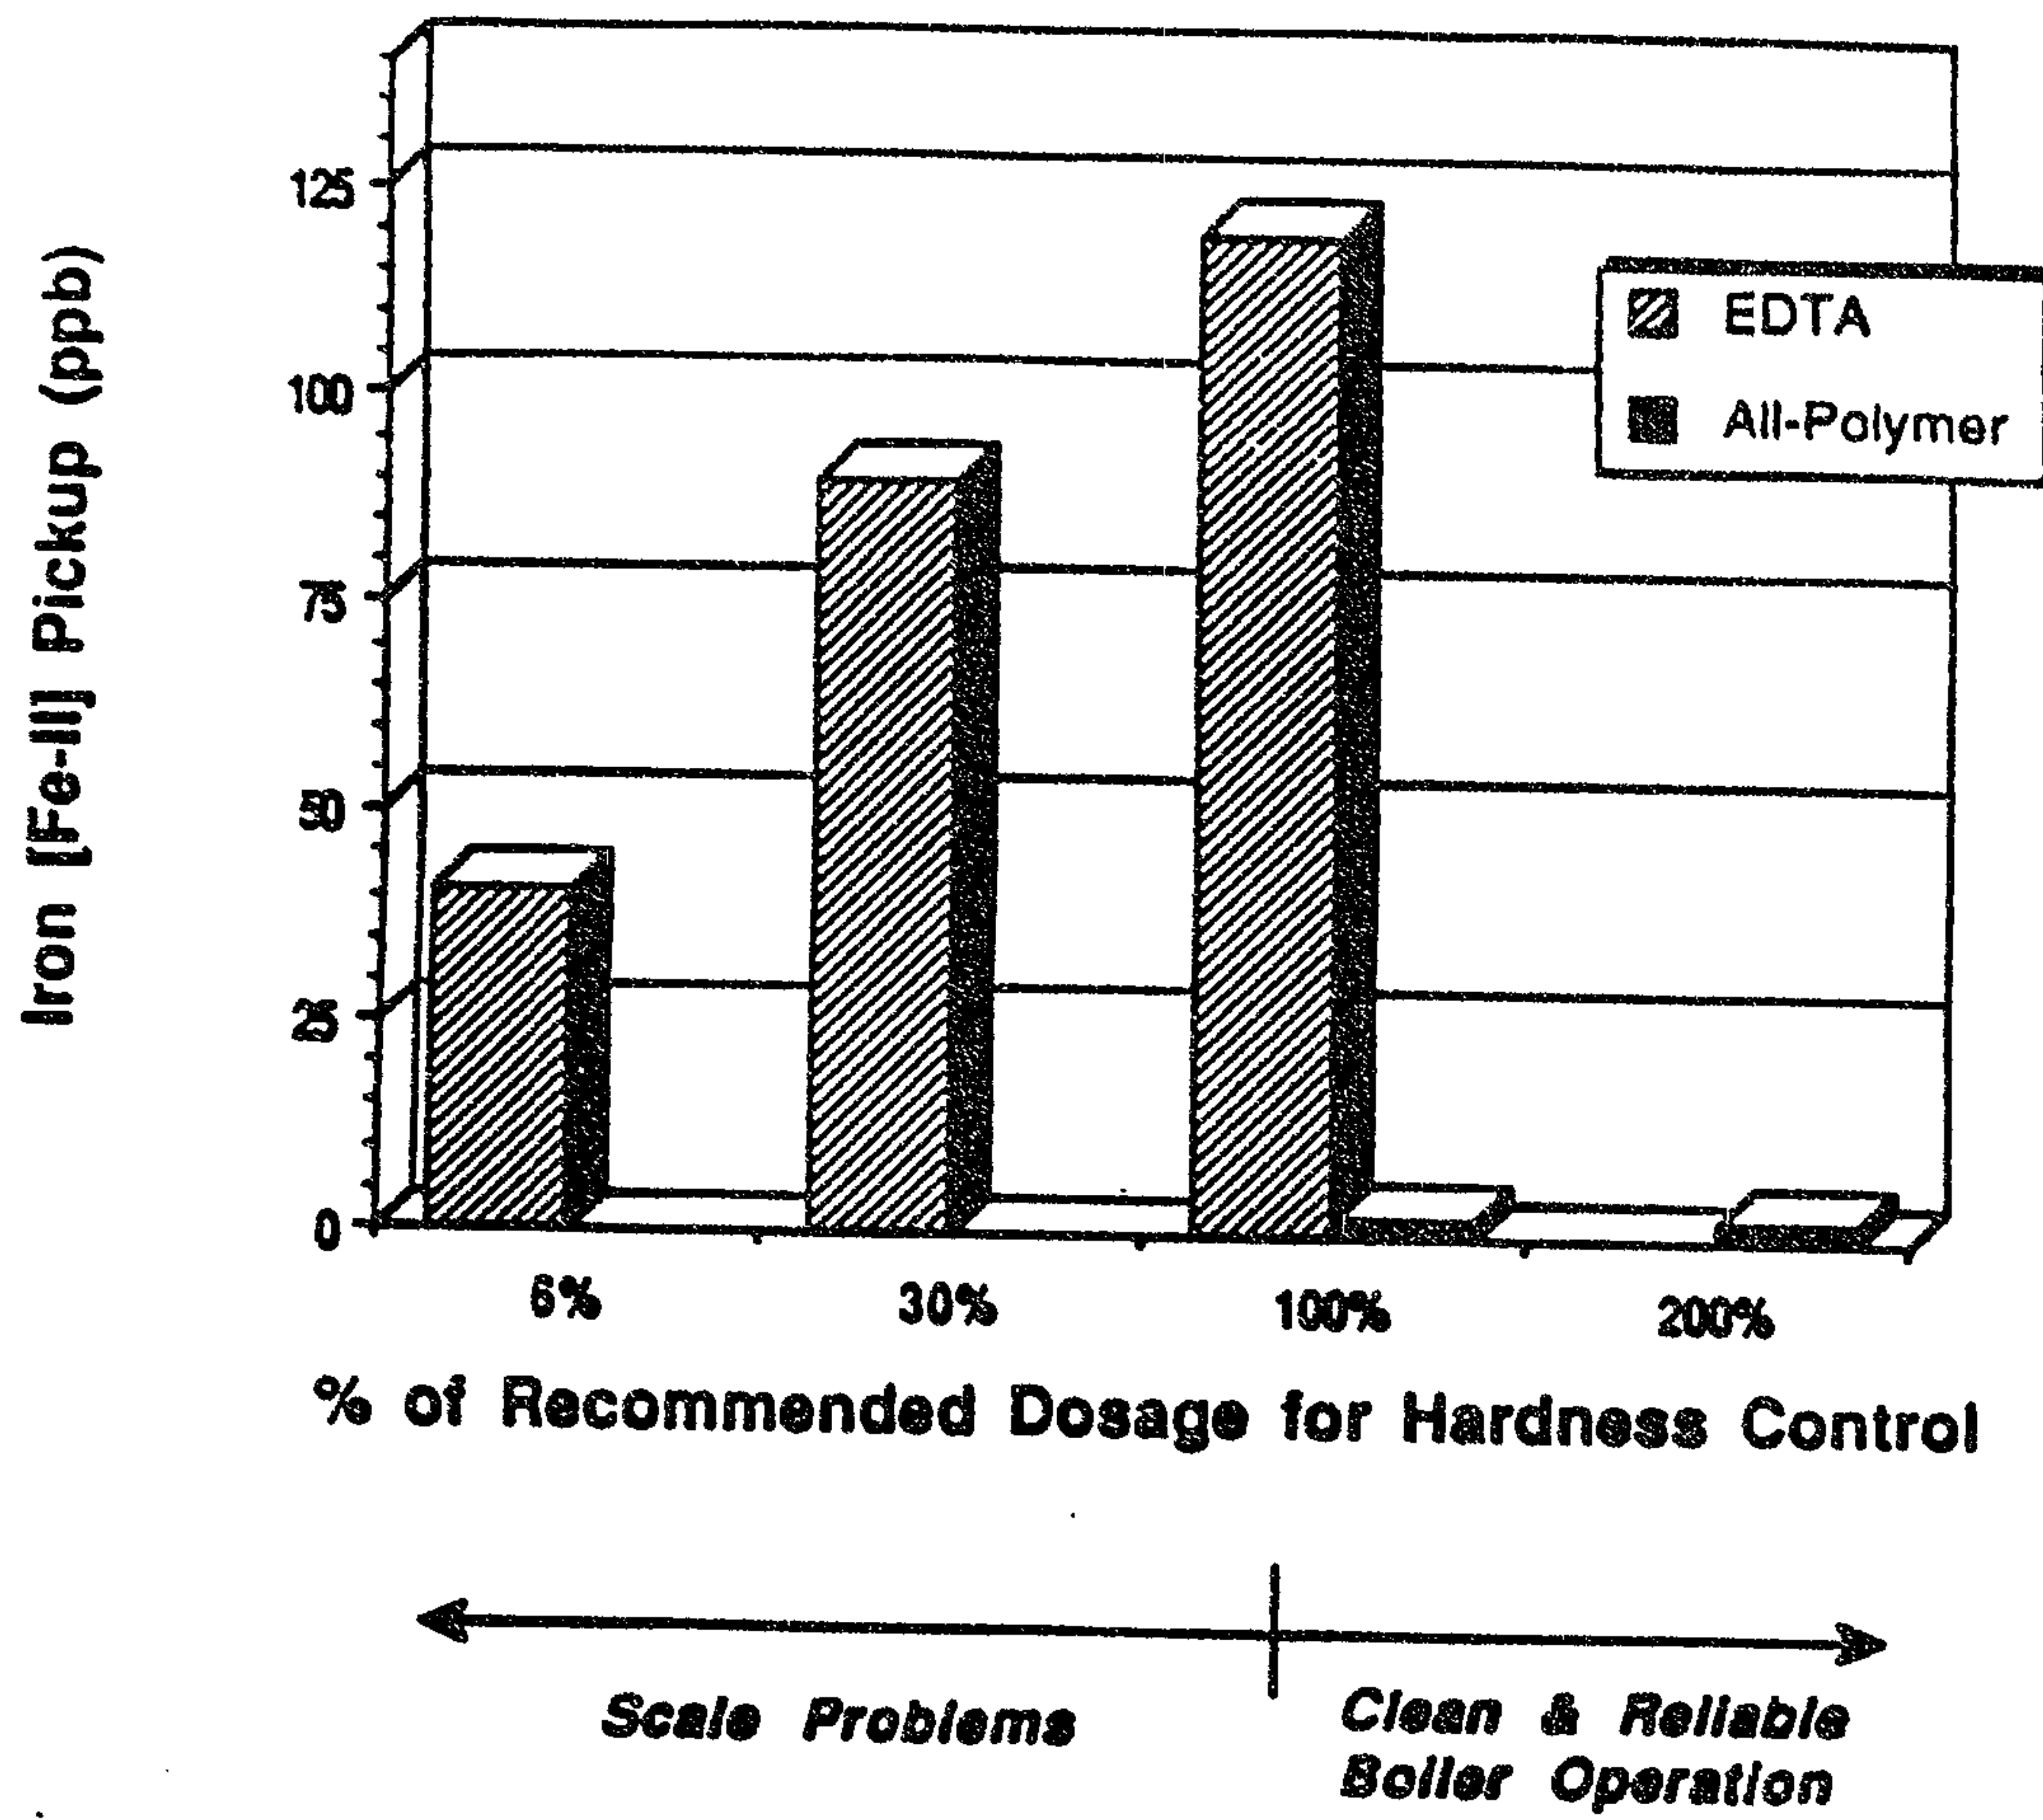

*Plotted April
Sundt C. H. Co.*

Absorbance of Ferrous- Ferrozine complex as a function of ferrous ion concentration

