(12) INTERNATIONAL APPLICATION PUBLISHED UNDER THE PATENT COOPERATION TREATY (PCT)

(19) World Intellectual Property Organization
International Bureau

(43) International Publication Date
10 May 2001 (10.05.2001)

PCT

(10) International Publication Number
WO 01/32268 A1

(51) International Patent Classification: A62C 37/08

(21) International Application Number: PCT/FI00/00949

(22) International Filing Date:
1 November 2000 (01.11.2000)

(25) Filing Language: English

(26) Publication Language: English

(30) Priority Data:
19992366 2 November 1999 (02.11.1999) FI

(71) Applicant and
(72) Inventor: SUNDHOLM, Göran [FI/FI]; Ilmari Kiannon kuja 3, FIN-04310 Tuusula (FI).

(74) Agent: KOLSTER OY AB; Iso Roobertinkatu 23, P.O. Box 148, FIN-00121 Helsinki (FI).

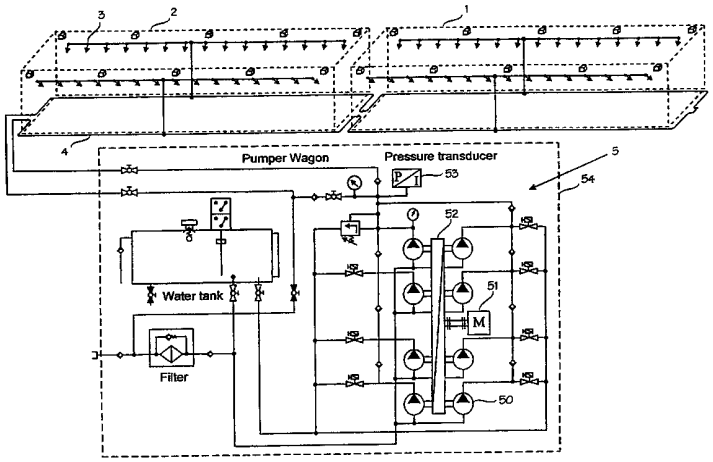
(81) Designated States *(national)*: AE, AG, AL, AM, AT, AT (utility model), AU, AZ, BA, BB, BG, BR, BY, BZ, CA, CH, CN, CR, CU, CZ, CZ (utility model), DE, DE (utility model), DK, DK (utility model), DM, DZ, EE, EE (utility model), ES, FI, FI (utility model), GB, GD, GE, GH, GM, HR, HU, ID, IL, IN, IS, JP, KE, KG, KP, KR, KR (utility model), KZ, LC, LK, LR, LS, LT, LU, LV, MA, MD, MG, MK, MN, MW, MX, MZ, NO, NZ, PL, PT, RO, RU, SD, SE, SG, SI, SK, SK (utility model), SL, TJ, TM, TR, TT, TZ, UA, UG, US, UZ, VN, YU, ZA, ZW.

(84) Designated States *(regional)*: ARIPO patent (GH, GM, KE, LS, MW, MZ, SD, SL, SZ, TZ, UG, ZW), Eurasian patent (AM, AZ, BY, KG, KZ, MD, RU, TJ, TM), European patent (AT, BE, CH, CY, DE, DK, ES, FI, FR, GB, GR, IE, IT, LU, MC, NL, PT, SE, TR), OAPI patent (BF, BJ, CF, CG, CI, CM, GA, GN, GW, ML, MR, NE, SN, TD, TG).

Published:
— *With international search report.*

For two-letter codes and other abbreviations, refer to the "Guidance Notes on Codes and Abbreviations" appearing at the beginning of each regular issue of the PCT Gazette.

(54) Title: INSTALLATION FOR FIGHTING FIRE



(57) Abstract: The invention relates to an installation for fighting fire in a unit, preferably a train with at least one railway carriage, or a tunnel, the installation comprising several spray heads whereof a number that is smaller than the total number of spray heads can be activated according to the location of the fire in the unit, and a drive source for delivering extinguishing medium through a pipe system to the activated spray heads, the drive source comprising a pump unit including a pump in order to provide by an effect of the pump unit a pumping pressure for pumping extinguishing medium into the activated spray head/heads, the pump unit comprising a control unit arranged to increase the extinguishing medium flow of the pump unit when the number of releasing spray heads increases. In order to provide a powerful and increased delivery of extinguishing medium from the active spray heads in such a case that only some of the spray heads in the installation are released, the control unit (52, 53) is arranged to increase the extinguishing medium flow of the pump unit (50, 51) in such a way that the effect of the pump unit is substantially kept constant.

WO 01/32268 A1

INSTALLATION FOR FIGHTING FIRE

BACKGROUND OF THE INVENTION

The invention relates to an installation for fighting fire in a unit, the installation comprising several spray heads whereof a number that is smaller than the total number of spray heads can be activated according to the location of the fire in the unit, and a drive source for delivering extinguishing medium through a pipe system to the activated spray heads, the drive source comprising a pump unit including a pump in order to provide by an effect of the pump unit a pumping pressure for pumping extinguishing medium into the activated spray head/heads, the pump unit comprising a control unit arranged to increase the extinguishing medium flow of the pump unit when the number of releasing spray heads increases.

Known fire fighting installations are generally arranged to provide a particular mainly constant flow from every spray head or sprinkler, i.e. a spray head comprising a release means (typically an ampoule that explodes at high temperatures) irrespective of the number of spray heads and sprinklers in the fire fighting installation. A constant flow for each spray head thus applies, irrespective of the number of releasing spray heads in the installation. If the installation comprises a larger number of spray heads, these can be divided into fire zones in such a manner that only the zone where fire is detected is released. The flow of extinguishing medium for each spray head is constant regardless of the number of released fire zones.

WO 9425112 discloses a fire fighting system comprising a drive source comprising a pump the rotation speed of which is adjusted in such a way that a predetermined constant value operational pressure is achieved, the flow being allowed to vary. This adjustment is carried out regardless how many sprinklers of the fire fighting system release. The effect of the pump unit thus varies according to the number of sprinklers that release.

Fire fighting installations are designed in such a way that the drive medium source that drives extinguishing medium to the spray heads has a particular effect that is assumed to provide a certain minimum flow for each spray head. If the installation comprises several spray heads, the effect of the drive medium source has to be high compared with an installation that includes a few spray heads only. This also applies if the installation has several fire zones.

Known fire fighting installations including several spray heads and possibly a number of fire zones are provided with a function and a construction meaning that only a part of the effect of the drive source is utilized in such a case that only a part of the spray heads (or fire zones) of the installation are released. The power available is therefore not utilized in the drive source of the fire fighting installation in case all the spray heads in the installation are not released.

It is commonly known that fire fighting must be started as efficiently as possible. This means that a particularly efficient extinguishing medium spray should initially be discharged which is able to fight/extinguish the fire at an early stage, before the fire spreads.

BRIEF DESCRIPTION OF THE INVENTION

It is an object of the present invention to efficiently fight fire by providing an installation which comprises several spray heads and which initially provides a maximum flow in the releasing spray heads, when only a part of the spray heads thereof are released.

This object is achieved with the present invention of the type defined in the introduction and being further characterized in that the control unit is arranged to increase the extinguishing medium flow of the pump unit in such a way that the effect of the pump unit is substantially kept constant. Here the term "effect" refers to the working or instantaneous power.

A particularly preferable embodiment of the invention is characterized in that the spray heads are placed in the unit in a number of fire zones, which are activated separately or in groups, comprising a number of spray heads for each fire zone, and in that the installation comprises a number of detectors for activating the fire zones, the detectors being arranged to start delivering extinguishing medium to the respective fire zone when detecting fire, the pump unit being arranged to increase the extinguishing medium flow when the number of activated fire zones and the number of releasing spray heads increase.

The pump unit preferably comprises 2 to 10 pumps whereof a minimum number is arranged to be coupled in operation depending on the number of activated spray heads, whereby the control unit comprises a gear box for coupling the minimum number of pumps in operation. A similar pump unit preferably includes a diesel motor operating with an optimal constant number of revolutions (rpm).

The preferred embodiments of the fire fighting installation are disclosed in the attached claims 2 to 12.

The installation is particularly suitable for fighting fire in trains and in tunnels and the like, where a fire fighting installation must typically be divided into a number of fire sections.

The main advantage of the fire fighting installation is to enable a powerful and increased delivery of extinguishing medium from the active spray heads in such a case that only some spray heads in the installation are released. The larger the number of non-releasing spray heads, the more powerful delivery of extinguishing medium is allowed from every releasing, or active, spray head, and the releasing spray heads are therefore able to fight fire efficiently. The fire can thus be rapidly fought/extinguished using as few as possible of the activated fire zones and using a relatively small amount of extinguishing medium, and the risk of the fire spreading is thus small. In practice it is most likely that only one fire zone or two at the most is activated.

BRIEF DESCRIPTION OF THE DRAWINGS

In the following the invention will be described in greater detail by means of three embodiments with reference to the accompanying drawing, in which

Figure 1 shows a fire fighting installation applied to a train,

Figure 2 shows how pressure is changed with the flow in Figure 1,

Figure 3 shows a second embodiment of the fire fighting installation applied to a train,

Figure 4 shows how pressure changes with the flow in Figure 3,

Figure 5 shows a third embodiment of the fire fighting installation applied to a train,

Figure 6 shows how pressure changes with the flow in Figure 5, and

Figure 7 shows a fire fighting installation applied to a tunnel.

DETAILED DESCRIPTION OF THE INVENTION

Figure 1 shows two railway carriages 1, 2 of a train with several railway carriages including a fire fighting installation comprising several sprinklers, i.e. spray heads 3 with release means reacting on heat and mounted along and close to the side walls of the railway carriages. A pipe system 4 is arranged to deliver extinguishing medium in the form of water-based liquid

from a drive source or a drive unit 5 to the spray heads 3.

The drive source 5 comprises a pump unit including eight high pressure pumps 50 and an engine 51, for example a diesel engine having a power of 270 kW operating the high pressure pumps, and a control unit 52, 53 that controls the flow and pressure of the pump unit. The drive unit can be arranged in a railway carriage 54.

The spray heads are arranged to be released after the heat-sensitive release means thereof explode or melt at high temperatures. A pressure transducer 53 measures the pressure in the pipe system 4 and starts the engine 51 of the pump unit after releasing one of the spray heads 3. Depending on the number of releasing spray heads, a different number of pumps 50 is coupled in operation through a gear box 52. The engine 51 operates with constant effect (power). If only one pump 50 is coupled in operation, the pressure in the released spray head/heads becomes very high, for example 160 bar. On account of the high pressure the released spray head/heads spray powerfully; the effect of the engine 51, typically the highest possible effect or power of the engine, is fully employed even if only some of the spray heads are released. If two or more pumps 50 are coupled in operation, as a result of the fact that several spray heads are released, the pressure in the individual spray heads decreases but the total flow increases. On account of the arrangement different maximum nozzle pressures and maximum flows can be achieved when fighting fire. Figure 2 illustrates how the pressure changes as a function of the total flow in the spray heads of the installation.

Figure 3 shows a second preferred embodiment of the invention. The same analogue reference numerals are used as in Figure 1 for corresponding components. The installation in Figure 2 differs from the one in Figure 1 in that the drive unit 5' comprises a control unit including a pressure transducer 53'. The control unit is arranged to adjust the number of revolutions in the diesel engine 51' in order to provide a maximum effect from the pump unit. The control unit 53' adjusting the number of revolutions in the diesel engine is not described in this context, as such a control unit can easily be accomplished by those skilled in the art. The control unit 53' is preferably arranged to measure the pressure or the pressure changes in the pipe system 4' and thereafter to control the number of revolutions in the diesel engine so that number of revolutions multiplied by the pressure is constant, thus providing an approximately constant effect. The maximum number of revolutions and the

maximum pressure are both limited.

Figure 4 shows how the pressure changes as a function of the total flow.

Figure 5 shows a third embodiment of the invention. Here the same analogue reference numerals are used as in Figure 1 for corresponding components. The fire fighting installation corresponds with the one in Figure 3 except that the spray heads of the railway carriages 1", 2" are divided into fire zones 8"-11", and the spray heads 3" are of such a type that they lack release means that can be activated by heat.

The spray heads 3" are arranged in fire zones 8"-11", both comprising a respective sectional valve 6", 6a". Detectors 7" reacting for example on radiation or smoke, or an optical detector, are arranged to control the respective sectional valves 6" so that these are opened when fire is detected: detector 7a", for example, controls sectional valve 6a" only.

In case of fire, extinguishing medium flows through a sectional valve 6" and a distribution pipe 40" to the fire zone in which fire is detected. Check valves 20" are arranged in the distribution pipe 40". The check valves 20" prevent the spray heads in the fire zone close by and on the same side of the railway carriage to be released if the detector thereof has not provided a signal.

The installation thus operates in such a manner that a detector 7a", for example, provides a signal, and as a result the sectional valve 6a" is opened, the pump unit 50", 51" is started and extinguishing medium is delivered to the spray heads 3a" which are placed on the right of the check valve 20a". The pump unit operates at a constant maximum effect despite the number of activated fire zones, i.e. in spite of e.g. the fire zone 11" also being activated.

An example on the influence of a control unit adjusting the number of revolutions in the diesel engine: in case only the fire zone 8" and a corresponding fire zone on the opposite side of the railway carriage (Zone 1 in Figure 5) is activated and the K factor of the spray heads 3" is 3,20, the nozzle pressure in the twenty activated spray heads is 141 bar, the total flow in the activated spray heads is 761l/min, the maximum pressure in the pump will obtain the value 177 bar (i.e. a pressure drop of 30 bar in the pipe system and the actual distribution pipes) and the effect of the pump unit is 270 kW. If several fire zones are activated, the nozzle pressure is lower, the total flow is

higher, and the maximum pressure in the pump unit remains lower (the pressure drop in the pipe system is also higher) and the effect of the pump unit is 270 kW.

Instead of a control unit that is arranged to increase the number of revolutions in the diesel engine if more than one fire zones are activated, a pump unit can be employed including several pumps and a gear box, as shown in Figure 1.

It is an advantage with the control unit in Figure 1 compared with a control unit controlling the number of revolutions in the diesel engine that the total flow within a larger interval can be varied without changing the effect of the pump unit. This is due to the fact that when the number of revolutions is adjusted, the diesel engines are not able to provide a maximum effect when the number of revolutions is small, which is associated with the characteristics of a diesel engine.

Figure 7 illustrates an installation of the invention mounted in a vehicle tunnel 1''', for example, a train or car tunnel. The same analogue reference numerals are used here as in Figures 1 and 2 for corresponding components. The tunnel 1''' is divided into six fire zones 8'''-13''' comprising four spray heads 3''' each. Each fire zone comprises a sectional valve 6''' respectively. It is obvious that a long tunnel should comprise hundreds, even thousands, of spray heads and many more fire sections and detectors 7''' than what is shown in Figure 7 in order to fight fire along the entire tunnel. Some of the sectional valves 6''' can be left out in case the distribution pipes 40''' in the fire zones following one another are connected and check valves are mounted in the same way as the distribution pipes in Figure 5.

The installation in Figure 7 operates in such a manner that if, for example, the fire detector 7a''' provides a signal, the corresponding sectional valve 6a''' is opened, and the spray heads in the fire zone 9''' start to spray extinguishing medium. The pressure becomes very high compared with a situation where several zones, for example the fire zones 8'''-10''', are activated. Regardless of the number of activated fire zones, the effect of the pump unit 5''' is set at a constant maximum value, as described above, by means of the control unit 53''' which is of the type that adjusts the number of revolutions in the power source, for example, the diesel engine. An engine operating with a constant number of revolution in order to operate a number of pumps through a gear box can alternatively be used.

The installation in Figures 1, 3, 5 and 7 can preferably be used periodically with reduced effect during a fire fighting process. This holds true particularly in applications where the amount of water is limited to a minimum and a particular protection time is desired so that fire fighters have time to arrive and take control of the fire. The capacity of the pump unit of the installation is then adjusted so that the pump unit flow and the installation pressure are reduced to a particular level after radiation heat from the fire is reduced to a certain level. If fire starts again and generates more heat, the pump unit flow and pressure are increased. The adjustment of the pumping effect can be implemented by means of connecting a number of pumps or by controlling the number of revolutions in the engine, as described above.

The invention has in the above been described with reference to four examples only, and it is therefore pointed out that the details of the invention may vary in many ways within the scope of the appended claims. For example, the number of fire zones and spray heads can vary. The installation may comprise combinations of said spray heads with and without release means that can be activated by heat. The number of pumps 50 can preferably vary between 2 to 10. The drive source for driving the pump/pumps does not have to be a diesel engine, but may also be a frequency or a thyristor-controlled electric engine.

CLAIMS

1. An installation for fighting fire in a unit, the installation comprising several spray heads (3, 3', 3'', 3''') whereof a number that is smaller than the total number of spray heads can be activated according to the location of the fire in the unit, and a drive source (5, 5', 5'', 5''') for delivering extinguishing medium through a pipe system (4, 4', 4'', 4''') to the activated spray heads, the drive source comprising a pump unit including a pump (50, 50', 50'', 50''') in order to provide by an effect of the pump unit a pumping pressure for pumping extinguishing medium into the activated spray head/heads, the pump unit comprising a control unit (52, 53, 53', 53'', 53''') arranged to increase the extinguishing medium flow of the pump unit when the number of releasing spray heads increases, **characterized** in that the control unit (52, 53, 53', 53'', 53''') is arranged to increase the extinguishing medium flow of the pump unit (50, 51, 50', 51', 50'', 51'', 5''') in such a way that the effect of the pump unit is substantially kept constant.

2. An installation as claimed in claim 1, **characterized** in that the spray heads (3'', 3''') are placed in the unit in a number of fire zones (8'' - 11'', 8''' - 13'''), which are activated separately or in groups, comprising a number of spray heads for each fire zone, and in that the installation comprises a number of detectors (7'', 7''') for activating the fire zones (8'' - 11'', 8''' - 13'''), the detectors being arranged to start delivering extinguishing medium to the respective fire zone when detecting fire, the pump unit being arranged to increase the extinguishing medium flow when the number of activated fire zones and the number of releasing spray heads increase.

3. An installation as claimed in claim 1, **characterized** in that the pump is a high pressure pump.

4. An installation as claimed in claim 3, **characterized** in that the pump unit comprises 2-10 pumps (50) whereof a minimum number is arranged to be coupled in operation depending on the number of activated spray heads (3).

5. An installation as claimed in claim 4, **characterized** in that the control unit comprises a gear box (52) for coupling a minimum number of pumps (50) in operation.

6. An installation as claimed in claim 1, in which the unit is an elongated unit (1, 2, 1', 2', 1'', 2'', 1''') with longitudinal side walls, **characterized** by fire zones (8'' - 11'', 8''' - 13''') and spray heads (3'', 3''') being

consecutively arranged along the elongated unit (1, 2, 1', 2', 1'', 2'', 1''').

7. An installation as claimed in claim 6, **characterized** in that the fire zones (8'' - 11'', 8''' - 13''') extend along the longitudinal side walls of the elongated unit (1, 2, 1', 2', 1'', 2'', 1''') in such a manner that both side walls comprise substantially the same number of fire zones.

8. An installation as claimed in claim 6 or 7, **characterized** in that the detectors (7'', 7''') are arranged to control sectional valves (6'', 6''') arranged between the pipe system (4'', 4''') and distribution pipes (40'', 40''') leading towards the fire zones (8'' - 11'', 8''' - 13'''), the sectional valves being arranged to be opened when the respective detectors provide a signal for delivering extinguishing medium to the respective fire zones.

9. An installation as claimed in claim 8, **characterized** in that check valves (20'') are arranged in connection with the distribution pipes (40''), the check valves allowing the extinguishing medium to flow through a sectional valve (6'') to the spray heads in a fire zone but preventing the extinguishing medium to flow through said sectional valve to an adjacent fire zone.

10. An installation as claimed in claim 9, **characterized** in that some of the consecutive and adjacent fire zones (8'', 9'' and 10'', 11'') comprise spray heads which are common for these fire zones and which are arranged to spray extinguishing medium when activating either of said fire zones.

11. An installation as claimed in claim 1 or 6, **characterized** in that the unit is a railway carriage (1, 2, 1', 2', 1'', 2'').

12. An installation as claimed in claim 3, **characterized** in that the unit is a tunnel (1''').

Fig. 1

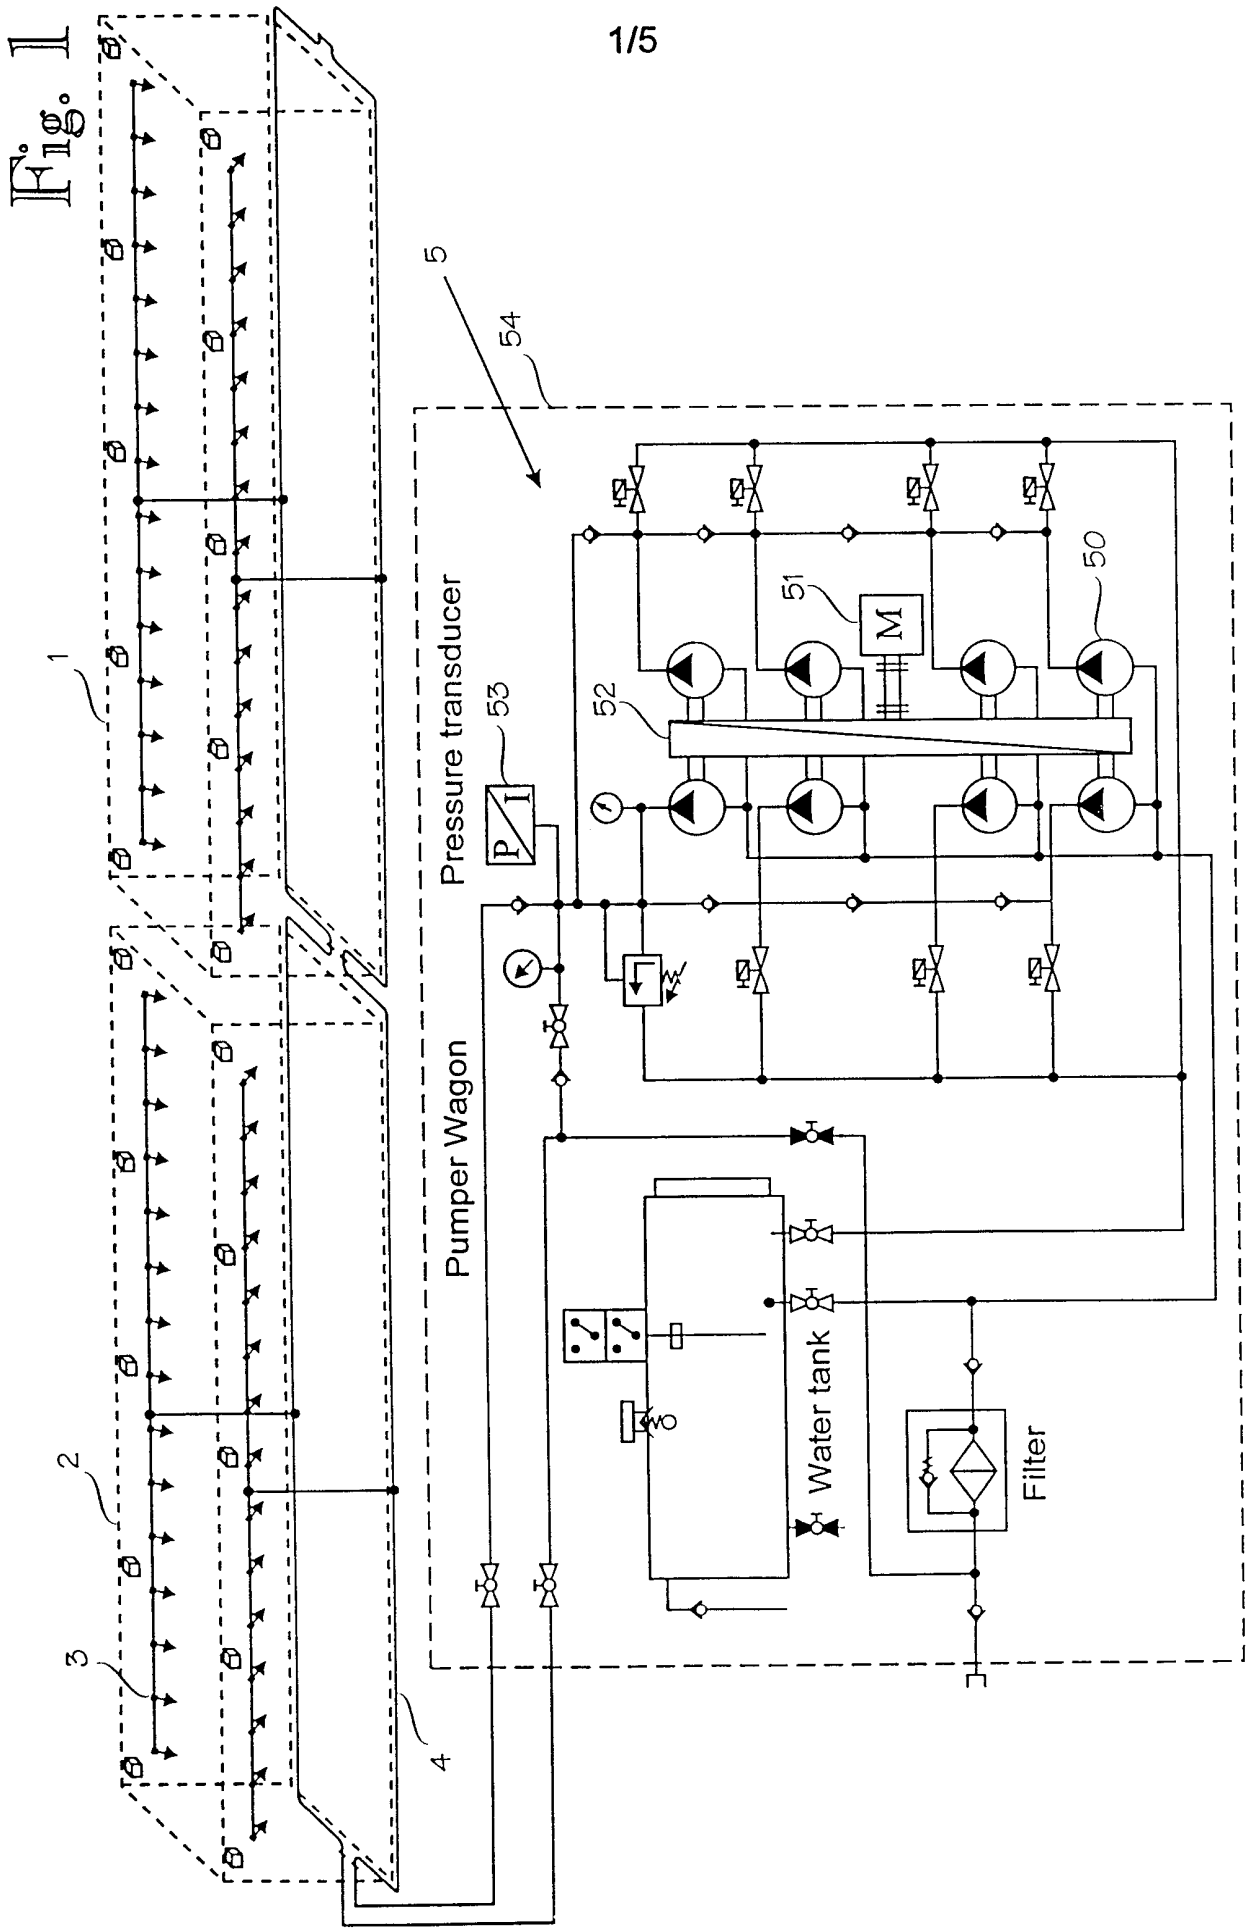

1
2
3
4
5
50
51
M
52
53
P
I
54
Pressure transducer
Pumper Wagon
Water tank
Filter

Fig. 2

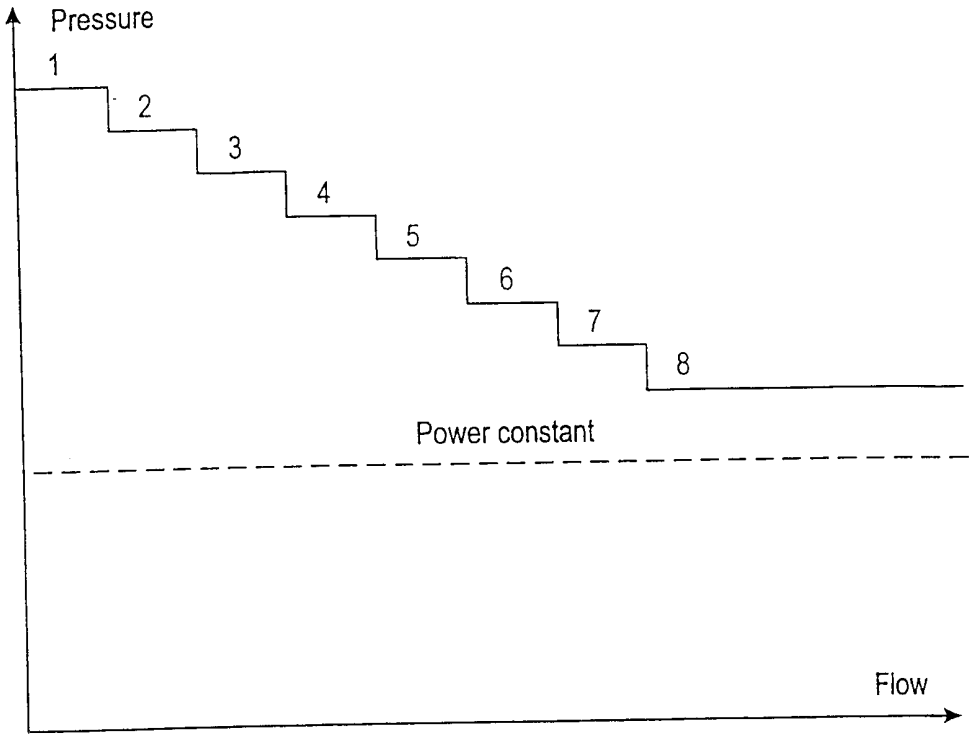

Pressure
1
2
3
4
5
6
7
8
Power constant
Flow

Fig. 4

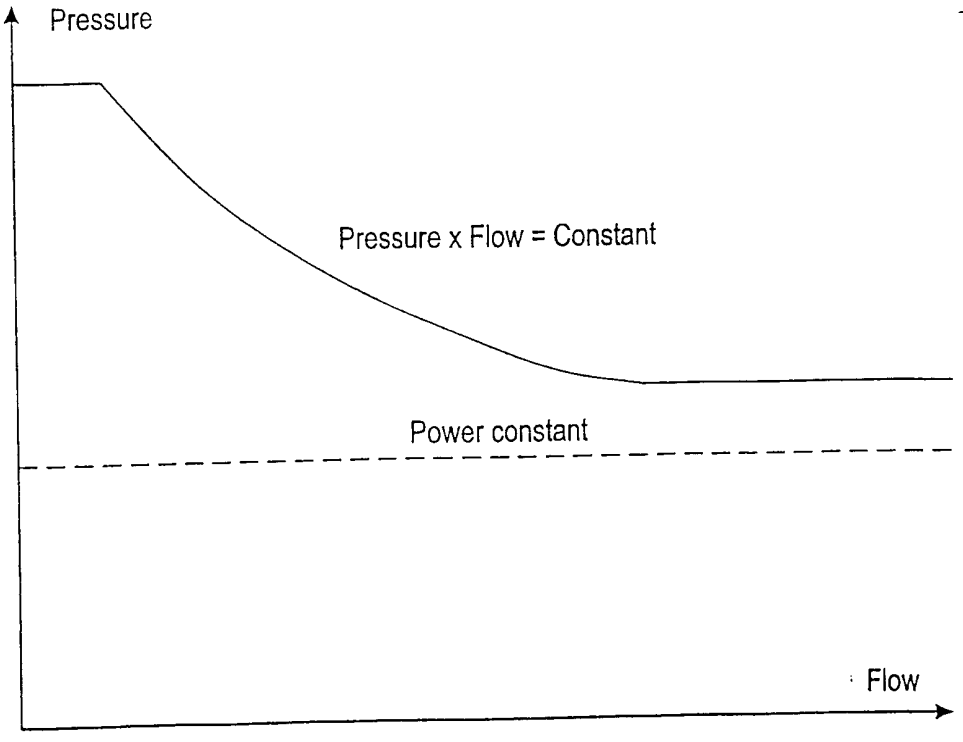

Pressure
Pressure x Flow = Constant
Power constant
Flow

Fig. 3

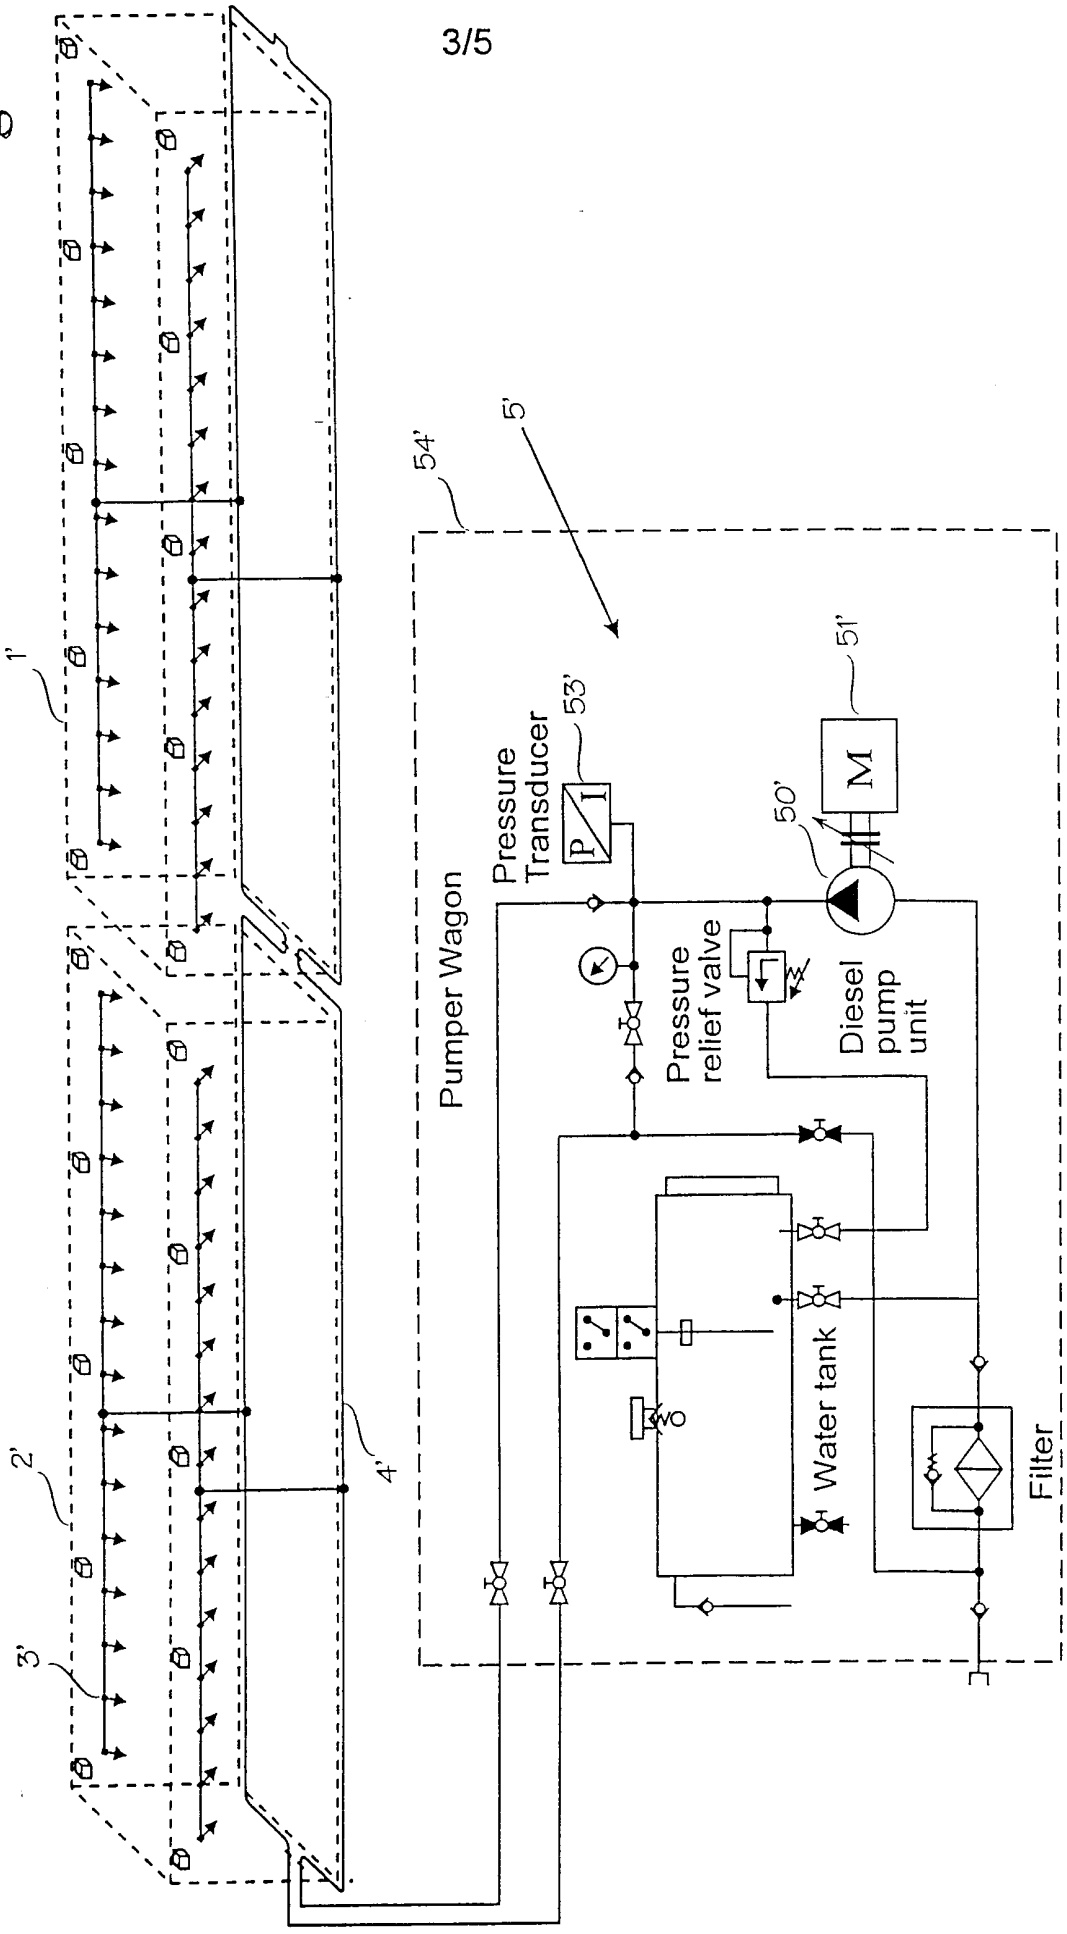

1'
2'
3'
4'
5'
54'
Pumper Wagon
Pressure Transducer
53'
P
I
50'
51'
M
Pressure relief valve
Diesel pump unit
Water tank
Filter

Fig. 5

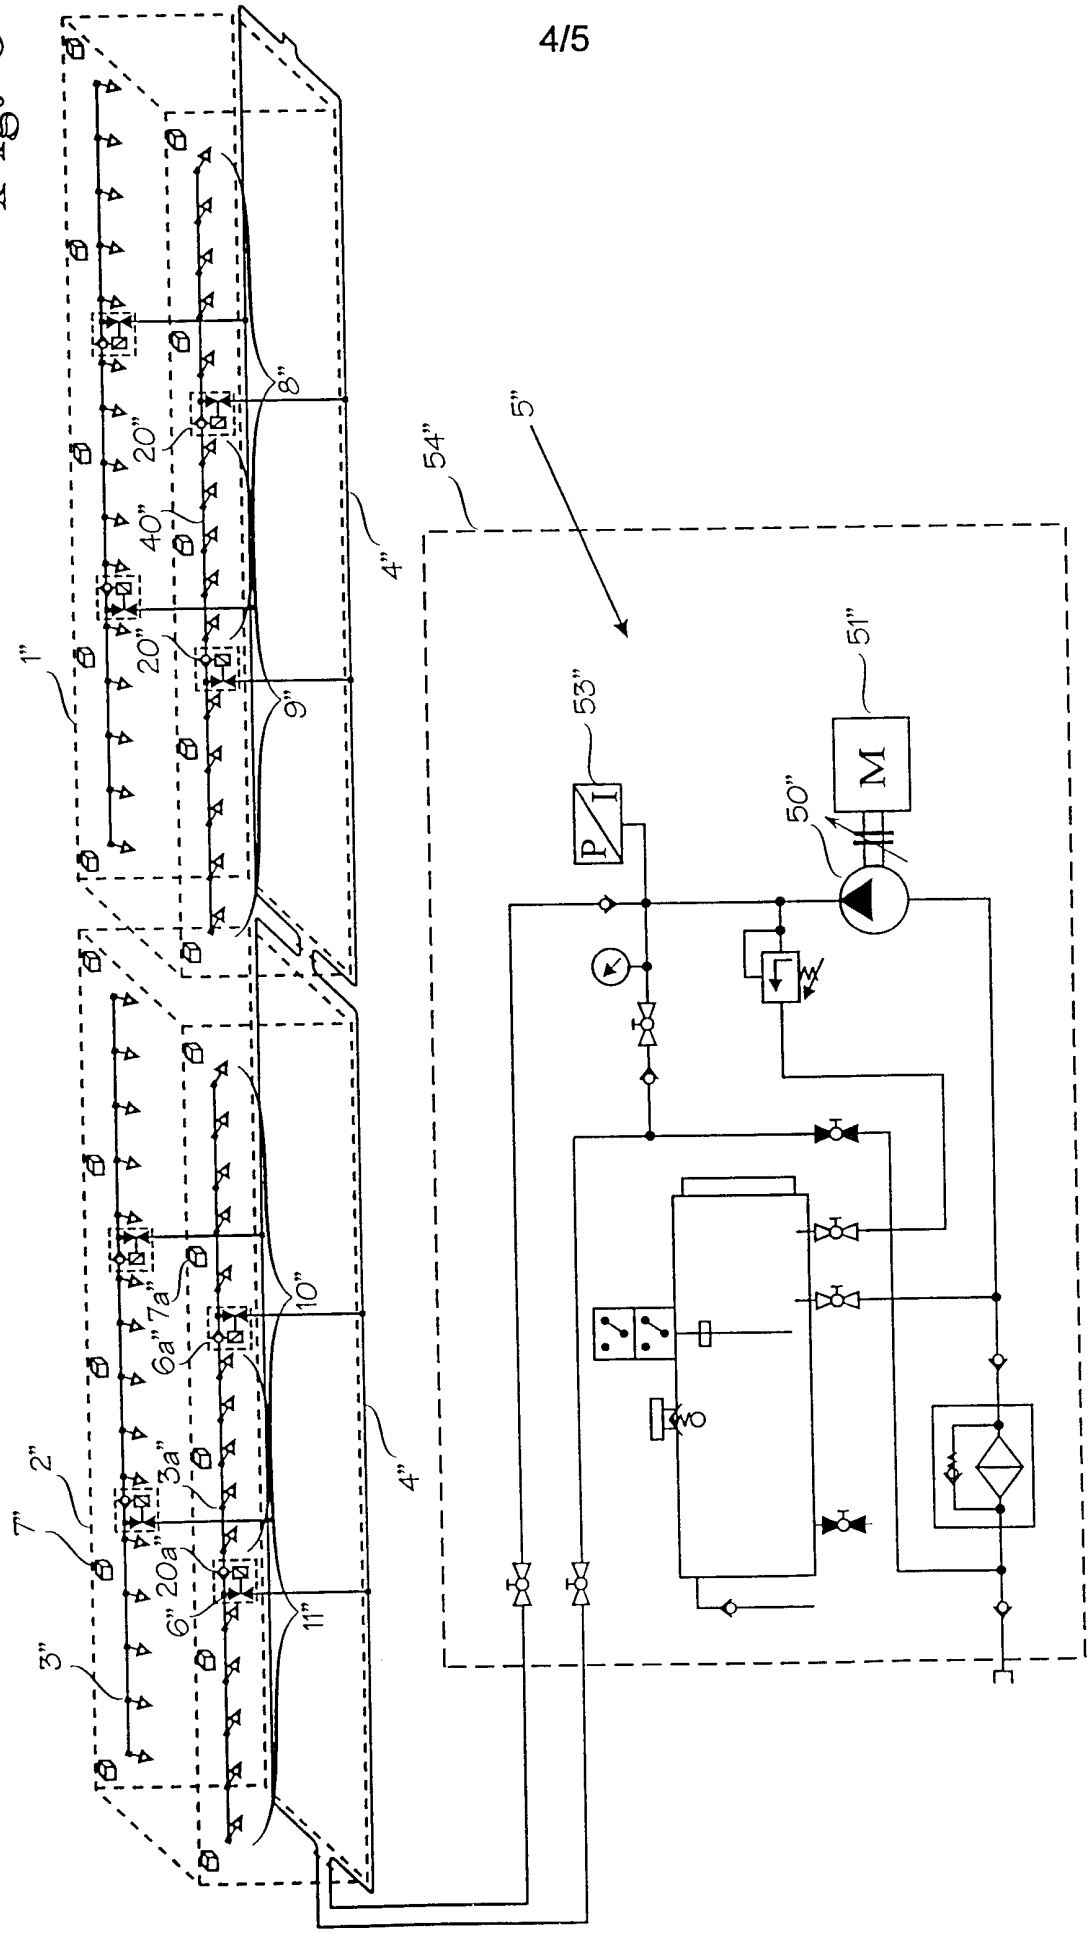


Fig. 6

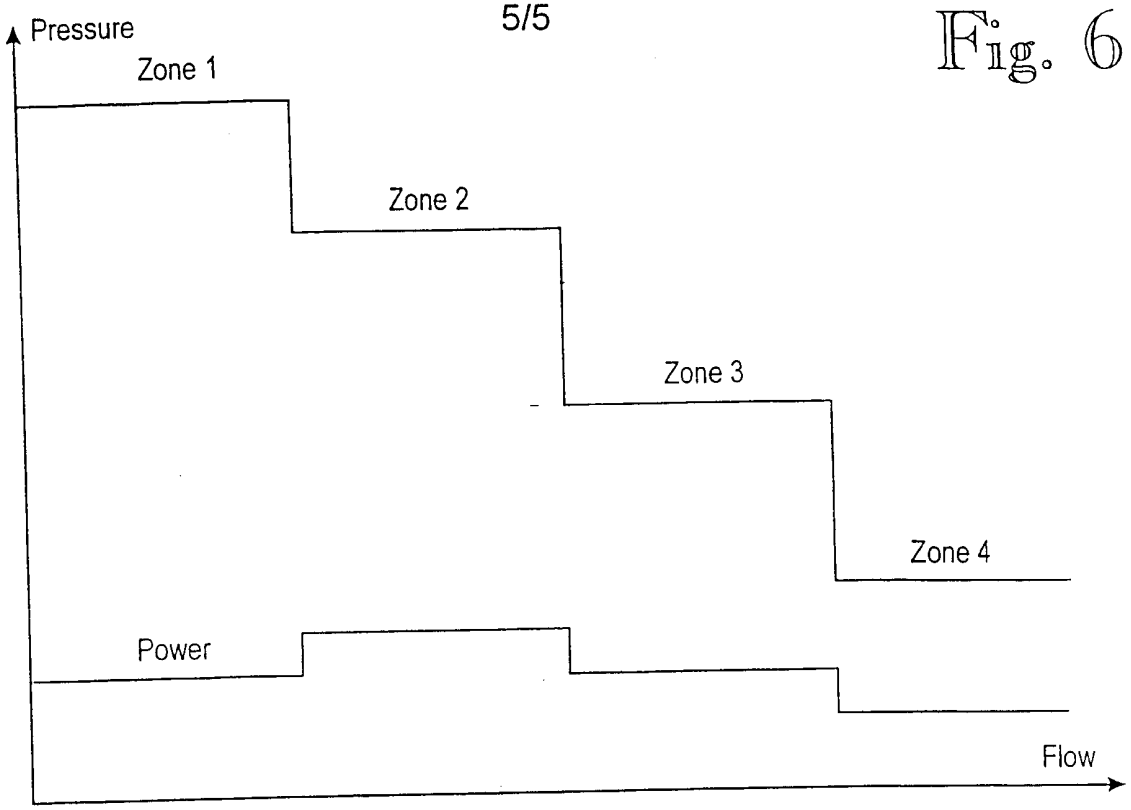
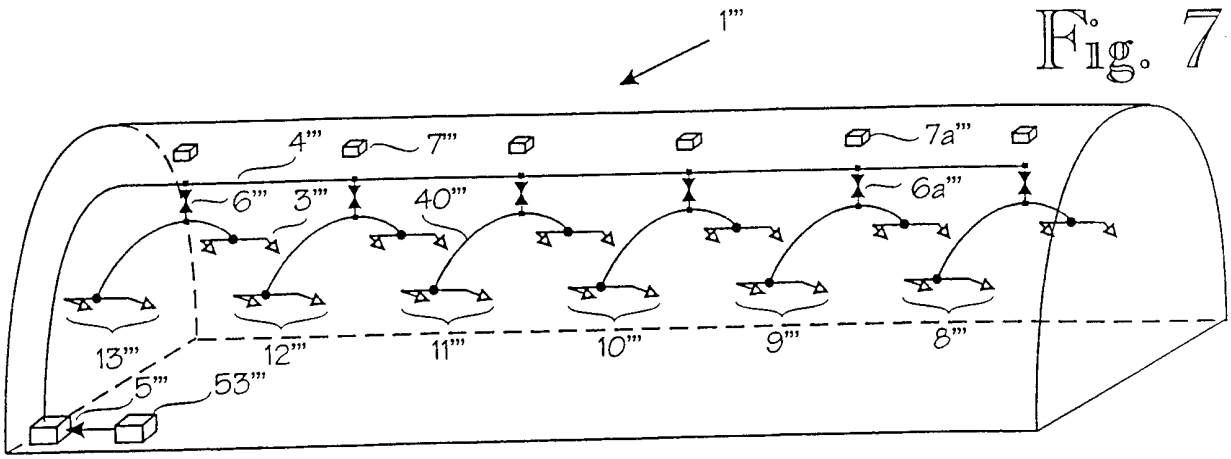

Pressure
Zone 1
Zone 2
Zone 3
Zone 4
Power
Flow

Fig. 7


1'''
4'''
7'''
7a'''
6'''
3'''
40'''
6a'''
13'''
12'''
11'''
10'''
9'''
8'''
5'''
53'''

INTERNATIONAL SEARCH REPORT

International application No.
PCT/FI 00/00949

A. CLASSIFICATION OF SUBJECT MATTER

IPC7: A62C 37/08
According to International Patent Classification (IPC) or to both national classification and IPC

B. FIELDS SEARCHED

Minimum documentation searched (classification system followed by classification symbols)

IPC7: A62C

Documentation searched other than minimum documentation to the extent that such documents are included in the fields searched

SE,DK,FI,NO classes as above

Electronic data base consulted during the international search (name of data base and, where practicable, search terms used)

C. DOCUMENTS CONSIDERED TO BE RELEVANT

Category*	Citation of document, with indication, where appropriate, of the relevant passages	Relevant to claim No.
Y	US 5072792 A (SIMONS, ET AL), 17 December 1991 (17.12.91), figures 1-7, claims 1-13	1,10
	--	
X	WO 9425113 A1 (HTC I ÄMÅL AB), 10 November 1994 (10.11.94), figure 1, claims 1-16	1-5
Y	figure 1, claims 1-16	1,10
	--	
X	EP 1010441 A2 (PROJECT FIRE ENGINEERS LIMITED), 10 December 1999 (10.12.99), figures 1-2, claims 1-7	1-5
Y	figures 1-2, claims 1-7	1,6-8,11,12
	--	

[X] Further documents are listed in the continuation of Box C. [X] See patent family annex.

* Special categories of cited documents:
"A" document defining the general state of the art which is not considered to be of particular relevance
"E" earlier application or patent but published on or after the international filing date
"L" document which may throw doubts on priority claim(s) or which is cited to establish the publication date of another citation or other special reason (as specified)
"O" document referring to an oral disclosure, use, exhibition or other means
"P" document published prior to the international filing date but later than the priority date claimed
"T" later document published after the international filing date or priority date and not in conflict with the application but cited to understand the principle or theory underlying the invention
"X" document of particular relevance: the claimed invention cannot be considered novel or cannot be considered to involve an inventive step when the document is taken alone
"Y" document of particular relevance: the claimed invention cannot be considered to involve an inventive step when the document is combined with one or more other such documents, such combination being obvious to a person skilled in the art
"&" document member of the same patent family

Date of the actual completion of the international search	Date of mailing of the international search report
6 February 2001	14 -02- 2001
Name and mailing address of the ISA/ Swedish Patent Office Box 5055, S-102 42 STOCKHOLM Facsimile No. +46 8 666 02 86	Authorized officer Agneta Änggård/JAn Telephone No. +46 8 782 25 00

INTERNATIONAL SEARCH REPORT

International application No.
PCT/FI 00/00949

C (Continuation). DOCUMENTS CONSIDERED TO BE RELEVANT

Category*	Citation of document, with indication, where appropriate, of the relevant passages	Relevant to claim No.
Y	GB 2215204 A (STEEL, J), 20 Sept 1989 (20.09.89), figures 1-2, claims 1-12	6-8,11,12

--

INTERNATIONAL SEARCH REPORT

Information on patent family members

27/12/00

International application No.
PCT/FI 00/00949

Patent document cited in search report	Publication date	Patent family member(s)	Publication date
US 5072792 A	17/12/91	NONE	
WO 9425113 A1	10/11/94	AU 6547894 A	21/11/94
		EP 0696218 A	14/02/96
		JP 7116281 A	09/05/95
		SE 501398 C	06/02/95
		SE 9301490 A	31/10/94
EP 1010441 A2	10/12/99	GB 2344762 A	21/06/00
		GB 9827434 D	00/00/00
GB 2215204 A	20/09/89	GB 8804284 D	00/00/00