




(86) Date de dépôt PCT/PCT Filing Date: 2011/09/08 (87) Date publication PCT/PCT Publication Date: 2012/04/12 (45) Date de délivrance/Issue Date: 2019/02/05 (85) Entrée phase nationale/National Entry: 2013/02/14 (86) N° demande PCT/PCT Application No.: US 2011/050741 (87) N° publication PCT/PCT Publication No.: 2012/047438 (30) Priorité/Priority: 2010/09/27 (US12/891,317)	(51) Cl.Int./Int.Cl. <i>G21D 5/12</i> (2006.01), <i>F22B 3/00</i> (2006.01), <i>G21C 1/08</i> (2006.01) (72) Inventeurs/Inventors: FORTINO, ROBERT, T., US; ALES, MATHEW, W., US; IDVORIAN, NICK, CA (73) Propriétaires/Owners: BABCOCK & WILCOX CANADA LTD., CA; BWXT FOREIGN HOLDINGS, LLC, US; BWXT MPOWER, INC., US (74) Agent: RIDOUT & MAYBEE LLP
---	---

(54) Titre : REACTEUR NUCLEAIRE COMPACT A GENERATEUR DE VAPEUR INTEGRE
(54) Title: COMPACT NUCLEAR REACTOR WITH INTEGRAL STEAM GENERATOR

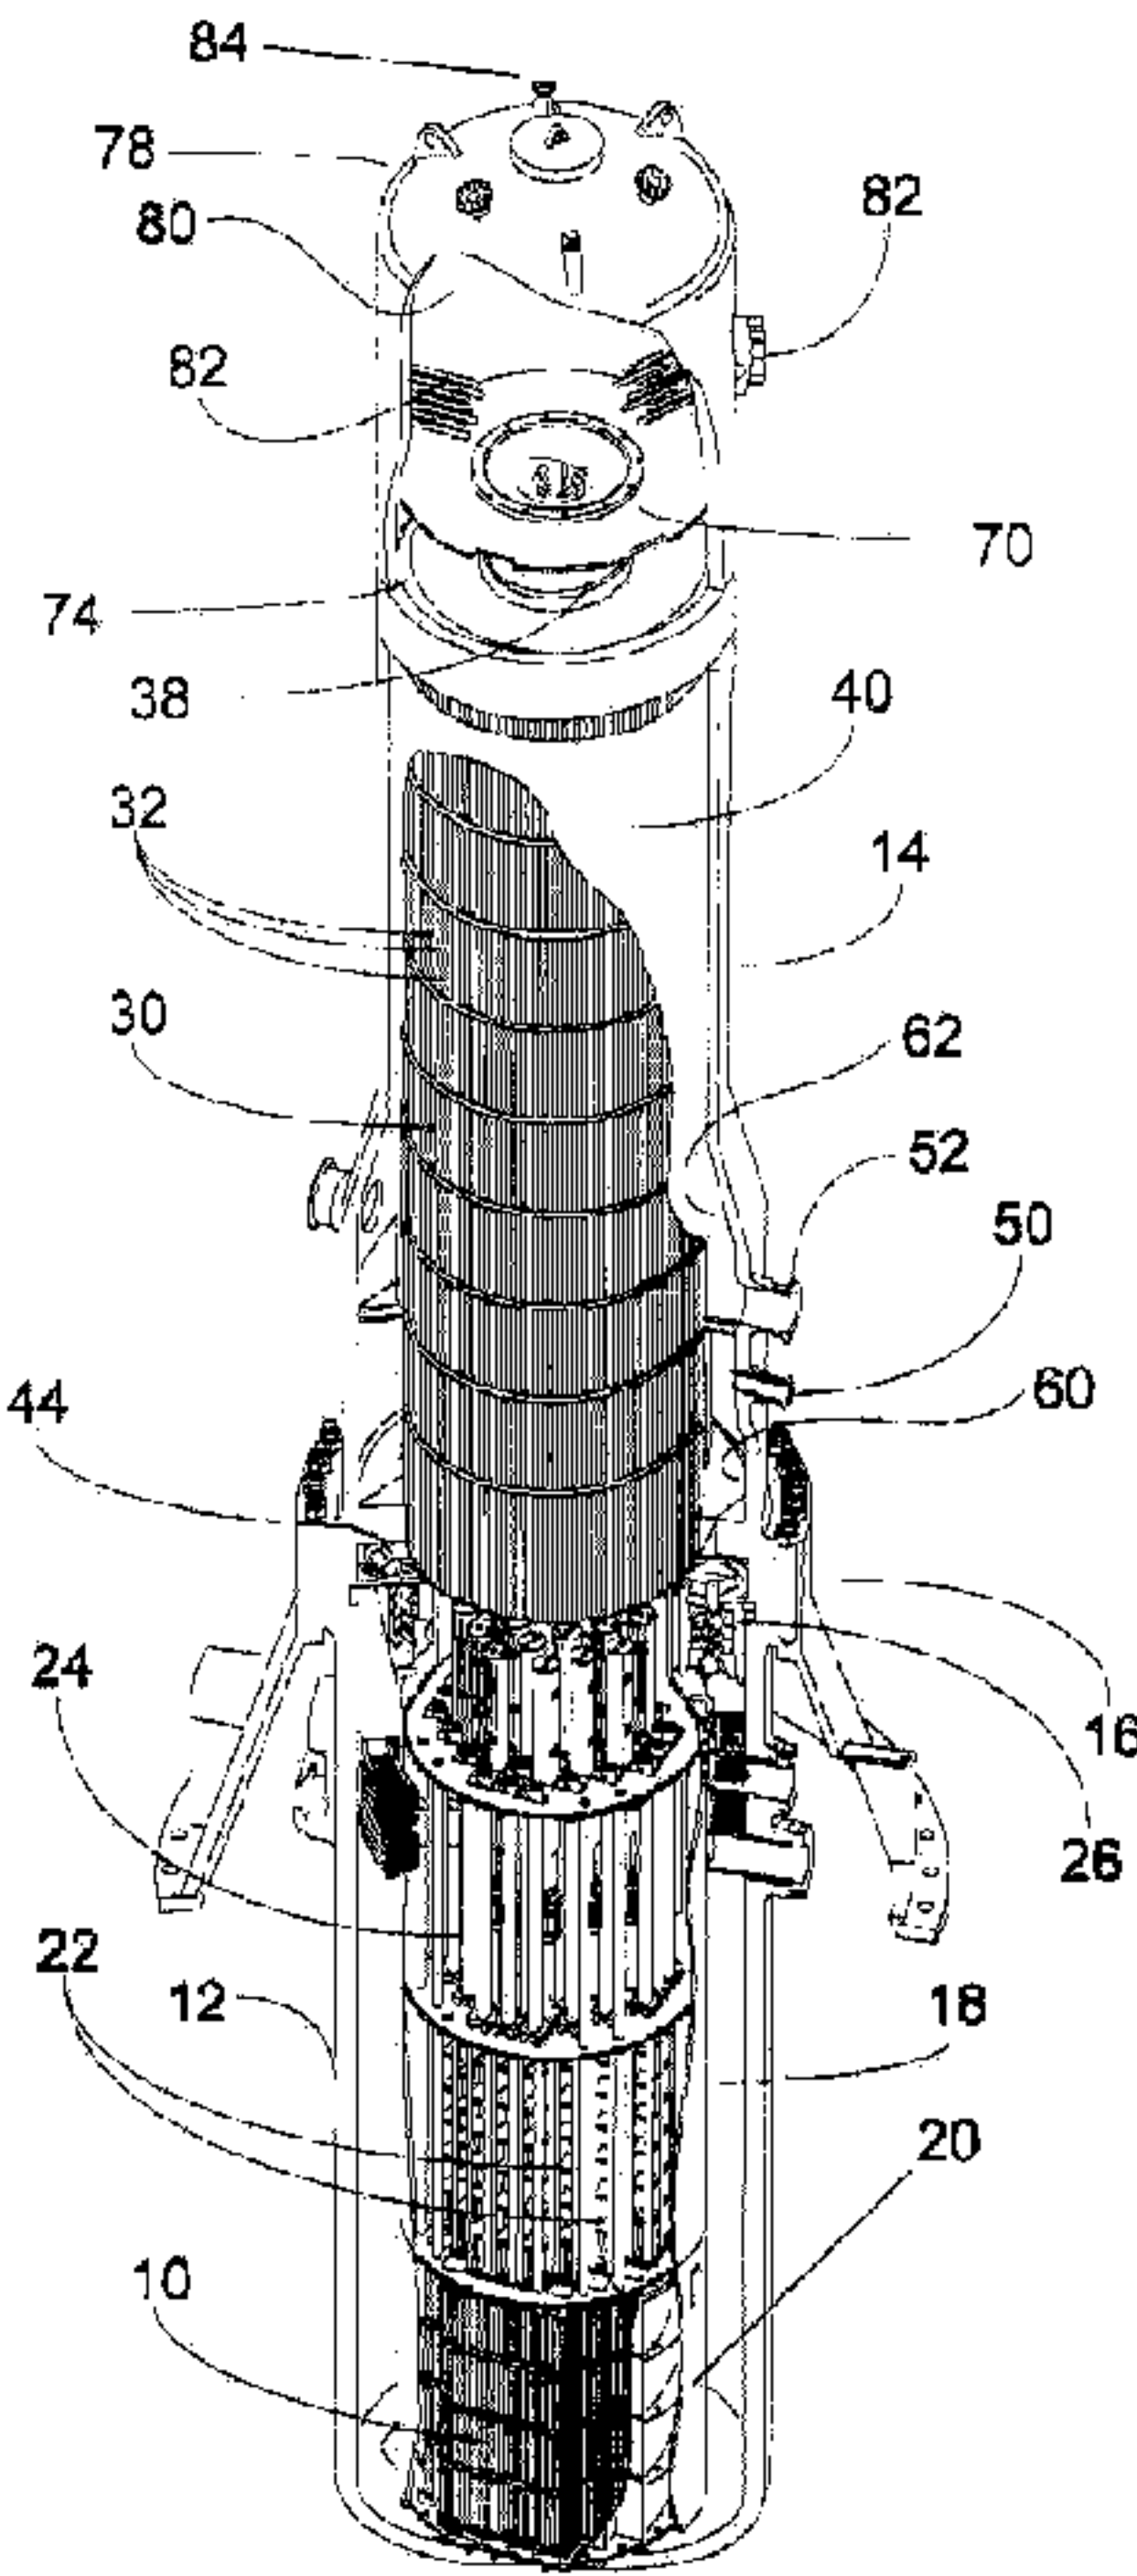

(57) Abrégé/Abstract:

In an illustrative embodiment, a pressurized water nuclear reactor (PWR) includes a pressure vessel (12, 14, 16), a nuclear reactor core (10) disposed in the pressure vessel, and a vertically oriented hollow central riser (36) disposed above the nuclear reactor core inside the pressure vessel. A once-through steam generator (OTSG) (30) disposed in the pressure vessel includes vertical tubes (32) arranged in an annular volume defined by the central riser and the pressure vessel. The OTSG further includes a fluid flow volume surrounding the vertical tubes and having a feedwater inlet (50) and a steam outlet (52). The PWR has an operating state in which feedwater injected into the fluid flow volume at the feedwater inlet is converted to steam by heat emanating from primary coolant flowing inside the tubes of the OTSG, and the steam is discharged from the fluid flow volume at the steam outlet.

(12) INTERNATIONAL APPLICATION PUBLISHED UNDER THE PATENT COOPERATION TREATY (PCT)

(19) World Intellectual Property Organization
International Bureau(43) International Publication Date
12 April 2012 (12.04.2012)(10) International Publication Number
WO 2012/047438 A1(51) International Patent Classification:
G21C 19/28 (2006.01)(21) International Application Number:
PCT/US2011/050741(22) International Filing Date:
8 September 2011 (08.09.2011)

(25) Filing Language: English

(26) Publication Language: English

(30) Priority Data:
12/891,317 27 September 2010 (27.09.2010) US(71) Applicants (for all designated States except US): **BABCOCK & WILCOX NUCLEAR ENERGY, INC.** [US/US]; 800 Main Street, Lynchburg, VA 24504 (US). **BABCOCK & WILCOX CANADA LTD.** [CA/CA]; 581 Coronation Boulevard, Cambridge, Ontario N1R 5V3 (CA). **BABCOCK & WILCOX POWER GENERATION GROUP, INC.** [US/US]; 20 S. Van Buren Avenue, Barberton, Ohio 44203 (US).

(72) Inventors; and

(75) Inventors/Applicants (for US only): **FORTINO, Robert, T.** [US/US]; 5328 Tanage Avenue, NE, Canton, OH 44705 (US). **ALES, Mathew, W.**; 1481 Lake Shore Drive, Forest, VA 24551 (US). **IDVORIAN, Nick** [CA/CA]; 101 Greengable Way, Kitchener, Ontario N2N 3B1 (CA).(74) Agent: **SEYMOUR, Michael, J.**; Babcock & Wilcox Nuclear Energy, Inc., Law Dept - Intellectual Property, 20 South Van Buren Avenue, Barberton, Ohio 44203 (US).

(81) Designated States (unless otherwise indicated, for every kind of national protection available): AE, AG, AL, AM, AO, AT, AU, AZ, BA, BB, BG, BH, BR, BW, BY, BZ, CA, CH, CL, CN, CO, CR, CU, CZ, DE, DK, DM, DO, DZ, EC, EE, EG, ES, FI, GB, GD, GE, GH, GM, GT, HN, HR, HU, ID, IL, IN, IS, JP, KE, KG, KM, KN, KP, KR, KZ, LA, LC, LK, LR, LS, LT, LU, LY, MA, MD, ME, MG, MK, MN, MW, MX, MY, MZ, NA, NG, NI, NO, NZ, OM, PE, PG, PH, PL, PT, QA, RO, RS, RU, RW, SC, SD, SE, SG, SK, SL, SM, ST, SV, SY, TH, TJ,

[Continued on next page]

(54) Title: COMPACT NUCLEAR REACTOR WITH INTEGRAL STEAM GENERATOR

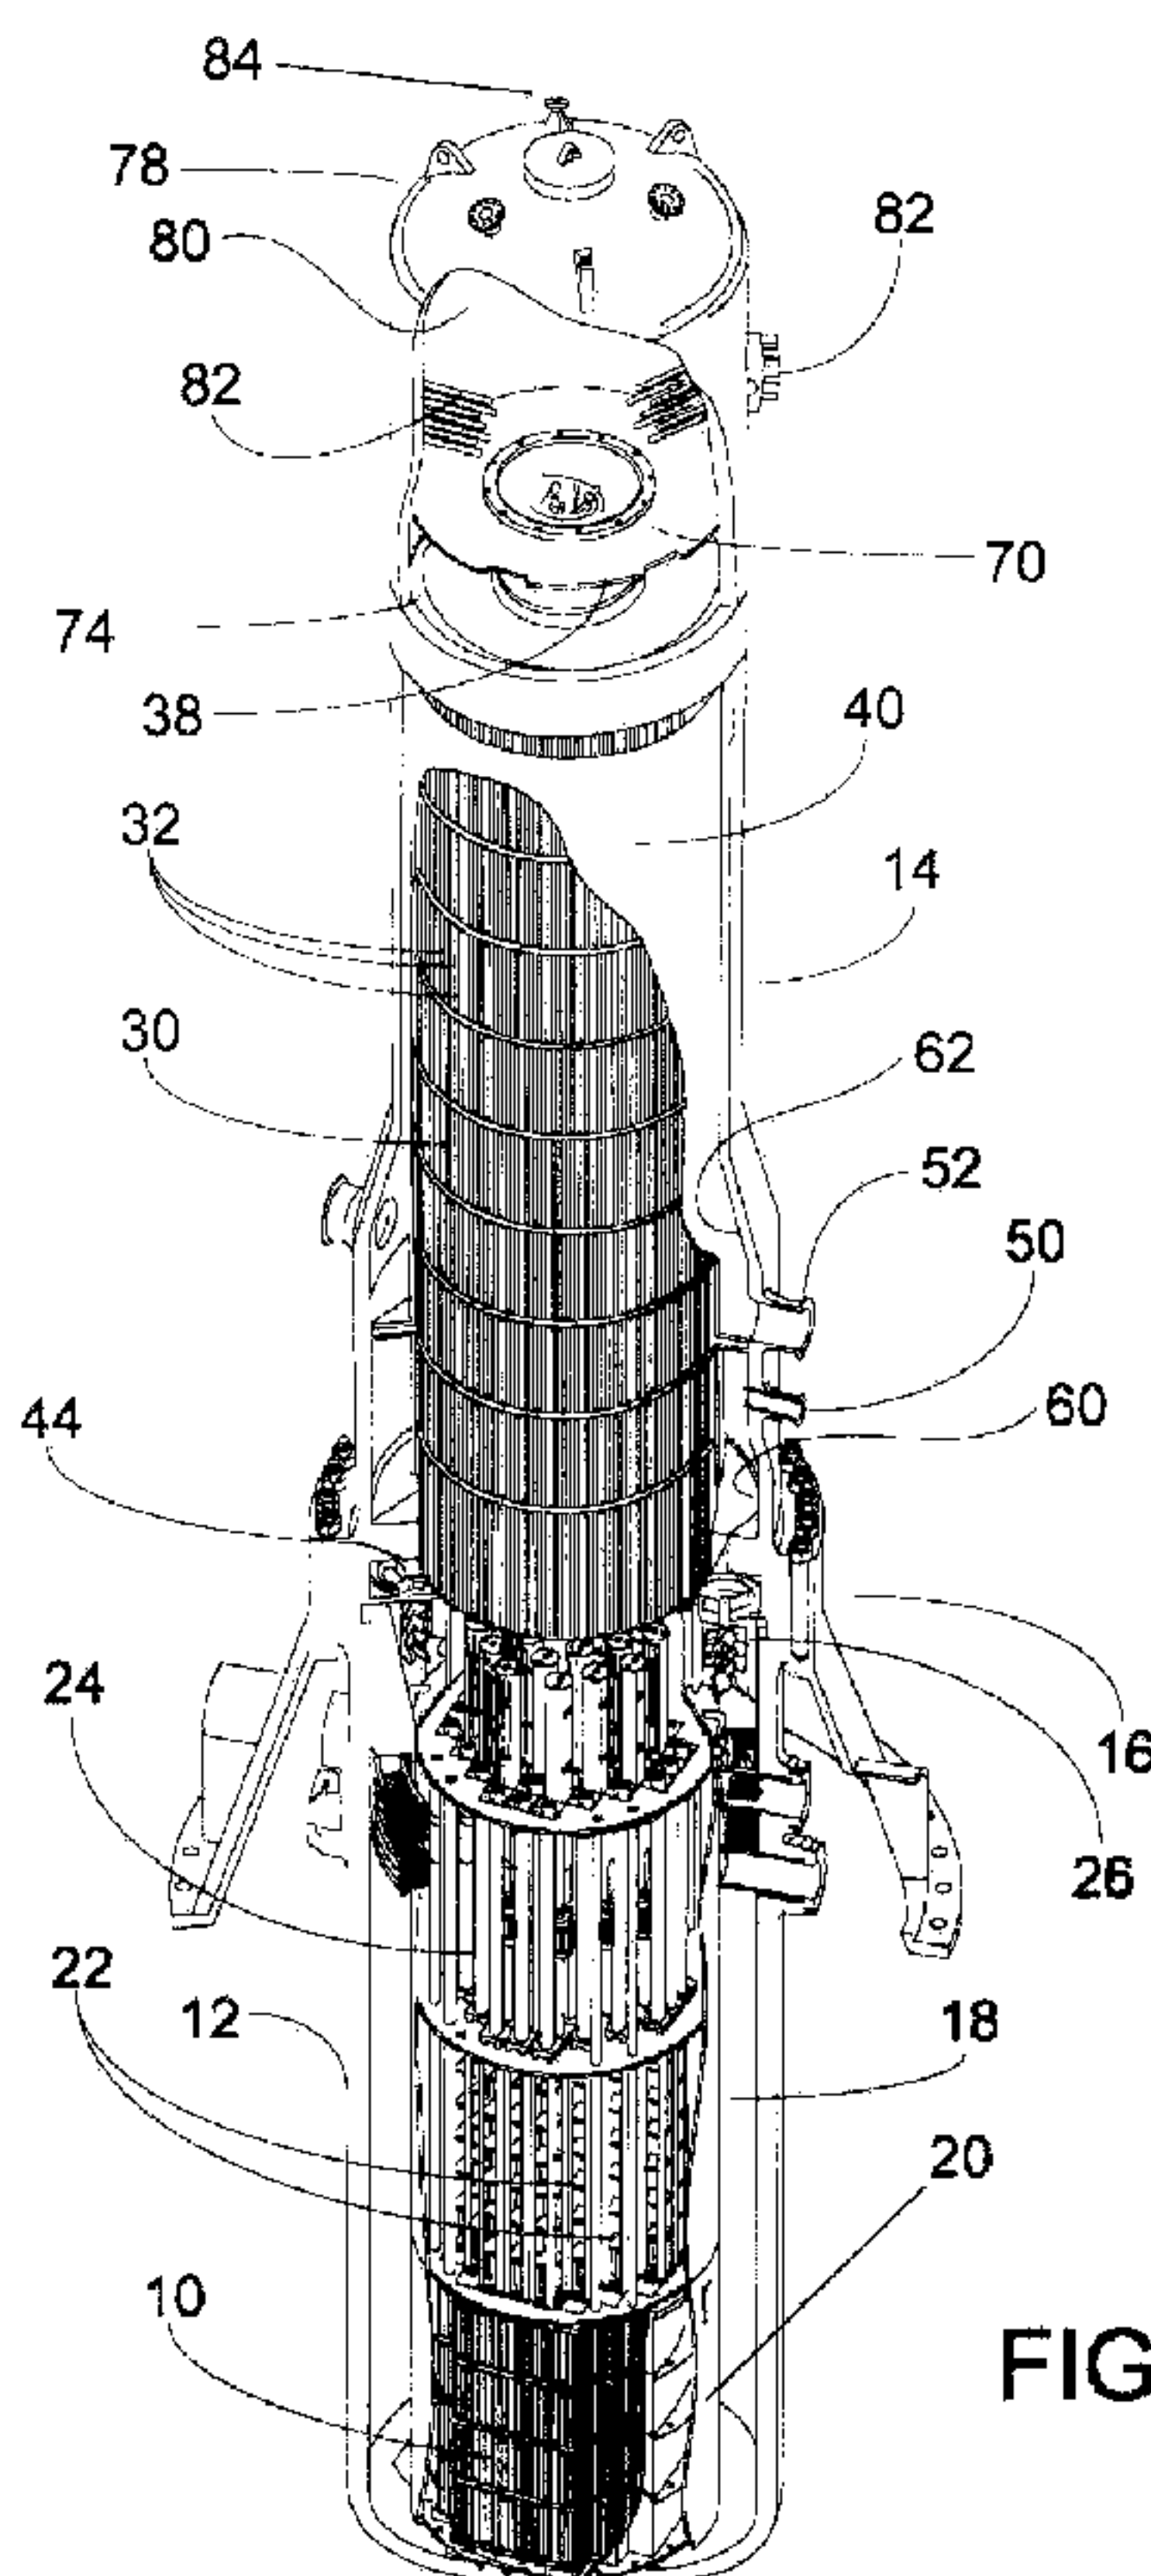


FIG. 1

(57) Abstract: In an illustrative embodiment, a pressurized water nuclear reactor (PWR) includes a pressure vessel (12, 14, 16), a nuclear reactor core (10) disposed in the pressure vessel, and a vertically oriented hollow central riser (36) disposed above the nuclear reactor core inside the pressure vessel. A once-through steam generator (OTSG) (30) disposed in the pressure vessel includes vertical tubes (32) arranged in an annular volume defined by the central riser and the pressure vessel. The OTSG further includes a fluid flow volume surrounding the vertical tubes and having a feedwater inlet (50) and a steam outlet (52). The PWR has an operating state in which feedwater injected into the fluid flow volume at the feedwater inlet is converted to steam by heat emanating from primary coolant flowing inside the tubes of the OTSG, and the steam is discharged from the fluid flow volume at the steam outlet.

WO 2012/047438 A1

TM, TN, TR, TT, TZ, UA, UG, US, UZ, VC, VN, ZA, ZM, ZW.

(84) **Designated States** *(unless otherwise indicated, for every kind of regional protection available):* ARIPO (BW, GH, GM, KE, LR, LS, MW, MZ, NA, SD, SL, SZ, TZ, UG, ZM, ZW), Eurasian (AM, AZ, BY, KG, KZ, MD, RU, TJ, TM), European (AL, AT, BE, BG, CH, CY, CZ, DE, DK, EE, ES, FI, FR, GB, GR, HR, HU, IE, IS, IT, LT, LU, LV, MC, MK, MT, NL, NO, PL, PT, RO, RS, SE, SI, SK, SM, TR), OAPI (BF, BJ, CF, CG, CI, CM, GA, GN, GQ, GW, ML, MR, NE, SN, TD, TG).

Published:

— *with international search report (Art. 21(3))*

COMPACT NUCLEAR REACTOR WITH INTEGRAL STEAM GENERATOR

BACKGROUND

[0001] The following relates to the nuclear reactor arts, steam generator and steam generation arts, electrical power generation arts, and related arts.

[0002] Compact nuclear reactors are known for maritime and land-based power generation applications and for other applications. In some such nuclear reactors, an integral steam generator is located inside the reactor pressure vessel, which has advantages such as compactness, reduced likelihood of a severe loss of coolant accident (LOCA) event due to the reduced number and/or size of pressure vessel penetrations, retention of the radioactive primary coolant entirely within the reactor pressure vessel, and so forth.

[0003] Disclosed herein are further improvements that provide reduced cost, simplified manufacturing, and other benefits that will become apparent to the skilled artisan upon reading the following.

BRIEF SUMMARY

[0004] In one aspect of the disclosure, an apparatus comprises: a generally cylindrical pressure vessel defining a cylinder axis; a nuclear reactor core disposed in the generally cylindrical pressure vessel; a central riser disposed coaxially inside the generally cylindrical pressure vessel, the central riser being hollow and having a bottom end proximate to the nuclear reactor core to receive primary coolant heated by the nuclear reactor core, the central riser having a top end distal from the nuclear reactor core; and a once-through steam generator (OTSG) comprising tubes arranged parallel with the cylinder axis in an annular volume defined between the central riser and the generally cylindrical pressure vessel, primary coolant discharged from the top end of the central riser flowing inside the tubes toward the nuclear reactor core, the OTSG further including a fluid flow volume having a feedwater inlet and a steam outlet wherein fluid injected into the fluid flow volume at the feedwater inlet and discharged from the fluid

CASE 7326

- 2 -

flow volume at the steam outlet flows outside the tubes in a direction generally opposite flow of primary coolant inside the tubes.

[0005] In another aspect of the disclosure, an apparatus comprises: a pressurized water nuclear reactor (PWR) including a pressure vessel, a nuclear reactor core disposed in the pressure vessel, and a vertically oriented hollow central riser disposed above the nuclear reactor core inside the pressure vessel; and a once-through steam generator (OTSG) disposed in the pressure vessel of the PWR, the OTSG including vertical tubes arranged in at least one of (i) the central riser and (ii) an annular volume defined by the central riser and the pressure vessel, the OTSG further including a fluid flow volume surrounding the vertical tubes; wherein the PWR has an operating state in which feedwater injected into the fluid flow volume at a feedwater inlet is converted to steam by heat emanating from primary coolant flowing inside the tubes of the OTSG, and the steam is discharged from the fluid flow volume at a steam outlet.

[0006] In another aspect of the disclosure, a method comprises: constructing a once-through steam generator (OTSG), the constructing including mounting tubes of the OTSG under axial tension; and operating the OTSG at an elevated temperature at which the tubes are under axial compression.

BRIEF DESCRIPTION OF THE DRAWINGS

[0007] The invention may take form in various components and arrangements of components, and in various process operations and arrangements of process operations. The drawings are only for purposes of illustrating preferred embodiments and are not to be construed as limiting the invention.

[0008] FIGURE 1 diagrammatically shows a perspective partial-sectional view a nuclear reactor including an integral steam generator as disclosed herein.

[0009] FIGURE 2 diagrammatically shows a side sectional view of the upper vessel section of the nuclear reactor of FIGURE 1 with the tubes of the steam generator omitted to emphasize the downcomer volume.

[0010] FIGURE 3 diagrammatically shows Section D-D indicated in FIGURE 2.

- 3 -

[0011] FIGURE 4 diagrammatically shows flow of the primary and secondary coolant fluids in the integral steam generator of FIGURE 1.

[0012] FIGURE 5 diagrammatically shows an illustrative process for manufacturing and deploying the integral steam generator of FIGURE 1.

[0013] FIGURE 6 diagrammatically illustrates the upper pressure vessel portion of a variant embodiment.

DETAILED DESCRIPTION OF THE PREFERRED EMBODIMENTS

[0014] With reference to FIGURE 1, a perspective partial-sectional view an illustrative nuclear reactor is shown. A nuclear reactor core **10** is disposed inside a generally cylindrical pressure vessel. In the illustrative embodiment the pressure vessel includes a lower pressure vessel portion or section **12** housing the nuclear reactor core **10**, an upper vessel portion or section **14**, and mid-flange region **16**. This is merely an illustrative configuration, and the pressure vessel can in general be constructed of as few as a single portion or section, or two portions or sections, three portions or sections (as illustrated), four portions or sections (for example including a fourth upper "cap" portion or section separate from the upper portion or section), or so forth. The pressure vessel **12**, **14**, **16** contains primary coolant, which in the illustrative case of a light water reactor is water (H_2O), optionally including other additives for reactivity control, such as a boron compound (e.g., "borated water"). In other contemplated embodiments the primary coolant may be another fluid, such as heavy water (D_2O). The primary coolant fills most or all of the volume of the pressure vessel **12**, **14**, **16**. A reactor inlet annulus **18** surrounds the reactor core **10** to enable primary coolant to flow to the reactor core **10**. Optional shielding or shrouding **20** disposed in the reactor inlet annulus **18** provides additional radiation shielding from the reactor core **10**. The illustrative reactor is a pressurized water reactor (PWR) in which the primary coolant is sub-cooled light water maintained under an elevated pressure at a temperature below the boiling point (saturation temperature) at the operating pressure; however, a boiling water reactor (BWR) in which the primary coolant operates at the saturation temperature at an

CASE 7326

- 4 -

elevated pressure, or another reactor configuration such as a configuration employing heavy water, is also contemplated.

[0015] Reactor control is provided by upper internal neutron-absorbing control rods **22** and a control rod drive mechanism (CRDM) **24** that is configured to controllably insert and withdraw the control rods into and out of the nuclear reactor core **10**. Diagrammatic FIGURE 1 only identifies two illustrative control rods **22**; however, in some embodiments the control rods may number in the dozens or hundreds, with insertion points spatially distributed across the reactor core area to collectively provide uniform reaction control. The CRDM **24** may be divided into multiple units (details not illustrated), each controlling one or more control rods. For example, a plurality of control rods may be operatively coupled with a single CRDM unit via a connecting rod/spider assembly or other suitable coupling (details not illustrated). In some illustrative embodiments, a CRDM unit includes a motor driving a lead screw operatively connected with control rods via a connecting rod/spider assembly, such that motor operation causes linear translation of the assembly including the lead screw, connecting rod, spider, and control rods. Such CRDM units provide fine control of the precise insertion of the control rods into the reactor core **10** via the lead screw, and hence are suitable for "gray rod" operation providing fine incremental reaction control. In some illustrative embodiments, a CRDM unit may comprise a lifting piston that lifts an assembly including the connecting rod, spider, and control rods out of the reactor core **10**, and during a SCRAM removes the lifting force to allow the control rods to fall into the reactor core **10** by gravity and optional hydraulic pressure force(s). Such CRDM units are suitably used for "shutdown rod" operation, as part of the reactor safety system. In yet other illustrative embodiments, the gray rod and shutdown rod functionality is integrated into a single CRDM unit, for example using a separable ball nut coupling with a lead screw such that the CRDM unit normally provides gray rod functionality but during a SCRAM the ball nut separates to release the control rods into the reactor core **10**. Some further illustrative embodiments of CRDM units are set forth in application serial number 12/722,662 titled "Control Rod Drive Mechanism for Nuclear Reactor" filed March 12, 2010 and related application serial number 12/722,696 titled

"Control Rod Drive Mechanism For Nuclear Reactor" filed March 12, 2010 are both useful references. These applications disclose CRDM units providing gray/shutdown rod functionality, in which the connection between the motor and the lead screw is not releasable, but rather a separate latch is provided between the lead screw and the connecting rod in order to effectuate SCRAM. In these alternative configurations the lead screw does not SCRAM, but rather only the unlatched connecting rod and control rod SCRAM together toward the reactor core while the lead screw remains engaged with the motor.

[0016] The diagrammatically illustrated CRDM **24** may include one or more CRDM units including various combinations of CRDM units of the described types or other CRDM unit configurations providing gray and/or shutdown rod functionality. The illustrative CRDM **24** is an internal CRDM in which all mechanical and electromagnetomotive components, including the motor, lead screw, connecting rod, and so forth are disposed inside the pressure vessel **12**, **14**, **16**, with only electrical wires, hydraulic lines, or other power or control leads connecting with these components. In other contemplated embodiments, the CRDM may employ external CRDM units in which the motor is mounted outside the pressure vessel, for example above or below.

[0017] With continuing reference to FIGURE 1, the primary coolant may be circulated naturally, due to natural convection set up by heating due of the primary coolant in the vicinity of the operating nuclear reactor core **10**. Additionally or alternatively, the primary coolant circulation may be driven or assisted by optional reactor coolant pumps **26**. The diagrammatically illustrated coolant pumps **26** are internal pumps having rotor and stator elements both located inside the pressure vessel **12**, **14**, **16**. Alternatively, an external pump can be employed, for example having an external stator and a rotor coupled with the pressure vessel volume via a suitable conduit or tube, or the circulation pumps may be omitted entirely, as per natural convection reactor embodiments.

[0018] The nuclear reactor is further described with continuing reference to FIGURE 1 and with further reference to FIGURES 2 and 3. FIGURE 2 illustrates a side sectional view of the upper vessel **14** and selected components therein, while FIGURE 3 shows

CASE 7326

- 6 -

Section D-D indicated in FIGURE 2. As seen in FIGURE 1, the illustrative nuclear reactor is an integral nuclear reactor, by which it is meant that a steam generator **30** is integrated inside the pressure vessel **12, 14, 16**. In the illustrative example, the pressure vessel **12, 14, 16** is generally cylindrical and defines a cylinder axis **A** (labeled only in FIGURE 2). The steam generator **30** is a straight-tube once-through steam generator (OTSG) **30** disposed in the upper vessel **14**. The OTSG **30** includes straight tubes **32** arranged vertically in parallel with the cylinder axis **A** in an annular "downcomer" volume **34** defined between: (i) a hollow central riser **36** disposed coaxially in the upper portion **14** of the generally cylindrical pressure vessel, and (ii) the upper portion **14** of the generally cylindrical pressure vessel. The hollow central riser **36** defines a central riser flow path **38** inside the central riser **36**. The OTSG **30** also includes an outer shroud **40** surrounding the tubes **32** disposed in the downcomer volume **34**, and an inner shroud **42** disposed between the central riser **36** and the tubes **32**. (Note that in FIGURES 2 and 3, the OTSG shrouds **40, 42** are shown and labeled, but the tubes **32** are omitted so as to more clearly show the annular downcomer volume **34** in FIGURES 2 and 3).

[0019] The primary coolant flow path in the illustrative reactor is as follows. The central riser **36** has a bottom end proximate to the nuclear reactor core **10** to receive primary coolant heated by the nuclear reactor core **10**, and a top end distal from the nuclear reactor core **10**. Primary coolant heated by the nuclear reactor core **10** flows upward through the central riser flow path **38** inside the central riser **36**. At the top of the central riser **36** the primary coolant flow turns 180° (that is, from flowing generally upward to flowing generally downward). The primary coolant enters the tubes **32** of the OTSG **30** and flows downward through the tubes **32**. The primary coolant is discharged from the lower ends of the tubes **32** into a primary outlet plenum **44**, which passes the primary coolant flow back to the reactor inlet annulus **18** and back to the reactor core **10**.

[0020] With continuing reference to FIGURES 1-3 and with further reference to FIGURE 4, the outer and inner shrouds **40, 42** of the OTSG **30** define a fluid flow volume of the OTSG **30** between the shrouds **40, 42**. This fluid flow volume surrounds the tubes **32**, and has a feedwater inlet **50** and a steam outlet **52**. Note that although a single inlet **50** and single outlet **52** are illustrated, in other embodiments there may be

multiple inlets and/or multiple outlets, to provide redundancy and/or improved radial symmetry in the plane transverse to the axis **A**. Fluid (e.g., feedwater) is injected into the fluid flow volume at the feedwater inlet **50** and is discharged from the fluid flow volume (e.g., as steam) at the steam outlet **52**. While in the fluid flow volume, the fluid flows outside the tubes **32** of the OTSG **30** in a generally upward direction generally opposite flow of primary coolant inside the tubes **32**.

[0021] With continuing reference to FIGURES 1-3 and with further reference to FIGURE 4, in the operating state of the illustrative PWR, feedwater injected into the fluid flow volume of the OTSG **30** at the feedwater inlet **50** is converted to steam by heat emanating from primary coolant flowing inside the tubes **32** of the OTSG **30**, and the steam is discharged from the fluid flow volume at a steam outlet **52**. This is diagrammatically shown in FIGURE 4, which shows portions of three illustrative tubes **32** carrying downward primary coolant flow (F_{primary}). The fluid flow volume of the OTSG **30** is diagrammatically shown in FIGURE 4 by indication of portions of the outer and inner shrouds **40**, **42** that define the fluid flow volume of the OTSG **30**. To facilitate correlation with FIGURES 1-3, the axial direction corresponding to the axis **A** of the generally cylindrical pressure vessel is also indicated in FIGURE 4. The fluid flowing in the fluid flow volume of the OTSG **30** is sometimes referred to herein as "secondary" coolant, and the generally upward "counter" flow of the secondary coolant in the fluid flow volume of the OTSG **30** is indicated as secondary coolant flow ($F_{\text{secondary}}$) in diagrammatic FIGURE 4. During the upward flow, heat emanating from the primary coolant flow F_{primary} transfers to the secondary coolant flow $F_{\text{secondary}}$, causing the secondary coolant to heat until it is converted to secondary coolant flow having the form of steam flow ($S_{\text{secondary}}$). (The steam flow $S_{\text{secondary}}$ is also diagrammatically indicated in FIGURE 4 by using dotted arrows). Although not illustrated, the steam flow $S_{\text{secondary}}$ exiting the steam outlet **52** suitably serves as working steam that flows to and operates a turbine or other steam-operated device.

[0022] In the illustrative embodiment, the fluid flow volume of the OTSG **30** is defined by the outer and inner shrouds **40**, **42** that are separate from the central riser **36** and the upper portion **14** of the pressure vessel. Advantageously, this enables the OTSG **30** to

CASE 7326

- 8 -

be constructed as a unit including the tubes **32** and surrounding shrouds **40**, **42**, and to then be installed as a unit in the upper portion **14** of the pressure vessel. However, it is also contemplated for the inner shroud to be embodied as an outer surface of the central riser **36**, and/or for the outer shroud to be embodied as an inner surface of the upper portion **14** of the pressure vessel.

[0023] In embodiments which include the outer shroud **40** which is separate from the upper pressure vessel portion **14** (as in the illustrative embodiment), an annular space between the outer shroud **40** and the pressure vessel **14** may optionally be employed for a useful purpose. In the illustrative example, the annular space between the outer shroud **40** and the pressure vessel **14** defines a feedwater annulus **60** between an outer shroud **40** of the OTSG **30** and the pressure vessel (upper portion **14**) buffers feedwater injected into the fluid flow volume at the feedwater inlet **50**. Similarly, a steam annulus **62** between the outer shroud **40** of the OTSG **30** and the pressure vessel (upper portion **14**) buffers steam discharged from the fluid flow volume at the steam outlet **52**.

[0024] In some embodiments, the feedwater annulus and the steam annulus have equal inner diameters and equal outer diameters. In such embodiments the outer shroud and the relevant pressure vessel portion have constant diameters over the axial length of the annuluses. In the illustrative embodiment, however, the feedwater annulus **60** has a larger outer diameter than the steam annulus **62**. This is obtained by increasing the diameter of the upper pressure vessel portion **14** surrounding the feedwater annulus **60** as compared with the diameter of the upper pressure vessel portion **14** surrounding the steam annulus **62**. In the illustrative embodiment the diameter of the outer shroud **40** remains constant over the axial length of the annuluses **60**, **62**. This configuration allows a larger local inventory of water so that the time available for steam generator boil-off is relatively longer in the event of a loss-of-feedwater (LOFW) accident.

[0025] With reference to FIGURES 1 and 2, as already mentioned the flow circuit for the primary coolant includes a 180° flow reversal as the primary coolant discharges from the central riser flow path **38** inside the central riser **36** and flows into the top ends of the

CASE 7326

- 9 -

tubes **32** of the OTSG **30**. Optionally, a flow diverter **70** is provided to facilitate this flow reversal. The illustrative flow diverter **70** is disposed in the generally cylindrical pressure vessel **14** and has a flow diverting surface **72** facing the top end of the central riser that is sloped or (as illustrated) curved to redirect primary coolant discharged from the top end of the central riser **36** toward inlets of the tubes **32** of the OTSG **30**. The flow diverter **70** is spaced apart from the top of the central riser **36** by a primary inlet plenum **74**.

[0026] As previously mentioned, the illustrative nuclear reactor is a pressurized water reactor (PWR) in which the primary coolant is sub-cooled and maintained under positive pressure. In some embodiments, the pressurization of the primary coolant is provided by an external pressurizer. However, in the illustrative embodiment the pressurization of the primary coolant is provided by an internal pressurizer. In this configuration, the flow diverter **72** also serves as a part of the divider plate **70** spaced apart from the top end of the central riser **36** by the aforementioned primary inlet plenum **74**. The generally cylindrical pressure vessel **12**, **14**, **16** (and, more precisely, the upper pressure vessel portion **14**) includes a sealing top portion **78** cooperating with the divider plate **70** to define an integral pressurizer volume **80** that is separated by the divider plate **70** from the remaining interior volume of the generally cylindrical pressure vessel **12**, **14**, **16**. In the operating state of the PWR, the integral pressurizer volume **80** contains fluid (saturated primary coolant liquid and steam) at a temperature that is greater than the temperature of the primary coolant disposed in the remaining interior volume of the generally cylindrical pressure vessel **12**, **14**, **16**. In this embodiment, the saturation temperature is maintained by pressurizer heaters **82** (shown only in FIGURE 1), while pressurizer spray nozzles **84** provide a mechanism for reducing the pressure by condensing some of the steam vapor in volume **80**. The divider plate **70** suitably includes openings (not shown) providing hydraulic fluid communication between the integral pressurizer volume **80** and the remaining interior volume of the generally cylindrical pressure vessel **12**, **14**, **16**. This hydraulic fluid communication establishes the pressure level in the remaining interior volume of the generally cylindrical pressure vessel **12**, **14**, **16**. Since there is a temperature difference across divider plate **70**

- 10 -

between the pressurizer volume **80** and primary inlet plenum **74**, the remaining primary fluid in the interior volume of the generally cylindrical pressure vessel **12**, **14**, **16** is maintained at sub-cooled liquid conditions at a temperature approximately 11°C (20°F) less than the saturation temperature in pressurizer volume **80**. This level of sub-cooled liquid prevents the primary fluid in reactor core **10** from experiencing saturated bulk boiling which has a significantly higher vapor volume fraction than sub-cooled nucleate boiling typically present in pressurized water nuclear reactor cores. This prevention of bulk boiling in a PWR core is made possible by the pressurizer (**80**, **82**, **84**, **78**, and **70**) and is beneficial for the integrity of the nuclear reactor fuel rods by minimizing the probability of departure from nucleate boiling (DNB) which increases the fuel pellet and fuel cladding temperatures.

[0027] Having set forth an illustrative integral PWR as an illustrative example in FIGURES 1-4, some further additional aspects and variants are set forth next.

[0028] In one illustrative quantitative example, the reactor core **10** in the operating state operates at 425 MW thermal. The hot reactor coolant water flows in a circuit, called the hot leg, which includes the space above the core flowing around the CRDM's **24**. The hot leg extends up the central riser **36** to the inlet plenum **74**, wherein the reactor coolant subsequently enters into the tubes **32** of the straight-tube OTSG **30** via the central riser flow path **38**. The straight-tube OTSG **30** encircles the central riser **36** and includes the annular array of steam generator tubes **32** disposed in the annulus between the central riser **36** and the outer shroud **40** of the OTSG **30**. An advantage of this configuration is that the central riser **36** is a high pressure component separating the high pressure reactor primary coolant at 1900 psia (in this illustrative quantitative embodiment) from the lower pressure secondary coolant which in this example is at 825 psia. The use of an internal pressure part via the central riser **36** yields a compact and efficient design since the primary pressure boundary is internal to the steam generator **30** and serves the dual use as a riser defining the flow path **38** for the hot leg. One design consideration is that there is differential thermal expansion between central riser **36**, the tubes **32**, and the upper vessel **14**. The differential expansion is further

complicated by the feedwater annulus **60** containing feedwater at a substantially lower temperature than the steam in the steam annulus **62**, which results in a range of temperatures in the upper vessel **14**, causing additional thermal stress.

[0029] One approach for mitigating the effect of these differential stresses is to balance the stresses over the operational and non-operational range of conditions of the steam generator. In one illustrative example, the tubes **32** are made of an austenitic nickel-chromium-based alloy, such as Inconel™ 690, and the tubes **32** are secured in a support made of steel. The support includes an upper tubesheet **90** and a lower tubesheet **92** (diagrammatically indicated in FIGURE 2) In general, the austenitic nickel-chromium-based alloy will have a higher coefficient of thermal expansion than the steel. The balancing of the stresses over the operational and non-operational range of conditions is suitably accomplished by pre-stressing the Inconel™ 690 steam generator tubes **32** by expanding the tubes **32** into mating holes of the upper and lower tubesheets **90**, **92**. This expansion draws the tubes into tension via the Poisson effect. In general, the concept is that in the operating state of the nuclear reactor the primary coolant flowing in the tubes **32** of the OTSG **30** is at a relatively high temperature, for example a temperature of at least 500°C, and the tubes **32** of the OTSG **30** are designed to be under axial compression in this operating state at high temperature. On the other hand, the tubes **32** of the OTSG **30** are designed to be under axial tension in a non-operating state of the nuclear reactor in which the tubes **32** are at a substantially lower temperature such as room temperature, for example suitably quantified as a temperature of less than 100°C. The balancing of the stresses over the operational and non-operational range is achieved by pre-stressing the tubes **32** to be in axial tension at room temperature (e.g., at less than 100°C in some embodiments), so that the differential thermal expansion between the Inconel™ 690 steam generator tubes **32** and the steel of the central riser **36** and vessel **14** causes the tubes to transition from axial tension to axial compression as the temperature is raised to the operating temperature, e.g. at least 500°C in some embodiments. These differential thermal stresses among components **14**, **32**, and **36** are set up by common connection of the components at the tubeheet supports **90**, **92** is also optionally reduced by having the feedwater nozzle **50**

- 12 -

positioned low in the pressure vessel leaving a longer steam outlet annulus **62** to blanket the vessel with high temperature outlet steam, and by reducing axial length of the feedwater annulus **60** by employing a larger radius for the feedwater annulus **60**.

[0030] With brief reference to FIGURE 5, a manufacturing sequence to prestress the tubes **32** to place them into axial tension is further described. In an operation **100**, the tubes **32** are mounted in the tubesheets **90**, **92** of the OTSG frame or support by expanding the tube ends to secure them to the tubesheets **90**, **92**. A consequential operation **102** is that this imparts axial tension to the tubes **32**. In an operation **104**, the OTSG **30** including the prestressed tubes **32** is installed in the pressure vessel **12**, **14**, **16** to construct the integral PWR of FIGURES 1-4. In an operation **106**, the integral PWR is started up and brought to its operating state which has the effect of raising the temperature the primary coolant flowing in the tubes **32** of the OTSG **30** to an operating temperature of (in the illustrative example) at least 500°C. A consequential operation **108** is that this imparts axial compression to the tubes **32** due to the relatively higher coefficient of thermal expansion of the austenitic nickel-chromium-based alloy of the tubes **32** as compared with the steel of the central riser **36** and vessel **14** connected via tubesheets **90**, **92**.

[0031] In some embodiments, in the operating state the OTSG **30** defines an integral economizer that heats feedwater injected into the fluid flow volume at the feedwater inlet **50** to a temperature at or below a boiling point of the feedwater. In such embodiments, the straight-tube OTSG **30** is an integral economizer (IEOTSG) design since the feedwater is heated by flow outside of the tubes **32**. Feedwater enters through the feedwater nozzles **50**, distributes throughout the feedwater annulus **60**, and enters the tubes **32** via a gap or other passage (not shown) between the bundle shroud **40** and the lower tubesheet **92**. In the operating mode, feedwater flows outside of the tubes **32** and there is forced convection heat transfer from the primary coolant flow to the feedwater flow followed by subcooled and saturated boiling to form the steam flow. Once the critical heat flux is reached at approximately 95% steam quality, the steam goes through a transition to stable film boiling followed by dryout at 100% steam quality. Thereafter in the tube bundle, the forced convection to steam raises the temperature to

CASE 7326

- 13 -

superheated conditions at which the steam exits the steam generator via the steam outlet annulus **62** and the steam outlet nozzle **52**. The superheated steam does not require moisture separators before the steam is delivered to the steam turbine (although it is contemplated to include moisture separators in some embodiments).

[0032] Some further aspects of the integral pressurizer are next described. The pressurizer controls the pressure of the primary coolant via the pressurizer heaters **82** and the pressurizer spray nozzles **84**. To increase system pressure, the heaters **82** are turned on by a reactor control system (not shown). To decrease pressure, the spray nozzles **84** inject cold leg water from the top of the reactor inlet annulus **18** on the discharge side of the reactor coolant pumps **26** via a small external line (not shown). The pressurizer volume **80** is formed by a divider plate **70** which separates the space between the primary inlet plenum **74** and the pressurizer volume **80**. The divider plate **70** optionally also serves as a flow diverter by including a perforated cylinder **124** (Fig. 6, top of divider plate not shown) or a cone shaped flow diverter surface **72** (Fig. 2) or other curved or slanted surface which aids in the turning of the flow in the primary coolant in the inlet plenum **74** before it enters the upper ends of the tubes **32** of the OTSG **30** setting up downward flow inside the tubes **30**. The illustrative pressurizer including the pressurizer volume **80** and pressure control structures **82**, **84** advantageously is a fully integral pressurizer (that is, is part of the pressure vessel **12**, **14**, **16**) and advantageously has no pass-throughs for external CRDM's or other components.

[0033] The central riser **36** forms a path **38** for the primary coolant flow leaving the reactor core **10** to reach the primary inlet plenum **74** of the steam generator **30**. In this embodiment there is no horizontal run of piping for this purpose. As a result, if the reactor is operated in a natural circulation mode with the reactor coolant pumps **26** turned off (as may occur during a malfunction or loss of electrical power causing the pumps **26** to stop operating), the hot rising primary coolant is only impeded by the upper internals (e.g., the CRDM's **24**). This flow resistance is not large compared to the flow resistance of the core **10** and the steam generator tubes **32** because the flow area is

relatively large. The flow resistance of the central riser **36** is also a relatively small percentage of the total because of the large diameter of the path **38**.

[0034] In some existing nuclear steam supply systems, after a loss of coolant accident (LOCA) steam and non-condensable gases can collect at the high points of the reactor coolant pipes, and can inhibit the natural circulation loop between the reactor core and the steam generators. Advantageously, the straight-tube OTSG **30** with integral pressurizer volume **80** disclosed herein automatically removes non-condensable gases from the primary coolant circulation loop since there is only one high point at the top of the pressurizer volume **80**. Buoyancy causes the non-condensable gases and vapor to go to the top of the pressurizer volume **80**, where these gases and vapor do not interfere with the natural circulation loop.

[0035] Another advantage of the disclosed straight-tube OTSG **30** is that it can optionally operate in multiple modes to remove decay heat from the reactor core **10**. Starting with the normal operating state, if the reactor coolant pumps **26** stop operating, then the primary coolant water continues to circulate, albeit now via natural circulation, through the core **10** and through the steam generator tubes **32**. As long as there is feedwater supplied to the inlet **50** of the steam generator **30**, there is a large tube surface area to remove radioactive fission product heat from the core **10**. If the primary coolant level falls below the level of the primary inlet plenum **74** during a LOCA, then the straight-tube OTSG **30** can operate as a condenser. In this mode, steam from boiling water in the reactor core **10** rises to fill the primary inlet plenum **74** and the pressurizer volume **80**. The lower temperature water and steam on the secondary side (that is, in the fluid flow volume defined outside the tubes **32** by the shrouds **40**, **42**) causes condensation inside the steam generator tubes **30**. By gravity alone, the condensate flows out of the steam generator tubes **32** into the primary outlet plenum **44** where it is returned to the core **10**.

[0036] In the straight-tube OTSG **30**, the primary coolant pressure is inside the tubes **32**. The primary coolant is at a substantially higher pressure than the secondary coolant flowing through the fluid flow volume defined outside the tubes **32** by the shrouds **40**, **42**. In some embodiments, in the operating state of the nuclear reactor the primary

CASE 7326

- 15 -

coolant flowing inside the tubes **32** is at a pressure that is at least twice a pressure of the secondary fluid (feedwater or steam) in the fluid flow volume. This enables the use of a thinner tube wall in tension. In contrast, if the primary coolant flows outside the tubes then the tube is in compression and a thicker tube wall is generally required. Some analyses have indicated that the tube wall in the tension design of the present OTSG embodiments can be made about one-half as thick as the tube wall thickness required for tubes placed in compression (for comparable tube diameter).

[0037] The use of thinner tube walls translates into the OTSG **30** being substantially lighter and including substantially less Inconel™ 690 or other nickel-chromium-based alloy material used for the tubes **32**. The weight saving of the straight-tube OTSG **30** is advantageous for an integral nuclear reactor. For example, in the illustrative embodiment of FIGURES 1-3, during refueling the core **10** is accessed by removing the steam generator **30**. This entails disconnecting the OTSG **30** from the lower pressure vessel portion **12** via the mid-flange **16**. The lightweight straight-tube OTSG **30** advantageously reduces the requisite size of the containment structure crane used for lifting the steam generator **30** off to the side during refueling.

[0038] The straight-tube OTSG **30** also has service and maintenance advantages. Manways are readily provided proximate to the pressurizer volume **80** and the primary inlet plenum **74** to provide service access. Inspection of the tubes **32** can be performed during a plant outage via the primary inlet plenum **74** without removing the steam generator **30** from the pressure vessel. Eddy current inspection thusly performed can reveal tube thinning and tube cracks. If tube plugging is indicated by such inspection, the steam generator **30** can be removed during the outage and tube plugs can be installed at the lower tubesheet **92** and the upper tubesheet **90**. In another approach, both tube inspection and tube plugging can be done during refueling when the steam generator **30** is placed off to the side of the reactor. In this case, there is easy access from the bottom for tube inspection and plugging.

[0039] With reference to FIGURE 6, a variant embodiment is described. This variant embodiment includes the IEOTSG **30** with tubes **32** mounted in upper and lower tubesheets **90**, **92**. In this variant embodiment, a modified upper pressure vessel portion

- 16 -

14' differs from the upper pressure vessel portion **14** in that it does not have a larger diameter to provide a feedwater annulus with larger outer diameter as compared with the steam annulus. Rather, a feedwater annulus **60'** connected with the feedwater inlet **50** in the variant embodiment of FIGURE 6 is of the same outer diameter as the steam annulus **62** that is connected with the steam outlet **52**. The modified upper pressure vessel portion **14'** also differs from the upper pressure vessel portion **14** in that it does not include the integral sealing top portion **78**. Rather, a separate sealing top portion **78'** is provided which is secured to the modified upper pressure vessel portion **14'** by an upper flange **120**. Still further, the variant embodiment also does not include an integral pressurizer volume or the diverter plate **70**. Rather, the sealing top portion **78'** defines a modified primary inlet plenum **74'** (but does not define a pressurizer volume), and the sealing top portion **78'** includes a curved surface **122** that cooperates with cylinder openings **124** at the top of the central riser **36** to perform the primary coolant flow diversion functionality.

[0040] As the pressurizer volume **80** of the embodiment of FIGURES 1-3 is omitted in the variant embodiment of FIGURE 6, primary coolant pressurization for the embodiment of FIGURE 6 is suitably provided by self-pressurization. In this approach, steam vapor from the reactor core collects at the top of the steam generator vessel, that is, in the primary inlet plenum **74'**. The compressibility of the vapor filled dome volume **74'** regulates the primary coolant pressure. To increase power, the feedwater flow into the feedwater inlet **50** is increased which increases the boiling lengths in the tubes **32**. The reactor core **10** follows the load demand by increasing power via a negative moderator coefficient of reactivity due to the reduction in core inlet temperature from the steam generator **30**. The core outlet temperature is maintained at a near constant temperature regulated by the pressure and saturation temperature of the steam dome volume **74'**. Accordingly, for an increase in power, the temperature rise across the reactor core **10** increases while the reactor flow rate remains constant as determined by the reactor coolant pumps **26**. Decreasing power employs analogous processes.

[0041] As another illustrative variation (not shown), the tubes of the OTSG can be placed in different locations within the pressure vessel. In the illustrative embodiments

of FIGURES 1-3 and 6, the OTSG **30** including tubes **32** is disposed entirely in the downcomer volume **34**. More generally, however, tubes may be disposed in the downcomer volume (as illustrated), or in the central riser flow path **38** inside the central riser **36**, or in both volumes **34**, **36**.

[0042] As other illustrative variations, it has already been noted that the separate inner shroud **42** may instead be embodied as an outer surface of the central riser **36**, and/or for the separate outer shroud **40** may instead be embodied as an inner surface of the upper portion **14** of the pressure vessel. Additionally, it is contemplated to integrate the lower tubesheet **92** with the mid-flange **16**.

[0043] The preferred embodiments have been illustrated and described. Obviously, modifications and alterations will occur to others upon reading and understanding the preceding detailed description. It is intended that the invention be construed as including all such modifications and alterations insofar as they come within the scope of the appended claims or the equivalents thereof.

CLAIMS

We claim:

1. An apparatus comprising:

a cylindrical pressure vessel defining a cylinder axis;

a nuclear reactor core disposed in the cylindrical pressure vessel;

a central riser disposed coaxially inside the cylindrical pressure vessel, the central riser being hollow and having a bottom end proximate to the nuclear reactor core to receive primary coolant heated by the nuclear reactor core, the central riser having a top end distal from the nuclear reactor core;

a once-through steam generator (OTSG) including:

tubes arranged parallel with the cylinder axis in an annular volume defined between the central riser and the cylindrical pressure vessel, primary coolant discharged from the top end of the central riser flowing inside the tubes toward the nuclear reactor core;

a fluid flow volume having a feedwater inlet and a steam outlet wherein fluid injected into the fluid flow volume at the feedwater inlet and discharged from the fluid flow volume at the steam outlet flows outside the tubes in a direction opposite flow of primary coolant inside the tubes; and

an outer shroud;

a feedwater annulus between the outer shroud and the pressure vessel, wherein the feedwater annulus buffers fluid injected into the fluid flow volume at the feedwater inlet and wherein the feedwater annulus has a feedwater annulus outer diameter; and

a steam annulus between the outer shroud and the pressure vessel, wherein the steam annulus buffers fluid discharged from the fluid flow volume at the steam

outlet, wherein the steam annulus has a steam annulus outer diameter, wherein the feedwater annulus outer diameter is larger than the steam annulus outer diameter.

2. The apparatus as set forth in claim 1, wherein the outer shroud of the OTSG comprises a cylindrical outer shroud having a constant outer diameter, the feedwater annulus and the steam annulus having the same inner diameter defined by the constant outer diameter of the cylindrical outer shroud of the OTSG.

3. The apparatus as set forth in claim 1, wherein the apparatus comprises a nuclear reactor having an operating state in which fluid comprising feedwater injected into the fluid flow volume at the feedwater inlet is converted by heat transfer from primary coolant flowing inside the tubes into steam that is discharged from the fluid flow volume at the steam outlet.

4. The apparatus as set forth in claim 3, wherein in the operating state the OTSG defines an integral economizer that heats feedwater injected into the fluid flow volume at the feedwater inlet to a temperature at or below a boiling point of the feedwater.

5. The apparatus as set forth in claim 3, wherein:

a feedwater annulus between an outer shroud of the OTSG and the pressure vessel buffers feedwater injected into the fluid flow volume at the feedwater inlet;

a steam annulus between the outer shroud of the OTSG and the pressure vessel buffers steam discharged from the fluid flow volume at the steam outlet; and

the feedwater annulus has a larger outer diameter than the steam annulus.

6. The apparatus as set forth in claim 5, wherein the outer shroud of the OTSG comprises a cylindrical outer shroud having a constant outer diameter, the feedwater annulus and the steam annulus having the same inner diameter defined by the constant outer diameter of the cylindrical outer shroud of the OTSG.

7. The apparatus as set forth in claim 3, further comprising:

a flow diverter disposed in the cylindrical pressure vessel, the flow diverter having a flow-diverting surface facing the top end of the central riser that is at least one of sloped and curved to redirect primary coolant discharged from the top end of the central riser toward inlets of the tubes of the OTSG.

8. The apparatus as set forth in claim 3, further comprising:

a perforated cylinder flow diverter disposed in the cylindrical pressure vessel, wherein the perforated cylinder flow diverter extends vertically from an upper portion of the central riser.

9. The apparatus as set forth in claim 3, further comprising:

a divider plate spaced apart from the top end of the central riser;

wherein the cylindrical pressure vessel includes a sealing top portion cooperating with the divider plate to define an integral pressurizer volume that is separated by the divider plate from the remaining interior volume of the cylindrical pressure vessel; and

wherein in the operating state of the nuclear reactor comprises a pressurized water reactor (PWR) and the integral pressurizer volume contains fluid at a temperature greater than a temperature of the primary coolant disposed in the remaining interior volume of the cylindrical pressure vessel.

10. The apparatus as set forth in claim 9, wherein the divider plate comprises:

a flow diverter having a flow-diverting surface facing the top end of the central riser that is at least one of sloped and curved to redirect primary coolant discharged from the top end of the central riser toward inlets of the tubes of the OTSG.

11. The apparatus as set forth in claim 9, further comprising:

neutron-absorbing control rods; and

a control rod drive mechanism (CRDM) configured to controllably insert and withdraw the control rods into and out of the nuclear reactor core;

wherein no portion of the CRDM is disposed in or passes through the integral pressurizer volume.

12. The apparatus as set forth in claim 3, wherein the tubes of the OTSG are under axial tension in a non-operating state of the nuclear reactor in which the tubes of the OTSG are at a temperature of less than 100°C.

13. The apparatus as set forth in claim 12, wherein:

in the operating state of the nuclear reactor the primary coolant flowing in the tubes of the OTSG is at a temperature of at least 500°C, and

the tubes of the OTSG are under axial compression in the operating state.

14. The apparatus as set forth in claim 13, wherein the tubes of the OTSG are made of an austenitic nickel-chromium-based alloy and the tubes are secured in a tubesheet support attached to the central riser and the pressure vessel, wherein the central riser and pressure vessel are made of a steel, and wherein the austenitic nickel-chromium-based alloy has a higher coefficient of thermal expansion than the steel.

15. The apparatus as set forth in claim 12, wherein:

the tubes of the OTSG are secured in a tubesheet support attached to the central riser and the pressure vessel wherein the central riser and the pressure vessel are made of a support material, and the tubes of the OTSG are made of a material having a higher coefficient of thermal expansion than the coefficient of thermal expansion of the support material; and

ends of the tubes are expanded to secure to the support whereby the tubes are under axial tension due to the Poisson effect.

16. The apparatus as set forth in claim 3, wherein:

in the operating state of the nuclear reactor the primary coolant flowing inside the tubes is at a higher pressure than the fluid in the fluid flow volume.

17. The apparatus as set forth in claim 3, wherein:

in the operating state of the nuclear reactor the primary coolant flowing inside the tubes is at a pressure that is at least twice a pressure of the fluid in the fluid flow volume.

18. An apparatus comprising:

a pressurized water nuclear reactor (PWR) including a pressure vessel, a nuclear reactor core disposed in the pressure vessel, and a vertically oriented hollow central riser disposed above the nuclear reactor core inside the pressure vessel; and

a once-through steam generator (OTSG) disposed in the pressure vessel of the PWR, the OTSG including:

vertical tubes arranged in at least one of (i) the central riser and (ii) an annular volume defined by the central riser and the pressure vessel;

a fluid flow volume surrounding the vertical tubes; and

an outer shroud of the OTSG surrounding vertical tubes of the OTSG arranged in the annular volume defined by the central riser and the pressure vessel;

a feedwater annulus between the outer shroud of the OTSG and the pressure vessel, wherein the feedwater annulus buffers feedwater injected into the fluid flow volume at the feedwater inlet and wherein the feedwater annulus has a feedwater annulus outer diameter; and

a steam annulus between the outer shroud of the OTSG and the pressure vessel, wherein the steam annulus buffers steam discharged from the fluid flow volume at the steam outlet, wherein the steam annulus has a steam annulus outer diameter, wherein the feedwater annulus outer diameter is larger than the steam annulus outer diameter;

wherein the PWR has an operating state in which feedwater injected into the fluid flow volume at a feedwater inlet is converted to steam by heat emanating from primary coolant flowing inside the tubes of the OTSG, and the steam is discharged from the fluid flow volume at a steam outlet.

19. The apparatus as set forth in claim 18, wherein in the operating state the OTSG defines an integral economizer that heats feedwater injected into the fluid flow volume at the feedwater inlet to a temperature at or below a boiling point of the feedwater.

20. The apparatus as set forth in claim 18, further comprising:

a flow diverter disposed in the cylindrical pressure vessel above the central riser, the flow diverter having a flow-diverting surface facing a top of the central riser that is at least one of sloped and curved to redirect primary coolant discharged from the top of the central riser toward inlets of the tubes of the OTSG.

21. The apparatus as set forth in claim 20, wherein the flow diverter divides the pressure vessel into an upper integral pressurizer volume and a remaining lower interior volume, and in the operating state the upper integral pressurizer volume contains fluid at a temperature greater than a temperature of the primary coolant disposed in the remaining lower interior volume of the pressure vessel.

22. The apparatus as set forth in claim 18, wherein the pressure vessel is divided into an upper integral pressurizer volume and a remaining lower interior volume, and in the operating state the upper integral pressurizer volume contains fluid at a temperature greater than a temperature of the primary coolant disposed in the remaining lower interior volume of the pressure vessel.

23. The apparatus as set forth in claim 22, further comprising:

neutron-absorbing control rods; and

a control rod drive mechanism (CRDM) configured to controllably insert and withdraw the control rods into and out of the nuclear reactor core;

wherein no portion of the CRDM is disposed in or passes through the integral pressurizer volume.

24. The apparatus as set forth in claim 18, wherein the tubes of the OTSG are under axial tension in a non-operating state of the PWR in which the tubes of the OTSG are at a temperature of less than 100°C.


25. The apparatus as set forth in claim 24, wherein:


in the operating state of the PWR the primary coolant flowing in the tubes of the OTSG is at a temperature of at least 500°C, and

the tubes of the OTSG are under axial compression in the operating state.

26. The apparatus as set forth in claim 18, wherein:

in the operating state of the nuclear reactor the primary coolant flowing inside the tubes is at a higher pressure than the fluid in the fluid flow volume.

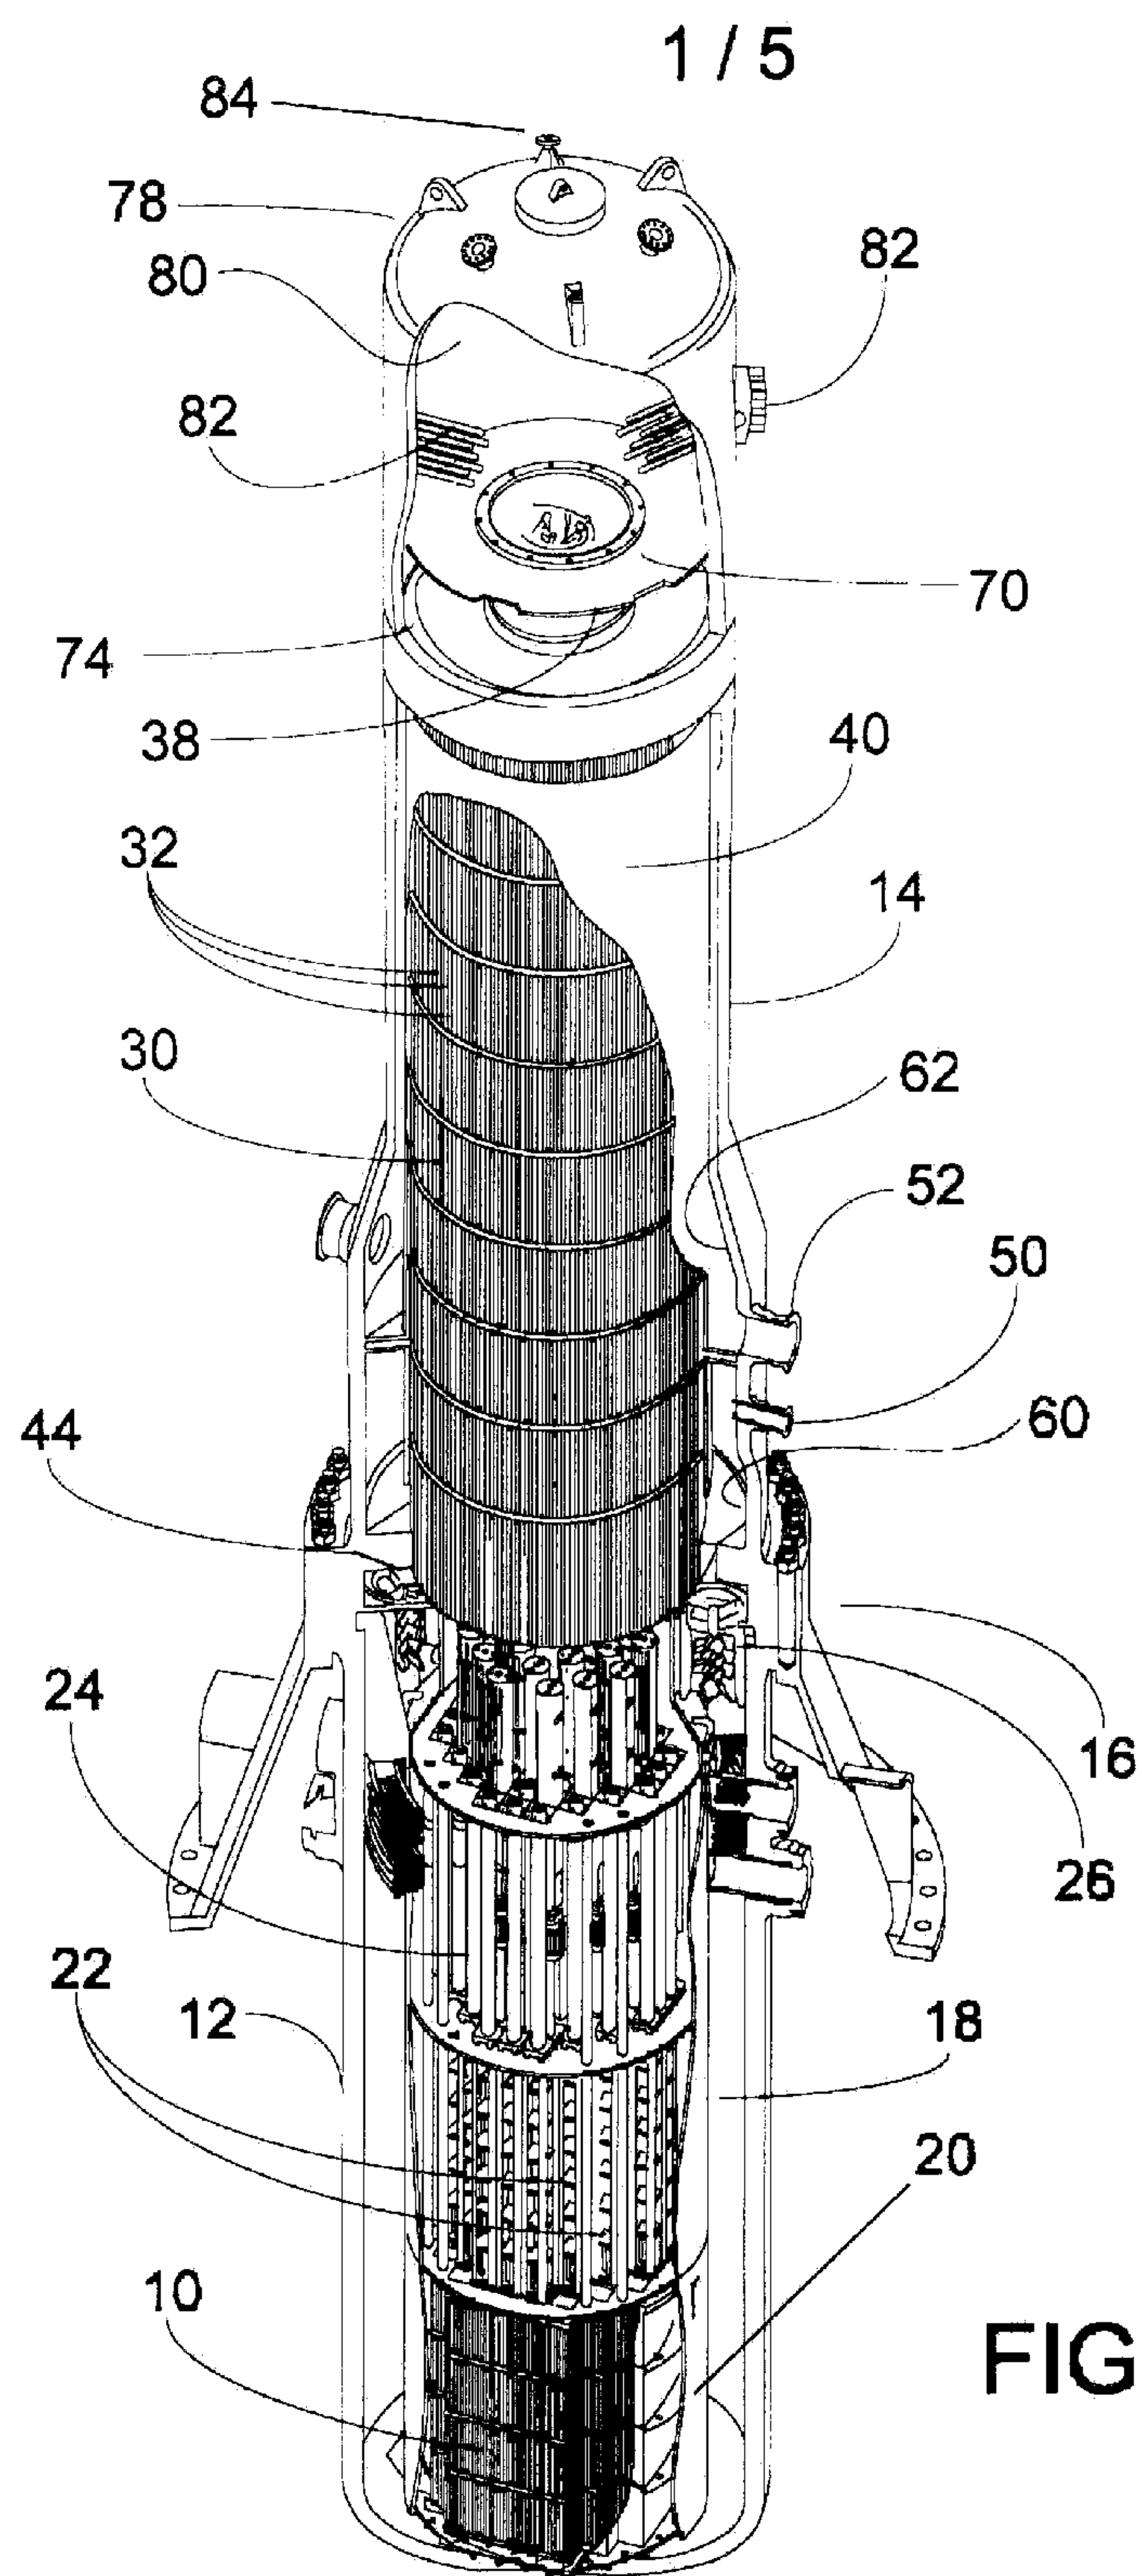

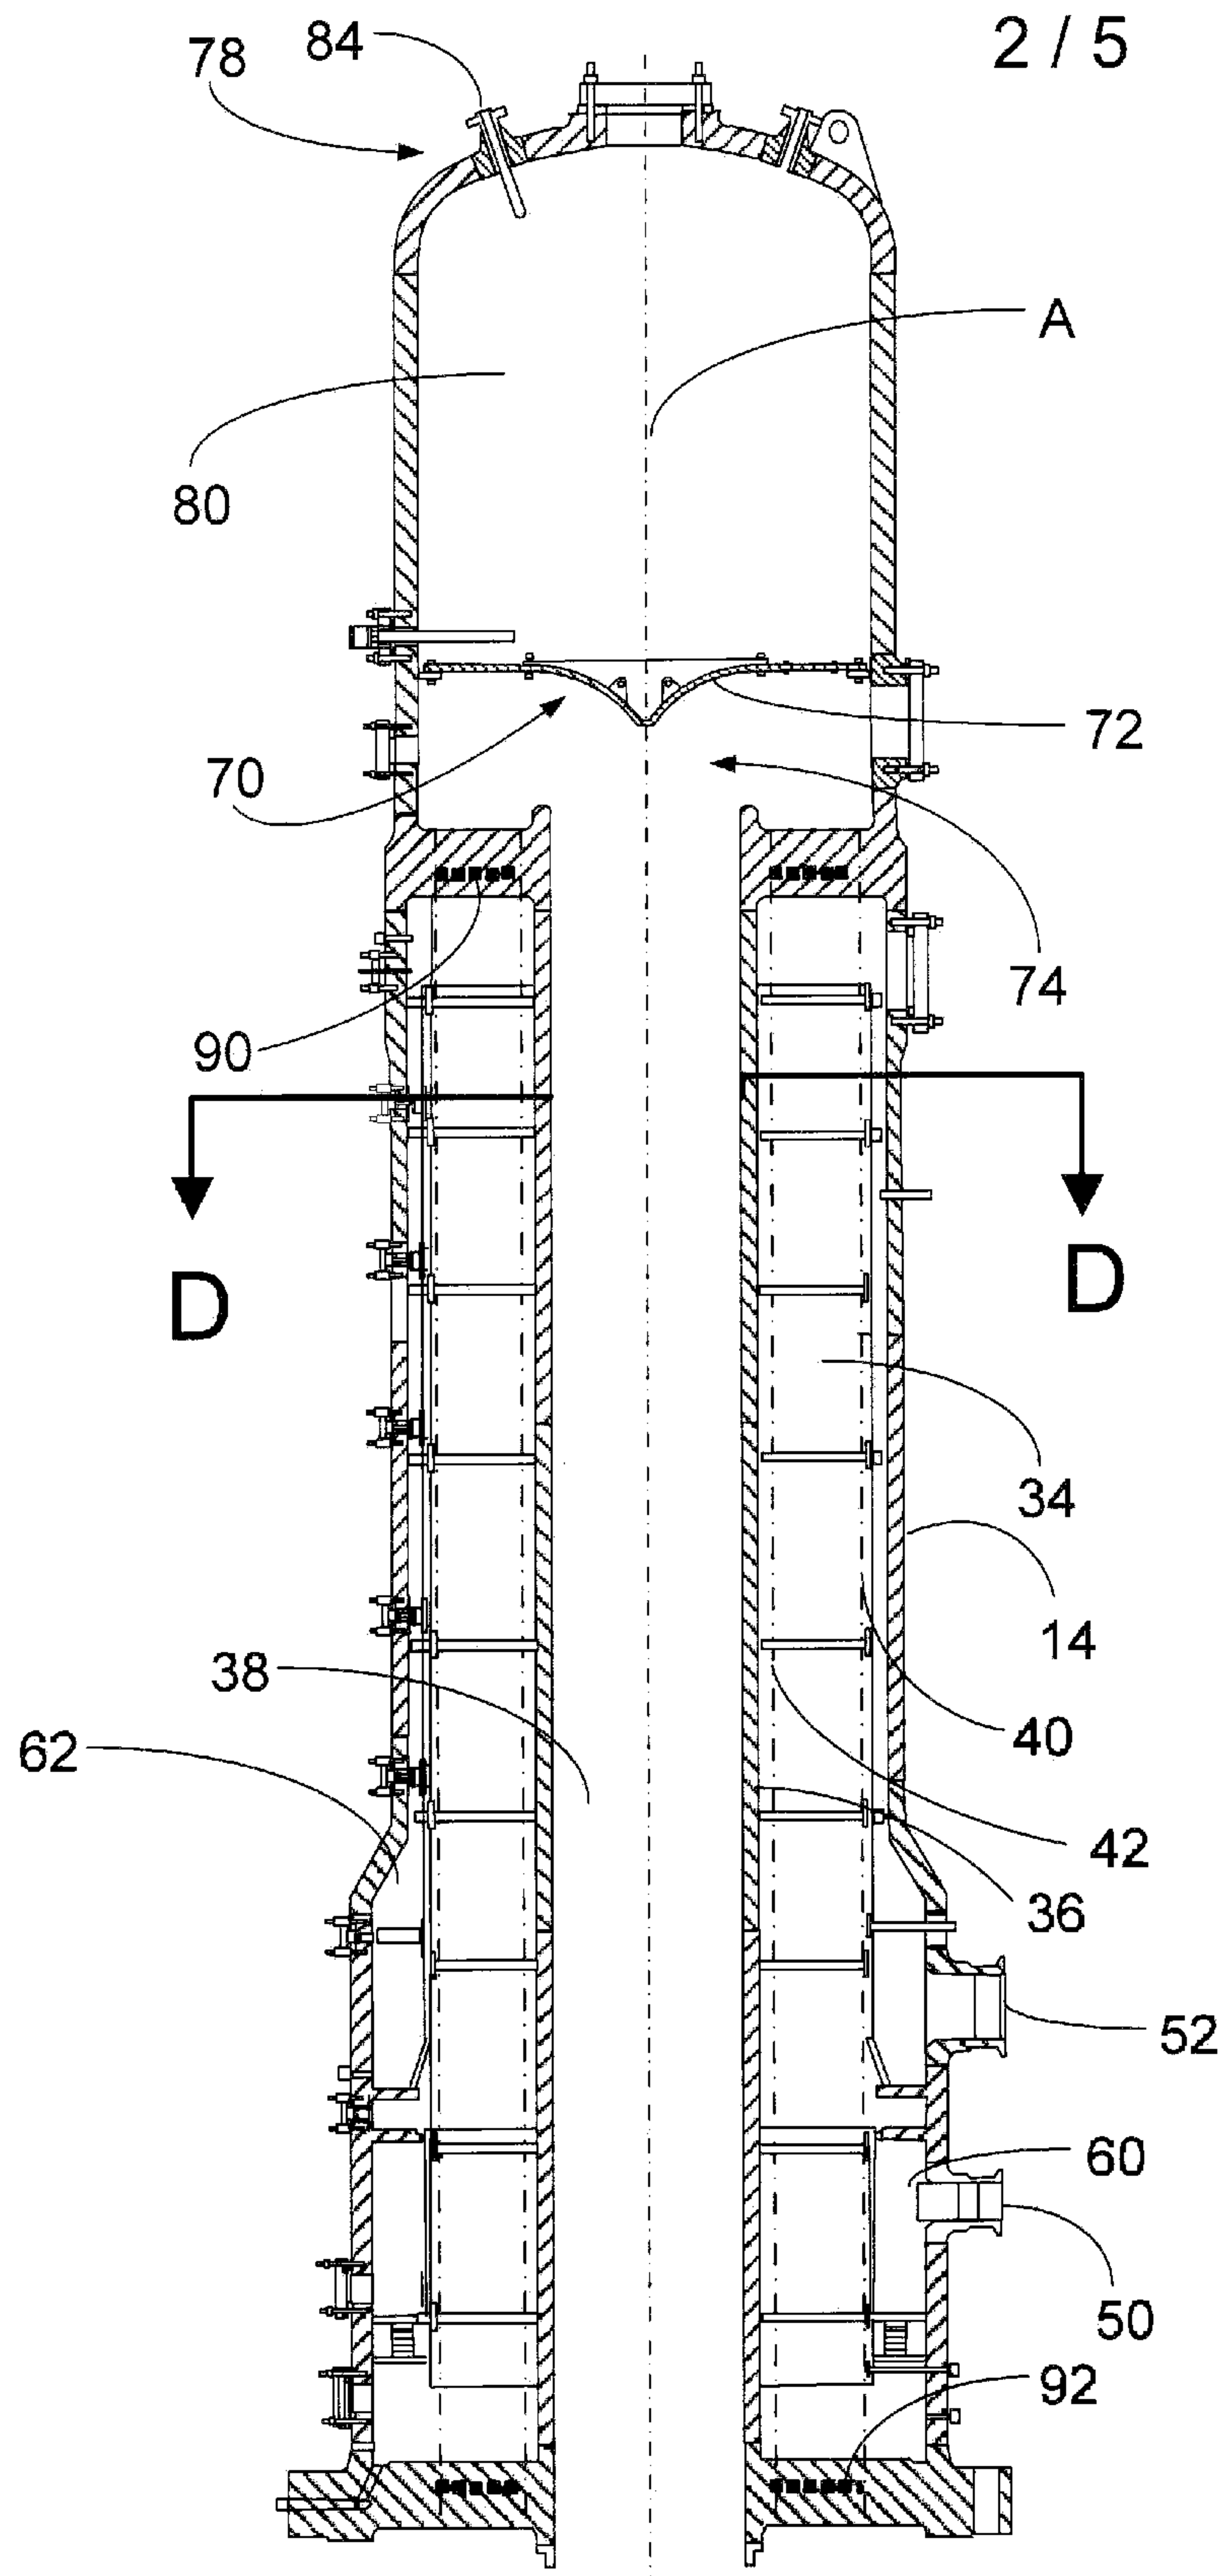

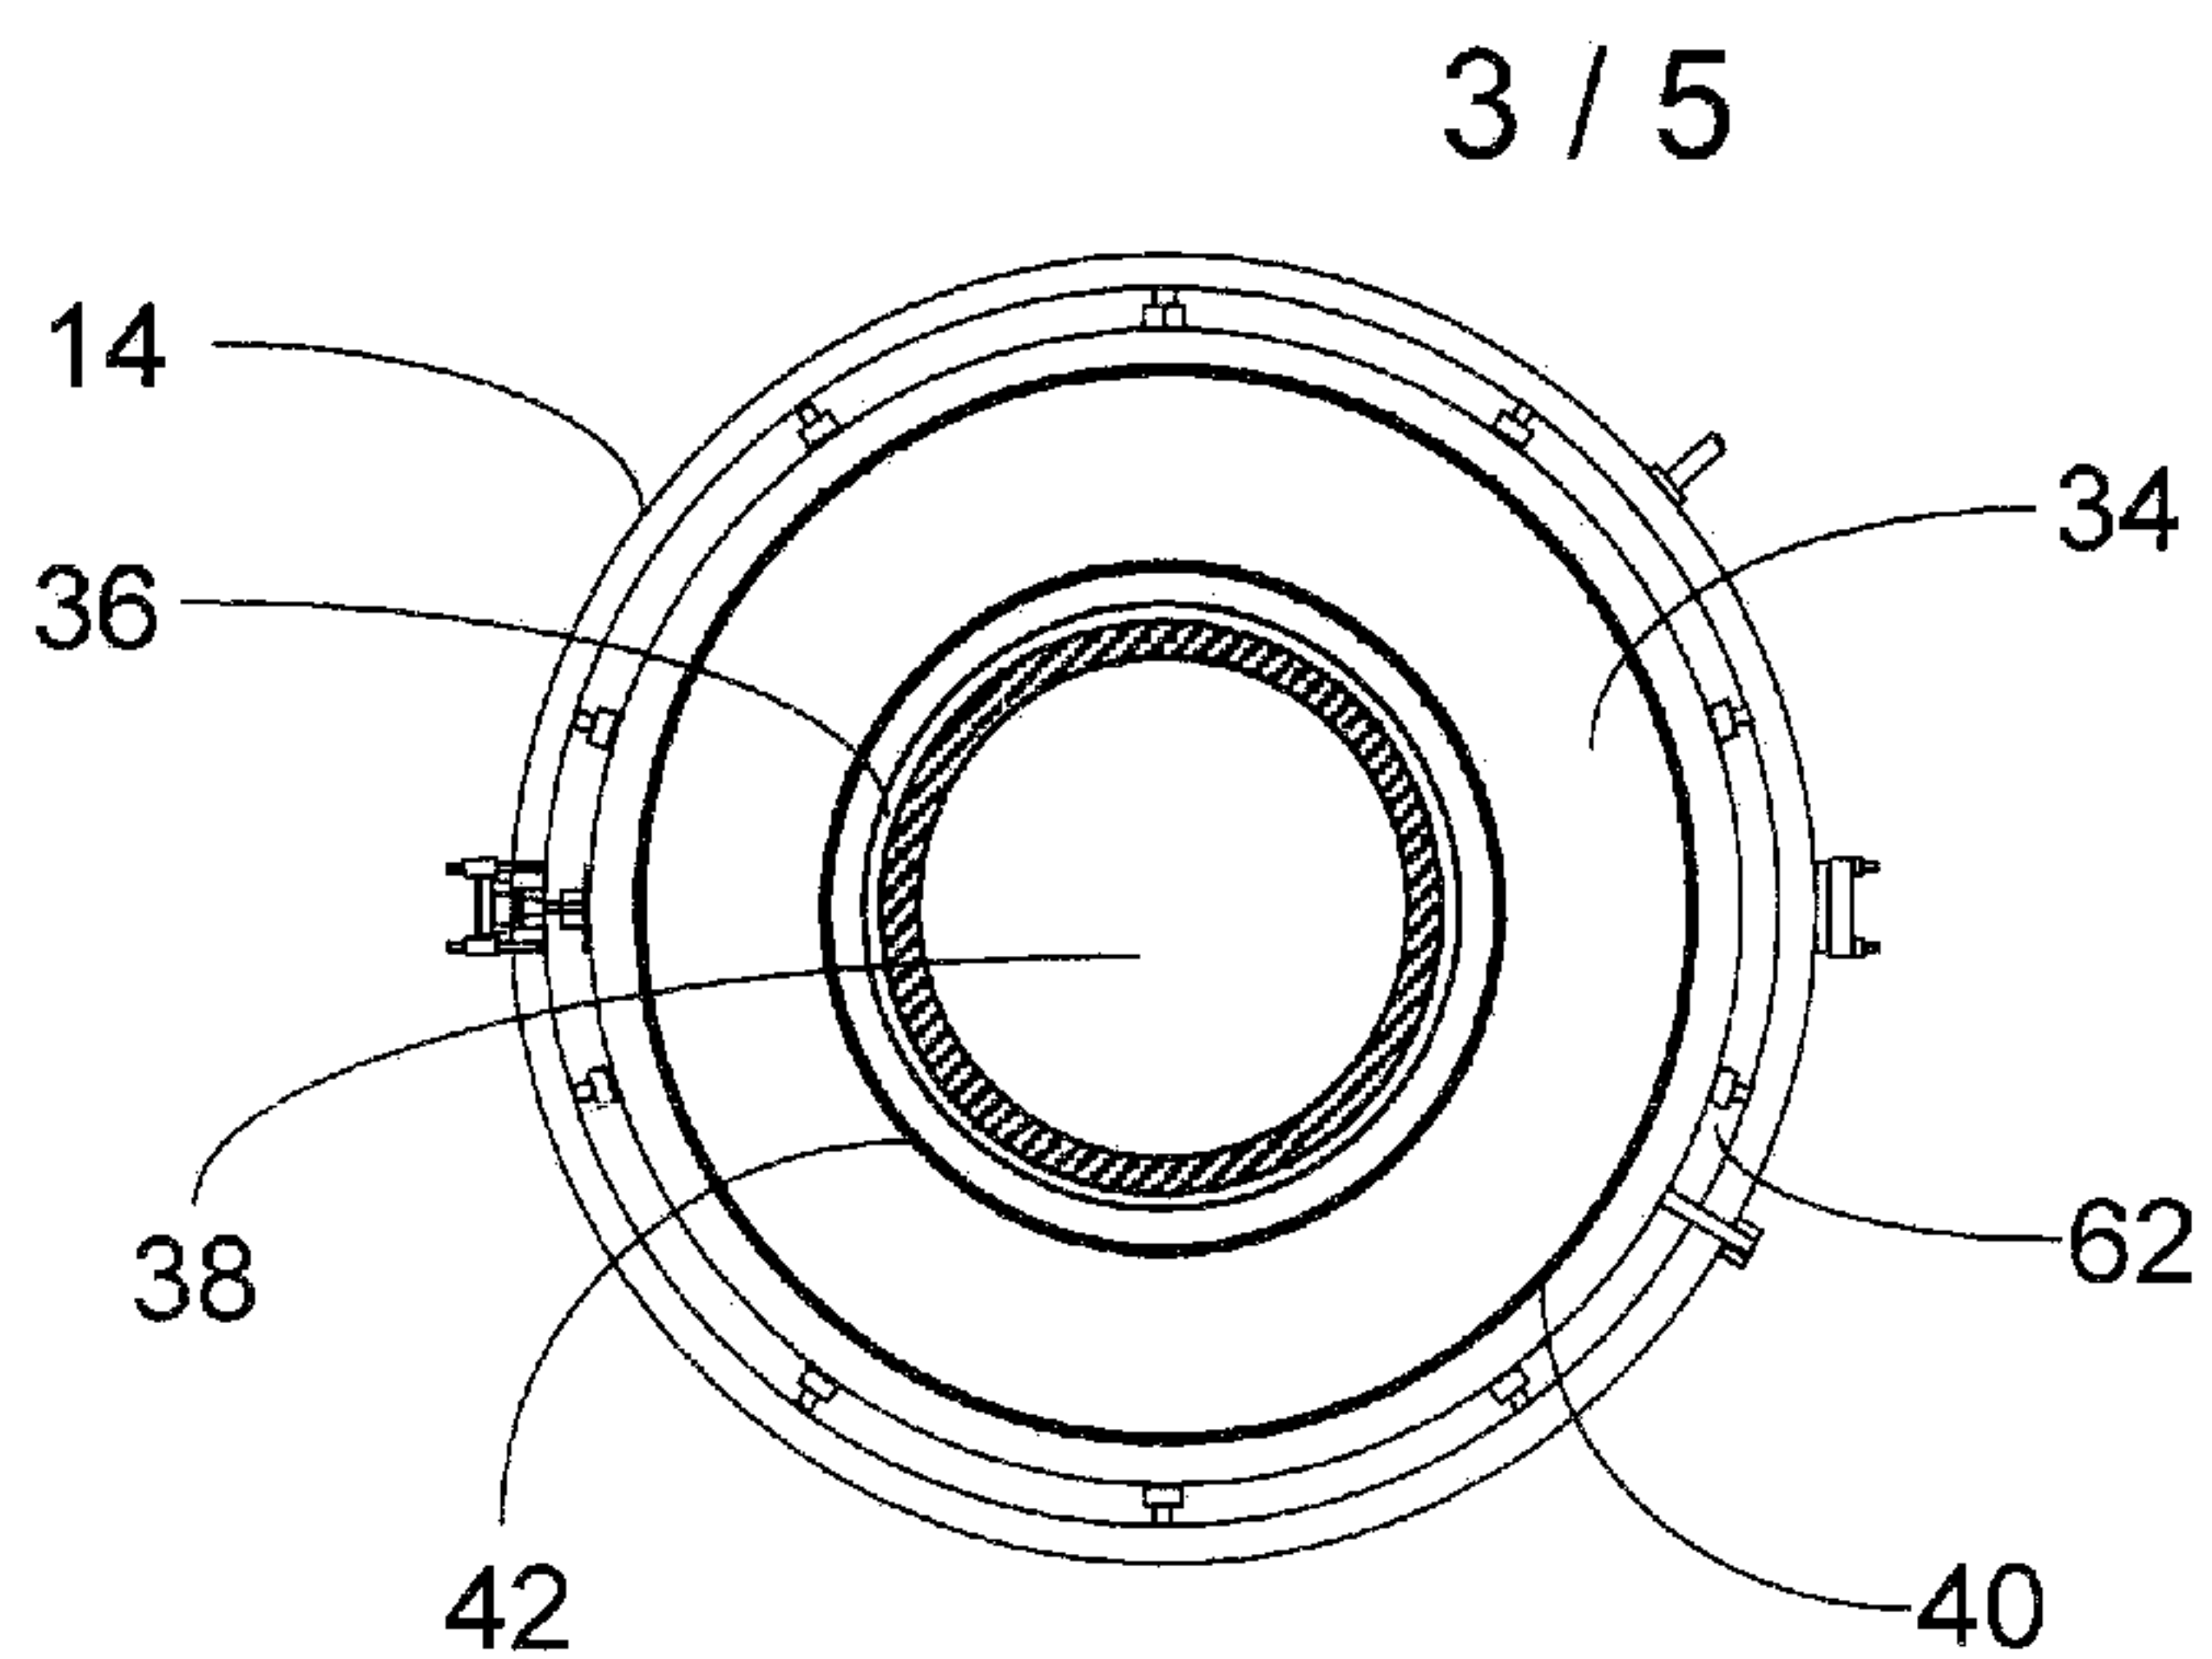


FIG. 3

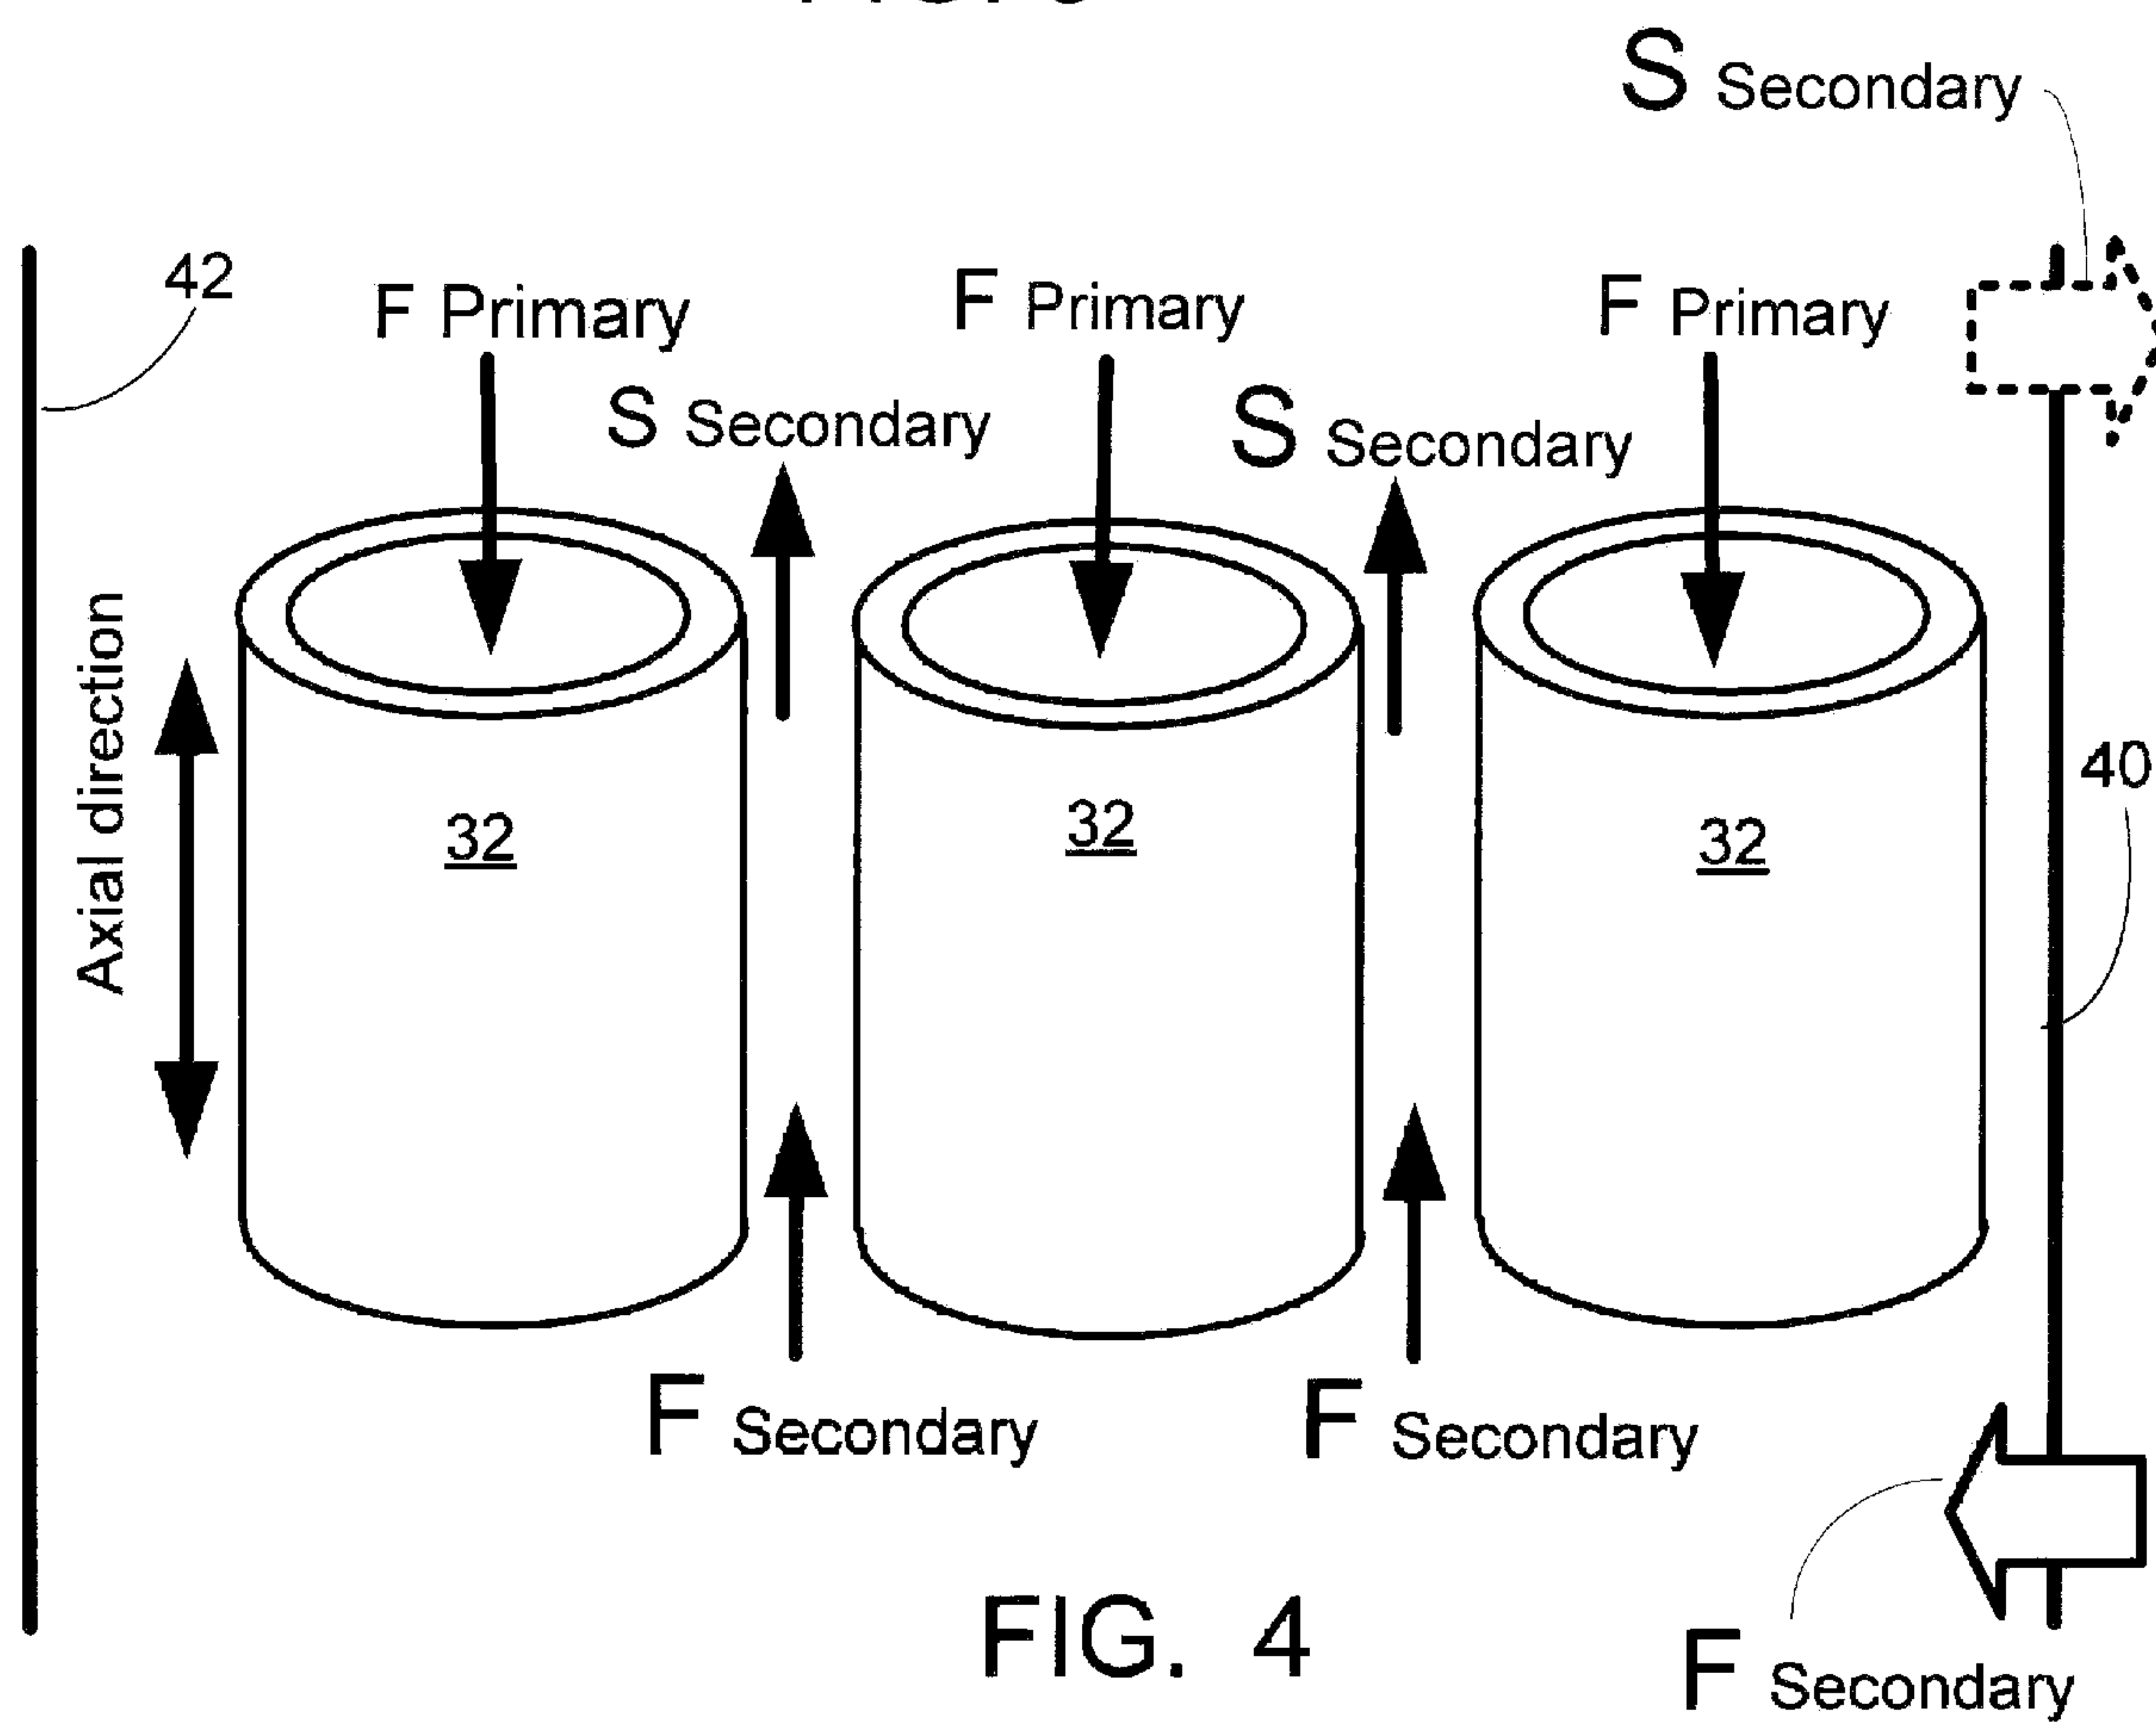


FIG. 4

4 / 5

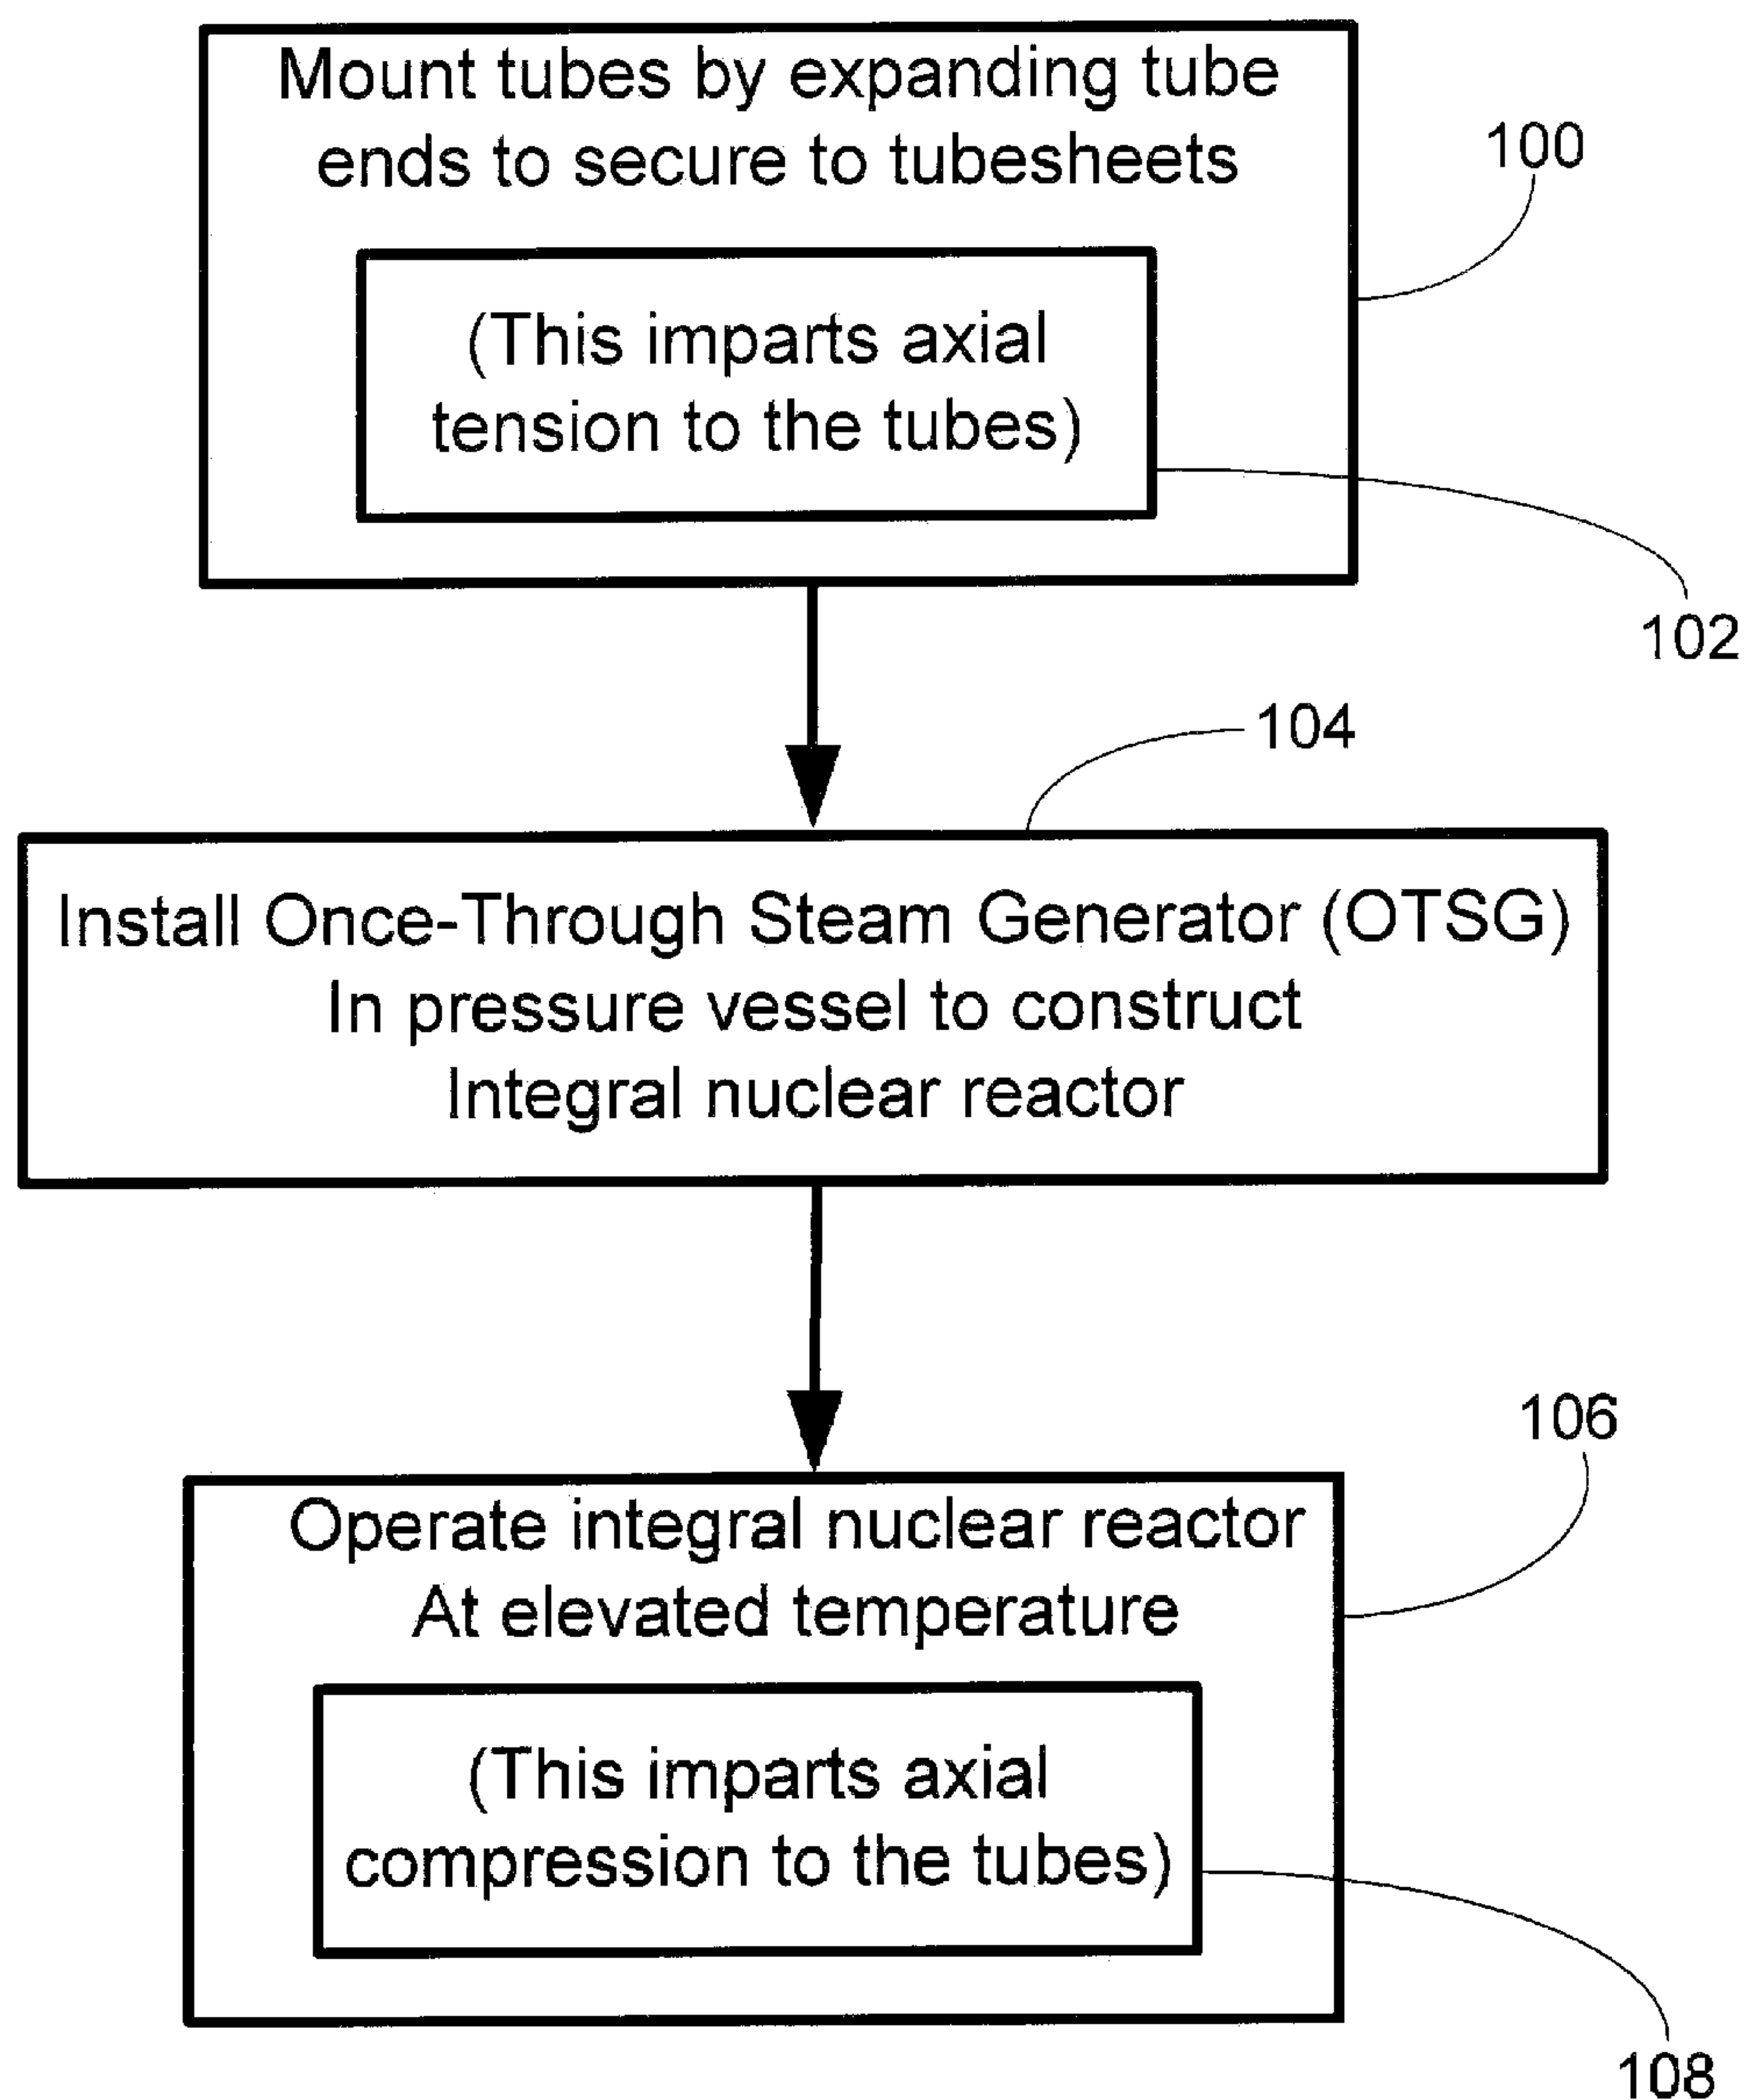


FIG. 5

5 / 5

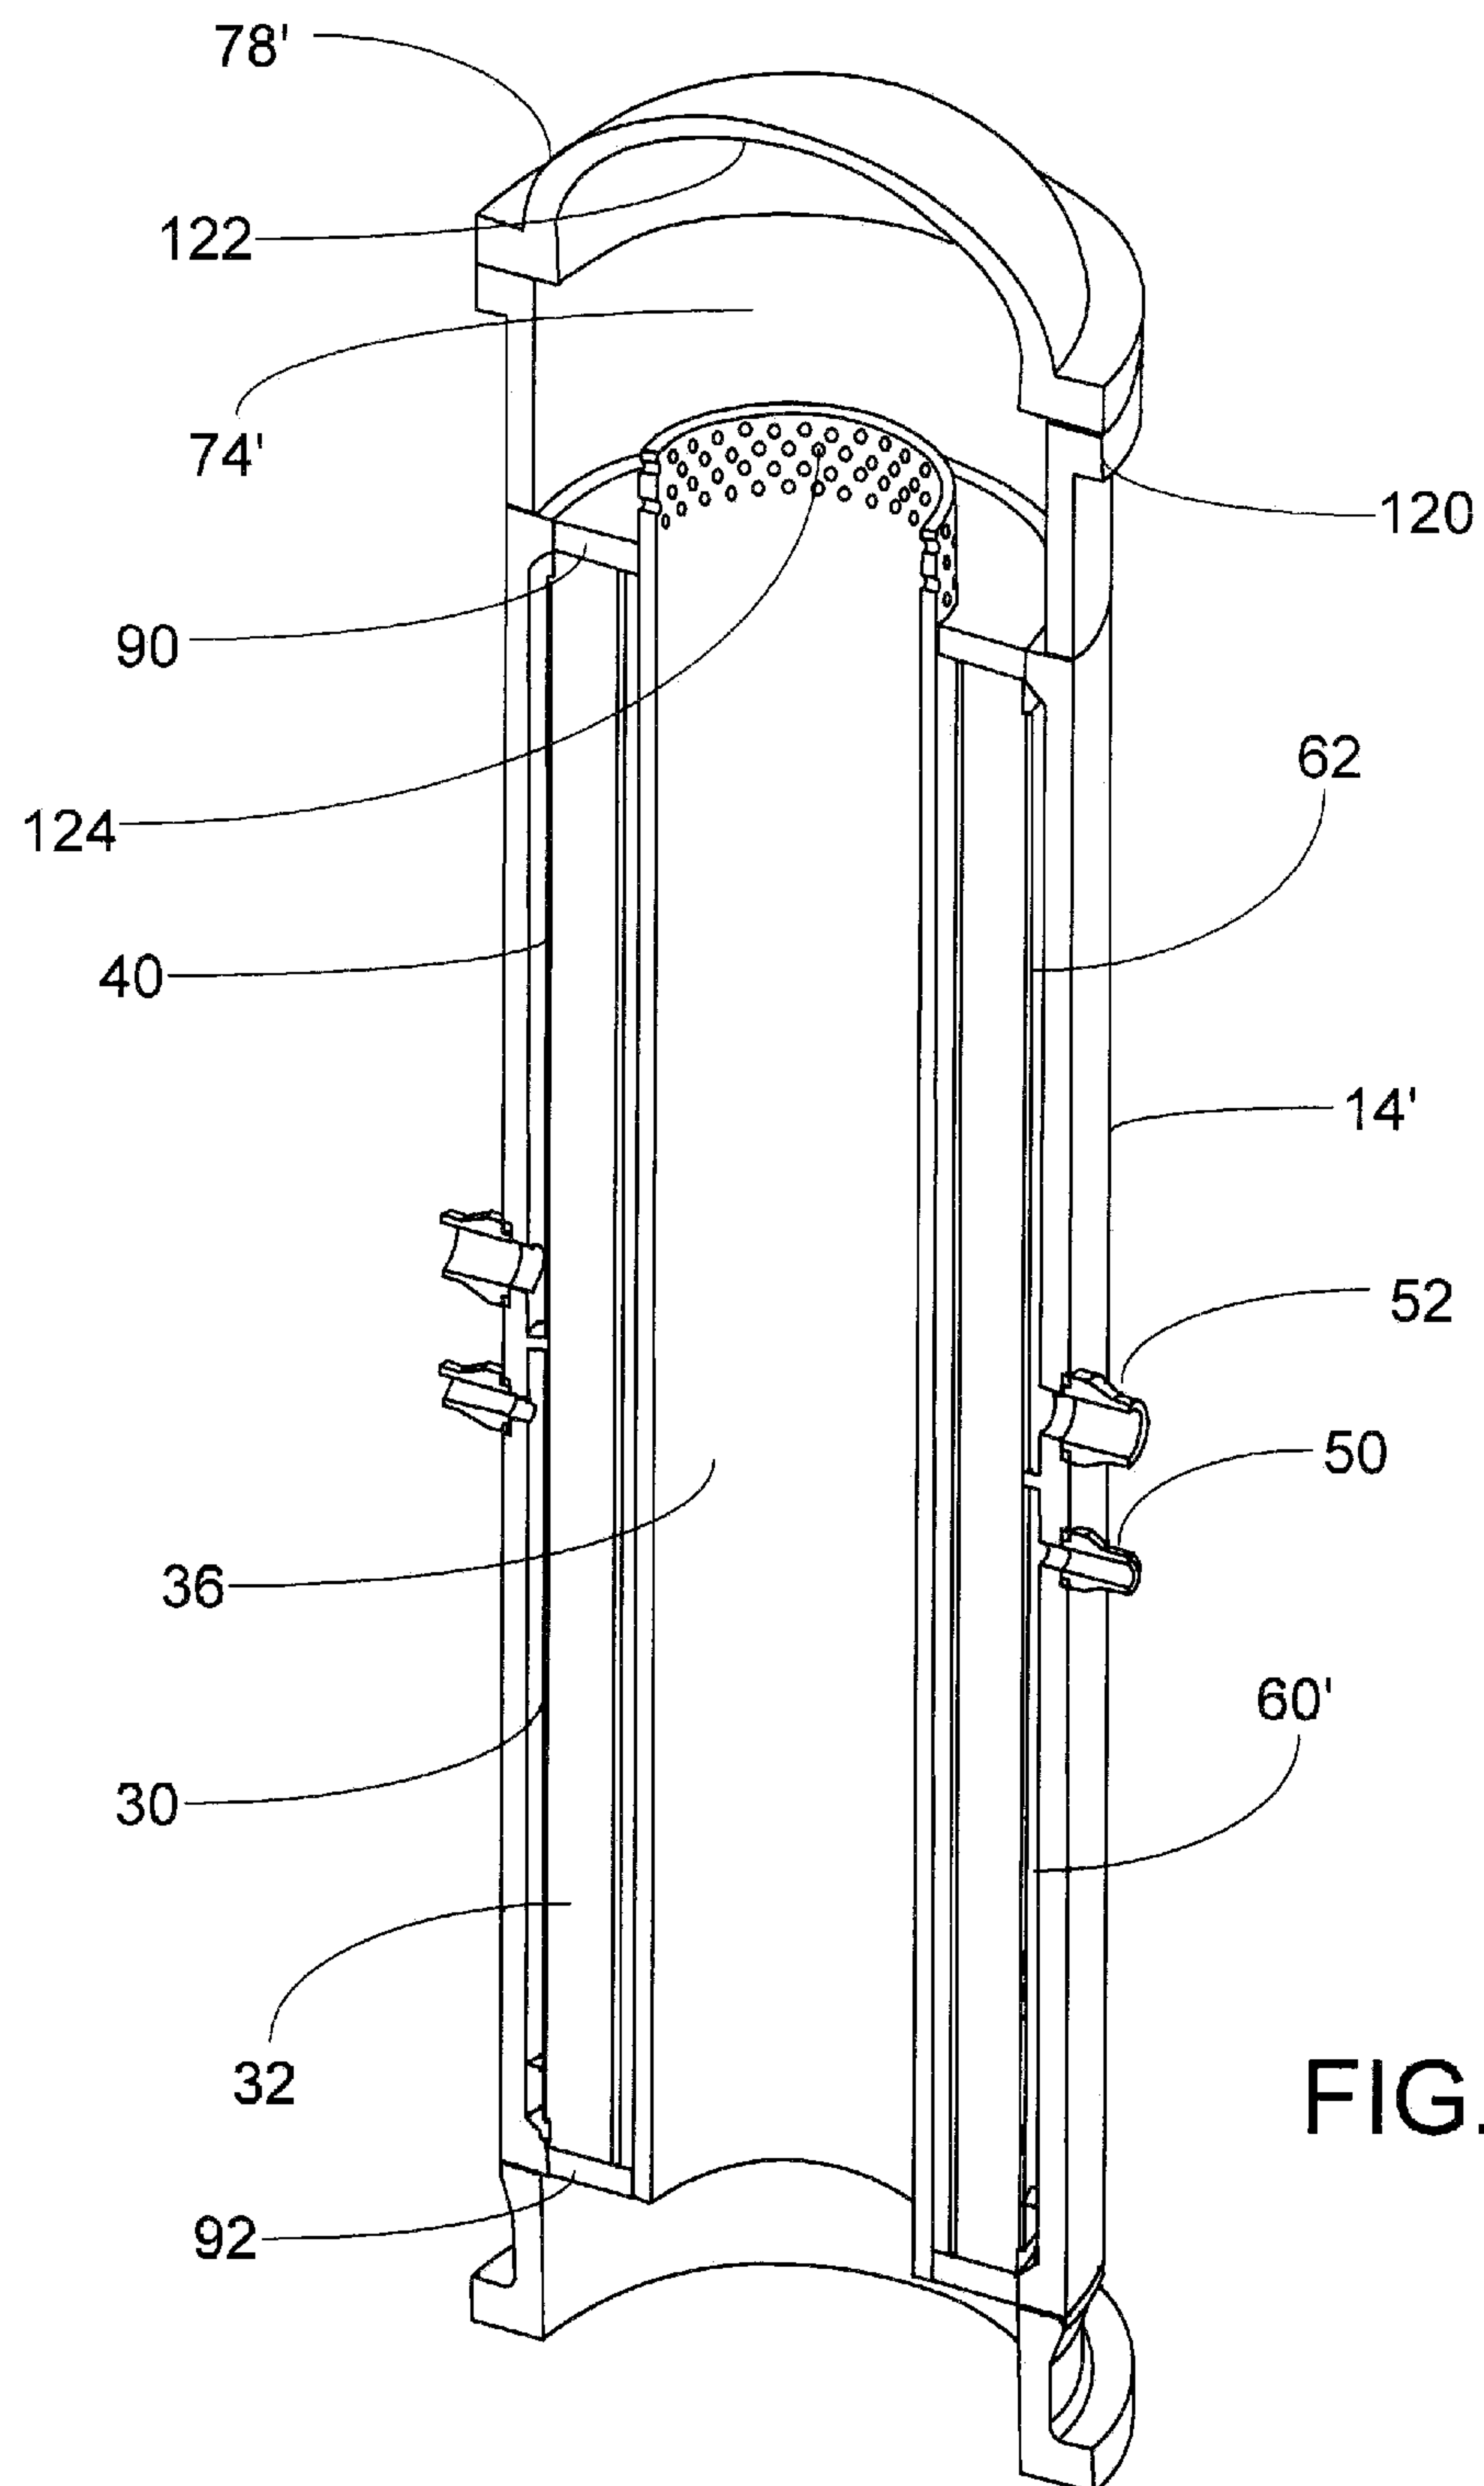


FIG. 6

