



US011644492B2

(12) **United States Patent**
Davis

(10) **Patent No.:** **US 11,644,492 B2**
(45) **Date of Patent:** **May 9, 2023**

(54) **ELECTRICITY METER THERMAL PERFORMANCE MONITORING**

(56) **References Cited**

(71) Applicant: **Landis+Gyr AG**, Cham (CH)

U.S. PATENT DOCUMENTS
6,847,300 B2 1/2005 Yee et al.
7,716,012 B2 5/2010 Bickel
(Continued)

(72) Inventor: **Ian Jackson Davis**, Peakhurst Heights (AU)

FOREIGN PATENT DOCUMENTS

(73) Assignee: **Landis+Gyr AG**, Cham (CH)

(*) Notice: Subject to any disclaimer, the term of this patent is extended or adjusted under 35 U.S.C. 154(b) by 0 days.

EP 1980862 A2 10/2008
WO 2013006901 A1 1/2013
WO 2016066373 A1 5/2016

OTHER PUBLICATIONS

(21) Appl. No.: **17/273,367**

International Search Report and Written Opinion, PCT Patent Application No. PCT/EP2019/073811, dated Dec. 4, 2019, 11 pages.

(22) PCT Filed: **Sep. 6, 2019**

(Continued)

(86) PCT No.: **PCT/EP2019/073811**

§ 371 (c)(1),
(2) Date: **Mar. 4, 2021**

Primary Examiner — Christopher P McAndrew
Assistant Examiner — Zannatul Ferdous

(87) PCT Pub. No.: **WO2020/053085**

(74) *Attorney, Agent, or Firm* — Kilpatrick Townsend & Stockton LLP

PCT Pub. Date: **Mar. 19, 2020**

(57) **ABSTRACT**

(65) **Prior Publication Data**

US 2021/0341520 A1 Nov. 4, 2021

A method of monitoring a functional state of an electricity meter, includes generating at least one temperature signal from which an actual temperature value of the electricity meter can be derived; determining whether the actual temperature value and/or a gradient thereof exceeds at least one threshold value derived from at least one predefined temperature curve representing predefined temperature values of the electricity meter over time according to a modelled thermal behaviour of the electricity meter. Further, a computer program, a computer-readable data carrier having stored thereon a computer program, a data carrier signal carrying a computer program, and an electricity meter configured to carry out the computer program are described. Finally, an electricity metering system, in particular an Advanced Metering Infrastructure, includes at least one electricity meter and/or at least one administration device

(Continued)

(30) **Foreign Application Priority Data**

Sep. 14, 2018 (EP) 18194512

(51) **Int. Cl.**


G01R 22/06 (2006.01)
G01M 99/00 (2011.01)
G01K 3/00 (2006.01)

(52) **U.S. Cl.**

CPC **G01R 22/068** (2013.01); **G01K 3/005** (2013.01); **G01M 99/002** (2013.01)

(58) **Field of Classification Search**

CPC G01R 22/068; G01K 3/005; G01M 99/002
See application file for complete search history.

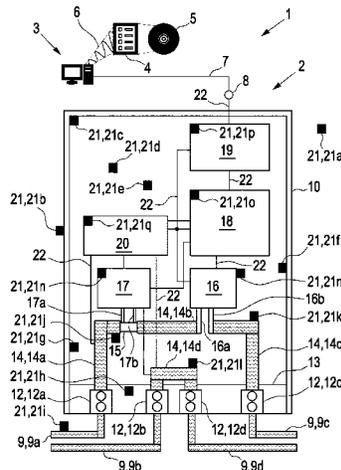

configured to carry out a method of monitoring a functional state of an electricity meter.

17 Claims, 12 Drawing Sheets

(56)

References Cited

U.S. PATENT DOCUMENTS

2003/0146758 A1* 8/2003 Koike G01F 1/6965
324/453
2008/0094231 A1 4/2008 Hohn et al.
2011/0218688 A1* 9/2011 Lentner H02J 1/14
700/292
2013/0088799 A1 4/2013 Zeller
2013/0261833 A1* 10/2013 Meghani G06Q 10/10
700/297
2014/0225737 A1 8/2014 Brown et al.
2016/0091904 A1* 3/2016 Horesh G05D 23/1904
700/276
2017/0363441 A1* 12/2017 Carpenter G01D 4/002
2018/0003572 A1* 1/2018 Garsd G01K 13/00
2021/0055348 A1* 2/2021 Kim G01R 31/367

OTHER PUBLICATIONS

Office Action, European Patent Application No. 18194512.2, dated Dec. 14, 2020, 6 pages.

* cited by examiner

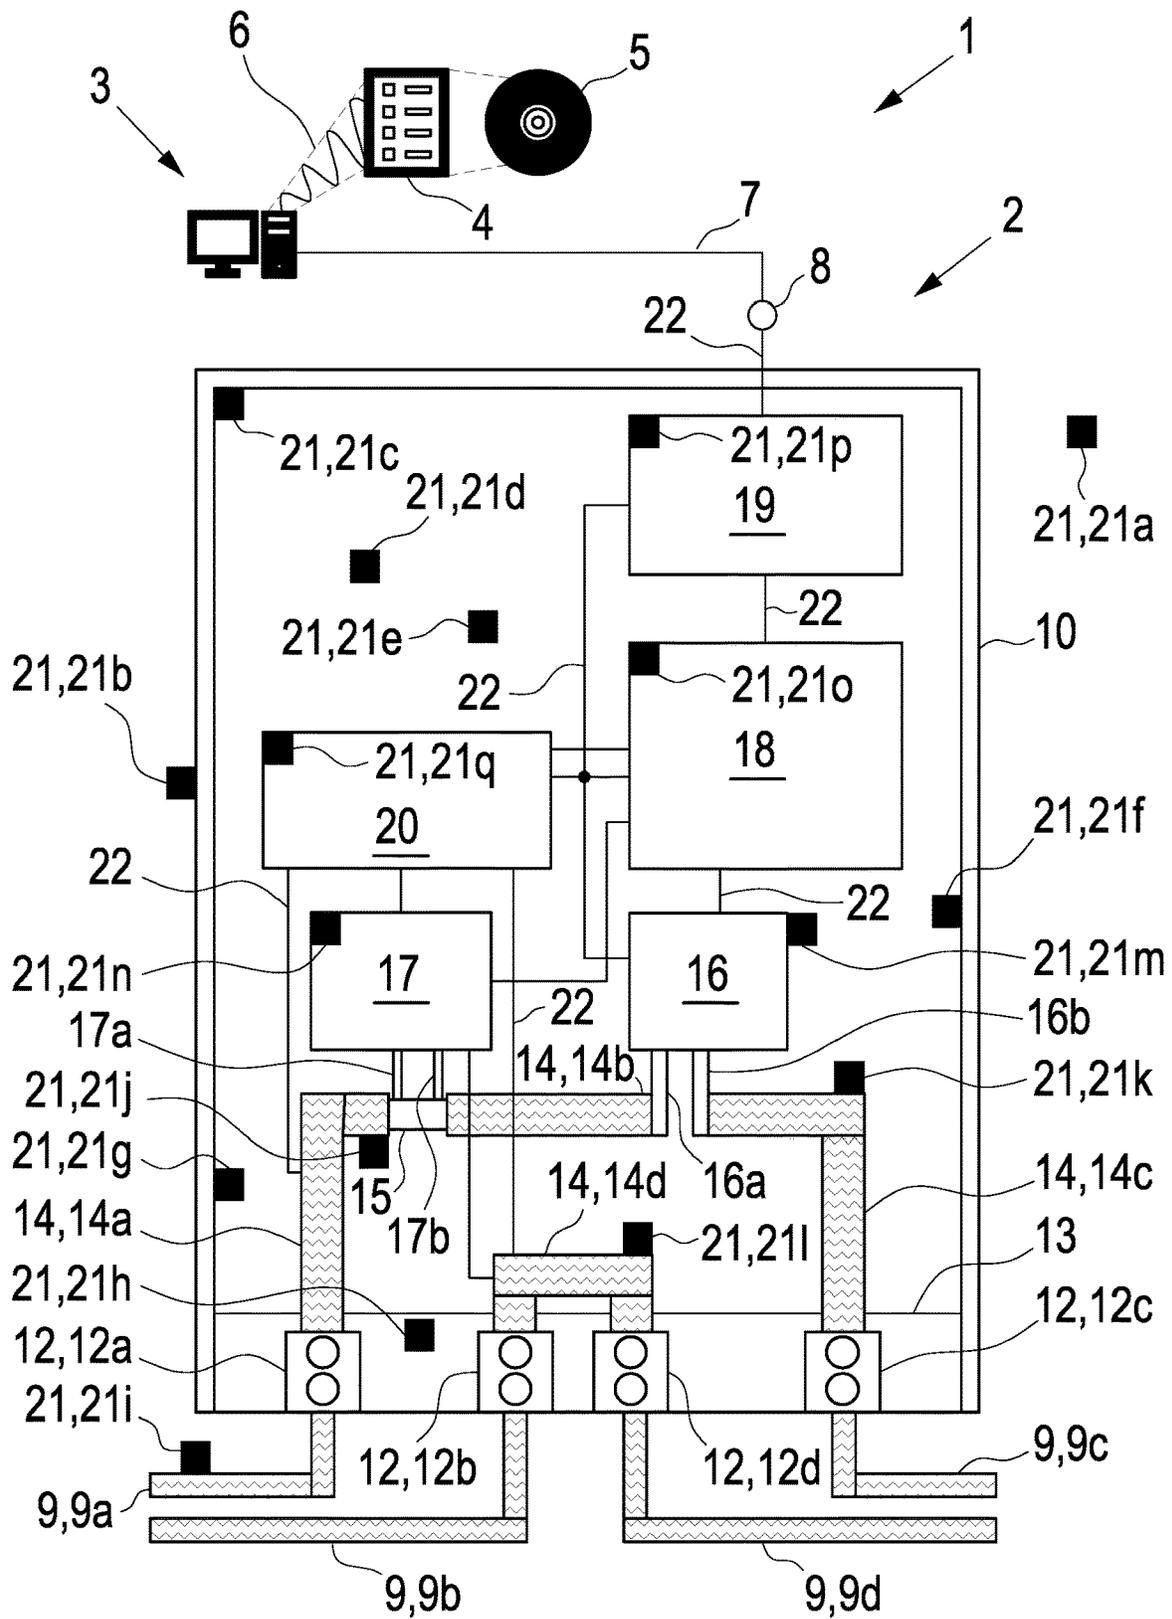


Fig. 1

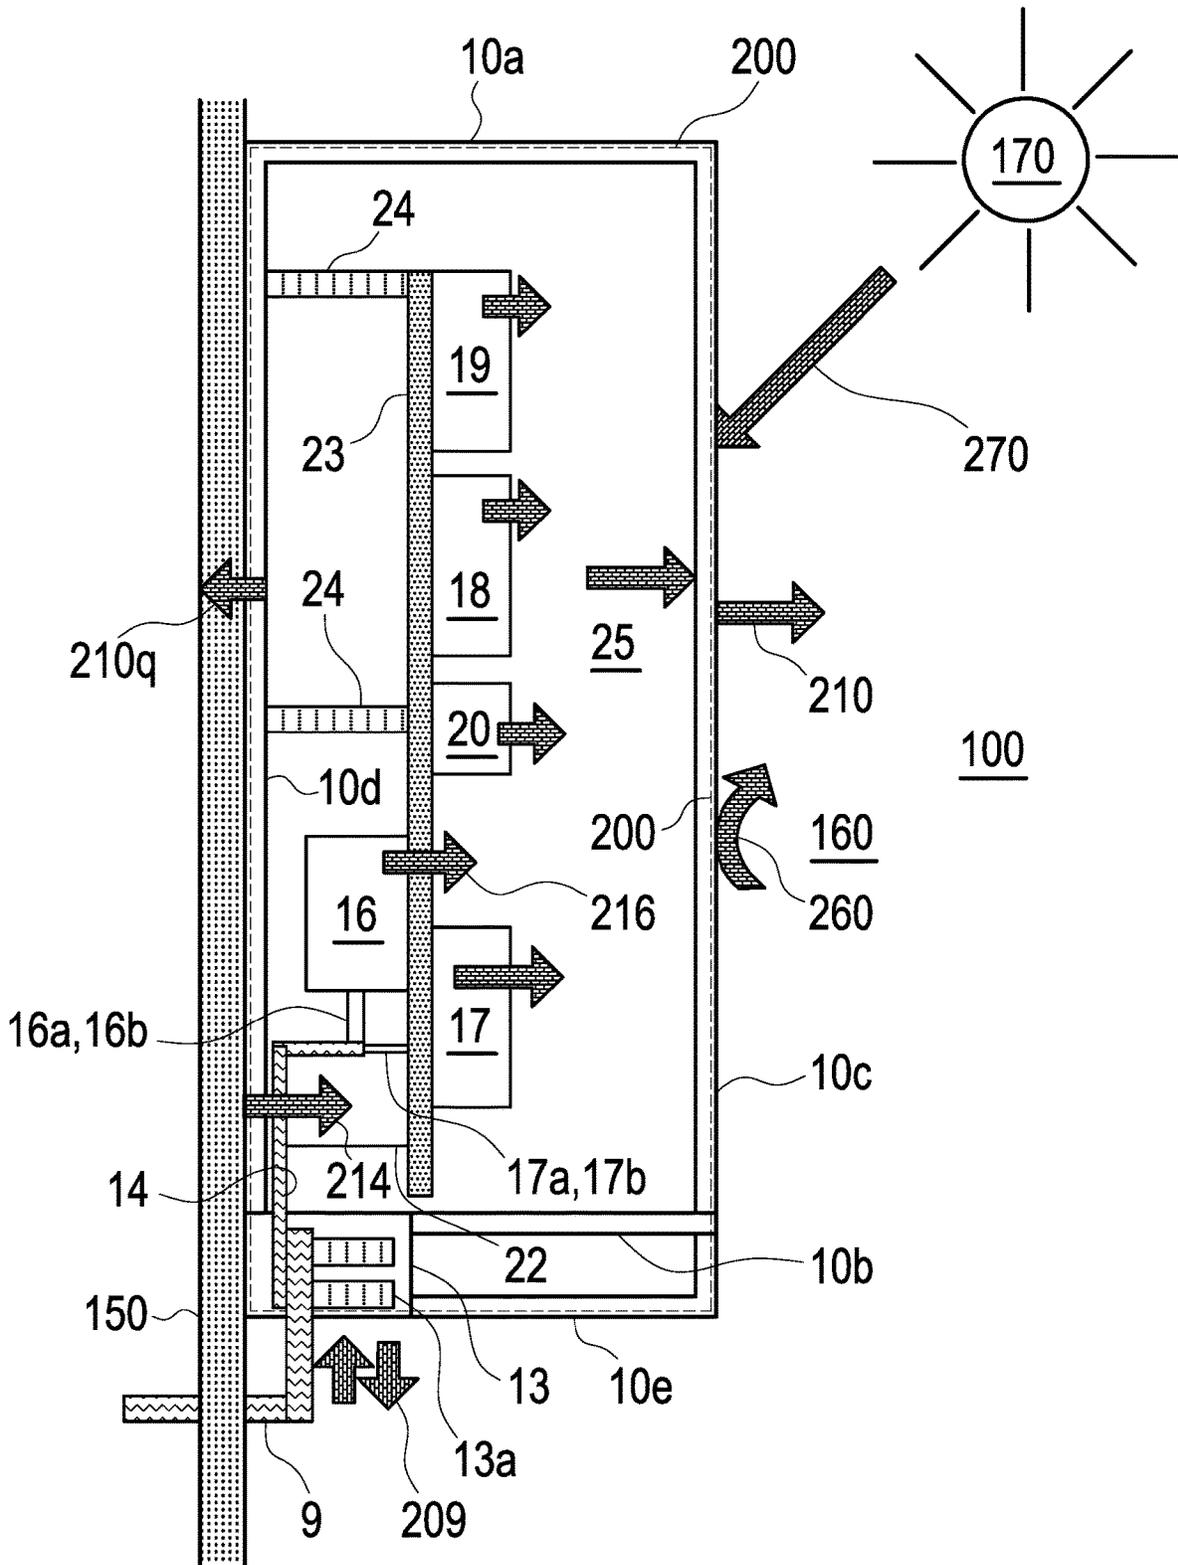


Fig. 2

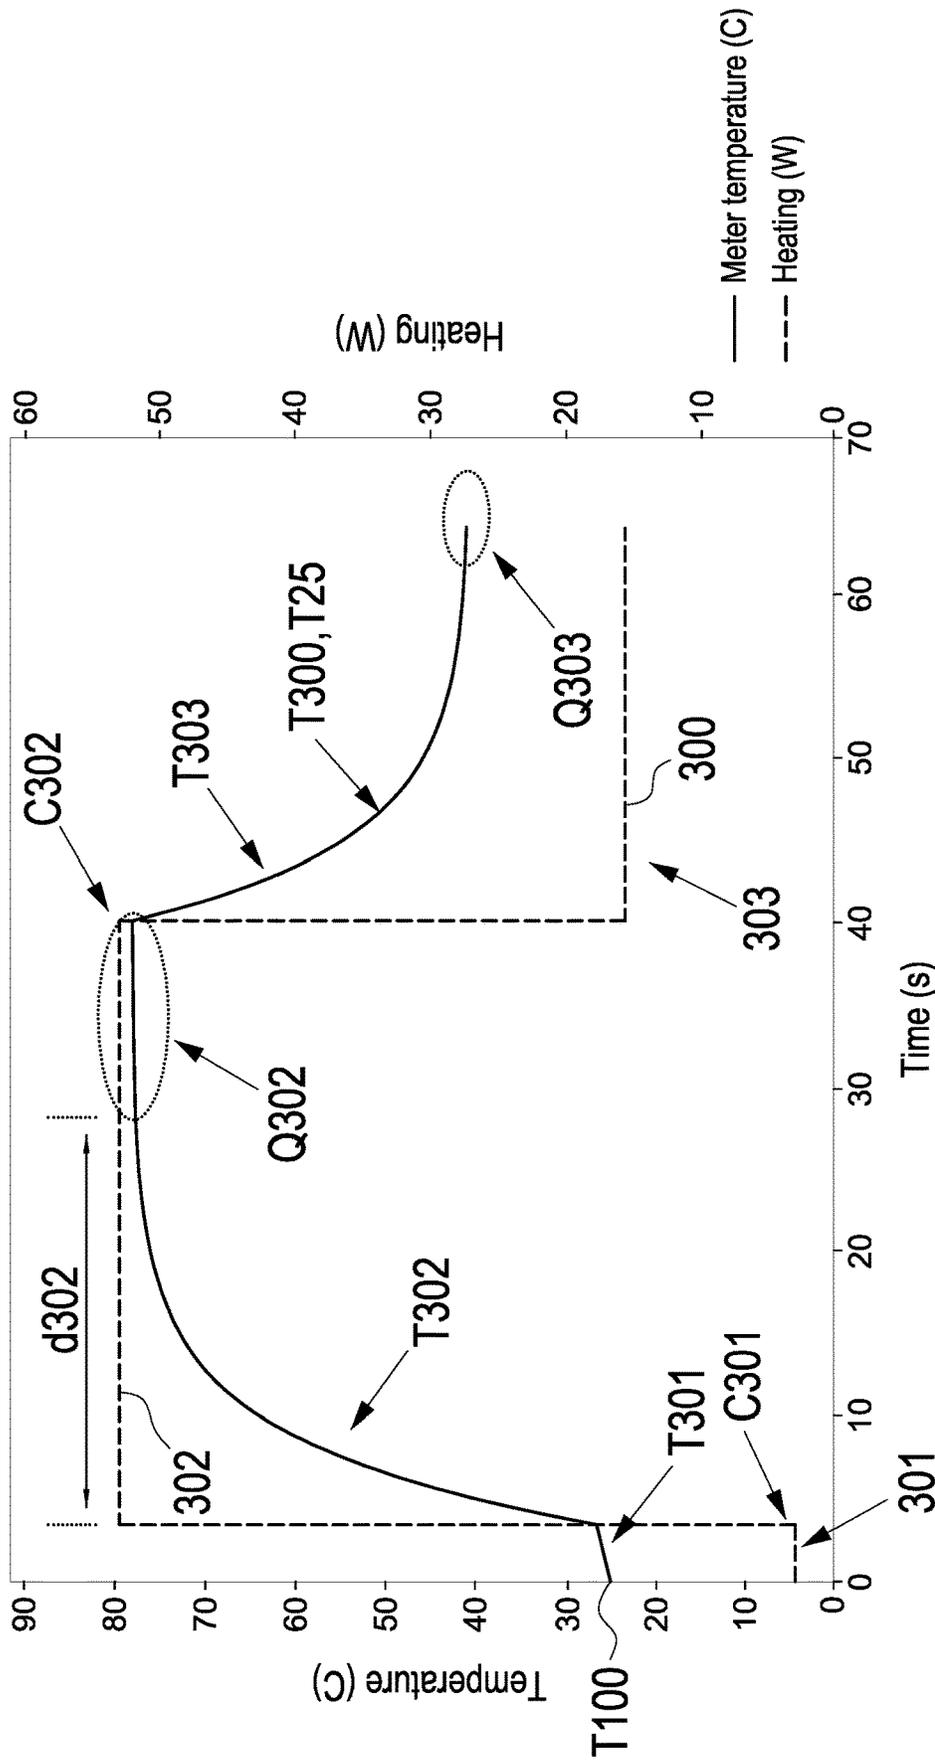


Fig. 3

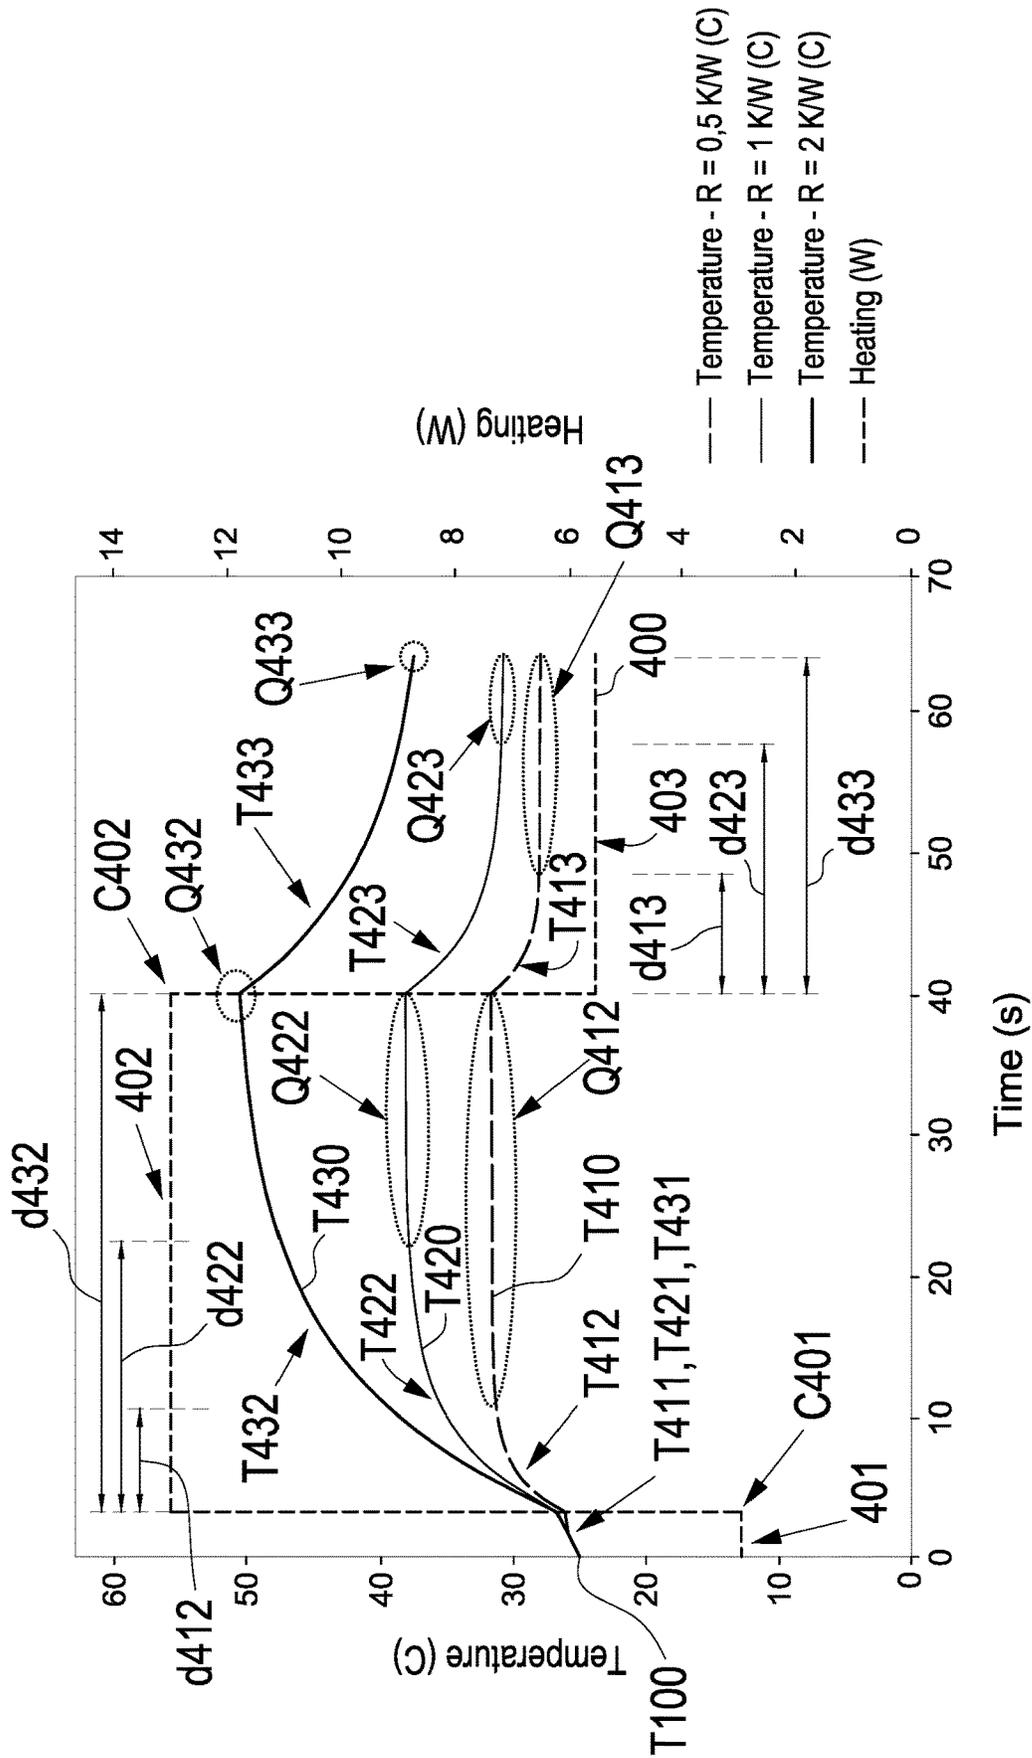


Fig. 4

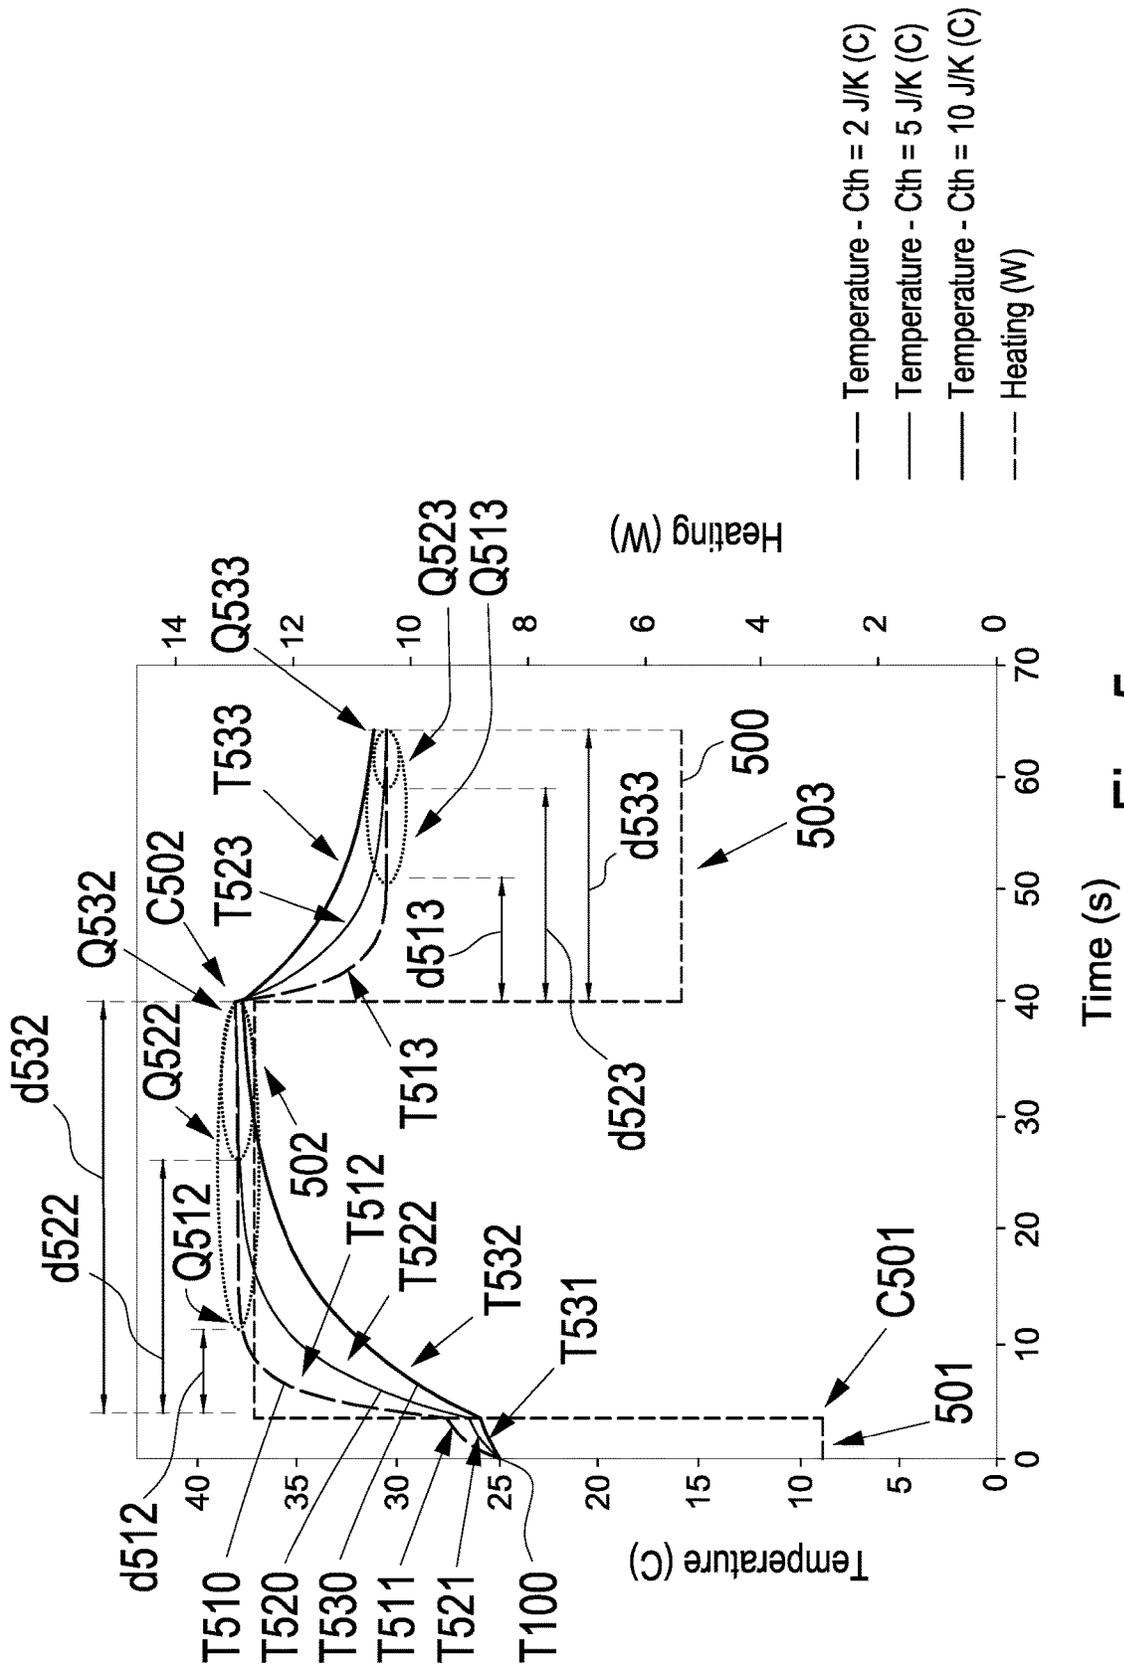


Fig. 5

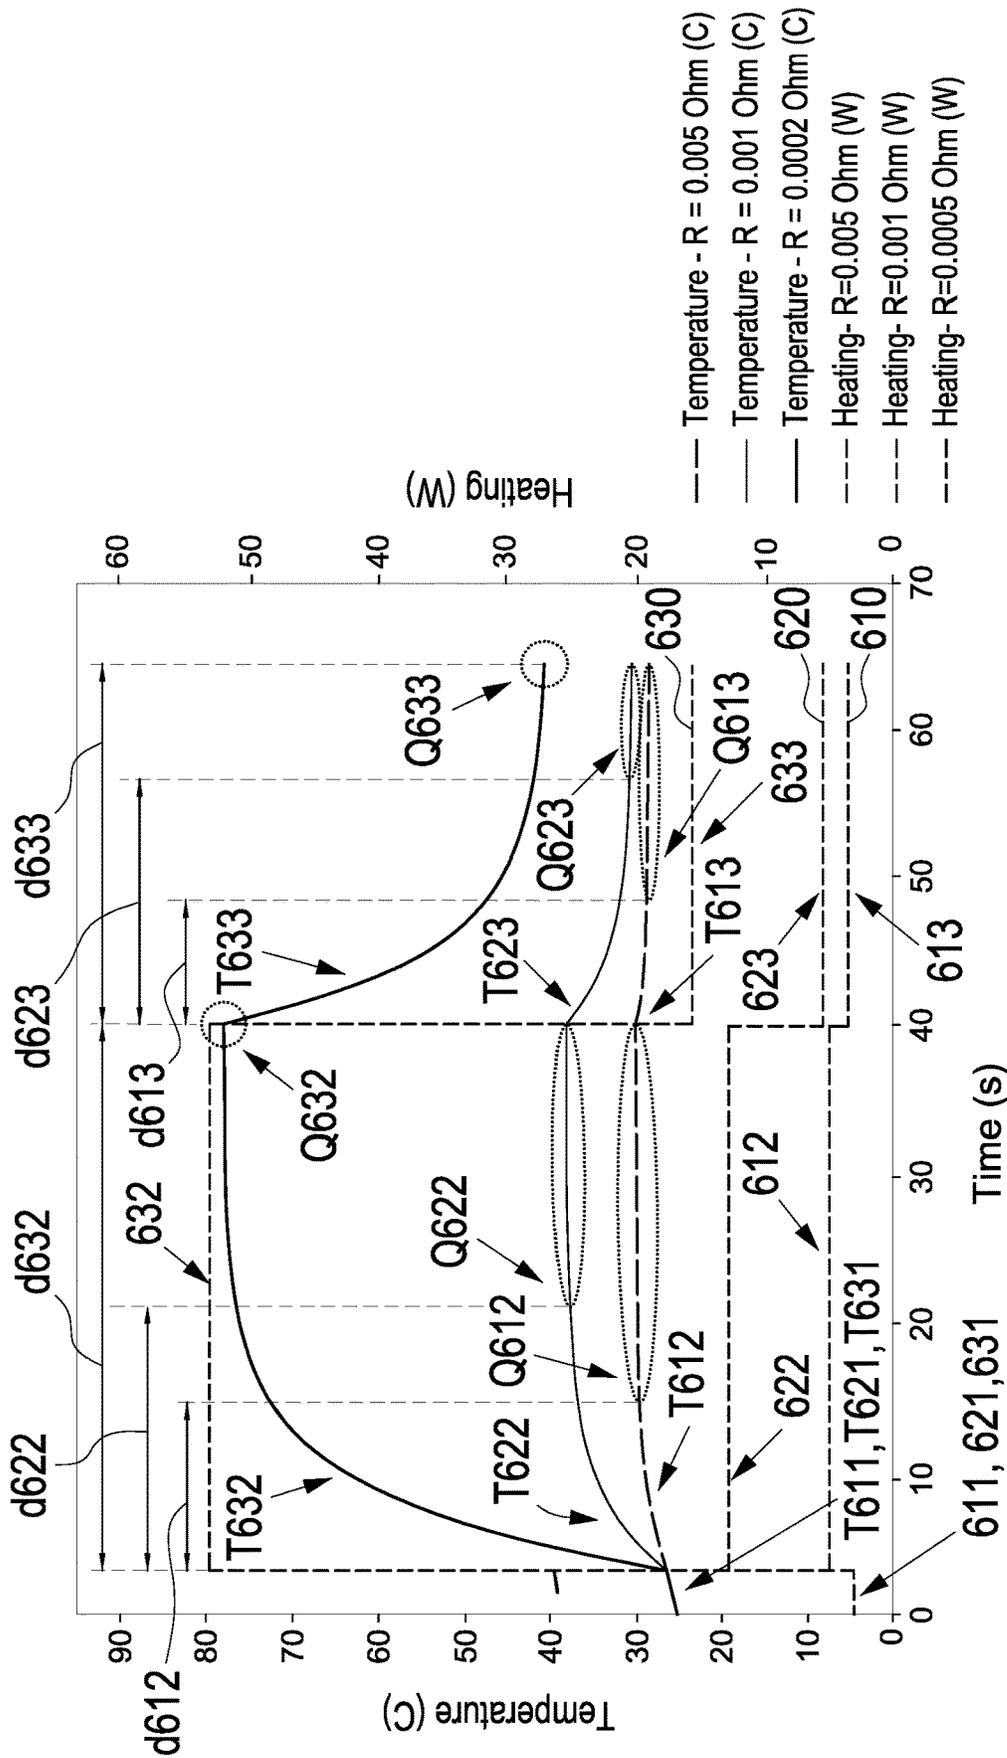


Fig. 6

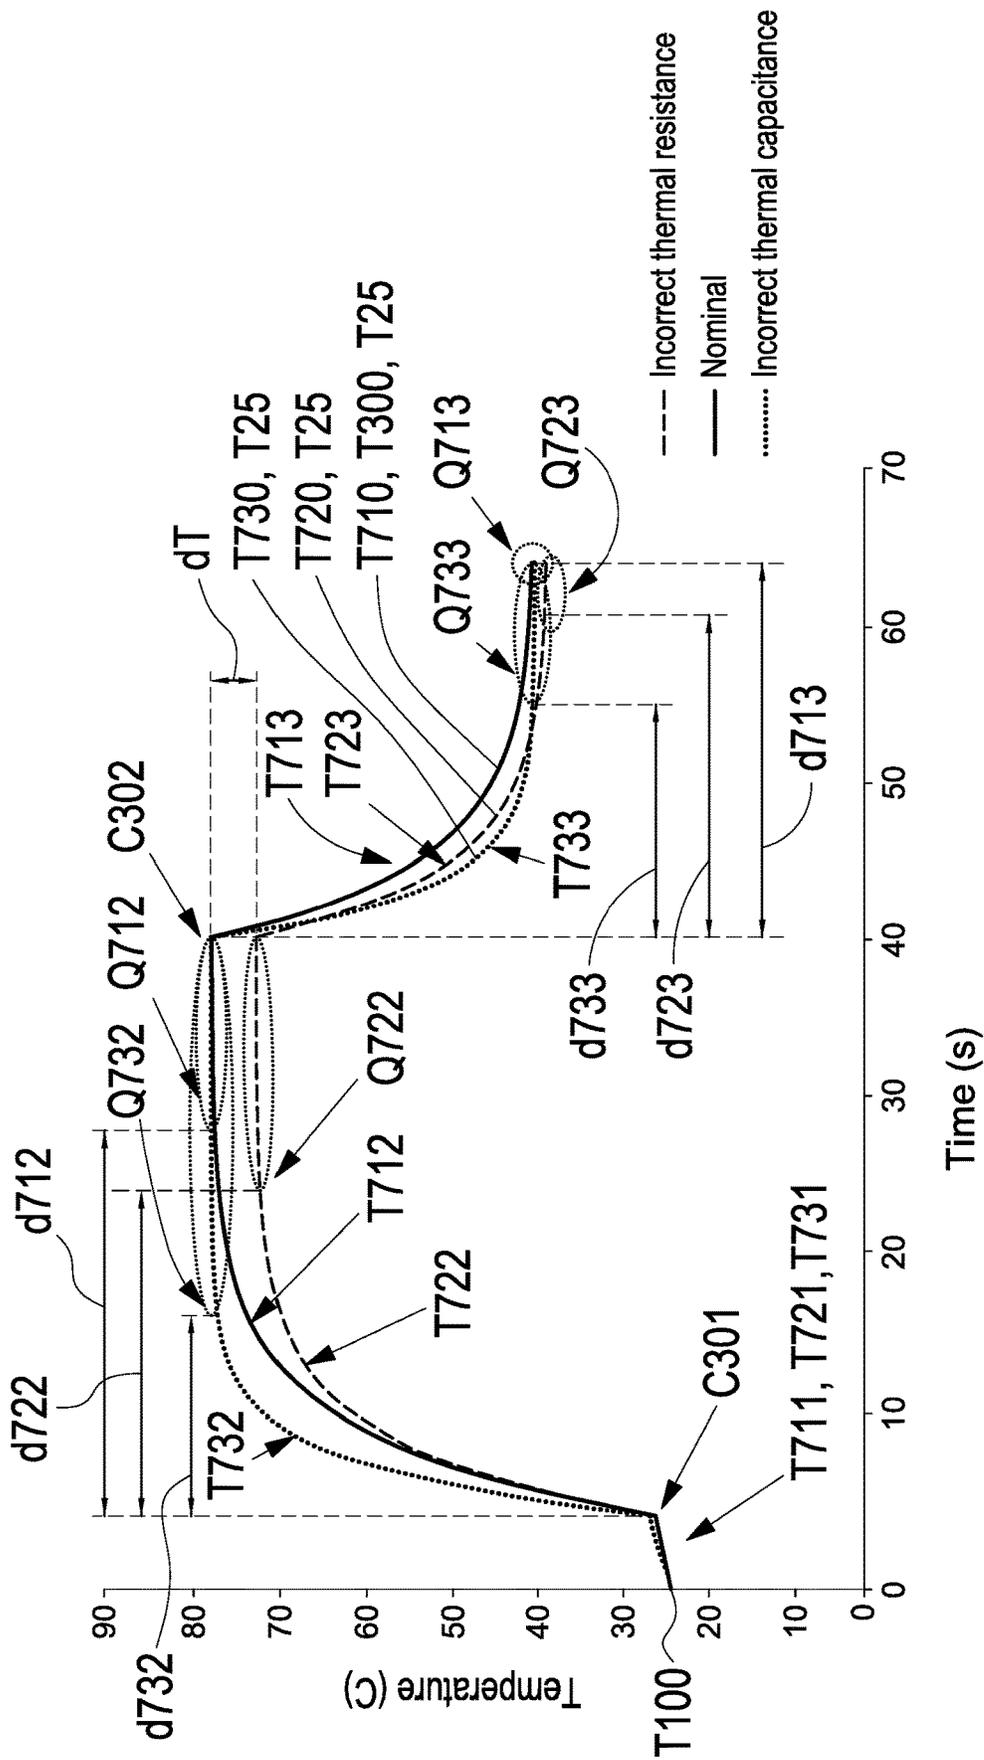


Fig. 7

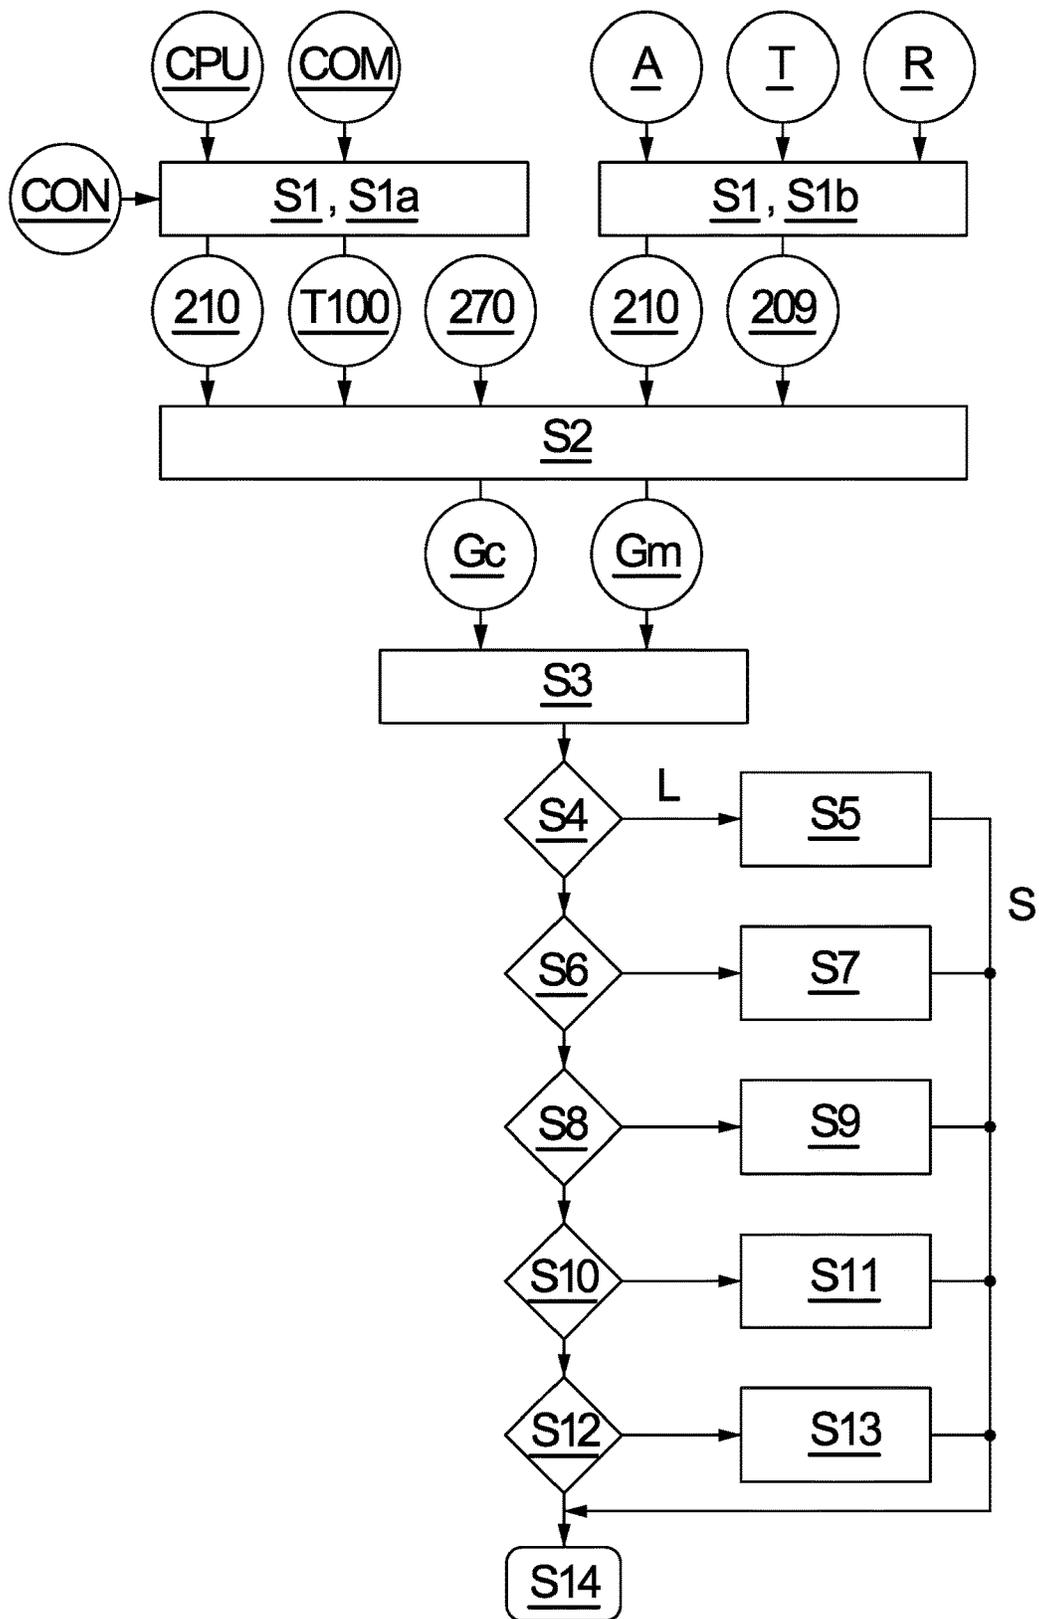


Fig. 8

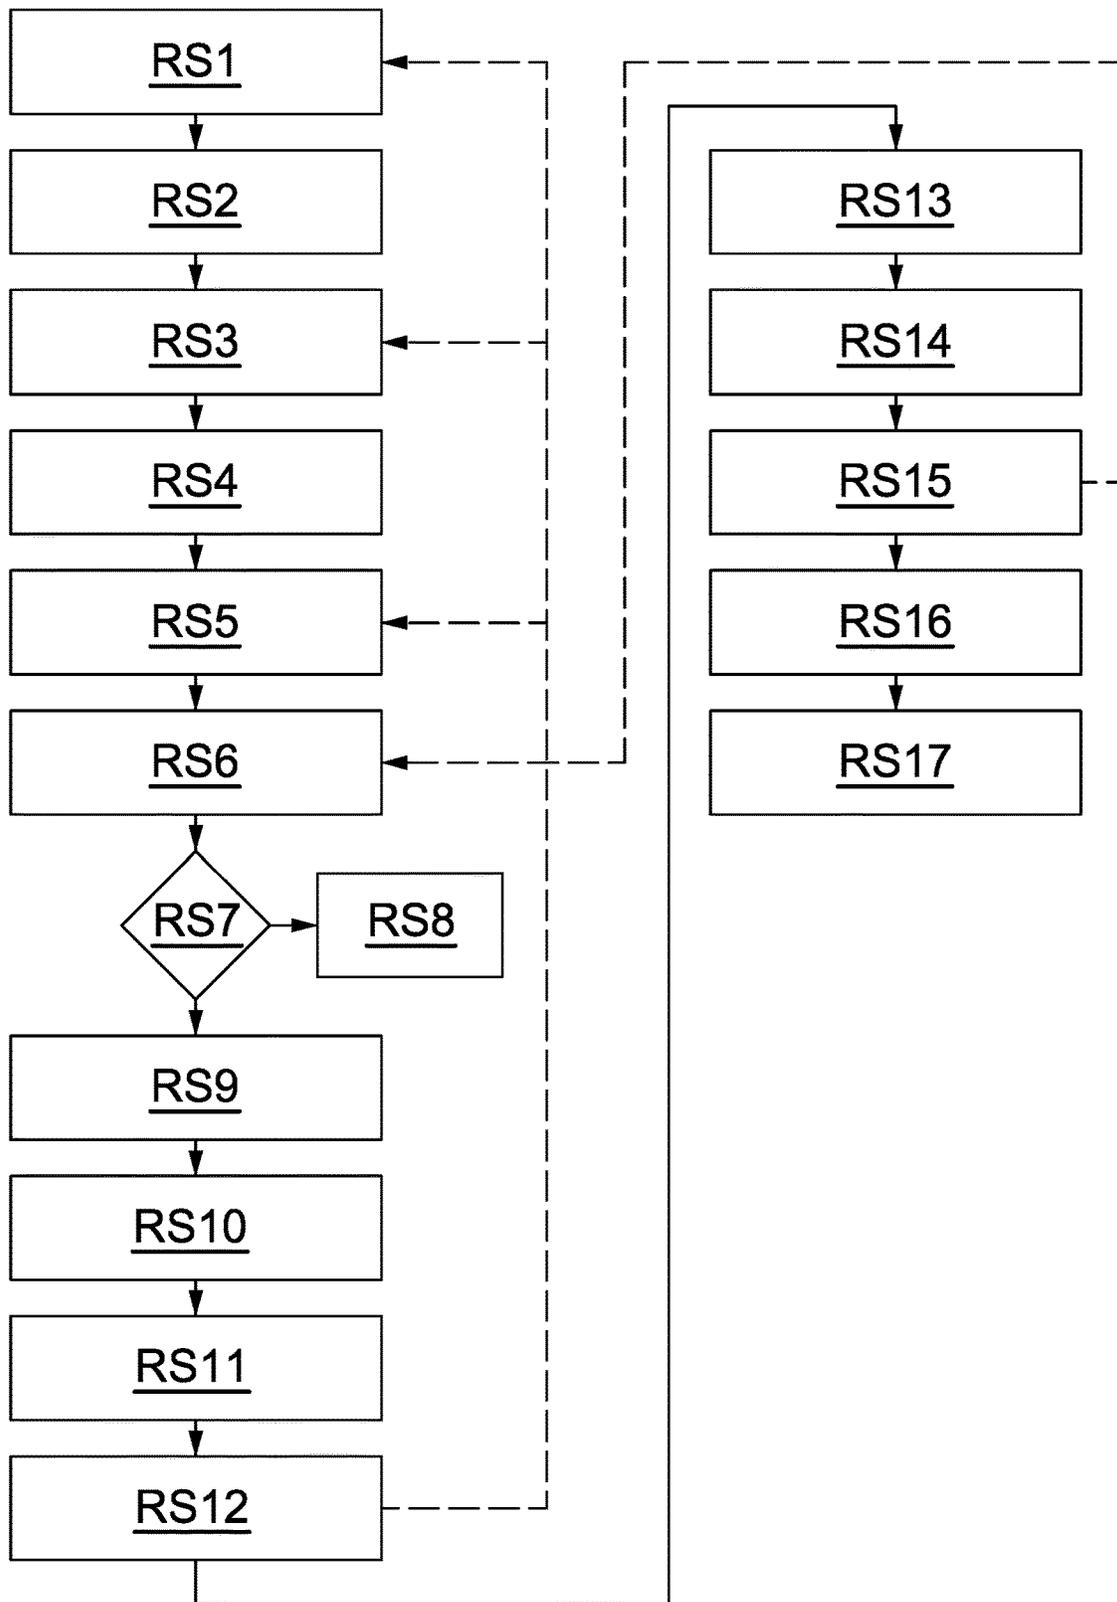


Fig. 9

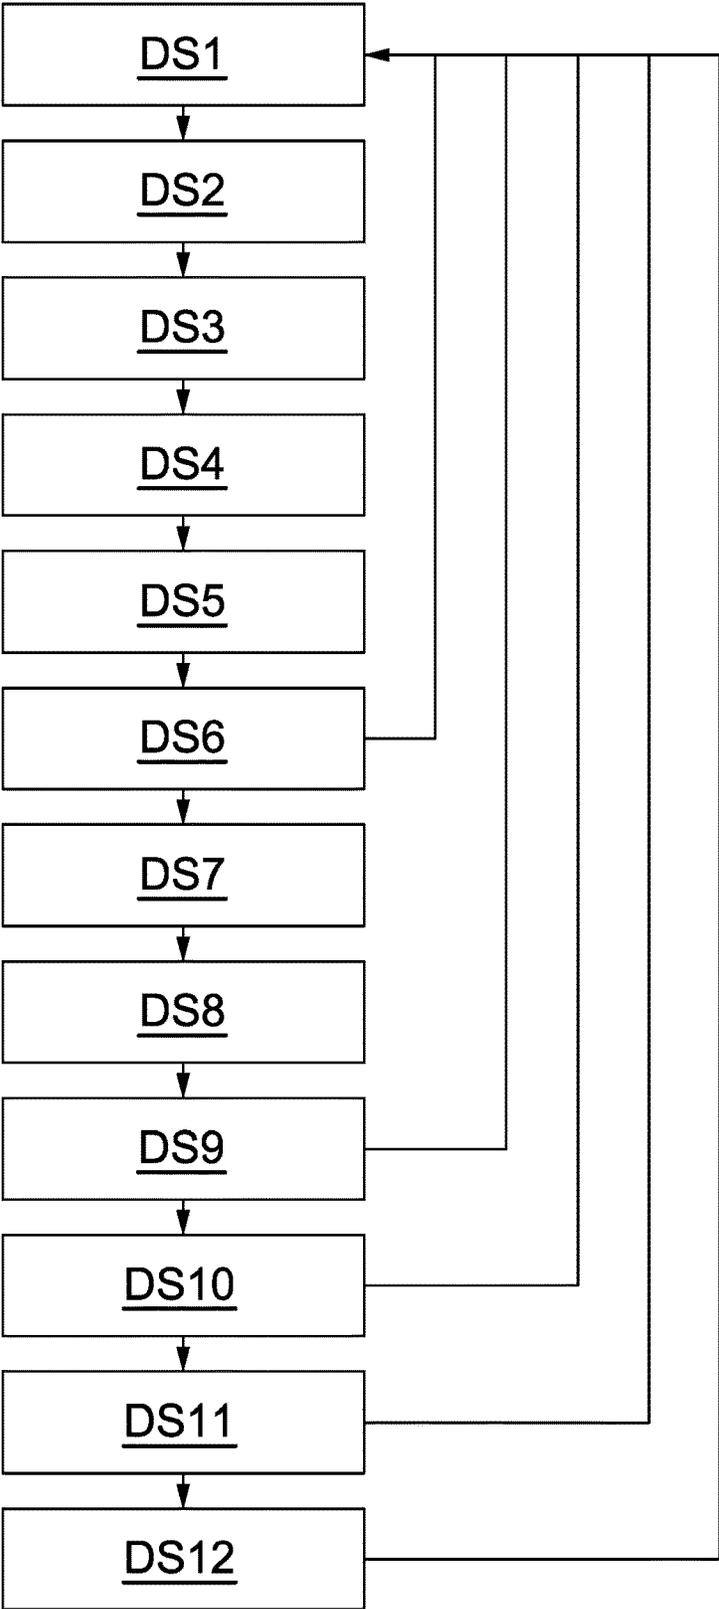


Fig. 10

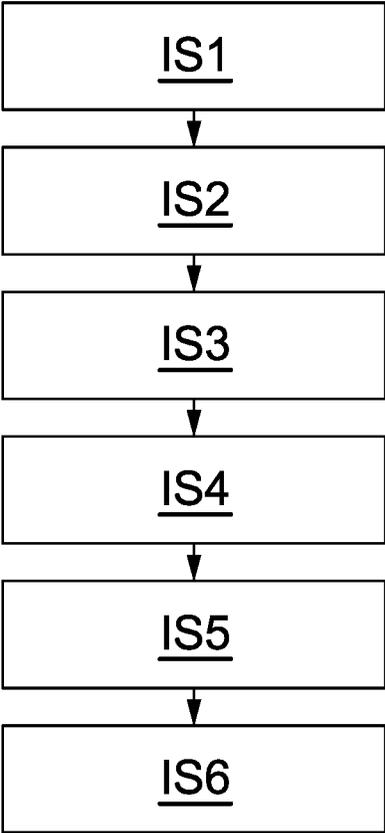


Fig. 11

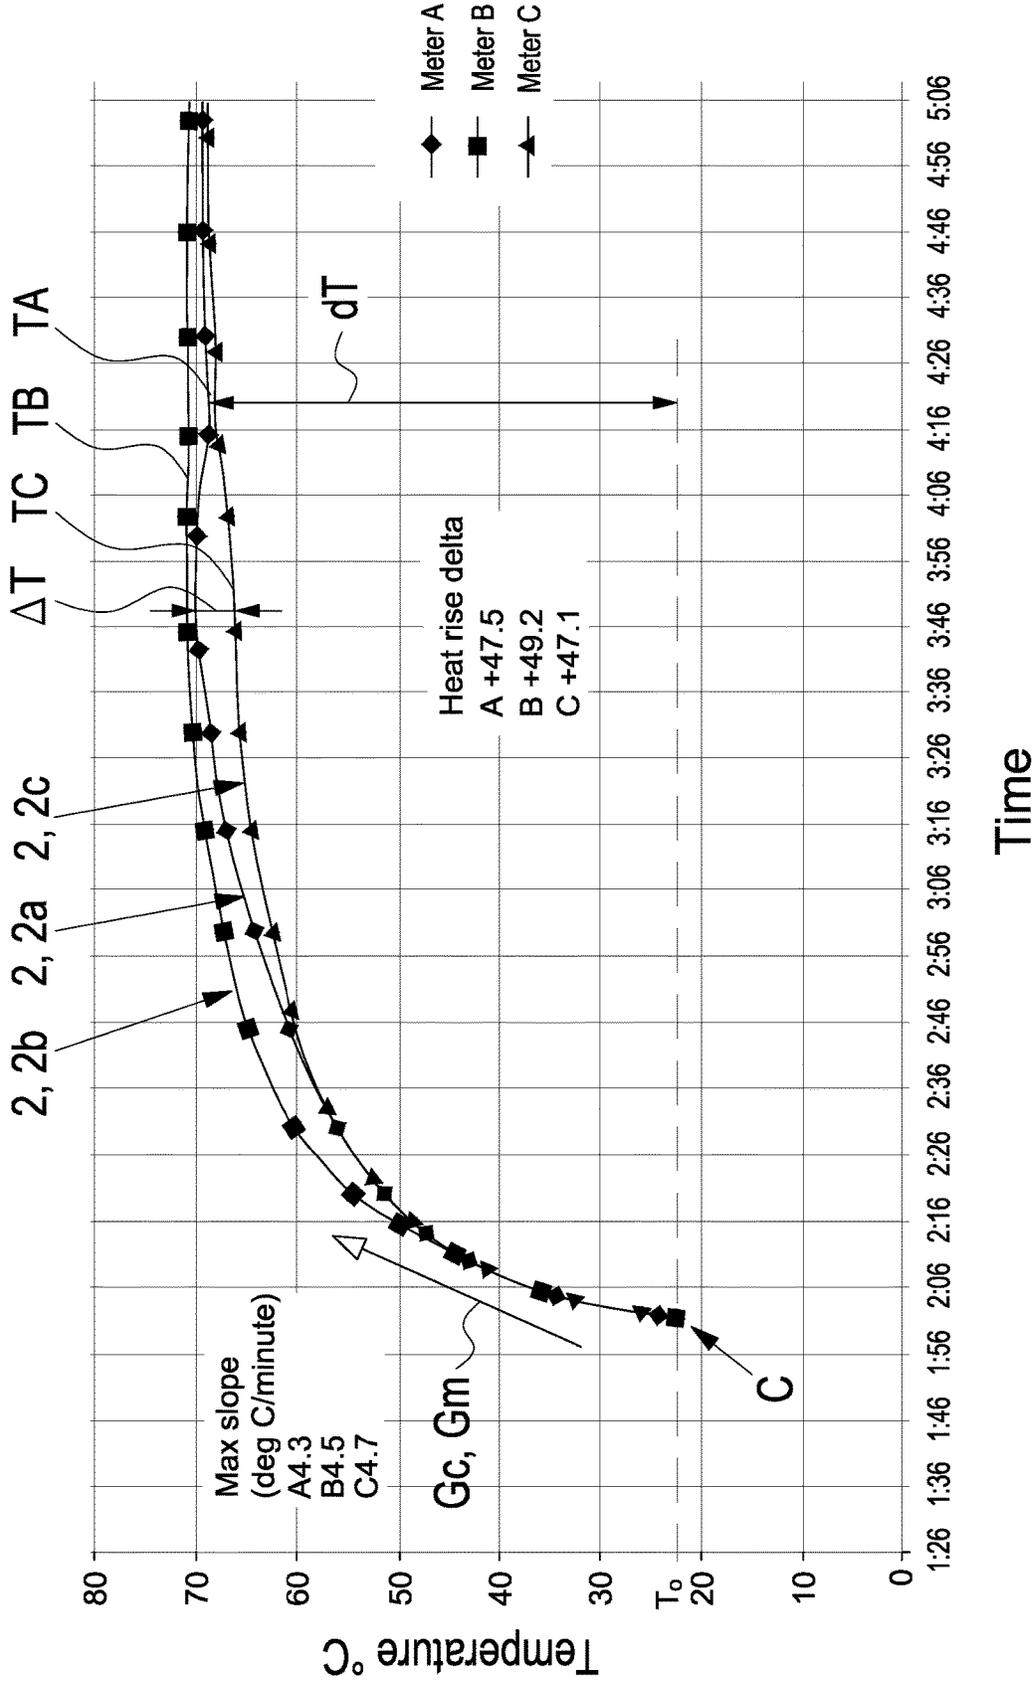


Fig. 12

ELECTRICITY METER THERMAL PERFORMANCE MONITORING

The present invention relates to a method of monitoring a functional state of an electricity meter. Further, the present invention relates to a computer program for monitoring a functional state of an electricity meter. Furthermore, the present invention relates to a computer-readable data carrier having stored thereon a computer program according to the present invention, and to a data carrier signal carrying a computer program according to the present invention. Moreover, the present invention relates to an electricity meter configured to carry out the computer program according to the present invention. Finally, the present invention relates to an electricity metering system, in particular an Advanced Metering Infrastructure (AMI), comprising at least one electricity meter according to the present invention.

TECHNOLOGICAL BACKGROUND

Methods for monitoring functional states of electricity meters are known from the prior art. Such methods are commonly used for monitoring, whether an electricity meter is functioning properly. In particular, faulty conditions of electricity meters should be identified in order to prevent hazardous events. Faulty conditions may occur, e.g. by self-heating of the electricity meter due to overload or malfunction in micro-electronic circuits of the electricity meter, due to excessive current flow or malfunction in a main internal busbar and associated electrical terminals of the electricity meter, or due to environmental impacts on the electricity meter, such as excessive temperatures in the surroundings of the electricity meter, which may be caused by sunlight or other heat sources, such as pipes of heating systems, or alike.

WO 2013 006901 A1 on behalf of the applicant of the present invention describes a method and apparatus for monitoring the condition of a utility meter by obtaining a temperature value associated with the meter, determining whether the temperature value crosses a threshold, triggering an action if the threshold value is crossed. In another form the temperature can be used as a fault parameter to determine the condition of a utility meter.

WO 2016 066373 A1 on behalf of the applicant of the present invention relates to a method of determining a reduction of remaining service lifetime of an electrical device during a specific time period. A measurement system is provided comprising a temperature measurement device, a current measurement device and a voltage measurement device. A temperature value, voltage values and current values are measured by using the measurement device. A harmonic load is determined based on the current values. A reduced maximum operating temperature is determined based on the harmonic load. An amount of transient over-voltages is determined based on the voltage values. A transient aging factor is determined based on the amount of transient over-voltages. A temperature dependent aging factor is determined based on the temperature value and the reduced maximum operating temperature. Finally, the reduction of remaining service life is determined based on the specific time period, the transient aging factor and the temperature dependent aging factor.

Furthermore, U.S. Pat. No. 6,847,300 B2 describes an electric power meter including a temperature sensor and a controller. The controller is operable, based on the temperature reported from the temperature sensor, to generate alarm(s) when the temperature exceeds certain alarm thresh-

old(s), and to activate a power disconnect switch, thereby shutting off power to customer premises, when the temperature exceeds a shut off threshold. The controller is operable to activate the power disconnect switch for non-payment of electricity cost, subject to secondary criteria based on regulatory requirements. A customer terminal may be used to notify a customer of an alarm condition, to provide information regarding electrical power usage or to provide information regarding disconnection of electrical power.

EP 1 980 862 A2 describes a meter having an interface that is connected to a temperature sensor, i.e. temperature-dependent resistor, by a wireless transmission circuit. A processor includes a saving unit for saving temperature data into a memory at pre-set time intervals or based on events registered in the processor, where the temperature data are provided with time information. The processor produces an alarm signal, which is applied to an interface or an interface contact, if a maximum temperature value is exceeded.

U.S. Pat. No. 7,716,012 B2 deals with a process monitoring method that aggregates monitoring devices and optionally sensors into one or more groups that are each related to a process of a utility system. The monitoring devices are organised into a monitoring system hierarchy manually or automatically. A process algorithm determines from the hierarchy which monitoring devices are connected to a load. Monitored data from load-connected monitoring device pairs are correlated to produce a correlation coefficient that is compared against a correlation threshold selected between 0 and 1. When the correlation coefficient exceeds the threshold, the device pair is grouped into a process group. Other device pairs exceeding the threshold are likewise grouped into the process group. Multiple processes may be determined with the process algorithm. Sensors may also be grouped manually with the process group containing monitoring devices, which may include virtual monitoring devices. Alarms associated with monitoring devices and sensors are aggregated into one process alarm.

Methods for monitoring functional states of electricity meters according to the prior art have the disadvantage that they rely on the assessment of temperature differences and gradients with respect to certain pre-defined thresholds. This renders known methods as well as devices and systems implementing such methods rather inflexible.

DESCRIPTION OF THE INVENTION

An object of the present invention is to solve or at least mitigate disadvantages of methods for monitoring functional states of electricity meters according to the prior art. In particular, it is an object of the present invention to provide a method for monitoring functional states of electricity meters as well as respective devices and systems therefore, which may be easily adapted to respective operating conditions.

This object is achieved by method, computer program, computer-readable data carrier, data carrier signal, electricity meter, and electricity metering system according to independent claims 1, 12, 13, 14, 15, and 16, respectively.

In particular, according to the present invention, the object is achieved by a method of monitoring a functional state of an electricity meter, in that the method comprises the steps of:

- generating at least one temperature signal from which an actual temperature value of the electricity meter can be derived;
- determining whether the actual temperature value and/or a gradient thereof exceeds at least one threshold value

derived from at least one predefined temperature curve representing predefined temperature values of the electricity meter over time according to a modelled thermal behaviour of the electricity meter.

With a computer program for monitoring a functional state of an electricity meter, the object is achieved in that the computer program comprises instructions which, when the computer program is executed by an electricity meter and/or an administration device in an electricity metering system, cause the electricity meter and/or the administration device to carry out the steps of a method according to the present invention.

A computer-readable data carrier according to the present invention has stored thereon a computer program according to the present invention.

A data carrier signal according to the present invention is carrying a computer program according to the present invention.

An electricity meter according to the present invention achieves the object in that the electricity meter is configured to carry out a method according to the present invention.

The object is achieved by an electricity metering system, in particular an AML, in that the metering system comprising at least one electricity meter according to the present invention and/or at least one administration device configured to carry out a method according to the present invention.

These solutions according to the present invention have the advantage over monitoring technologies known from the prior art that not only temperature differences and gradients with respect to certain pre-defined thresholds are monitored, but an additional dimension is added to the monitoring process in that temporal effects of temperatures relating to operational states and conditions of electricity meters are considered. In other words, according to the present invention, a dynamic behaviour of temperature values and/or temperature gradients is monitored as they are based on temperatures curves as functions of time in correspondence with a respective thermal behaviour of a certain type of electricity meter, rather than merely monitoring whether temperatures values or temperature gradients exceed certain nominal values according to the prior art. Thereby, the present invention allows for early detection of overheating in an electricity meters, and potentially other electronic devices, due to fault conditions.

By using at least one temperature curve according to the present invention, a change of the respective temperature value can be monitored over time according to an individual performance of an electricity meter as it may change over time, instead of assuming general or common performance parameters of electricity meters as done according to the prior art. The present invention allows for considering certain timespans of the course of temperature values and/or temperature gradients to be monitored, and thus allows to adapt the threshold values according to certain events, load conditions, operational conditions, and/or environmental conditions of the electricity meter within these time spans.

Thereby, on the one hand, the solutions according to the present invention enable to increase accuracy of the monitoring in that the dynamic consideration of predefined temperature curves allows for setting tighter thresholds for temperature values and/or gradients than possible with static thresholds as used according to the prior art. On the other hand, the solutions according to the present invention enable to increase accuracy of the monitoring in that the thermal behaviour itself and thus the at least one predefined temperature curve may be readjusted over time, thereby providing moving or rolling thresholds or limits for respective

temperature values and/or temperature gradients in a manner like moving means or averages are applied to time series of data points. Thus, flexibility and adaptability of the monitoring process are enhanced.

The solutions are not limited to monitoring electricity meters themselves but are also directed to a detection of faulty electrical lines or cabling connected to electricity meters. Such conditions can occur, when fixing elements, such as screws, in electrical terminals to which the electrical lines are attached, are overtightened, not tightened well enough, or an insulation of the electrical lines is not removed properly. In case of overtightening, the electrical lines may be damaged e.g. such that their diameter is significantly reduced, and/or their strands are disrupted. In case of not well enough tightened or stripped electrical lines, the contact area between the line and the terminal can be significantly reduced. Both cases may result in high resistance contacts, which can cause an overheating that can be detected by solutions according to the present invention.

The solutions according to the present invention can be combined as desired and further improved by the following embodiments that are advantageous on their own in each case. Unless specified to the contrary, the embodiments can be readily combined with each other. A skilled person will easily understand that all apparatus features of devices and systems according to the present invention may as well be implemented as and/or constitute steps of a method and/or computer program according to the present invention and vice versa.

In a possible embodiment of method according to the present invention, the method further comprises the step of generating a trigger signal if the actual temperature value and/or a gradient thereof exceeds the at least one threshold value. The trigger signal may be used to influence the operational state or operational conditions of the electricity meter, and may be further used to signalise a faulty state of the electricity meter, e.g. by creating an error signal.

For example, the operational state may be influenced by switching off an electrical load applied to the electricity meter, in order to reduce heat generation within and/or around the electricity meter. An operational condition of electricity meter may be influenced for example by providing an interior and/or exterior heat sink for the electricity meter, e.g. in the form of a cooling fan, in order to lower an actual temperature within and/or around the electricity meter to a desired value. Respective signals representing the change in the operational state and/or operational condition, as well as error signals may be logged within the electricity meter and/or send to a higher instance administration device, such as a data concentrator or Head-End System (HES) of an electricity metering system, in order to be processed and made available for data analysis and decision-making. Alternatively, or additionally, the electricity meter may send or receive information to or from a higher instance device, respectively, such as instructions for changing the operational state or operational conditions, the adjustment of temperature curves and/or threshold values, or alike. This helps in further improving flexibility and accuracy of monitoring functional states of electricity meters.

Moreover, a derivation and/or adaptation of threshold values for triggering signals according to the present invention helps in improving reaction time in solutions for monitoring functional states of electricity meters in comparison to the prior art. According to the prior art, thresholds are set such that they allow for detecting a worst-case thermal perform for a normally functioning meter, and hence, triggering signals will not be generated until a worst case

normal condition is exceeded. In contrast to that, according to the present invention, varying thresholds are being continually computed for any given instant in time. Thus, the present invention allows for detecting a fault condition sooner as the prior art, when a measured performance of the electricity meter exceeds an expected performance for a given set of operational parameters of the electricity meter.

In a possible embodiment of a method according to the present invention, the method further comprises the step of adjusting the at least one temperature curve and/or to select the temperature curve from a set of predefined temperature curves according to a certain operational state and/or according to a certain operational condition of the electricity meter. Adjustment of the at least one temperature curve may involve calculating intermediate values between two adjacent predefined temperature curves. Different operational states may include various modes of operating the electricity meter, for example whether the electricity meter is in an idle mode, a standby mode, a standard mode, a data receiving and/or sending mode, a data processing mode, a firmware update mode, or alike. Different operational conditions may also include different environmental conditions of electricity meter, in particular an ambient temperature, airflow, and/or thermal radiation in the surroundings of the electricity meter.

Operational states may further be distinguished from faulty states of the electricity meter, such as when an error in hardware and/or software of the electricity meter occurs. In distinguishing the operational states from the faulty states, the functional state of the electricity meter may be assessed. By adjusting the at least one temperature curve and/or selecting the temperature curve from a set of predefined temperature curves, the determination of whether a threshold value is exceeded, can be based on a specific temperature curve representing a respective operational state and/or respective operational conditions. Threshold values for determining, whether the electricity meter has entered a faulty state can be adjusted accordingly. This helps in further improving accuracy and reliability of the monitoring of functional states of the electricity meter.

In a possible embodiment of a method according to the present invention, the method further comprises the step of identifying at least one point of interest in the at least one temperature curve. Points of interest may relate to certain operational conditions of the electricity meter, such as a steady state, load changes, heating or cooling conditions and large variations in thermal energy generation. In defining the points of interest, specific thermal behaviours of the electricity meter may be closely monitored, such as by an increased density of predefined temperature values of the at least one predefined temperature curve and/or an increased rate of sampling temperature signals, which helps to better define and detect certain thermal phenomena in a differentiated manner. Thereby, accuracy and reliability of the monitoring of the functional state of the electricity meter can be further improved.

In a possible embodiment of a method according to the present invention, an electrical resistance in a primary current path within the meter is associated to the at least one predefined temperature curve and/or derived from the actual temperature value and/or gradient thereof. The primary current path may comprise a bus bar a shunt, a switch or alike. The electrical resistance in the primary current path determines heat generation along the primary current path according to a respective electrical load on the primary current path. Hence, in associating the at least one predefined temperature curve to an electrical resistance in the primary current path, the at least one predefined temperature

curve may become a function of the electrical load on the primary current path under the respective electrical resistance. The actual temperature value and/or gradient thereof can be used to determine the electrical resistance of the primary current path. Thereby, critical electrical resistances of the primary current path may be identified. This helps in further improving accuracy and reliability of the monitoring of functional states of electricity meters, since temperature abnormalities in high current mains connected devices, such as overheating, may be a first indicator of a fault that could lead to fire or device disintegration.

In a possible embodiment of a method according to the present invention, the method further comprises the step of establishing at least one thermal model for modelling the thermal behaviour of the electricity meter, the at least one thermal model comprising the at least one predefined temperature curve. Such a thermal model may be implemented in any kind of computer software, such as a firmware of an electricity meter and/or an operating software of an administration device in an electricity metering system. The thermal model is used to model thermal behaviour of the electricity meter or any other electrical device and may comprise one or more thermally active elements or components of the electricity meter, the thermal behaviour of which is modelled in order to estimate power dissipation and therefore the amount of heating due to both micro-electronic circuits and heating due to current flow in main current paths. Machine learning may then be applied to the output of the model to tune configuration parameters of the thermal model in order to adapt the thermal model to certain operation conditions and operational states of the electricity meter.

For example, input parameters of the thermal model comprise the following:

- heating due to heat generation in micro-electronic circuits;
- heating based on current flow and resistance in a primary current path
- heating due to ambient environment, e.g. other heat generating installations or devices in the vicinity of the electricity meter, or direct sunlight shining onto the electricity meter;
- currently measured absolute actual temperature or temperature gradient; and/or
- estimated (or measured) external ambient temperature.

For example, output parameters of the thermal model comprise the following:

- predefined Temperatures, temperature gradients and/or temperature curves; and/or
- time spans until the electricity meter or thermally active elements or components thereof reach points of interest in the temperature curves, such as certain thermal states, e.g. steady states or alike.

Such outputs of the thermal model are preferably continuously calculated, for example every tenth of a second, every second and/or every minute. Due to variability in estimated input parameters, the thermal model may be calculated multiple times with different possible minimum and maximum values to determine a range of possible output parameters. The output parameters may be used to perform certain actions in the course of determining whether the actual temperature value and/or a gradient thereof exceeds at least one threshold value.

For example, based on a comparison between a measured or estimated actual temperature gradient and a predefined temperature gradient, it may be determined whether:

the electricity meter or an element or component thereof has a fault;
 model parameters of thermally active elements or components require adjustment;
 a measured or estimated external ambient temperature require adjustment; and/or
 a temperature sensor requires adjustment.

For example, based on a comparison between a measured or estimated actual temperature value and a predefined temperature value, it may be determined whether:

the electricity meter or an element or component thereof has a fault;
 model parameters of thermally active elements or components require adjustment;
 a measured or estimated external ambient temperature requires adjustment; and/or
 a temperature sensor requires adjustment.

For example, when the electricity meter is in a steady state with a low load condition, it may be determined whether:

model parameters of thermally active elements or components require adjustment;
 a measured or estimated external ambient temperature requires adjustment; and/or
 a temperature sensor requires adjustment.

Any deviations or differences between actual values and predefined values, i.e. between model output parameters and measured and/or estimated values of the respective parameters may indicate a modelling error and/or a faulty condition of the electricity meter, and are tracked over time, preferably long term, to determine based on further processing of the parameters, if any kind of trend, pattern or correlation hinting to a specific modelling, software and/or hardware error, can be identified.

In a possible embodiment of a method according to the present invention, upon identification of certain errors, trends, patterns or correlations between the actual temperature value and/or the gradient thereof, and the at least one predefined temperature curve, at least one parameter of the thermal model is automatically adjusted by machine learning.

Preferably, in the course of identification, errors due to faulty conditions are distinguished from incorrectly set configuration parameters or external effects and operating conditions, such as heating from sources outside of the electricity meter. For example, a logic implemented for identifying and distinguishing certain errors, trends, patterns or correlations from each other in a machine learning process to be carried out as a part of a method according to the present invention, may be based on the following:

considering certain astronomical and seasonal effects corresponding to a certain time of day and time of year, respectively;

determining if there is a low load condition;

comparing parameters and values to respective historical parameters and values, in particular transient thermal responses of the electricity meter;

determining if operating states relating to a primary current path have changed, in particular due to changes in a metered electrical load;

determining if operating states relating to microelectronic circuits have changed; and/or

determining if a cooling-off effect is at hand, e.g. due to a drop of electrical load metered and/or applied to microelectronic circuits.

When the process of identifying and distinguishing certain errors, trends, patterns or correlations from each other determination is successful, the machine learning process

will involve adjustment and/or change of parameters of the model in such a way that the respective error or an unwanted trend is reduced.

Whenever a machine learning process is applied, it should be avoided that a respective system carrying out the machine learning process draws false conclusions, i.e. accepts a faulty state or condition as a new norm or reference. False conclusions can be avoided by placing range limits on model configuration parameters. If in the machine learning process, it is attempted to modify a particular configuration parameter beyond its limits, then an exceptional condition is indicated, and/or an alarm condition is raised. Thereby, a machine learning monitoring logic is implemented, which runs in parallel to the primary logic that triggers warnings when the model output errors exceed certain thresholds.

In a possible embodiment of a method according to the present invention, the step of establishing the at least one thermal model includes the step of defining at least one equilibrium state which the electricity meter assumes during operation, the at least one equilibrium state representing a thermal equilibrium of the electricity meter in dependence of at least one electrical load running through the electricity meter, and of environmental conditions existing in an environment of the electricity meter. The at least one equilibrium state may be based on a certain operational state of the electricity meter, e. g. an electrical power condition of the electricity meter based on a certain current flowing through the electricity meter at a certain phase and voltage. Environmental conditions may in particular refer to a temperature in the surroundings of the electricity meter and/or to thermal radiation to which the electricity meter is exposed or which is emitted from the electricity meter. The at least one temperature curve can then be adjusted according to the at least one equilibrium state. In particular, an equilibrium temperature corresponding to the at least one equilibrium state may be identified and/or defined. Threshold values to be monitored may then be defined based on the respective equilibrium temperature. This helps in further adapting the threshold values to respective operational conditions of the electricity meter, and thus to improve flexibility and accuracy of the monitoring of the functional state of the electricity meter.

In a possible embodiment of a method according to the present invention, the step of establishing the at least one thermal model includes the step of defining at least one heating behaviour and/or at least one cooling behaviour of the electricity meter based on at least one step response of the electricity meter to a change in an operational and/or functional state of the electricity meter. Step responses particularly occur when operational conditions of the electricity meter suddenly change, such as when electrical power applied to the electricity meter suddenly rises or falls, either when the electrical load to be measured by the electricity meter changes, or when electronic circuitry of the electricity meter itself performs certain operations, including power on or power off. Accordingly, the at least one heating behaviour commonly relates to a rise in electrical power, whereas the at least one cooling behaviour relates to a drop of electrical power applied to the electricity meter. In considering these behaviours, respective thresholds values to be monitored can be adjusted, which helps in further improving flexibility and accuracy of the monitoring of the functional state of the electricity meter.

For example, the at least one functional step response relates to a change of an electrical load on a bus bar of the electricity meter. The bus bar or collecting bar of the electricity meter carries the electrical power to be metered

and is thus exposed to relatively high maximal currents and voltages. Consequently, the bus bar is a critical component to be monitored, since due to the relatively high loads, failures on the busbar and related terminals can cause hazardous conditions, including overheating, melting, arcing or alike, of respective components, which on the one hand may cause power failures, and on the other hand can ignite fires. Thus, involving changes of the electrical loads on the bus bar in the temperature model helps to further improve accuracy and reliability of the monitoring of the functional state of the electricity meter.

In a possible embodiment of a method according to the present invention, the step of establishing the thermal model involves the step of determining at least one thermal resistance value and/or the step of determining at least one thermal capacitance value of the electricity meter. The at least one thermal resistance value serves for defining temperature differences across the structure of the electricity meter, and to model the thermal behaviour, e.g. a heat sink behaviour, of the electricity meter and its ability to conduct thermal energy as a reaction to being exposed to thermal energy which may be generated on the inside of the electricity meter or in the surroundings thereof. The at least one thermal capacitance value helps to define a thermal mass of the electricity meter, and to model the thermal behaviour thereof, in particular its ability to store thermal energy. The at least one thermal resistance value and/or the at least one thermal capacitance value may be applied to each thermally active element or component of the electricity meter as a respective modelling parameter of the thermal model to be established. Thereby, the at least one thermal resistance value and at least one thermal capacitance value help to refine the thermal model of the electricity meter to provide a precise understanding of the thermal behaviour of the electricity meter and thus generate the at least one predefined temperature curve. Consequently, the at least one thermal resistance value and at least one thermal capacitance value help to further improve accuracy and reliability of the monitoring of functional states of the electricity meter.

In a possible embodiment of a method according to the present invention, the step of establishing at least one thermal model is carried out for at least two different types of operating conditions of the electricity meter and/or at least two different types of electricity meters. The at least two different types of operating conditions may relate to different load conditions and operational states of the electricity meter and/or to different functional states of the electricity meter. In the different load conditions, different electrical loads on the electricity meter may be considered. As mentioned above, different operational states may include various modes of operating the electricity meter, for example an idle mode, a standby mode, a standard mode, a data receiving and/or sending mode, a data processing mode, a firmware update mode, or alike, and may further include different environmental conditions of electricity meter, in particular temperature, airflow, and/or thermal radiation in the surroundings of the electricity meter. Operational states are to be distinguished from faulty states of the electricity meter, such as when an error in hardware and/or software of the electricity meter occurs. This helps in further improving accuracy and reliability of the monitoring of functional states of the electricity meter.

Furthermore, establishing at least one thermal model for at least two different types of electricity meters may involve establishing a general thermal model for the at least two different types of electricity meters. Alternatively, or additionally, an individual thermal model may be established for

each one of the at least two different types of electricity meters. Thereby, common and individual behaviours of electricity meters may be considered when establishing thermal models. On the one hand, this helps in improving accuracy and reliability of the monitoring of functional states of the electricity meter. On the other hand, efficiency in establishing thermal models may be improved.

Based on the at least one thermal model being established for at least two different types of operating conditions of the electricity meter and/or at least two different types of electricity meters, a set of predefined temperature curves may be generated, comprising temperature curves for respective different operating conditions and/or different electricity meters. Each of the predefined temperature curves of the set of predefined temperature curves may represent a specific thermal behaviour of an electricity meter or of different electricity meters under respective operating conditions. Hence, by selecting a predefined temperature curve from the set of predefined to curves, the monitoring of the functional state of the electricity meter may be easily adapted to respective operational conditions as or different types of electricity meters. This helps in further improving flexibility and accuracy of the monitoring of functional states of electricity meters.

BRIEF DESCRIPTION OF THE ACCOMPANYING DRAWINGS

The invention will be described hereinafter in more detail and in an exemplary manner using advantageous embodiments and with reference to the drawings. The described embodiments are only possible configurations in which, however, individual features as described above can be provided independently of one another or can be omitted.

In the drawings:

FIG. 1 shows a schematic diagram illustrating an exemplary schematic architectural illustration of an electricity metering system comprising an electricity meter according to an embodiment of the present invention, the electricity meter being illustrated in a schematic front view;

FIG. 2 shows a schematic cross-sectional side view of an electricity meter according to an embodiment of the present invention in an operating environment of the electricity meter;

FIG. 3 shows an exemplary thermal performance plot of a thermal model according to the present invention for modelling a thermal behaviour of an electricity meter;

FIG. 4 shows an exemplary diagram illustrating effects of thermal resistance in a thermal model according to the present invention for modelling a thermal behaviour of an electricity meter;

FIG. 5 shows an exemplary diagram illustrating effects of thermal capacitance in a thermal model according to the present invention for modelling a thermal behaviour of an electricity meter;

FIG. 6 shows an exemplary diagram illustrating effects of electrical resistance in a primary current path of an electricity meter considered in a thermal model according to the present invention for modelling a thermal behaviour of an electricity meter;

FIG. 7 shows an exemplary diagram illustrating modelling deviations which may occur when establishing a thermal model according to the present invention for modelling a thermal behaviour of an electricity meter;

FIG. 8 shows an exemplary flowchart illustrating steps of establishing a thermal model according to the present invention for modelling a thermal behaviour of an electricity meter;

FIG. 9 shows an exemplary flowchart illustrating steps of a runtime logic of an electricity meter when establishing a thermal model according to the present invention for modelling a thermal behaviour of an electricity meter;

FIG. 10 shows an exemplary flowchart illustrating steps of a design time course thermal model discovery procedure when establishing a thermal model according to the present invention for modelling a thermal behaviour of an electricity meter;

FIG. 11 shows an exemplary flowchart illustrating steps of an installation time course thermal model discovery procedure when establishing a thermal model according to the present invention for modelling a thermal behaviour of an electricity meter; and

FIG. 12 shows an exemplary diagram illustrating actual temperature curves of three different electricity meters to be emulated with a thermal model according to the present invention.

WAYS OF EXECUTING THE INVENTION

FIG. 1 shows a schematic diagram illustrating an exemplary schematic architectural front view of an electricity metering system 1 comprising an electricity meter 2 according to an embodiment of the present invention. The electricity metering system 1 further comprises an administration device 3, such as a data concentrator or Head-End system (HES) in the form of a computer, or alike, for administering and controlling the electricity metering system 1. Control and administration of the electricity metering system 1, in particular of the electricity meter 2 and the administration device 3, is performed with the help of a computer program 4.

The computer program 4 can be provided on a computer-readable data carrier 5 configured to be accessed by the electricity meter 2 and/or the administration device 3. Alternatively, or additionally, the computer program 4 can be provided as being carried on a data carrier signal 6. The data carrier signal 6 or any other kind of data and/or information, can be exchanged between the electricity meter 2 and the administration device 3 via energy and/or information transmission lines 7. The energy and/or information transmission lines 7 may be established in a wired and/or wireless manner. For receiving and sending data and information via the energy and/or information transmission line 7, the electricity meter 1 is provided with a transmission means 8, in the form of a wired or wireless communication line, antenna, or alike. Furthermore, the electricity metering system 1 comprises electrical lines 9 in the form of cables or wires for transmitting electrical power to be metered by the electricity meter 2.

The electricity meter 2 comprises an enclosure 10, in the form of a housing, case, shell or alike, for housing in various components of the electricity meter 1. At a bottom section 11 of the enclosure 10, the electricity meter 2 is provided with electrical terminals 12 for connecting the electrical lines 9 to the electricity meter 2 in an electrically conductive manner. In particular, an active input terminal 12a is configured to be connected to a phase input line 9a, a neutral input terminal 12b is configured to be connected to a neutral input line 9b, an active output terminal 12c is configured to be connected to a phase output line 9c, and a neutral output terminal 12d is configured to be connected to a neutral output line 9d. The

terminals 12 are mounted on a terminal block 13 of the electricity meter 2. The terminal block 13 is held by the enclosure 10 and is formed of a highly insulating material and supports the terminals 12.

A bus bar 14 with high current carrying capacity and low electrical resistance is provided within the electricity meter 2 as a primary current path for conducting electrical loads from the input terminals 12a, 12b to the output terminals 12c, 12d. The bus bar 14 has an active input section 14a, an active linking section 14b, an active output section 14c, and a neutral linking section 14d. The active input section 14a connects the active input terminal 12a to a resistive shunt 15. The active linking section 14b connects the resistive shunt 15 to a supply disconnect switch 16, in particular a switch input line 16a thereof.

The active output section 14c connects the supply disconnect switch 16, in particular a switch output line 16b thereof, to the active output terminal 12c. The neutral linking section 14d connects the neutral input terminal 12b to the neutral output terminal 12d.

A metering unit 17 of the electricity meter 2 comprising metering means in the form of microelectronics is connected to the busbar 14 in the region of the resistive shunt 15 used for measuring current flow through the busbar 14 by converting current to a proportional voltage. In particular, a metering input line 17a of the metering means 17 is connected to the resistive shunt 15 close to where the active input section 14a is connected to the resistive shunt 15. A metering output line 17b is connected to the resistive shunt 15 close to where the active linking section 14b is connected to the resistive shunt 15.

A processing unit 18 of the electricity meter 2 comprises at least one microelectronic primary processor, memory, oscillator and/or supporting circuitry. A communications unit 19 comprises communications microelectronics, such as at least one transceiver or radio transmitter for communication via the transmission means 8. A power supply unit 20 of the electricity meter 2 comprises a power supply circuitry and microelectronics for converting grid supply voltage to voltages suitable for operating internal meter circuitry and components, such as the supply disconnect switch 16, the metering means 17, the processing unit 18, and the communications unit 19.

Temperature sensors 21 are provided for generating temperature signals and/or temperature values. The temperature sensors 21 comprise a remote sensor 21a, external sensor 21b, internal top sensor 21c, internal front sensor 21d, internal back sensor 21e, internal side sensor 21f, terminal region sensor 21g, terminal block sensor 21h, supply line sensor 21i, input section sensor 21j, output section sensor 21k, linking section sensor I, switch sensor 21m, metering unit sensor 21n, processing unit sensor 21o, communications unit sensor 21p, and/or power supply unit sensor 21q.

The remote sensor 21a is arranged and configured to measure an ambient temperature in the surroundings of the electricity meter 2 and is therefore preferably not physically connected to the electricity meter 2 in order to avoid a conductive thermal energy transfer between the remote sensor 21a and the electricity meter 2. The external sensor 21b is arranged and configured to measure an external temperature of the electricity meter 2, in particular of the enclosure 10. The internal sensors 21c to 21f are arranged and configured to measure internal temperatures of the electricity meter 2 at a top wall, a front wall, a back wall, and a side wall, respectively (see FIG. 3), on the inside of the enclosure 10. The terminal region sensor 21g is arranged and configured to measure a temperature in the region near or

around the electrical terminals 12 on the inside of the enclosure 10. The supply line sensor 21*i* is arranged and configured to measure a temperature of the electrical lines 9, in particular of the phase input line 9*a*. The terminal block sensor 21*h* is arranged and configured to measure a temperature of the terminal block 13. The input section sensor 21*j*, output section sensor 21*k*, and linking section sensor 21*l* are arranged and configured to measure a temperature of the busbar 14, in particular of the active input section 14*a*, preferably in the vicinity of the resistive shunt 15, the active output section 14*c*, and the neutral linking section 14*d*, respectively. The switch sensor 21*m*, the metering unit sensor 21*n*, the processing unit sensor 21*o*, the communications unit sensor 21*p*, and the supply unit sensor 21*q* are arranged and configured to measure a temperature of the supply disconnect switch 16, the metering unit 17, the processing unit 18, the communications unit 19, and the power supply unit 20, respectively.

Furthermore, internal conductors 22 of the electricity meter are provided in the form of cables, wires, conducting paths, conductor tracks, strip conductors, or alike, in order to connect the transmission means 8, bus bar 14, in particular the active input section 14*a* and the neutral linking section 14*d* thereof, the supply disconnect switch 16, the metering unit 17, the processing unit 18, the communications unit 19, the power supply unit 20, and/or the temperature sensors 21 to each other, whenever and exchange of information and/or energy between these components and elements of the electricity meter 2 is required. For the sake of lucidity, an explicit illustration of internal conductors 22 connected to the temperature sensors 21 has been omitted in FIG. 1.

FIG. 2 shows a schematic cross-sectional side view of the electricity meter 2 in an operating environment 100 of the electricity meter 2. Here it becomes apparent, that the enclosure 10 of the electricity meter 2 comprises a top wall section 10*a*, a bottom wall section 10*b*, a front wall section 10*c*, and a back wall section 10*d*. Furthermore, the enclosure 10 is provided or complemented with terminal cover 10*e* covering the electrical terminals 12. In the terminal block 13, the electrical terminals 12 are each provided with at least one fixing elements 13*a*, such as a terminal screw, clamp, latch, or alike for fixing the electrical lines 9 to the electrical terminals 12 while establishing in electrical contact between the electrical lines 9 and the busbar 14.

The supply disconnect switch 16, metering unit 17, processing unit 18, communications unit 19, and power supply unit 20 are mounted on a substrate 23, such as a printed circuit board (PCB). The substrate 23 is mounted to the enclosure 10, in particular the back wall section 10*d* thereof, by means of mounting elements 24. The mounting elements 24 may be embodied as mounting pegs, studs, spacer bolts, or alike.

The operating environment 100 typically comprises a mounting structure 150 such as a wall of e.g. a building structure an electric cabinet, or alike, an air mass 160, and external heat sources 170, such as the sun, piping, conducts, exhausts, or alike.

An envelope boundary 200 for defining a thermal balance of the electricity meter 2 with respect to the operating environment 100 is defined in order to establish a thermal model in line with a method according to the present invention. For example, the envelope boundary 200 extends along the walls of the enclosure 10, in particular runs within the top wall section 10*a*, the front wall section 10*c*, the back wall section 10*d*, and the terminal cover 10*e* which enclose an inner space 25 of the electricity meter 2.

With respect to the envelope boundary 200, certain thermal energy flows pertaining to the elements and components of the electricity meter 2 are defined for establishing a thermal model in line with a method according to the present invention. In the present example, the thermal energy flows in the form of negative or positive conduction, convection, and/or radiation heat transfers comprise a heat transfer 209 across the envelope boundary 200 via the electrical lines 9, a heat transfer 210 across the envelope boundary 200 from the enclosure 10 to the air mass 160 and the operating environment 100, a heat transfer 210*d* across the envelope boundary 200 from the back wall section 10*d* to the mounting structure 150, a heat transfer 214 within the envelope boundary 200 from the busbar 14 to the inner space 25 of the electricity meter 2, a heat transfer 216 within the envelope boundary 200 from the supply disconnect switch 16 to the inner space 25 of the electricity meter 2, a heat transfer 217 within the envelope boundary 200 from the metering unit to the inner space 25 of the electricity meter 2, a heat transfer 218 within the envelope boundary 200 from the processing unit 18 to the inner space 25 of the electricity meter 2, a heat transfer 219 within the envelope boundary 200 from the communications unit 19 to the inner space 25 of the electricity meter 2, a heat transfer 220 within the envelope boundary 200 from the power supply unit 20 to the inner space 25 of the electricity meter 2, a heat transfer 260 across the envelope boundary 200 due to convection of the air mass 160, and/or a heat transfer 270 across the envelope boundary 200 from the external heat source 170 to the electricity meter 2.

FIG. 3 shows an exemplary thermal performance plot 300 of a thermal model according to the present invention for modelling a thermal behaviour the electricity meter 2. Based on the thermal performance plot 300, a temperature curve T300, for example representing inner temperature T25 as a temperature of air within the inner space 25 of the electricity meter 2 is determined. In a first phase 301 of the thermal performance plot 300, heat transfers from internal micro-electronic circuits of the electricity meter 2, which for example comprise heat transfers 216, 217, 218, 219, 220 pertaining to the supply disconnect switch 16, metering unit 17, processing unit 18, communications unit 19, and/or power supply unit 20, respectively, amounting to approx. 3 W, and lead to a slow temperature increase T301 starting from an external ambient temperature T100 representing the temperature of the operating environment 100.

At a first step change C301 in the thermal performance plot 300, a sudden rise in heat generation by the bus bar 14 sets in due to a current load of 100 A being applied to the bus bar 14 and associated parts and the primary current path of the electricity meter 2. Thus, in a second phase 302 of the thermal performance plot 300, a rapid temperature increase T302 takes place due to the respective heat transfer 214 of approx. 50 W in addition to the heat transfers 216, 217, 218, 219, 220. Towards the end of the second phase 302, a first steady-state Q302 representing a thermal equilibrium state between the electricity meter 2 and the operating environment 100 is reached at a temperature of approx. 78° C. after a time period d302 of approx. 24 s between the first step change C301 and the first steady state Q302.

At a second step change C302, a sudden drop of the electrical load of the bus bar 14 takes place in that the current drops from 100 A to 50 A. Accordingly, the heat transfer 214 drops to approx. 12 W in addition to the heat transfers 216, 217, 218, 219, 220. Consequently, during a third phase 303 of the thermal performance plot, a rapid temperature decrease 303 takes place from the approx. 78° C. in the first

steady-state **Q302** to a temperature of approximately 42° C. in a second steady-state **Q303**.

FIG. 4 shows an exemplary diagram illustrating effects of thermal resistance in a thermal model according to the present invention for modelling a thermal behaviour of the electricity meter **2**. In the present example, based on a thermal performance plot **400**, the modelled thermal behaviour leads to three different temperature curves **T410**, **T420**, and **T430** which are based on three different thermal resistance values R_{th} of 0.5 K/W, 1 K/W, and 2 K/W, respectively, assumed for the electricity meter **2**. Commonly, the thermal resistance values R_{th} are determined by the enclosure **10** of the electricity meter **2**, in particular by the thickness and material properties of the wall sections **10a**, **10b**, **10c**, **10d**, and of the terminal cover **10e** with their specific heat transfer coefficients. The temperature curves **T410**, **T420**, and **T430**, for example represent the inner temperature **T25** of the electricity meter **2**.

In a first phase **401** of the thermal performance plot **400**, a heat transfer from internal microelectronic circuits of the electricity meter **2**, which for example again comprises heat transfers **216**, **217**, **218**, **219**, **220** pertaining to the supply disconnect switch **16**, metering unit **17**, processing unit **18**, communications unit **19**, and/or power supply unit **20**, respectively, amounting to approx. 3 W, leads to a slow temperature increase **T411**, **T421**, and **T431** in the temperature curves **T410**, **T420**, and **T430**, respectively, starting from the external ambient temperature **T100** of approx. 25° C. representing the temperature of the operating environment **100**.

At a first step change **C401** in the thermal performance plot **400**, a sudden rise in heat generation of approx. 10 W, e.g. by the bus bar **14** due to a respective current load being applied to the bus bar **14** and associated parts in the primary current path of the electricity meter **2**, sets in. Thus, in a second phase **402** of the thermal performance plot **400**, rapid temperature increases **T412**, **T422**, and **T432**, take place in the in the temperature curves **T410**, **T420**, and **T430**, respectively, due to the respective heat transfer **214** of approx. 10 W in addition to the heat transfers **216**, **217**, **218**, **219**, **220**.

During the second phase **402**, first steady-states **Q412**, **Q422** and **Q432** representing thermal equilibrium states between the electricity meter **2** and the operating environment **100** are reached at temperatures of approx. 31° C., 38° C. and 50° C. in the temperature curves **T410**, **T420**, and **T430**, respectively. The first steady-states **Q412**, **Q422** and **Q432** are reached after time periods **d412**, **d422** and **d432** of approx. 8 s, 22 s and 40 s, respectively, after the first step change **C401**. The differences in the temperatures reached at the first steady-states **Q412**, **Q422** and **Q432** and the differences in the time periods **d412**, **d422** and **d432** until reaching the first steady-states **Q412**, **Q422** and **Q432**, respectively, arise from the respective different thermal resistance values R_{th} of 0.5 K/W, 1 K/W, and 2 K/W assumed for the electricity meter **2**. It becomes evident that with increasing thermal resistance, a heat sink performance of the electricity meter **2** decreases, i.e. after a step change with rising heat generation, equilibrium temperatures with corresponding steady heat transfers **209**, **210**, **210d**, **260** crossing the envelope boundary towards **200** the operating environment **100** are reached later and are higher, the higher, the thermal resistance value is. In other words, the lower the thermal resistance is, the higher are the heat transfers **209**, **210**, **210d**, **260** during the time periods **d412**, **d422** and **d432**.

At a second step change **C402**, a sudden drop of the electrical load of the bus bar **14** takes place. Accordingly, the heat transfer **214** drops to approx. 1.5 W in addition to the

heat transfers **216**, **217**, **218**, **219**, **220**. Consequently, during a third phase **403** of the thermal performance plot, rapid temperature decreases **T413**, **T423**, and **T433** take place in the in the temperature curves **T410**, **T420**, and **T430**, respectively. In the present example, temperatures drop from temperatures of approx. 31° C., 38° C. and 50° C. in the first steady-states **Q412**, **Q422** and **Q432** to temperatures of approx. 28° C., 31° C. and 38° C. in second steady-states **Q413**, **Q423** and **Q433** for the temperature curves **T410**, **T420**, and **T430**, respectively. The second steady-states **Q413**, **Q423** and **Q433** are reached after time periods **d413**, **d423** and **d433** of approx. 9 s, 18 s and 24 s, respectively, after the first step change **C401**.

Hence, in analogy to the impact of the respective different thermal resistance values R_{th} of 0.5 K/W, 1 K/W, and 2 K/W on the heat sink behaviour of the electricity meter **2**, it becomes evident that with increasing thermal resistance, a heat source performance of the electricity meter **2** based on heat transfers **209**, **210**, **210d**, **260** crossing the envelope boundary towards **200** the operating environment **100** decreases, i.e. after a step change with falling heat generation, equilibrium temperatures are reached later and are higher, the higher, the thermal resistance value is. Correspondingly, the lower the thermal resistance is, the higher are the heat transfers **209**, **210**, **210d**, **260** during the time periods **d413**, **d423** and **d433**.

FIG. 5 shows an exemplary diagram illustrating effects of thermal capacitance in a thermal model according to the present invention for modelling a thermal behaviour of the electricity meter **2**. In the present example, based on a thermal performance plot **500**, the modelled thermal behaviour leads to three different temperature curves **T510**, **T520**, and **T530** which are based on three different thermal capacitance values C_{th} of 2 J/K, 5 J/K, and 10 J/K, respectively, assumed for the electricity meter **2**. The temperature curves **T510**, **T520**, and **T530**, for example represent the inner temperature **T25** of the electricity meter **2**. In the present example, a thermal resistance R_{th} of 1 K/W is assumed for the modelled thermal behaviour leads to three different temperature curves **T510**, **T520**, and **T530**. The thermal performance plot **500** and the temperature curve **T520** equal the thermal performance plot **400** and temperature curve **T420**, respectively, illustrated in FIG. 4.

In a first phase **501** of the thermal performance plot **500**, a heat transfer from internal microelectronic circuits of the electricity meter **2**, which for example again comprises heat transfers **216**, **217**, **218**, **219**, **220**, pertaining to the supply disconnect switch **16**, metering unit **17**, processing unit **18**, communications unit **19**, and/or power supply unit **20**, respectively, amounting to approx. 3 W, leads to a slow temperature increase **T511**, **T521**, and **T531** in the temperature curves **T510**, **T520**, and **T530**, respectively, starting from the external ambient temperature **T100** of approx. 25° C. representing the temperature of the operating environment **100**. Effects of the different thermal capacitance values C_{th} of 2 J/K, 5 J/K, and 10 J/K already become evident based on the relatively low heat transfer from internal microelectronic circuits of the electricity meter **2** alone, as differences in the slow temperature increases **T511**, **T521**, and **T531** are significant. During the slow temperature increases **T511**, **T521**, and **T531**, temperatures rise from **T100** of 25° C. to approx. 25.5° C., 26° C., and 27° C., respectively, reflecting a strong effect of thermal capacitance on the thermal behaviour of the electricity meter **2** on temperature gradients, i.e. slopes of temperature curves.

At a first step change **C501** in the thermal performance plot **500**, a sudden rise in heat generation of approx. 10 W,

e.g. by the bus bar **14** due to a respective current load being applied to the bus bar **14** and associated parts and the primary current path of the electricity meter **2**, sets in. Thus, in a second phase **502** of the thermal performance plot **500**, rapid temperature increases **T512**, **T522**, and **T532**, take place in the in the temperature curves **T510**, **T520**, and **T530**, respectively, due to the respective heat transfer **214** of approx. 10 W in addition to the heat transfers **216**, **217**, **218**, **219**, **220**.

During the second phase **502**, first steady-states **Q512**, **Q522** and **Q532** representing thermal equilibrium states between the electricity meter **2** and the operating environment **100** are reached at a temperature of approx. 38° C. in the temperature curves **T510**, **T520**, and **T530**, respectively. The first steady-states **Q512**, **Q522** and **Q532** are reached after time periods **d512**, **d522** and **d532** of approx. 8 s, 22 s and 37 s, respectively, after the first step change **C501**. The differences in the time periods **d512**, **d522** and **d532** until reaching the first steady-states **Q512**, **Q522** and **Q532**, respectively, arise from the respective different thermal capacitance values C_{th} of 2 J/K, 5 J/K, and 10 J/K assumed for the electricity meter **2**. It becomes evident that with increasing thermal capacitance, a heat buffering performance of the electricity meter **2** increases, i.e. after a step change with rising heat generation, an equilibrium temperature with corresponding steady heat transfers **209**, **210**, **210d**, **260** crossing the envelope boundary **200** towards the operating environment **100** are reached later, the higher, the thermal capacitance value is. In other words, the lower the thermal capacitance is, the higher are the heat transfers **209**, **210**, **210d**, **260** during the time periods **d512**, **d522** and **d532**.

At a second step change **C502**, a sudden drop of the electrical load of the bus bar **14** takes place. Accordingly, the heat transfer **214** drops to approx. 1.5 W in addition to the heat transfers **216**, **217**, **218**, **219**, **220**. Consequently, during a third phase **503** of the thermal performance plot, rapid temperature decreases **T513**, **T523**, and **T533** take place in the in the temperature curves **T510**, **T520**, and **T530**, respectively. In the present example, temperatures drop from temperatures of approx. 38° C. in the first steady-states **Q512**, **Q522** and **Q532** to temperatures of approx. 31° C. in second steady-states **Q513**, **Q523** and **Q533** for the temperature curves **T510**, **T520**, and **T530**, respectively. The second steady-states **Q513**, **Q523** and **Q533** are reached after time periods **d513**, **d523** and **d533** of approx. 11 s, 18 s and 24 s, respectively, after the first step change **C501**.

Hence, by the impact of the respective different thermal capacitance values C_{th} of 2 J/K, 5 J/K, and 10 J/K on the heat buffering behaviour of the electricity meter **2**, it becomes evident that with increasing thermal capacitance, a heat storage performance of the electricity meter **2** based on heat transfers **209**, **210**, **210d**, **260** crossing the envelope boundary towards **200** the operating environment **100** increases, i.e. after a step change with falling heat generation, equilibrium temperatures are reached later, the higher, the thermal capacitance value C_{th} is. Correspondingly, the lower the thermal capacitance value C_{th} is, the lower are the heat transfers **209**, **210**, **210d**, **260** during the time periods **d513**, **d523** and **d533**.

FIG. 6 shows an exemplary diagram illustrating effects of electrical resistance in a primary current path of the electricity meter **2** considered in a thermal model according to the present invention for modelling a thermal behaviour of an electricity meter **2**. In the present example, based on three thermal performance plots **610**, **620**, and **630** which are emulated based on three different electrical capacitance values R of 0.0002 Ohm, 0.001 Ohm, and 0.005 Ohm,

respectively, assumed for the primary current path of the electricity meter **2**. The modelled thermal behaviour leads to three different temperature curves **T610**, **T620**, and **T630**, pertaining to the electrical capacitance values R of 0.0002 Ohm, 0.001 Ohm, and 0.005 Ohm, respectively. The temperature curves **T610**, **T620**, and **T630**, for example represent the inner temperature **T25** of the electricity meter **2**.

In first phases **611**, **621**, and **631**, of the thermal performance plot **610**, **620**, and **630**, respectively, equal heat transfers from internal microelectronic circuits of the electricity meter **2**, which for example again comprise respective heat transfers **216**, **217**, **218**, **219**, **220**, pertaining to the supply disconnect switch **16**, metering unit **17**, processing unit **18**, communications unit **19**, and/or power supply unit **20**, respectively, amounting to approx. 3 W, lead to uniform slow temperature increases **T611**, **T621**, and **T631** in the temperature curves **T610**, **T620**, and **T630**, respectively, starting from the external ambient temperature **T100** of approx. 25° C. representing the temperature of the operating environment **100**.

At first step changes **C611**, **C621**, and **C631** in the thermal performance plots **610**, **620**, and **630**, sudden rises in heat generation of approx. 2 W, 10 W, and 50 W, respectively, e.g. by the bus bar **14** due to a respective current load being applied to the bus bar **14** and associated parts in the primary current path of the electricity meter **2**, set in. Thus, in second phases **612**, **622**, and **632** of the thermal performance plots **610**, **620**, and **630**, respectively, rapid temperature increases **T612**, **T622**, and **T632**, take place in the in the temperature curves **T610**, **T620**, and **T630** due to the respective heat transfers **214** of approx. 2 W, 10 W, and 50 W, respectively, in addition to the heat transfers **216**, **217**, **218**, **219**, **220**.

During the second phases **612**, **622**, and **632**, first steady-states **Q612**, **Q622** and **Q632** representing thermal equilibrium states between the electricity meter **2** and the operating environment **100** are reached at temperatures of approx. 29° C., 38° C., and 78° C. in the temperature curves **T610**, **T620**, and **T630**, respectively. The first steady-states **Q612**, **Q622** and **Q632** are reached after time periods **d612**, **d622** and **d632** of approx. 12 s, 18 s and 37 s, respectively, after the first step change **C601**. The differences in the time periods **d612**, **d622** and **d632** until reaching the first steady-states **Q612**, **Q622** and **Q632**, respectively, arise from the respective different heat transfers **214** of approx. 2 W, 10 W, and 50 W. With increasing electrical resistance, a heat generating performance of the electricity meter **2** increases, i.e. after a step change with rising heat generation, equilibrium temperatures with corresponding steady heat transfers **209**, **210**, **210d**, **260** crossing the envelope boundary **200** towards the operating environment **100** are reached later and at higher temperatures, the higher, the electrical resistance value R is.

At a second step change **C602**, a sudden drop of the electrical load of the bus bar **14** takes place. Accordingly, the heat transfers **214** drop to approx. 1.5 W, 2 W, and 12 W in the thermal performance plots **610**, **620**, and **630**, respectively, in addition to the heat transfers **216**, **217**, **218**, **219**, **220**. Consequently, during third phases **613**, **623**, and **633**, of the thermal performance plots **610**, **620**, and **630**, rapid temperature decreases **T613**, **T623**, and **T633** take place in the in the temperature curves **T610**, **T620**, and **T630**, respectively. In the present example, temperatures drop from temperatures of approx. 29° C., 38° C., and 78° C. in the first steady-states **Q612**, **Q622** and **Q632**, respectively, to temperatures of approx. 29° C., 28° C., and 42° C. in second steady-states **Q613**, **Q623** and **Q633** for the temperature curves **T610**, **T620**, and **T630**, respectively. The second steady-states **Q613**, **Q623** and **Q633** are reached after time

periods **d613**, **d623** and **d633** of approx. 9 s, 18 s and 24 s, respectively, after the first step change **C601**.

Hence, with increasing electrical resistance of the primary current path, a heat generation performance of the electricity meter **2** based on heat transfers **209**, **210**, **210d**, **260** crossing the envelope boundary towards **200** the operating environment **100** increases, i.e. after a step change with falling heat generation, equilibrium temperatures are higher and reached later, the higher, the electrical resistance value of the primary current path is. Correspondingly, the lower the electrical resistance value is, the lower are the heat transfers **209**, **210**, **210d**, **260** and respective equilibrium temperatures.

FIG. 7 shows an exemplary diagram illustrating modelling deviations which may occur when establishing a thermal model according to the present invention for modelling a thermal behaviour of the electricity meter **2**. In the present example, based on thermal performance plot **300** (see FIG. 3), the modelled thermal behaviour leads to three different temperature curves **T710**, **T720**, and **T730** which are based on nominal parameters for thermal resistance as well as thermal capacity, incorrect thermal resistance, and incorrect thermal capacity, respectively, assumed for the electricity meter **2**. The temperature curves **T710**, **T720**, and **T730**, for example each represent the inner temperature **T25** of the electricity meter **2**.

In the first phase **301** of the thermal performance plot **300**, the heat transfer from internal microelectronic circuits of the electricity meter **2**, which for example again comprises heat transfers **216**, **217**, **218**, **219**, **220**, pertaining to the supply disconnect switch **16**, metering unit **17**, processing unit **18**, communications unit **19**, and/or power supply unit **20**, respectively, amounting to approx. 3 W, leads to slow temperature increases **T711**, **T721**, and **T731** in the temperature curves **T710**, **T720**, and **T730**, respectively, starting from the external ambient temperature **T100** of approx. 25° C. representing the temperature of the operating environment **100**. Effects of the incorrect thermal capacitance value already become evident based on the relatively low heat transfer from internal microelectronic circuits of the electricity meter **2** alone, as differences in the slow temperature increases **T711**, **T721**, and **T731** are noticeable. During the slow temperature increases **T711**, **T721**, and **T731**, temperatures rise from **T100** of 25° C. to approx. 27° C. as well as 27° C., and 27.5° C., respectively, reflecting a strong effect of thermal capacitance on the thermal behaviour of the electricity meter **2** on temperature gradients, i.e. slopes of temperature curves.

At the first step change **C301** in the thermal performance plot **300**, the sudden rise in heat generation of approx. 50 W, e.g. by the bus bar **14** due to the respective current load being applied to the bus bar **14** and associated parts and the primary current path of the electricity meter **2**, sets in. Thus, in the second phase **302** of the thermal performance plot **700**, rapid temperature increases **T712**, **T722**, and **T732**, take place in the in the temperature curves **T710**, **T720**, and **T730**, respectively, due to the respective heat transfer **214** of approx. 50 W in addition to the heat transfers **216**, **217**, **218**, **219**, **220**.

During the second phase **302**, first steady-states **Q712**, **Q722** and **Q732** representing thermal equilibrium states between the electricity meter **2** and the operating environment **100** are reached at a temperature of approx. 78° C., 71° C., and 78° C. in the temperature curves **T710**, **T720**, and **T730**, respectively. The first steady-states **Q712**, **Q722** and **Q732** are reached after time periods **d712**, **d722** and **d732** of approx. 24 s, 20 s and 12 s, respectively, after the first step change **C301**. The differences in the time periods **d712**, **d722**

and **d732** until reaching the first steady-states **Q712**, **Q722** and **Q732**, respectively, reflect the deviations from the nominal values assumed for the thermal resistance **R_{th}** and the thermal capacitance **C_{th}** of the electricity meter **2**.

At the second step change **C302**, the sudden drop of the electrical load of the bus bar **14** takes place. Accordingly, the heat transfer **214** drops to approx. 12 W in addition to the heat transfers **216**, **217**, **218**, **219**, **220**. Consequently, during the third phase **303** of the thermal performance plot **300**, rapid temperature decreases **T713**, **T723**, and **T733** take place in the in the temperature curves **T710**, **T720**, and **T730**, respectively. In the present example, temperatures drop from temperatures of approx. 78° C., 71° C., and 78° C. in the first steady-states **Q712**, **Q722** and **Q732** to temperatures of approx. 40° C., 38° C., and 40° C. in second steady-states **Q713**, **Q723** and **Q733** for the temperature curves **T710**, **T720**, and **T730**, respectively. The second steady-states **Q713**, **Q723** and **Q733** are reached after time periods **d713**, **d723** and **d733** of approx. 11 s, 18 s and 24 s, respectively, after the first step change **C701**.

It becomes evident that deviations in thermal resistance lead to deviations in both, a different temperature difference **dT** with respect to the temperature assumed for the nominal parameters, and a difference in time periods between a step change and reaching a next equilibrium state, whereas deviations of the thermal capacitance from the nominal parameters merely leads to the latter.

FIG. 8 shows an exemplary flowchart illustrating steps of establishing a thermal model according to the present invention for modelling a thermal behaviour of the electricity meter **2**. In a first step **S1**, heat generation within the electricity meter **2** is calculated. In particular, in a first substep **S1a**, heat generation in microelectronic components and units is calculated, e.g. heat transfers **216**, **217**, **218**, **219**, **220**, pertaining to the supply disconnect switch **16**, metering unit **17**, processing unit **18**, communications unit **19**, and/or power supply unit **20**, respectively, based on a configuration status **CON**, a CPU load **CPU** and a communications status **COM** of the electricity meter **2**. In a second sub step **S1b**, heat generation by the bus bar **14** and associated parts and the primary current path of the electricity meter **2** is calculated while taking into account a current load **A** being applied to the busbar **14**, temperature **T** of the busbar **14** and/or the inner temperature **T25** of the electricity meter **2**, and electrical resistance **R** of primary current path. As output values of the first and second substeps **S1a**, **S1b**, heat dissipation from the electricity meter **2** due to heat transfer **210** and alike crossing the envelope boundary **200** is calculated for both, the microelectronic components and the primary current path of the electricity meter **2**. In addition, heat dissipation and/or absorption due to heat transfer **209** and alike crossing the envelope boundary **200** is calculated for the primary current path of the electricity meter **2**.

In a second step **S2**, the output values of step **S1** along with minimum and maximum values of the ambient temperature **T100** and heat transfer **270** from external heat sources **170**, temperature gradients characterising the thermal behaviour of the electricity meter **2** are calculated as a computed or emulated gradient **G_c** based on the thermal modelling and a measured gradient **G_m** making use of temperature sensors **21**. Output values of the second step are minimum and maximum values for the computed gradient **G_c** and the measured gradient **G_m**.

In a third step **S3**, as input values, the minimum and maximum values for the computed gradient **G_c** and the

measured gradient Gm are used for computing respective temperature gradient and/or temperature value errors and/or deviations.

In a fourth step S4, the temperature gradient errors and/or deviations computed in the third step S3 are checked against respective error ranges and/or threshold values used as limits L. If such limits L are exceeded, then in the fifth step S5, respective triggering signal S is generated, such that a respective event is logged, an alarm is initiated, and/or the supply disconnect switch 16 is actuated.

A sixth step S6 follows the fourth step S4 if it has been decided in the fourth step S4 that the respective limits L were not exceeded. Then, in the sixth step S6 it is checked if any temperature gradient and/or temperature value errors and/or deviations are due to self heating of the electricity meter 2 as a result of heat generation in microelectronic components, e.g. by heat transfers 216, 217, 218, 219, 220, for instance by taking into account the configuration status CON, the CPU load CPU and the communications status COM as well as any required temperature value T derived from temperature sensors 21. If it is decided in the sixth step S6 that temperature gradient and/or temperature value errors and/or deviations are due to self heating of the electricity meter 2, then in a seventh step S7, respective parameters, in particular heat transfers 216, 217, 218, 219, 220, the configuration status CON, the CPU load CPU and/or the communications status COM, used as input values in step 1, are adjusted accordingly.

An eighth step S8 follows the sixth step S6 if it has been decided in the sixth step S6 that temperature gradient and/or temperature value errors and/or deviations are not due to self heating of the electricity meter 2. Then, in the eighth step S8 it is decided, if any temperature gradient and/or temperature value errors and/or deviations are due to heating of the primary current path, in particular the busbar 14 of the electricity meter 2, e.g. by taking into account respective heat transfers 214 and any one of temperature sensors 21 associated to the busbar 14. If it is decided in the eighth step S8 that temperature gradient and/or temperature value errors and/or deviations are due to heating of the primary current path, in particular the busbar 14, then in a ninth step S9, the value of the electrical resistance R associated to the primary current path, in particular the busbar 14, used as input value in step 1 is adjusted accordingly.

A tenth step S10 follows the eighth step S8, if it has been decided in the eighth step S8 that temperature gradient and/or temperature value errors and/or deviations are not due to heating of the primary current path, in particular the busbar 14, of the electricity meter 2. Then, in the tenth step S10 it is decided, if any temperature gradient and/or temperature value errors and/or deviations are due to the heat transfer 270 from external heat sources 170, in particular by using respective temperature sensors 21 associated thereto. If it is decided in the eighth step S8 that temperature gradient and/or temperature value errors and/or deviations are due to heating the heat transfer 270 from external heat sources 170, then in an eleventh step S11, the values considered for computing the respective heat transfer 270, in particular outside temperatures T used as input values in step 1, are adjusted accordingly.

A tenth step S10 follows the eighth step S8, if it has been decided in the eighth step S8 that temperature gradient and/or temperature value errors and/or deviations are not due to heating of the primary current path, in particular the busbar 14, of the electricity meter 2. Then, in the tenth step S10 it is decided, if any temperature gradient and/or temperature value errors and/or deviations are due to the heat

transfer 270 from external heat sources 170, in particular by using respective temperature sensors 21 associated thereto. If it is decided in the tenth step S10 that temperature gradient and/or temperature value errors and/or deviations are due to the heat transfer 270 from external heat sources 170, then in the eleventh step S11, the values considered for computing the respective heat transfer 270 are adjusted accordingly.

A twelfth step S12 follows the tenth step S10, if it has been decided in the tenth step S10 that temperature gradient and/or temperature value errors and/or deviations are not due to heat transfer 270 from external heat sources 170. Then, in the twelfth step S12 it is decided, if any temperature gradient and/or temperature value errors and/or deviations are due to the heat transfer 209 via the electrical lines 9, in particular by using respective temperature sensors 21 associated thereto. If it is decided in the twelfth step S12 that temperature gradient and/or temperature value errors and/or deviations are due to the heat transfer 270 from external heat sources 170, then in a thirteenth step S13, the values considered for computing the respective heat transfer 209 are adjusted accordingly.

In a fourteenth step S14, following the fifth step S5, the seventh step S7, the ninth step S9, the eleventh step S11, the twelfth step 12, and/or the thirteenth step 13, the procedure shown in FIG. 8 is terminated and/or repeated in beginning again from the first step S1.

FIG. 9 shows an exemplary flowchart illustrating steps of a runtime logic of the electricity meter 2 when establishing a thermal model according to the present invention for modelling a thermal behaviour of the electricity meter 2. The runtime logic are computer-readable instructions, such as software and/or firmware, constituting at least a part of the computer program 4, to be executed by the supply disconnect switch 16, metering unit 17, processing unit 18, communications unit 19, and/or power supply unit 20.

In a first runtime step RS1, instantaneous temperature values T and computed temperature gradient values Gc are continuously generated under using formulas for thermal capacitance Cth and thermal resistance Rth to model the electricity meter 2, while using readings from at least one of the temperature sensors 21, measurements of current load A, and/or microelectronic heating estimates, in particular for heat transfers 216, 217, 218, 219, and 220, pertaining to the metering unit 17, processing unit 18, communications unit 19, and/or power supply unit 20, respectively.

The thermal model is based on the following three equations used for calculating temperatures T as a function of time t:

$$T(t) = T_0 \times (1 - e^{(-t/\lambda)}), \quad (1)$$

wherein T(t) [K] is the instantaneous temperature during a heating phase of the electricity meter 2, T₀ [K] is the final steady state instantaneous temperature of the electricity meter 2, and λ [1/s] is a time constant resulting from a multiplication of thermal resistance Rth and thermal capacitance Cth;

$$T(t) = T_0 \times (e^{(-t/\lambda)}), \quad (2)$$

wherein T(t) [K] is the instantaneous temperature during a cooling phase of the electricity meter 2, T₀ [K] is the initial instantaneous temperature of the electricity meter 2, and λ

[1/s] is the time constant resulting from a multiplication of thermal resistance R_{th} and thermal capacitance C_{th} ; and

$$\Delta T = Q \times R_{th}, \quad (3)$$

wherein ΔT [K] is a temperature difference between two points of an object, such as the electricity meter **2** as well as parts, elements, or components thereof, Q [W] the heat flow running through the object, and R_{th} [KM] is the thermal resistance between the two defined points of the object, for which thermal performance is emulated.

In a second runtime step **RS2**, multiple results for slight variations in model parameters over a range of potential model parameters, such as thermal capacitance C_{th} , thermal resistance R_{th} , electrical resistance R , and/or microelectronic heating factors, in particular for heat transfers **216**, **217**, **218**, **219**, and **220**, pertaining to the metering unit **17**, processing unit **18**, communications unit **19**, and/or power supply unit **20**, respectively, are calculated.

In a third runtime step **RS3**, errors and/or deviations between measured results and model results, i.e. measured temperatures gradients thereof versus emulated temperatures and gradients thereof, are calculated.

In a fourth runtime step **RS4**, model parameters are identified, that yield the smallest error/deviation between measured results and emulated results.

In a fifth runtime step **RS5**, small incremental changes are made to the model parameters identified in the fourth runtime step **RS4**, in the direction and proportional to the identified model parameters that yielded the smallest error or deviation. For such an adjustment, filtering may be used, for example by applying a finite impulse response filter and/or infinite impulse response filter.

In a sixth runtime step **RS6**, the identified and adjusted model parameters from runtime step **S** are compared to pre-configured range limitations to detect when the thermal model being established is normalising to a certain thermal model that is indicate if of an error or fault condition, such as excessive electrical resistance in the primary current path, in particular the bus bar **14**, and/or faults in microelectronic components.

In a seventh runtime step **RS7**, it is decided, whether parameters of certain thermal model from the sixth runtime step **RS6**, that indicate an error or fault condition, are out of a particular parameter range. Therefore, the respective model results are compared to respective threshold values. If the respective model parameters exceed the respective threshold values, then an error, fault and/or alarm event is recorded, and/or an additional action is taken, such as actuation of the supply disconnect switch **16**, or alike.

In a ninth runtime step **RS9**, following the seventh runtime step **RS7**, points of interest are determined, such as steady-states, heating conditions, cooling conditions, and/or any relatively large variations in thermal energy generation.

In a tenth runtime step **RS10**, when the points of interest are identified in the ninth runtime step **RS9**, then corresponding information, including underlying thermal model parameters, such as instantaneous temperature T and temperature gradients G , current loads A , microelectronic heating estimates, and alike, are recorded.

In an eleventh runtime step **RS11**, information and parameters characterising points of interest recorded during the tenth runtime step **RS 10**, are used for adjusting model parameters and weighting of respective filter values of the finite impulse response filter and/or the infinite impulse

response filter applied. For example, from a certain steady state, a sudden step change in load current A to near zero and the associated cooling provides an excellent opportunity to adjust the thermal capacitance C_{th} free from any error in estimated electrical resistance R in the primary current path. Alternatively, or additionally, a steady state condition provides an opportunity to adjust the thermal resistance R_{th} without the effect of thermal capacitance C_{th} complicating the calculation. Furthermore, a change in temperature T during a certain steady state while load current A and heating due to microelectronic heating factors, in particular heat transfers **216**, **217**, **218**, **219**, and **220**, pertaining to the metering unit **17**, processing unit **18**, communications unit **19**, and/or power supply unit **20**, respectively, is relatively stable over time t , could be an indication of thermal changes in the operating environment **100**.

In a twelfth runtime step **RS12**, thermal model results are again being computed, as done in the first runtime step **RS 1**, but now based on information and parameters recorded in runtime step **R10** during points of interest, if applicable, as adjusted in the eleventh runtime step **RS11**. Analogously, in the twelfth runtime step **RS12**, respective errors and/or deviations between measured results and emulated results, i.e. measured temperatures gradients thereof versus emulated temperatures and gradients thereof, are calculated, similar to as done in the third runtime step **RS3**.

Furthermore, in the twelfth runtime step **RS12**, small incremental changes are made to the model parameters recorded in the tenth runtime step **RS10**, and/or as adjusted in the eleventh runtime step **RS11**, in the direction and proportional to the identified model parameters that yielded the smallest error or deviation, as done in the fifth runtime step **RS5**. For such an adjustment, the adjusted filter values may be used, as obtained by weighting of respective filter values in runtime step **11**, for example when applying a finite impulse response filter and/or infinite impulse response filter. In other words, from the twelfth runtime step **RS 12**, information and parameters may be fed back to the first runtime steps **RS1**, the third runtime step **RS3**, and/or the fifth runtime step **RS5**, so that these steps are carried out in an iterative manner.

In a thirteenth runtime step **RS13**, model parameters obtained in previous runtime steps, in particular the twelfth runtime step **RS12**, are recorded as historical values of model parameters.

In a fourteenth runtime step **RS 14**, the historical model parameters recorded in the thirteenth runtime step **RS13** are scanned in order to identify any large answers or suspicious value and/or parameter variations.

In a fifteenth runtime step **RS15**, variations in the historical model parameters recorded in the fourteenth runtime step **RS14** are used to incrementally adjust range limits of model parameters. Respective adjusted range limits can be fed back to the sixth runtime step **RS6** for the detection of error or fault conditions based on the respective range limits.

In a sixteenth runtime step **RS16**, maximum variations for each model parameter are recorded.

In a seventeenth runtime step **RS17**, the first to sixteenth runtime steps **RS1** to **RS16**, as described above, can be repeated in order to compute thermal model results of multiple thermal models used to represent different parts, elements and/or components, within the electricity meter **2**. Preferably, a single thermal model comprising a single thermal capacitance C_{th} and thermal resistance R_{th} is required and should be sufficient for modelling thermal behaviour of the electricity meter **2**. However, in order to improve accuracy of a method for monitoring a functional

25

state of an electricity meter **2** according to the present invention, thermal behaviour of different parts, element and/or components within the electricity meter **2** can be modelled as described herein.

FIG. **10** shows an exemplary flowchart illustrating steps of a design time course thermal model discovery procedure when establishing a thermal model according to the present invention for modelling a thermal behaviour of the electricity meter **2**. The steps illustrated in FIG. **10** serve for providing initial parameters and values to be implemented in the method steps as described above with reference to FIGS. **8** and **9**.

In a first design step DS1 of the design time course thermal model discovery procedure illustrated in FIG. **10**, the electricity meter **2** in an un-energised state, i.e. the electricity meter is not electrically powered, is placed in a controlled temperature chamber (not illustrated) and allowed to reach a thermal equilibrium state with respect to the temperature chamber having the ambient temperature T100.

In a second design step DS2, the meter is energised without any load being applied to the primary current path, and with unvarying, i.e. steady micro-electronic behaviour to ensure that heating due to microelectronic heating factors, in particular heat transfers **216**, **217**, **218**, **219**, and **220**, pertaining to the metering unit **17**, processing unit **18**, communications unit **19**, and/or power supply unit **20**, respectively, is relatively stable, preferably constant over time.

In a third design step DS3, a series of temperature readings from the point of time of energising the microelectronic parts of the electricity meter **2** carried out in the second design step DS2, until a point of time where the electricity meter **2** again reaches a thermal equilibrium state with respect to the temperature chamber, is recorded. Based on these temperature readings, thermal resistance Rth and/or capacitance Cth of the electricity meter **2** as well as, if desired, any parts, elements and/or components thereof, are calculated.

In a fourth design step DS4, microelectronic heating factors turned on in the second design step DS2, in particular heat transfers **216**, **217**, **218**, **219**, and **220**, pertaining to the metering unit **17**, processing unit **18**, communications unit **19**, and/or power supply unit **20**, respectively, are abruptly eliminated by de-energising the electricity meter **2**.

In a fifth design step DS5, the supply disconnect switch **16** is activated under various load conditions with altered magnitude and phase of electrical power applied to the primary current path, i.e. different load currents A are applied to the active and neutral input terminals **12a**, **12b** of the electricity meter **2**. By applying the various load conditions, a range of respective relay contact resistances of the supply disconnect switch **16** is measured and/or derived therefrom.

In a sixth design step DS6, impedance of the primary current path running through the electricity meter **2** from the active input terminal **12a** to the active output terminal **12c** thereof is measured after each switching operation of the supply disconnect switch **16** carried out in the fifth design step DS5.

The first design step DS1 to the sixth design step DS6 as described above are then repeated.

In a seventh design step DS7, the electrical lines **9** are disconnected and reattached to the electrical terminals **12** numerous times using different wire diameters for the electrical lines **9**.

26

In an eighth design step DS8, impedance of the primary current path running through the electricity meter **2** from the active input terminal **12a** to the active output terminal **12c** thereof is measured after each change of the electrical lines **9** carried out in the seventh design step DS7.

In a ninth design step DS8, impedance of the primary current path running through the electricity meter **2** from the neutral input terminal **12b** to the neutral output terminal **12d** thereof is measured after each change of the electrical lines **9** carried out in the seventh design step DS7 and/or after each switching operation of the supply disconnect switch **16** carried out in the fifth design step DS5.

The first design step DS1 to the ninth design step DS9 as described above are then repeated.

In a tenth design step DS10, the temperature of the controlled temperature chamber representing the ambient temperature T100 is altered.

The first design step DS1 to the tenth design step DS10 as described above are then repeated.

In an eleventh design step DS11, different external heat sources **170**, such as direct radiation from light and/or heat sources for simulating solar radiation, and/or controlled air flows are applied to the electricity meter **2**, in particular to the enclosure **10** thereof. Furthermore, the type of material of the mounting structure **150** to which the electricity meter **2** is attached and/or a certain location of the electricity meter **2** in an electrical closet and/or at an electrical switchboard, are or is, respectively, altered.

The first design step DS1 to the eleventh design step DS11 as described above are then repeated.

In a twelfth design step DS12, a behaviour of the micro-electronic components of the electricity meter **2** is a varied, in particular for varying heat transfers **216**, **217**, **218**, **219**, and **220**, pertaining to the metering unit **17**, processing unit **18**, communications unit **19**, and/or power supply unit **20**, respectively. Such variations can be achieved e.g. by changing sample rates of the metering unit **17**, changing processing loads, i.e. CPU loads, of the processing unit **18**, and/or changing communication frequencies applied by the communications unit **19**, etc.

The first design step DS1 to the eleventh design step DS12 as described above are then repeated for the electricity meter **2**. Additionally, after a desired number of repetitions of the first design step DS1 to the eleventh design step DS12, these steps of the design time course thermal model discovery procedure carried out when establishing a thermal model according to the present invention for modelling a thermal behaviour of the electricity meter **2** can be carried out for multiple different electricity meters **2** of the same kind and/or of different kinds in order to provide respective model parameters and values for a range of multiple different electricity meters **2**.

FIG. **11** shows an exemplary flowchart illustrating possible steps of an installation time course thermal model discovery procedure when establishing a thermal model according to the present invention for modelling a thermal behaviour of the electricity meter **2**.

In a first installation step IS1 of the installation time course thermal model discovery procedure when establishing a thermal model according to the present invention, impedance of the primary current path running through the electricity meter **2** from the active input terminal **12a** to the active output terminal **12c** thereof is measured.

In a second installation step IS2, impedance of the primary current path running through the electricity meter **2** from the neutral input terminal **12b** to the neutral output terminal **12d** thereof is measured

In a third installation step IS3, a type of the electrical lines 9 attached to the terminals 12 of the electricity meter 2 is specified, e.g. recorded and/or selected from a predefined list of possible types and/or diameters of the electrical lines 9 as enabled by the firmware of the electricity meter 2.

In a fourth installation step IS4, a type of installation of the electricity meter 2, i.e. the type of operating environment 100, mounting structure 150 and/or external heat sources 170, for example in an electrical closet, on a wall, an exposure to radiation sources, etc., is specified, e.g. recorded and/or selected from a predefined list of possible types of operating environments 100, mounting structures 150 and/or external heat sources 170, respectively, as enabled by the firmware of the electricity meter 2.

In a fifth installation step IS5, a current ambient temperature T100 is recorded in the electricity meter 2 as enabled by the firmware of the electricity meter 2.

In a sixth installation step IS6, a current time, date, and/or weather conditions at the installation site of the electricity meter 2 are or is, respectively, recorded in the electricity meter 2 as enabled by the firmware of the electricity meter 2.

FIG. 12 shows an exemplary diagram illustrating actual temperature curves TA, TB, and TC of three different electricity meters 2a, 2b, and 2c, respectively, to be emulated with a thermal model according to the present invention. For example, the three temperature curves TA, TB, and TC are emulated in line with a method according to the present invention by carrying out respective method steps as described above while assuming the same operational states, i.e. current load A, configuration status CON, communications status COM, CPU load CPU, thermal capacitance Cth, and thermal resistance Rth, for each of the electricity meters 2. Consequently, any differences in temperature values and temperature gradients shown in FIG. 12 should be due to different electrical resistances R of the current paths and/or different environmental conditions of the electricity meters 2a, 2b, and 2c.

Assuming that the electricity meters 2a, 2b, and 2c are of the same type and are each in an operational state, respective ranges, limits and/or thresholds which may be regarded as being acceptable for a correct operation of the electricity meters 2a, 2b, and 2c can be derived the three temperature curves TA, TB, and TC. In particular, FIG. 12 shows maximum slopes, i.e. emulated temperature gradients Gc of 4.3° C./min, 4.5° C./min, and 4.7° C./min, as well as maximum temperature rises dT of 47.1° C., 49.2° C., and 47.5° C., emulated by the model for the electricity meters 2a, 2b, and 2c, respectively, after a step change C happening approximately at a time t of 2:01.

Consequently, it may be derived from the three temperature curves, that an acceptable range of measured gradients Gm under the respective operating conditions extends from 4.3° C./min to 4.7° C./min, the latter constituting an upper range limit, both constituting thresholds, i.e. an upper threshold and a lower threshold, respectively, of a range of maximum values of emulated gradients dGc of 0.2° C./min. Correspondingly, an acceptable range of temperature rises dT under the respective operating conditions extends from 47.1° C. to 49.2° C., the later constituting an upper range limit, both constituting thresholds, i.e. an upper threshold and a lower threshold, respectively, of a range of maximum values of emulated temperature differences dT of 2.1° C. If then respective measured gradients Gm and/or temperatures T exceeded or fall below the thresholds, based on respective trigger signals S, events may be logged, actions may be

taken, and/or alarms may be generated by the electricity meters 2a to 2c and/or a respective administration device 3.

In the alternative, it may be assumed by way of example that that the three temperature curves TA, TB, and TC illustrated in FIG. 12 pertain to one and the same electricity meter 2 with the same configuration status CON, communications status COM, CPU load CPU, thermal capacitance Cth, and supposedly thermal resistance Rth. For example, temperature curve TA is based on temperature measurements carried out by utilising at least one of the temperature sensors 21 after a certain load current A has been applied to the primary path of the electricity meter 2 at the step change C. Temperature curve TB could be an emulated temperature curve computed for an alternative load current A, which is higher than the load current underlying temperature curve TA. Temperature curve TC could be an emulated temperature curve computed for the same load current A underlying temperature curve TA.

Under these alternative assumptions, it becomes evident, that based on thresholds derived from a range of temperature gradients and temperature values between the two emulated temperature curves TB and TC alone, a faulty functional state or any hint thereto could not be detected because the measured maximum temperature gradient Gm of 4.5° C./min in temperature curve TB lies well within the two emulated maximum temperature gradients Gc of 4.3° C./min and 4.7° C./min in temperature curves TA and TC, respectively. Also, the maximum measured temperature rise dT of 47.5° C. at a time t of 4:20 in temperature curve A lies well within the two emulated temperature rises 47.1° C. and 49.2° C. at that point of time in the two emulated temperature curves TA and TC, respectively.

However, taking into account that under the alternative assumptions, temperature curve TA has been measured with the same current load A as underlying the emulated temperature curve TC, then the higher measured temperature rise dT of 47.5° C. in temperature curve TA at the time of 4:20 exceeding the emulated temperature rise dT of 47.1° C. at that point of time in temperature curve TC by a relative temperature difference ΔT of 0.4° C. between the two temperature curves at that point of time could hint to a faulty state or could at least indicate a tendency towards the development of a faulty state. Moreover, if a maximum relative temperature difference ΔT of approx. 4° C. between temperature curves TA and TC at the point of time t around 3:47 is taken into account, where the measured temperature T almost reaches the temperature in temperature curve TB emulated under assuming are higher current load A than that underlying temperature curve TA, then the deviations between temperature curves TA and TC under the alternative assumptions clearly indicate that certain parameters of the electricity meter 2 are out of range. It would then have to be assessed by applying method steps as laid down above, whether the deviations are based on modelling errors, whether the deviations are based on differences in ambient conditions, or whether indeed, the excessive heat rise in temperature curve TA indicates an increase in electrical resistance R of the primary current path of the electricity meter and/or microelectronic components, which may be due to a deterioration of electrical connections within the primary current path and/or the microelectronic components, respectively, and could therefore constitute a faulty state of the electricity meter 2.

Deviations from the above-described embodiments are possible within the scope of the present invention.

The electricity metering system 1 may comprise electricity meters 2, 2a, 2b, 2c, administration devices 3, computer

programs 4, computer-readable data carriers 5, data carrier signal 6, energy and/or information transmission lines 7, transmission means 8, and/or electrical lines 9, 9a, 9b, 9c, 9d in any number and form required for implementing a desired configuration for operating, monitoring and/or controlling the electricity metering system 1 and in particular any electricity meters 2, 2a, 2b, 2c therein.

The electricity meter 2 may be provided with an enclosure 10 having wall sections 10a, 10b, 10c, 10d, terminal covers 10e, bottom sections 11, electrical terminals 12, 12a, 12b, 12c, 12d, terminal blocks 13, fixing element 13a, bus bars 14 with sections 14a, 14b, 14c, 14d, resistive shunts 15, supply disconnect switches 16, switch input lines 16a, switch output line 16b, metering unit 17, metering input lines 17a, metering output lines 17b, processing unit 18, communications units 19, power supply units 20, temperature sensors 21, 21a to 21q, internal conductors 22, substrates 23, mounting elements 24, and/or inner spaces 25 in any number and form required for performing desired functions.

Hence, the present invention is not limited to electricity meters 2 with electrical terminals 12, 12a, 12b, 12c, 12d as described herein, but can also applied to e.g. so-called socket meters having contact elements or terminals embodied as blades that slot into a socket that is part of a base assembly affixed to the wall or distribution board, which allows a fast replacement of such socket meters and avoids cabling adjustments. In such a setup, the present invention can be implemented within the socket meter, the base assembly including the socket, or a combination thereof. Socket meters may suffer from high resistance contacts on the blades and/or sockets interfacing the socket meter. For any parts or elements associated to the interfacing, analogous issues with regard to contact resistances and heat generation may arise as described herein with reference to the electrical lines 9, 9a, 9b, 9c, 9d, electrical terminals 12, 12a, 12b, 12c, 12d, respective fixing elements 13, such as contact springs, and the connections therebetween.

The administration device 3, transmission means 8, metering unit 17, processing unit 18, communication unit 19, power supply units 20 and/or temperature sensors 21, 21a to 21q may comprise any kind of electronic data processing, storage, interface and/or operation means in any number and form desired. The energy and/or information transmission lines 7, transmission means 8 and/or internal conductors 22 can be embodied as any kind of wired and/or wireless means for transferring energy, in particular electrical energy, and/or information, such as analogue and/or digital data, including any kind of computer software programs, interfaces, modules and/or functions, as well as communication systems, such as e.g. the Global System for Mobile Communications (GSM), DLMS/COSEM, Powerline communication (PLC), and alike.

The functions performed by the elements, units and modules of the metering system 1 may be implemented as hardware and/or software in order to be carried out by a single entity and/or multiple entities within the electricity meter 2 and/or the administration device 3. The electricity meter 2 and/or administration device 3 may therefore comprise at least one computer, (micro)processor or other type of processor, and at least one computer-readable medium, such as the computer readable data carrier 5, which may be embodied as any kind of internal and/or external RAM and/or ROM memory device or data storage as well as corresponding permanent or non-permanent computer and/or machine-readable media, including but not limited to e.g. cloud storage devices, microchips, flash drives, EEPROM, magnetic disks, cards, tapes, and drums, punched cards and

paper tapes, optical discs, barcodes, smart codes, and/or magnetic ink characters, that stores computer-readable program code (e.g., software or firmware), such as the computer program 4, executable by the (micro)processor, logic gates, switches, interfaces, gateways, transceivers, an application specific integrated circuit (ASIC), a programmable logic controller, and/or an embedded microcontroller, for example. In particular, the electricity meter 2 and/or the administration device 3 may be configured to perform any kind of measurement, computation, calculation, processing, generation, determination, decision, monitoring and/or control step as described herein.

The at least one thermal model according to the present invention may comprise simplified thermal models and/or sophisticated thermal models as required for modelling thermal performance of the electricity meter 2 and/or of elements, parts and/or components thereof, as well as of the operating environment 100 with respective mounting structures 150, air mass 160, and/or external heat sources 170. According to the required degree of sophisticatedness of the thermal model, the envelope boundary 200 and respective heat transfers 209, 210, 210d, 214, 216, 217, 218, 219, 220, 260, 270 may be considered for any of the elements, parts, and/or components of the electricity meter 2. For modelling the thermal behaviour, any kind of thermal performance plots with respective phases, step changes, steady states, periods of time, as well as temperature values, gradients, and temperature curves with respective temperature increases and/or temperature decreases may be used, while any combination of the temperature curves may constitute a set of temperature curves.

Accordingly, a method according to the present invention may comprise steps S1 to S14, design steps DS1 to DS12, installation steps IS1 to IS6, and/or runtime steps RS1 to RS17 as required and in any number and form desired to model thermal behaviour of the electricity meter 2, 2a, 2b, 2c as well as of the operating environment 100 in order to monitor a functional state of the electricity meter 2.

Besides electricity meters 2 as described herein, a method according to the present invention as well as corresponding systems 1 comprising administration devices 3, computer programs 4, computer readable data carriers 5, data carrier signal is 6, energy and/or information transmission lines 7, transmission means 8, and/or electrical lines 9 may be used to monitor a functional state of any kind of electrical appliances, apparatuses, and/or devices, such as household devices, computers, transformers, generators, motors, or alike, in particular devices with a relatively large power input, throughput and/or output. Respective electrical appliances, apparatuses, and/or devices themselves and/or respective administration devices may be configured to carry out a method according to the present invention.

Reference Signs

1	electricity metering system
2	electricity meter
2a	electricity meter A
2b	electricity meter B
2c	electricity meter C
3	administration device
4	computer program
5	computer-readable data carrier
6	data carrier signal
7	energy and/or information transmission line
8	transmission means
9	electrical line
9a	phase input line

31

-continued

Reference Signs	
9b	neutral input line
9c	phase output line
9d	neutral output line
10	enclosure
10a	top wall section
10b	bottom wall section
10c	front wall section
10d	back wall section
10e	terminal cover
11	bottom section
12	electrical terminal
12a	active input terminal
12b	neutral input terminal
12c	active output terminal
12d	neutral output terminal
13	terminal block
13a	fixing element
14	bus bar/primary current path
14a	active input section
14b	active linking section
14c	active output section
14d	neutral linking section
15	resistive shunt
16	supply disconnect switch
16a	switch input line
16b	switch output line
17	metering unit
17a	metering input line
17b	metering output line
18	processing unit
19	communications unit
20	power supply unit
21	temperature sensor
21a	remote sensor
21b	external sensor
21c	internal top sensor
21d	internal front sensor
21e	internal back sensor
21f	internal side sensor
21g	terminal region sensor
21h	terminal block sensor
21i	supply line sensor
21j	input section sensor
21k	output section sensor
21l	linking section sensor
21m	switch sensor
21n	metering unit sensor
21o	processing unit sensor
21p	communications unit sensor
21q	supply unit sensor
22	internal conductor
23	substrate
24	mounting element
25	inner space
100	operating environment
150	mounting structure
160	air mass
170	external heat source
200	envelope boundary
209	heat transfer
210	heat transfer
210d	heat transfer
214	heat transfer
216	heat transfer
217	heat transfer
218	heat transfer
219	heat transfer
220	heat transfer
260	heat transfer
270	heat transfer
300	thermal performance plot
301	first phase
302	second phase
303	third phase
400	thermal performance plot
401	first phase
402	second phase

32

-continued

Reference Signs	
403	third phase
500	thermal performance plot
501	first phase
502	second phase
503	third phase
610	thermal performance plot
611	first phase
612	second phase
613	third phase
620	thermal performance plot
621	first phase
622	second phase
623	third phase
630	thermal performance plot
631	first phase
632	second phase
633	third phase
d302	period of time
d412	period of time
d422	period of time
d432	period of time
d413	period of time
d423	period of time
d433	period of time
d512	period of time
d522	period of time
d532	period of time
d513	period of time
d523	period of time
d533	period of time
d612	period of time
d622	period of time
d632	period of time
d613	period of time
d623	period of time
d633	period of time
d712	period of time
d722	period of time
d732	period of time
d713	period of time
d723	period of time
d733	period of time
C301	first step change
C302	second step change
C401	first step change
C402	second step change
C501	first step change
C502	second step change
C611	first step change
C612	second step change
C621	first step change
C622	second step change
C631	first step change
C632	second step change
Q302	first steady-state/equilibrium
Q303	second steady-state/equilibrium
Q412	first steady-state/equilibrium
Q422	first steady-state/equilibrium
Q432	first steady-state/equilibrium
Q413	second steady-state/equilibrium
Q423	second steady-state/equilibrium
Q433	second steady-state/equilibrium
Q512	first steady-state/equilibrium
Q522	first steady-state/equilibrium
Q532	first steady-state/equilibrium
Q513	second steady-state/equilibrium
Q523	second steady-state/equilibrium
Q533	second steady-state/equilibrium
Q612	first steady-state/equilibrium
Q622	first steady-state/equilibrium
Q632	first steady-state/equilibrium
Q613	second steady-state/equilibrium
Q623	second steady-state/equilibrium
Q633	second steady-state/equilibrium
Q712	first steady-state/equilibrium
Q722	first steady-state/equilibrium
Q732	first steady-state/equilibrium

Reference Signs	
Q713	second steady-state/equilibrium
Q723	second steady-state/equilibrium
Q733	second steady-state/equilibrium
T25	inner temperature
T100	ambient temperature
T300	temperature curve
T301	slow temperature increase
T302	rapid temperature increase
T303	rapid temperature decrease
T410	temperature curve
T411	slow temperature increase
T412	rapid temperature increase
T413	rapid temperature decrease
T420	temperature curve
T421	slow temperature increase
T422	rapid temperature increase
T423	rapid temperature decrease
T430	temperature curve
T431	slow temperature increase
T432	rapid temperature increase
T433	rapid temperature decrease
T510	temperature curve
T511	slow temperature increase
T512	rapid temperature increase
T513	rapid temperature decrease
T520	temperature curve
T521	slow temperature increase
T522	rapid temperature increase
T523	rapid temperature decrease
T530	temperature curve
T531	slow temperature increase
T532	rapid temperature increase
T533	rapid temperature decrease
T610	temperature curve
T611	slow temperature increase
T612	rapid temperature increase
T613	rapid temperature decrease
T620	temperature curve
T621	slow temperature increase
T622	rapid temperature increase
T623	rapid temperature decrease
T630	temperature curve
T631	slow temperature increase
T632	rapid temperature increase
T633	rapid temperature decrease
T710	temperature curve
T711	slow temperature increase
T712	rapid temperature increase
T713	rapid temperature decrease
T720	temperature curve
T721	slow temperature increase
T722	rapid temperature increase
T723	rapid temperature decrease
T730	temperature curve
T731	slow temperature increase
T732	rapid temperature increase
T733	rapid temperature decrease
DS1	first design step
DS2	second design step
DS3	third design step
DS4	fourth design step
DS5	fifth design step
DS6	sixth design step
DS7	seventh design step
DS8	eighth design step
DS9	ninth design step
DS10	tenth design step
DS11	eleventh design step
DS12	twelfth design step
IS1	first installation step
IS2	second installation step
IS3	third installation step
IS4	fourth installation step
IS5	fifth installation step
IS6	sixth installation step
RS1	first runtime step
RS2	second runtime step

Reference Signs	
RS3	third runtime step
RS4	fourth runtime step
RS5	fifth runtime step
RS6	sixth runtime step
RS7	seventh runtime step
RS8	eighth runtime step
RS9	ninth runtime step
RS10	tenth runtime step
RS11	eleventh runtime step
RS12	twelfth runtime step
RS13	thirteenth runtime step
RS14	fourteenth runtime step
RS15	fifteenth runtime step
RS16	sixteenth runtime step
RS17	seventeenth runtime step
S1	first step
S1a	first substep
S1b	second substep
S2	second step
S3	third step
S4	fourth step
S5	fifth step
S6	sixth step
S7	seventh step
S8	eights step
S9	ninth step
S10	tenth step
S11	eleventh step
S12	twelfth
S13	thirteenth step
S14	fourteenth step
A	current load
C	step change
CON	configuration status
COM	communications status
CPU	CPU load
Cth	thermal capacitance
dT	temperature difference/range
dt	time difference
dG	gradient difference/range
G	gradient
Gc	computed/emulated gradient
Gm	measured gradient
L	limit/threshold
Q	heat transfer/heat flux
R	electrical resistance
Rth	thermal resistance
S	triggering signal
T	temperature
t	time
TA	temperature curve meter A
TB	temperature curve meter B
TC	temperature curve meter A
ΔT	relative temperature difference

The invention claimed is:

1. A method of monitoring a functional state of an electricity meter, comprising the steps of:
 - generating at least one temperature signal from which an actual temperature value of the electricity meter can be derived; and
 - determining whether the actual temperature value and/or a gradient thereof exceeds at least one threshold value, wherein the at least one threshold value is being derived from at least one predefined temperature curve representing predefined temperature values of the electricity meter over time according to a modelled thermal behaviour of the electricity meter, wherein the at least one predefined temperature curve is readjusted over time, thereby providing moving or rolling thresholds or limits for respective temperature values and/or gradients.

35

2. The method according to claim 1, wherein the method further comprises the step of generating a triggering signal if the actual temperature value and/or a gradient thereof exceeds the at least one threshold value.

3. The method according to claim 1, wherein the method further comprises the step of adjusting the at least one predefined temperature curve and/or to select the at least one predefined temperature curve from a set of predefined temperature curves according to a certain operational state and/or according to a certain operational condition of the electricity meter.

4. The method according to claim 1, wherein the method further comprises the step of identifying at least one point of interest in the at least one predefined temperature curve, the at least one point of interest relating to certain operational conditions of the electricity meter.

5. The method according to claim 1, wherein an electrical resistance in a primary current path within the electricity meter is associated to the at least one predefined temperature curve and/or derived from the actual temperature value and/or gradient thereof.

6. The method according to claim 1 wherein the method further comprises the step of establishing at least one thermal model for modelling thermal behaviour of the electricity meter, the at least one thermal model comprising the at least one predefined temperature curve.

7. The method according to claim 6, wherein upon identification of certain errors, trends, patterns or correlations between the actual temperature value and/or the gradient thereof, and the at least one predefined temperature curve, at least one parameter of the thermal model is automatically adjusted by machine learning.

8. The method according to claim 6, wherein the step of establishing the at least one thermal model includes the step of defining at least one equilibrium state which the electricity meter assumes during operation, the at least one equilibrium state representing a thermal equilibrium of the electricity meter in dependence of at least one electrical load running through the electricity meter, and of environmental conditions existing in an environment of the electricity meter.

36

9. The method according to claim 6, wherein the step of establishing the at least one thermal model includes the step of defining at least one heating behaviour and/or at least one cooling behaviour of the electricity meter based on at least one functional step response of the electricity meter to a change in a functional state and/or operational state of the electricity meter.

10. The method according to claim 6, wherein the step of establishing the thermal model involves the step of determining at least one thermal resistance value and/or the step of determining at least one thermal capacitance value of the electricity meter.

11. The method according to claim 6, wherein the step of establishing at least one thermal model is carried out for at least two different types of operating conditions of the electricity meter and/or at least two different types of electricity meters.

12. A computer program for monitoring a functional state of an electricity meter, comprising instructions which, when the computer program is executed by an electricity meter and/or an administration device in an electricity metering system, cause the electricity meter and/or the administration device to carry out the steps of a method according to claim 1.

13. A computer-readable data carrier having stored thereon the computer program of claim 12.

14. A data carrier signal carrying the computer program of claim 12.

15. An electricity meter configured to carry out the method of claim 1.

16. An electricity metering system, in particular an Advanced Metering Infrastructure (AMI), comprising at least one electricity meter according to claim 15.

17. An electricity metering system, in particular an Advanced Metering Infrastructure-(AMI), comprising at least one administration device configured to carry out the method of claim 1.

* * * * *