



(22) Date de dépôt/Filing Date: 1995/11/16

(41) Mise à la disp. pub./Open to Public Insp.: 1996/05/18

(45) Date de délivrance/Issue Date: 2006/01/03

(30) Priorité/Priority: 1994/11/17 (945404) FI

(51) Cl.Int.⁷/Int.Cl.⁷ F23N 3/04, D21C 11/12, F22B 31/00

(72) Inventeurs/Inventors:

AHTILA, PEKKA, FI;
HAAPIO, JAAKKO, FI


(73) Propriétaire/Owner:

KVAERNER POWER OY, FI

(74) Agent: BORDEN LADNER GERVAIS LLP

(54) Titre : METHODE ET APPAREIL DE REGULATION DE L'AIR DE COMBUSTION DANS UNE CHAUFFERIE

(54) Title: METHOD AND APPARATUS FOR CONTROLLING COMBUSTION AIR IN A BOILER PLANT

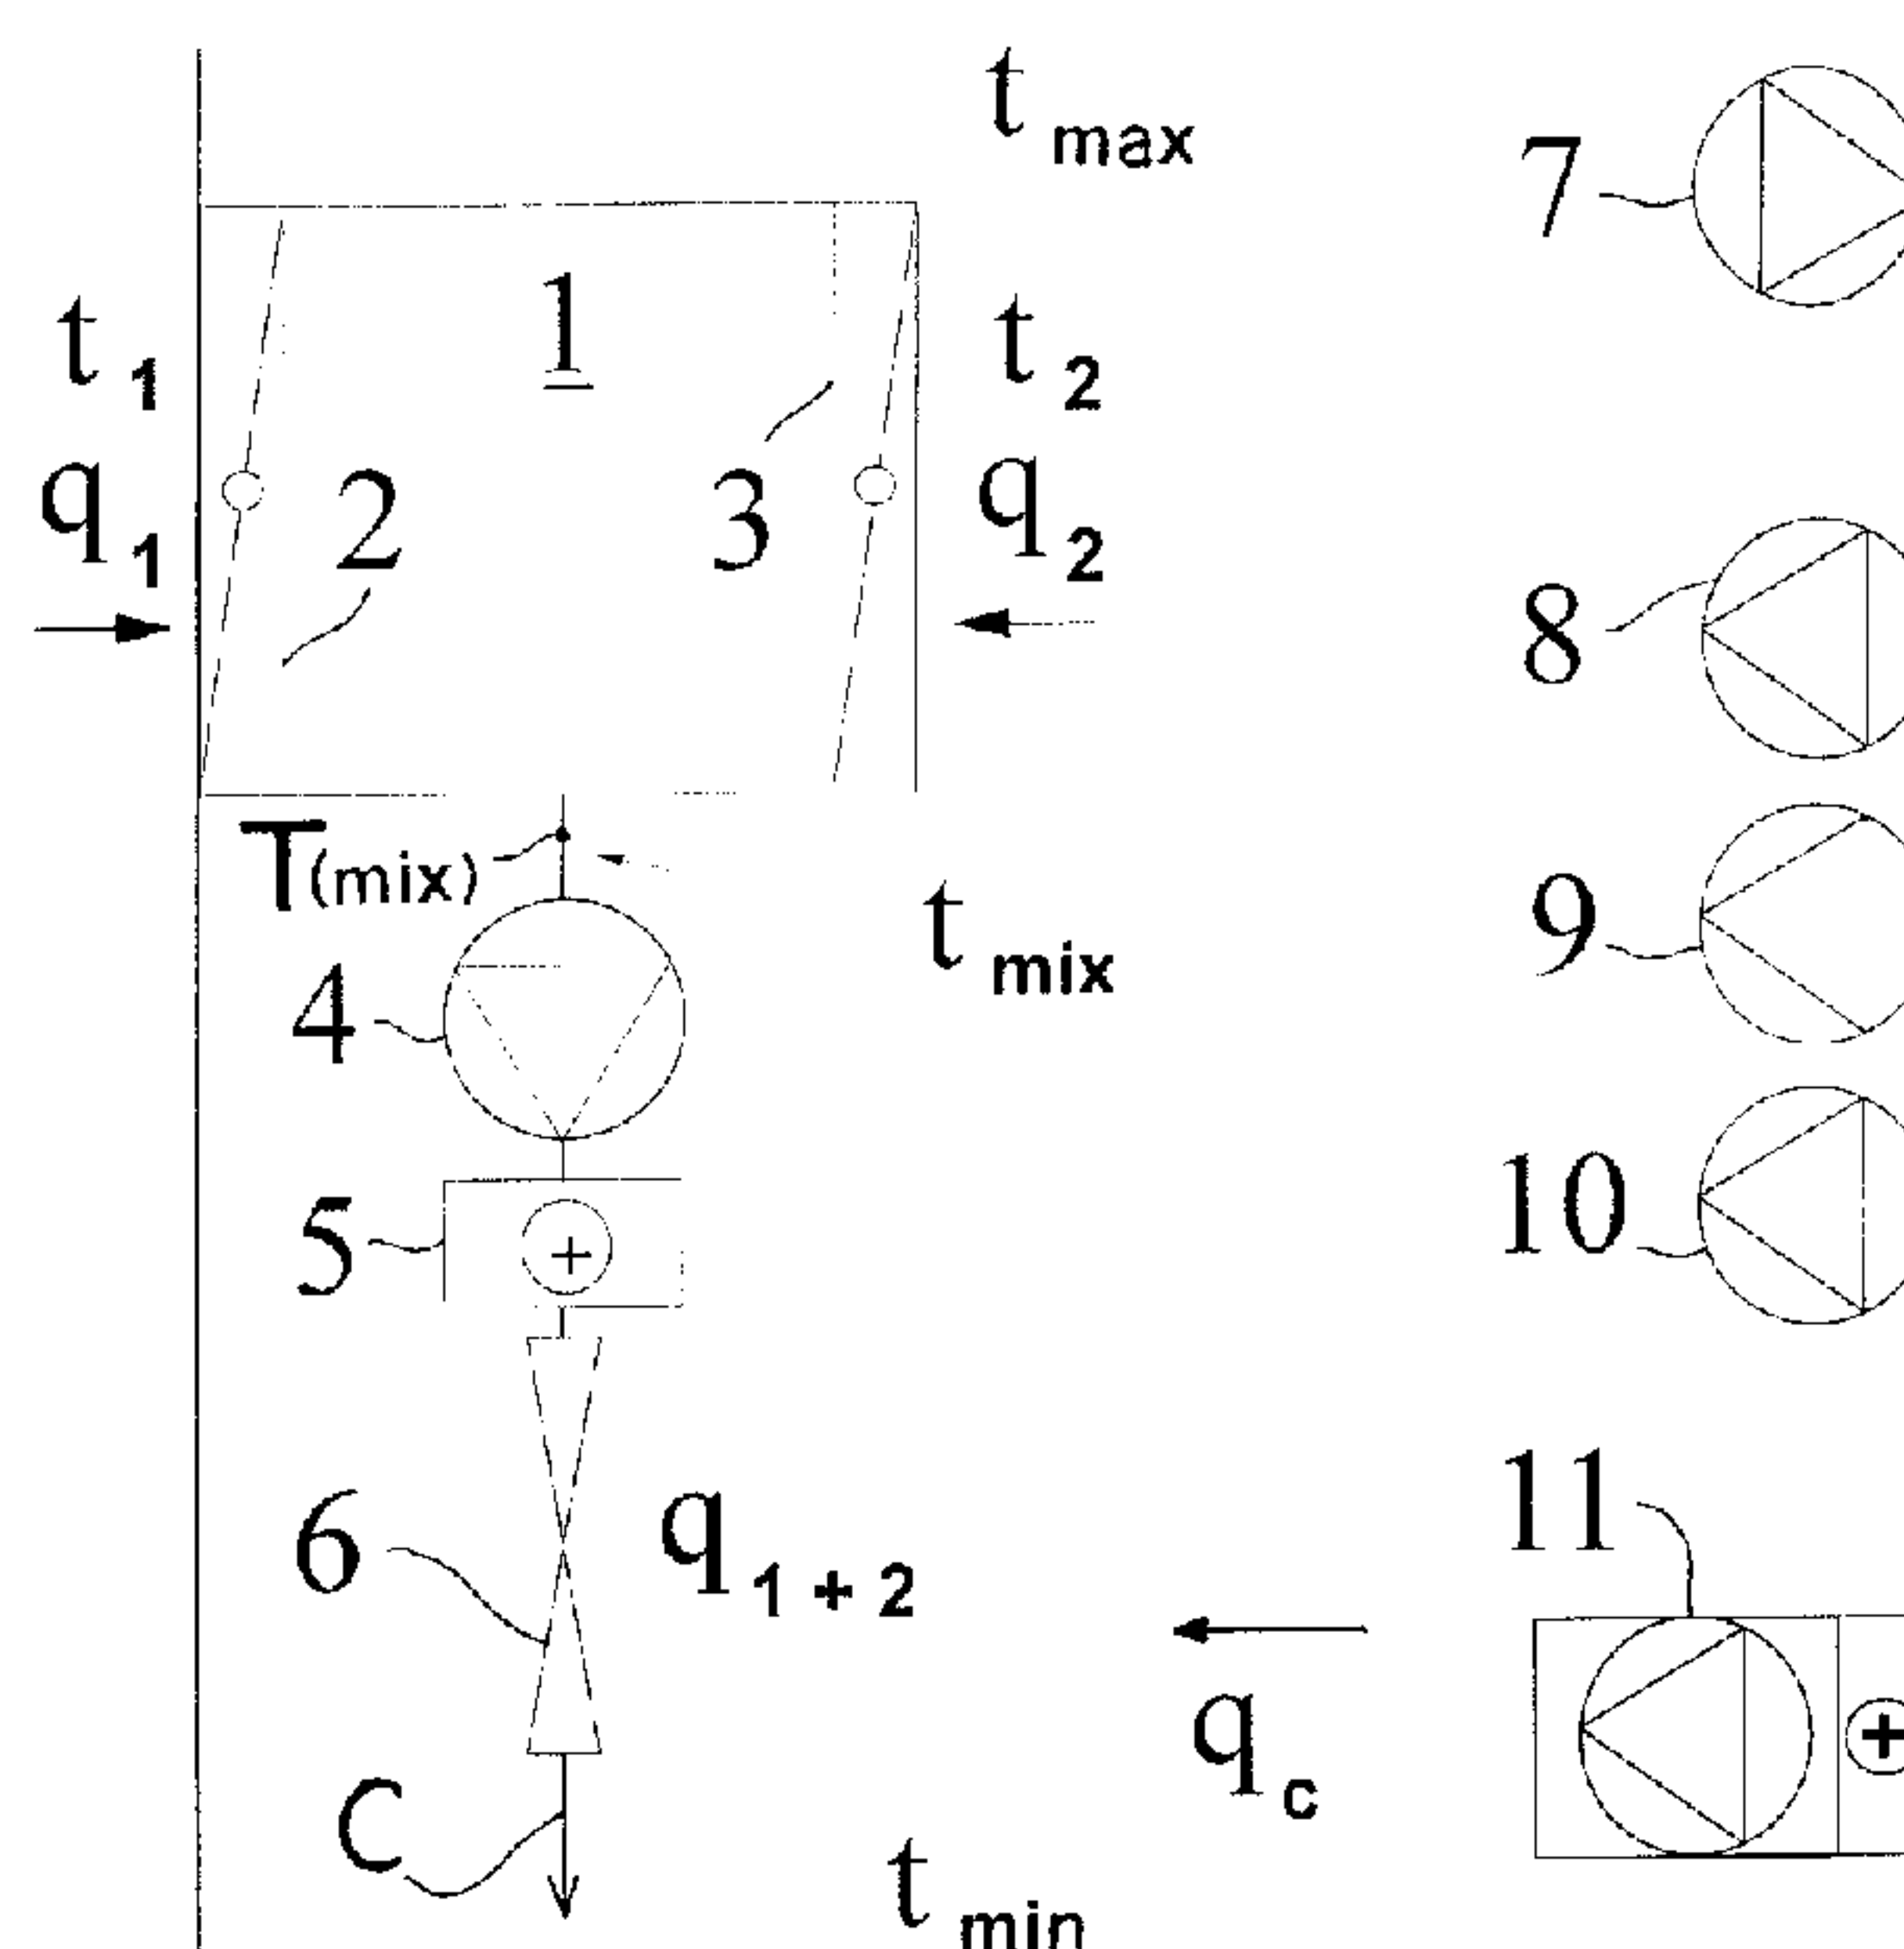

(57) Abrégé/Abstract:

The invention relates to a method for controlling combustion air in a boiler plant, wherein combustion air is supplied into a boiler located in a boiler building. Combustion air is taken both from the inside and the outside of the building in a suitable ratio, wherein the air flow (q_1) taken from outside is used to supply part of the combustion air required by the boiler. The ratio (q_1/q_2) is determined at least on the basis of the temperature of the outside air and the load of the boiler. The invention relates also to an apparatus for controlling combustion air in a boiler plant. The apparatus comprises a combustion air duct (C) for conveying combustion air into a boiler located in a boiler building. Combustion air duct (C) is provided with a mixing section (1) connected to both the inside of the building for supplying inside air into the boiler and the outside of the building for supplying outside air into the boiler. The mixing part (1) is further provided with control devices (2, 3) for mixing the air flow taken from the inside (q_2) and the air flow taken from the outside (q_1) to a total air flow (q_{1+2}) entering the combustion air duct in a desired ratio. The apparatus comprises means for measuring the temperature (t_{mix}) of the air flow (q_{1+2}) which are connected to a comparator unit arranged to control the control devices (2, 3) of the mixing section (1) for adjusting the ratio of said flows (q_2, q_1).

Abstract

The invention relates to a method for controlling combustion air in a boiler plant, wherein combustion air is supplied into a boiler located in a boiler building. Combustion air is taken both from the inside and the outside of the building in a suitable ratio, wherein the air flow (q_1) taken from outside is used to supply part of the combustion air required by the boiler. The ratio (q_1/q_2) is determined at least on the basis of the temperature of the outside air and the load of the boiler. The invention relates also to an apparatus for controlling combustion air in a boiler plant. The apparatus comprises a combustion air duct (C) for conveying combustion air into a boiler located in a boiler building. Combustion air duct (C) is provided with a mixing section (1) connected to both the inside of the building for supplying inside air into the boiler and the outside of the building for supplying outside air into the boiler. The mixing part (1) is further provided with control devices (2, 3) for mixing the air flow taken from the inside (q_2) and the air flow taken from the outside (q_1) to a total air flow (q_{1+2}) entering the combustion air duct in a desired ratio. The apparatus comprises means for measuring the temperature (t_{mix}) of the air flow (q_{1+2}) which are connected to a comparator unit arranged to control the control devices (2, 3) of the mixing section (1) for adjusting the ratio of said flows (q_2, q_1).

Method and apparatus for controlling combustion air in a boiler plant

5 The method relates to a method for controlling combustion air in a boiler plant, which method is presented in the preamble of the appended claim 1. The invention relates also to an apparatus presented in the preamble of the appended claim 9.

10 The invention is suitable for use particularly in connection with boiler plants placed in buildings substantially closed from outside air. In this context, the term boiler plant indicates a combustion plant where either solid, liquid or gaseous fuels are burned by means of air. The boiler itself is manufactured of water-cooled tube panels, the heat produced by combustion being transferred to the water flowing inside the tube
15 panels. Thus steam will be produced which can be later utilized in the process.

Boiler plants include for example the black liquor recovery boiler. In the black liquor recovery boiler, all the combustion air required is currently
20 supplied from the inside of the boiler building, and most of it from its upper part. Because heat released into the boiler building from the boiler and the associated devices will not be sufficient, depending on the location of the boiler, to heat the fresh replacement air and the building to a sufficient degree in the coldest seasons and, on the other
25 hand, natural air exchange is not sufficient to cool down the building to a sufficient degree during warm seasons, the heaters and ventilation equipment of the building must be used for additional heating and ventilation.

30 The building acts as a kind of air duct, and because the quantity of air required by the boiler is very large, a considerable negative pressure will be produced in the lower part of the building by the need for replacement air and by the duct effect of the high house. This will increase the proportion of uncontrolled air leaks in the replacement air,
35 increase freezing risks in the plant and make the operation of doors more difficult. Further, the operation of the plant will be immediately disturbed upon failure of ventilation in the building, because alternative operation modes compensating for broken equipment are not possible.

Further, some solutions are previously known, in which combustion air is supplied to the boiler from both the inside and the outside of the building, wherein combustion will not be dependent on air supplied from the inside only. For example US Patent 4,245,779 discloses inlet arrangements for combustion air into the heating furnace of a dwelling house. Air is supplied to the same furnace both from the inside and from the outside, whereby draft and flow of cold fresh air through door and window structures can be avoided.

10

Also published European Patent Application 281 501 discloses a method for mixing air from the outside and air from the boiler room as combustion air to be supplied to the burners.

15 Further, published Swedish Specification 451 755 presents a method for controlling combustion air. In a specific mixing device, preheated warm air is mixed with cold air e.g. supplied from the outside. The purpose is to keep the mass flow constant by adjusting the temperature measured after mixing to a predetermined set value, i.e. the air flows
20 are mixed in a suitable quantity ratio.

However, the techniques presented above do not give sufficient control of air flows in boiler buildings during long-term use with varying conditions. Consequently, it is the ratio of air flows supplied from the inside
25 of the building and from the outside that is important.

It is an aim of the invention to eliminate the above disadvantages and to present a method and an apparatus for better control of air flows in boiler buildings, particularly in regions where temperature variations
30 can be great during a shorter or longer period of time, e.g. within a day or within a year. Further, it is an aim of the invention to present a method and an apparatus for eliminating disadvantages caused by failures or malfunctions of ventilation equipment. For achieving these goals, the method is primarily characterized in what is presented in the
35 characterizing part of the appended claim 1. The apparatus, in turn, is characterized in what is presented in the characterizing part of claim 9.

According to the invention, it is expressly the ratio of air flows supplied from the inside of the building and from the outside that is important. This ratio will be determined on the basis of at least the temperature of the outside air and the load of the boiler. The dependency of the ratio on these factors can be determined by tests for each plant, and the ratio can be continuously adjusted on the basis of these factors. When air is supplied to the combustion air duct both from the inside and from the outside of the building, the process will not be dependent on combustion air supplied from the inside only, and its quantity can be adjusted in a more flexible way according to the situation, not affecting the combustion process itself. Also in case of failure or maintenance of the ventilation system, it is possible to run the boiler plant during reparation work by supplying the combustion air directly from the outside. The combustion air duct can be equipped with a mixing section for adjusting the ratio of air flows from the inside and the outside of the boiler building to a desired level. For example, the temperature t_{mix} of the combined flow of the above-mentioned flows can be used as a set value, whereby this temperature is continuously observed and the ratio is adjusted to comply with this. The optimal set value is pre-calculated on the basis of precisely known heat losses to correspond to each momentary outside temperature and boiler load. The aim of the set value is to utilize all the extra heat conducted to the interior, taking into account the guarantee values of the interior temperatures. If the temperature of the plant gets above the limit value, the set value temperature of the mixing point of the combustion air will be raised, whereby a larger quantity of the combustion air will be supplied from the boiler room, and in the opposite situation the set value temperature will be lowered and the air intake from the boiler room will be reduced.

By using the invention, the operating efficiency of boiler plants can be raised, because the air flows and their temperatures are better under control.

The boiler can be for example a black liquor recovery boiler. In the black liquor recovery boiler, spent liquor called black liquor, originating from sulfate or sulfite cellulose processes of the pulp manufacturing industry, is burned as one part of the recovery process of the chemicals. The heat generated by combustion is recovered in the same

way as in an ordinary steam boiler. The invention is not, however, limited only to black liquor recovery boilers but is applicable in all other types of boiler where similar problems exist.

5 Embodiments of the invention will now be described in more detail with reference to the accompanying drawings in which:

Fig. 1 illustrates schematically air flows in a boiler building, an apparatus embodying the invention, and ventilation equipment,
10

Fig. 2 shows graphs of combustion air temperature against outside temperature for different boiler load values,

15 Fig. 3 shows one control diagram for apparatus embodying the invention,

Fig. 4 shows another control diagram for apparatus embodying the invention, and
20

Fig. 5 illustrates a boiler plant containing apparatus embodying the invention.

A boiler building for the part concerning the air flows and devices controlling them is shown schematically in Fig. 1. Combustion air is led to a boiler (not shown) through a combustion air duct C. In the beginning of the combustion air duct C there is a mixing section 1, which is in connection both to air mass within the building and to air outside the building at an outside temperature determined by the meteorological conditions. To the mixing section 1 of the combustion air is led a first air flow q_1 from the outside and a second air flow q_2 from the inside through corresponding control devices 2 and 3, such as dampers. By adjusting the control devices 2 and 3, a desired ratio of the above-mentioned partial flows is reached, whereby the amount of the air flow taken from the inside can be varied according to the situation without influencing the total combustion air flow introduced to the boiler, because the partial flow taken from the outside will allow flexibility in the adjustment.
35

For example, the ratio of the partial flows can be adjusted on the basis of the temperature of the outside air and the load of the boiler. Figure 2 shows a calculated or experimentally determined temperature of the combined combustion air flow in an ideal situation as a function of the outside air temperature at different boiler load values in a boiler building. This temperature of the combined combustion air flow can be taken as a set value, whereby the control devices 2 and 3 are continuously adjusted to give a ratio of partial flows that realizes said value. In this manner it can be ensured that the air flow taken from the inside is correctly dimensioned considering the heat which is released to the building and is dependent on the boiler load at each moment, as well as considering the temperature of the outside air, that is, the inlet replacement air. The set value can be measured by a sensor $T(\text{mix})$ located in the combustion air duct C after the mixing section 1 and being shown in the example of Fig. 1 in a place situated before a combustion air fan 4 and a heater 5.

Figure 3 shows a control diagram for adjusting the mixing of air flows taking place in the mixing section 1, and corresponding parts are designated therein by the same reference numerals as in Fig. 1. The reference numeral of the temperature sensor designates the sensor itself and the corresponding temperature transmitter. The load of the boiler is measured by means of flow measurement on steam production. The data about the boiler load and the temperature measured by a temperature sensor $T(1)$ enter the computing section 12, which determines the set value t_{mix} for the air flow of the combustion air duct C automatically on the basis of these data. This set value can further be changed on the basis of temperature measurements in the upper and lower parts of the boiler room. The sensor $T(\text{mix})$ measures this air flow and gives the temperature data to a comparator unit 13, which compares the data with the set value given by the computing section 12. Based on this comparison, control messages leave the comparator unit for the control device 2 of the outside air and for the control device 3 of the inside air. Further, a manual adjustment of the control devices is provided by the possibility of changing the set value for example in a control room 14 through a switch 15 situated in the data transmission line between the computing section 12 and the comparator unit 13. Further in Fig. 3 the analog-to-digital converters situ-

ated after the temperature sensors $T(1)$ and $T(\text{mix})$ are designated by reference numeral 16 and digital-to-analog converters situated between the comparator unit 13 and the control devices 2 and 3 are designated by reference numeral 17. In the case of Fig. 3 the comparator unit 13 is
5 a PI controller.

For ensuring the air balance it is necessary to know the amount q_2 of the air taken from the inside. In the principle, this could be measured by means of flow meters, but for the economy in space utilization and
10 equipment expenses, it is advisable to carry out the measurement in the following manner. The temperatures t_1 and t_2 of the part flows entering the mixing section are measured by means of the sensors $T(1)$ and $T(2)$, respectively. The combined air flow of these air flows, that is the combustion air flow q_{1+2} is measured by means of a flow meter 6,
15 which is situated in the combustion air duct C after the mixing section 1 and which in Fig. 1 is a venturi situated after the combustion air fan 4 and air heater 5. These flow data are used for combustion control, and the data are converted to normal cubic meters per second [nm^3/s]. By means of the measured air flows q_{1+2} and temperatures t_1 , t_2 and t_{mix} ,
20 the air flow q_2 to be taken directly from the inside of the boiler building to the mixing section 1 of the combustion air can be calculated. These air flow data are used for controlling the inlet air equipment (devices 7 to 11) of the boiler building in such a manner that the combustion air flow q_2 to be taken from the inside of the boiler building and the inlet air
25 flow q_c (devices 7 to 11) are always well balanced, that is, in a desired proportion to each other. In Fig. 1 this inlet air equipment comprises an outlet fan 7, inlet air fans 8, 9 and 10, and a central ventilation unit 11 comprising a heater and a fan. The balance is ensured by means of temperature measurements located in the lower and upper parts of the
30 boiler room in such a manner that in the lower part the temperature is not allowed under any circumstances to decrease below nor in the upper part to increase above the guarantee values (t_{min} and t_{max} respectively).

35 The need of the inlet air can be calculated in the following manner:

The energy balance of one mixing section 1 is calculated as follows:

$$c_1 q_1 t_1 + c_2 q_2 t_2 = c_{\text{mix}} q_{1+2} t_{\text{mix}} \quad (1)$$

wherein c_1 , c_2 and c_{mix} are the thermal capacities of the corresponding flows. In the equation (1) the ratio q_1/q_2 and q_2 can be solved, because
5 it is given that $q_1 + q_2 = q_{1+2}$. When the flow rates are calculated, the density and specific heat of the air as a function of temperature are taken into account.

A black liquor recovery boiler contains as a rule several combustion air
10 levels, that is, a primary, secondary and tertiary level. The air flow to be replaced using all inlet air devices = q_{1+2} (primary) + q_{1+2} (secondary) + q_{1+2} (tertiary) + process exhaust. By "process exhaust" is meant exit of gases to the outside air from a smelt dissolving tank below the boiler. Consequently, the combustion air flow to be taken from the inside is
15 constituted in the following manner: $q_2 = q_2$ (primary) + q_2 (secondary) + q_2 (tertiary). Each level may have a system and a mixing section of its own, or several or all levels can have a joint system and mixing section.

Figure 4 shows a control diagram for carrying out the adjustment of the
20 inlet air q_c . Parts with corresponding function are designated by the same reference numerals as in Fig. 3. The temperature of the outside air is measured by means of a sensor T(1) and the temperature of the air entering from the inside by means of the sensor T(2), and these data together with the temperature data given by the sensor T(mix) are
25 transmitted to the computing section 12, which receives also the data about the total amount of the combustion air flow. The need of the inlet air is calculated by the computing section, which will switch the fans 7 to 11 on or off on the basis of the result. The situation can be monitored in the control room 14. Reference numeral 18 designates limit com-
30 parisons, which are situated between the computing section 12 and the fans and by means of which the fans are controlled based on the value of needed inlet air given by the computing section 12.

The control of the inlet air equipment according to the combustion air
35 flow ensures the balance of the air streams in the boiler room and consequently the maintenance of the desired interior temperatures and pressure differences, whereby the risks of excess heating or freezing in the plant are avoided. The heat received from the boiler and its equip-

ment in the boiler room can be recovered in a controlled manner for preheating of combustion air while the temperature limitations set by the environment are at the same time taken into account. In case of failure of the inlet air equipment the proportion of the combustion air from the outside can be increased to correspond to the air flow of the failed part of the equipment during the period of its reparation, in which event the manual adjustment shown in Fig. 3 can be employed.

Figure 5 shows a boiler plant including the apparatus according to the invention and showing the same numerals as in Fig. 1 for the equivalent parts. The mixing section 1 is placed in the upper part of the boiler building in the beginning of a vertical air duct C.

The corresponding system including the mixing section can be also in the secondary air duct and, when needed, also in the tertiary air duct. In this case, all mixing sections can have the same set value, but the set values can also be allotted separately to each mixing section. Several air ducts can further have a joint mixing section, whereafter the ducts branch off.

20

The invention is not restricted to the above-described embodiment, but it can be varied within the inventive concept defined by the appended claims. The method can for example be applied in all air ducts of the boiler or only in a part of them, for example in a black liquor recovery boiler both in the primary and secondary combustion air duct, as well as also in the tertiary combustion air duct when necessary.

25

CLAIMS:

1. A method for controlling combustion air in a boiler plant, where combustion air is supplied into a boiler located in a boiler building, said method comprising the steps of:

determining a ratio of air flow inside the building to air flow outside the building on the basis of at least the temperature of the outside air and of a load of the boiler;

taking a first air flow from inside the building in accordance with said ratio;

taking a second air flow from outside the building in accordance with said ratio; said second air flow being at a certain temperature; and

supplying a combined combustion air flow including said first and second air flows in accordance with said ratio to said boiler.

2. A method according to claim 1 further comprising the step of mixing said first and second air flows at said ratio at an inlet of a combustion air duct for said boiler.

3. A method according to claim 1 further comprising the steps of:
mixing said first air flow and said second air flow into a combined air flow;
determining a set value for the temperature of the combined air flow on the basis of the temperature of outside air and said load of the boiler; and
adjusting said ratio continuously for realizing said set value.

4. A method according to claim 1 further comprising the step of controlling an inlet air equipment to said boiler building on the basis of an air quantity of said first air flow.

5. A method according to claim 4 further including the following steps for calculating the air quantity taken from the inside at a certain temperature:
measuring the combustion air flow of the boiler, consisting of said first air flow taken from the inside and said second air flow taken from the outside;

measuring the temperature of said first air flow;
measuring the temperature of said second air flow; and
measuring the temperature of the combined air flow of the first and second air flows.

6. A method according to claim 1 used in connection with several different levels in a boiler plant comprising different combustion air levels.

7. A method according to claim 6, characterized in that combustion air is supplied into different levels separately in a suitable ratio from the inside and from the outside of the building.

8. A method according to claim 1 used in connection with controlling combustion air in a black liquid recovery boiler where spent liquor of pulp manufacturing industry is burned.

9. An apparatus for controlling combustion air in a boiler plant comprising a combustion air duct for conveying combustion air into a boiler located in a boiler building, wherein the combustion air duct is provided with a mixing section connected with both the inside of the building for supplying inside air thereto and the outside of the building for supplying outside air thereto, the mixing section being further provided with control devices for mixing the air flow taken from the inside and the air flow taken from the outside into a total air flow entering the combustion air duct in a desired ratio, and the apparatus further comprising in the combustion air duct, after the mixing section in the flow direction of the air flow, means for measuring the temperature of the air flow which are connected to a comparator unit arranged to control the control devices of the mixing section for adjusting the ratio of said flows to be taken from the inside and from the outside, characterized in that the apparatus further comprises meters for measuring the load of the boiler and the temperature of the outside air which are connected to a computing section arranged to calculate a set value for the comparator unit at least on the basis of data received from said meters.

10. An apparatus according to claim 9, characterized in that it is provided with a computing section for calculating the quantity of air flow to be taken from the inside on the basis of data received from different air flows.
11. An apparatus according to claim 10, wherein said computing section further comprises calculating means connected to means for adjusting at least one of an air inlet and outlet equipment, said means adjusting a flow of inlet air to be conveyed into the building.
12. An apparatus according to claim 9, 10 or 11, characterized in that in a boiler plant comprising several combustion air ducts, the apparatus comprises a mixing section common to at least two ducts.
13. An apparatus according to claim 9, 10 or 11, characterized in that in a boiler plant comprising several combustion air ducts, the apparatus comprises a separate mixing section for each duct.
14. An apparatus according to any one of claims 9, 10, 11, 12 or 13, characterized in that the boiler is a black liquor recovery boiler burning spent liquor from the pulp manufacturing industry.

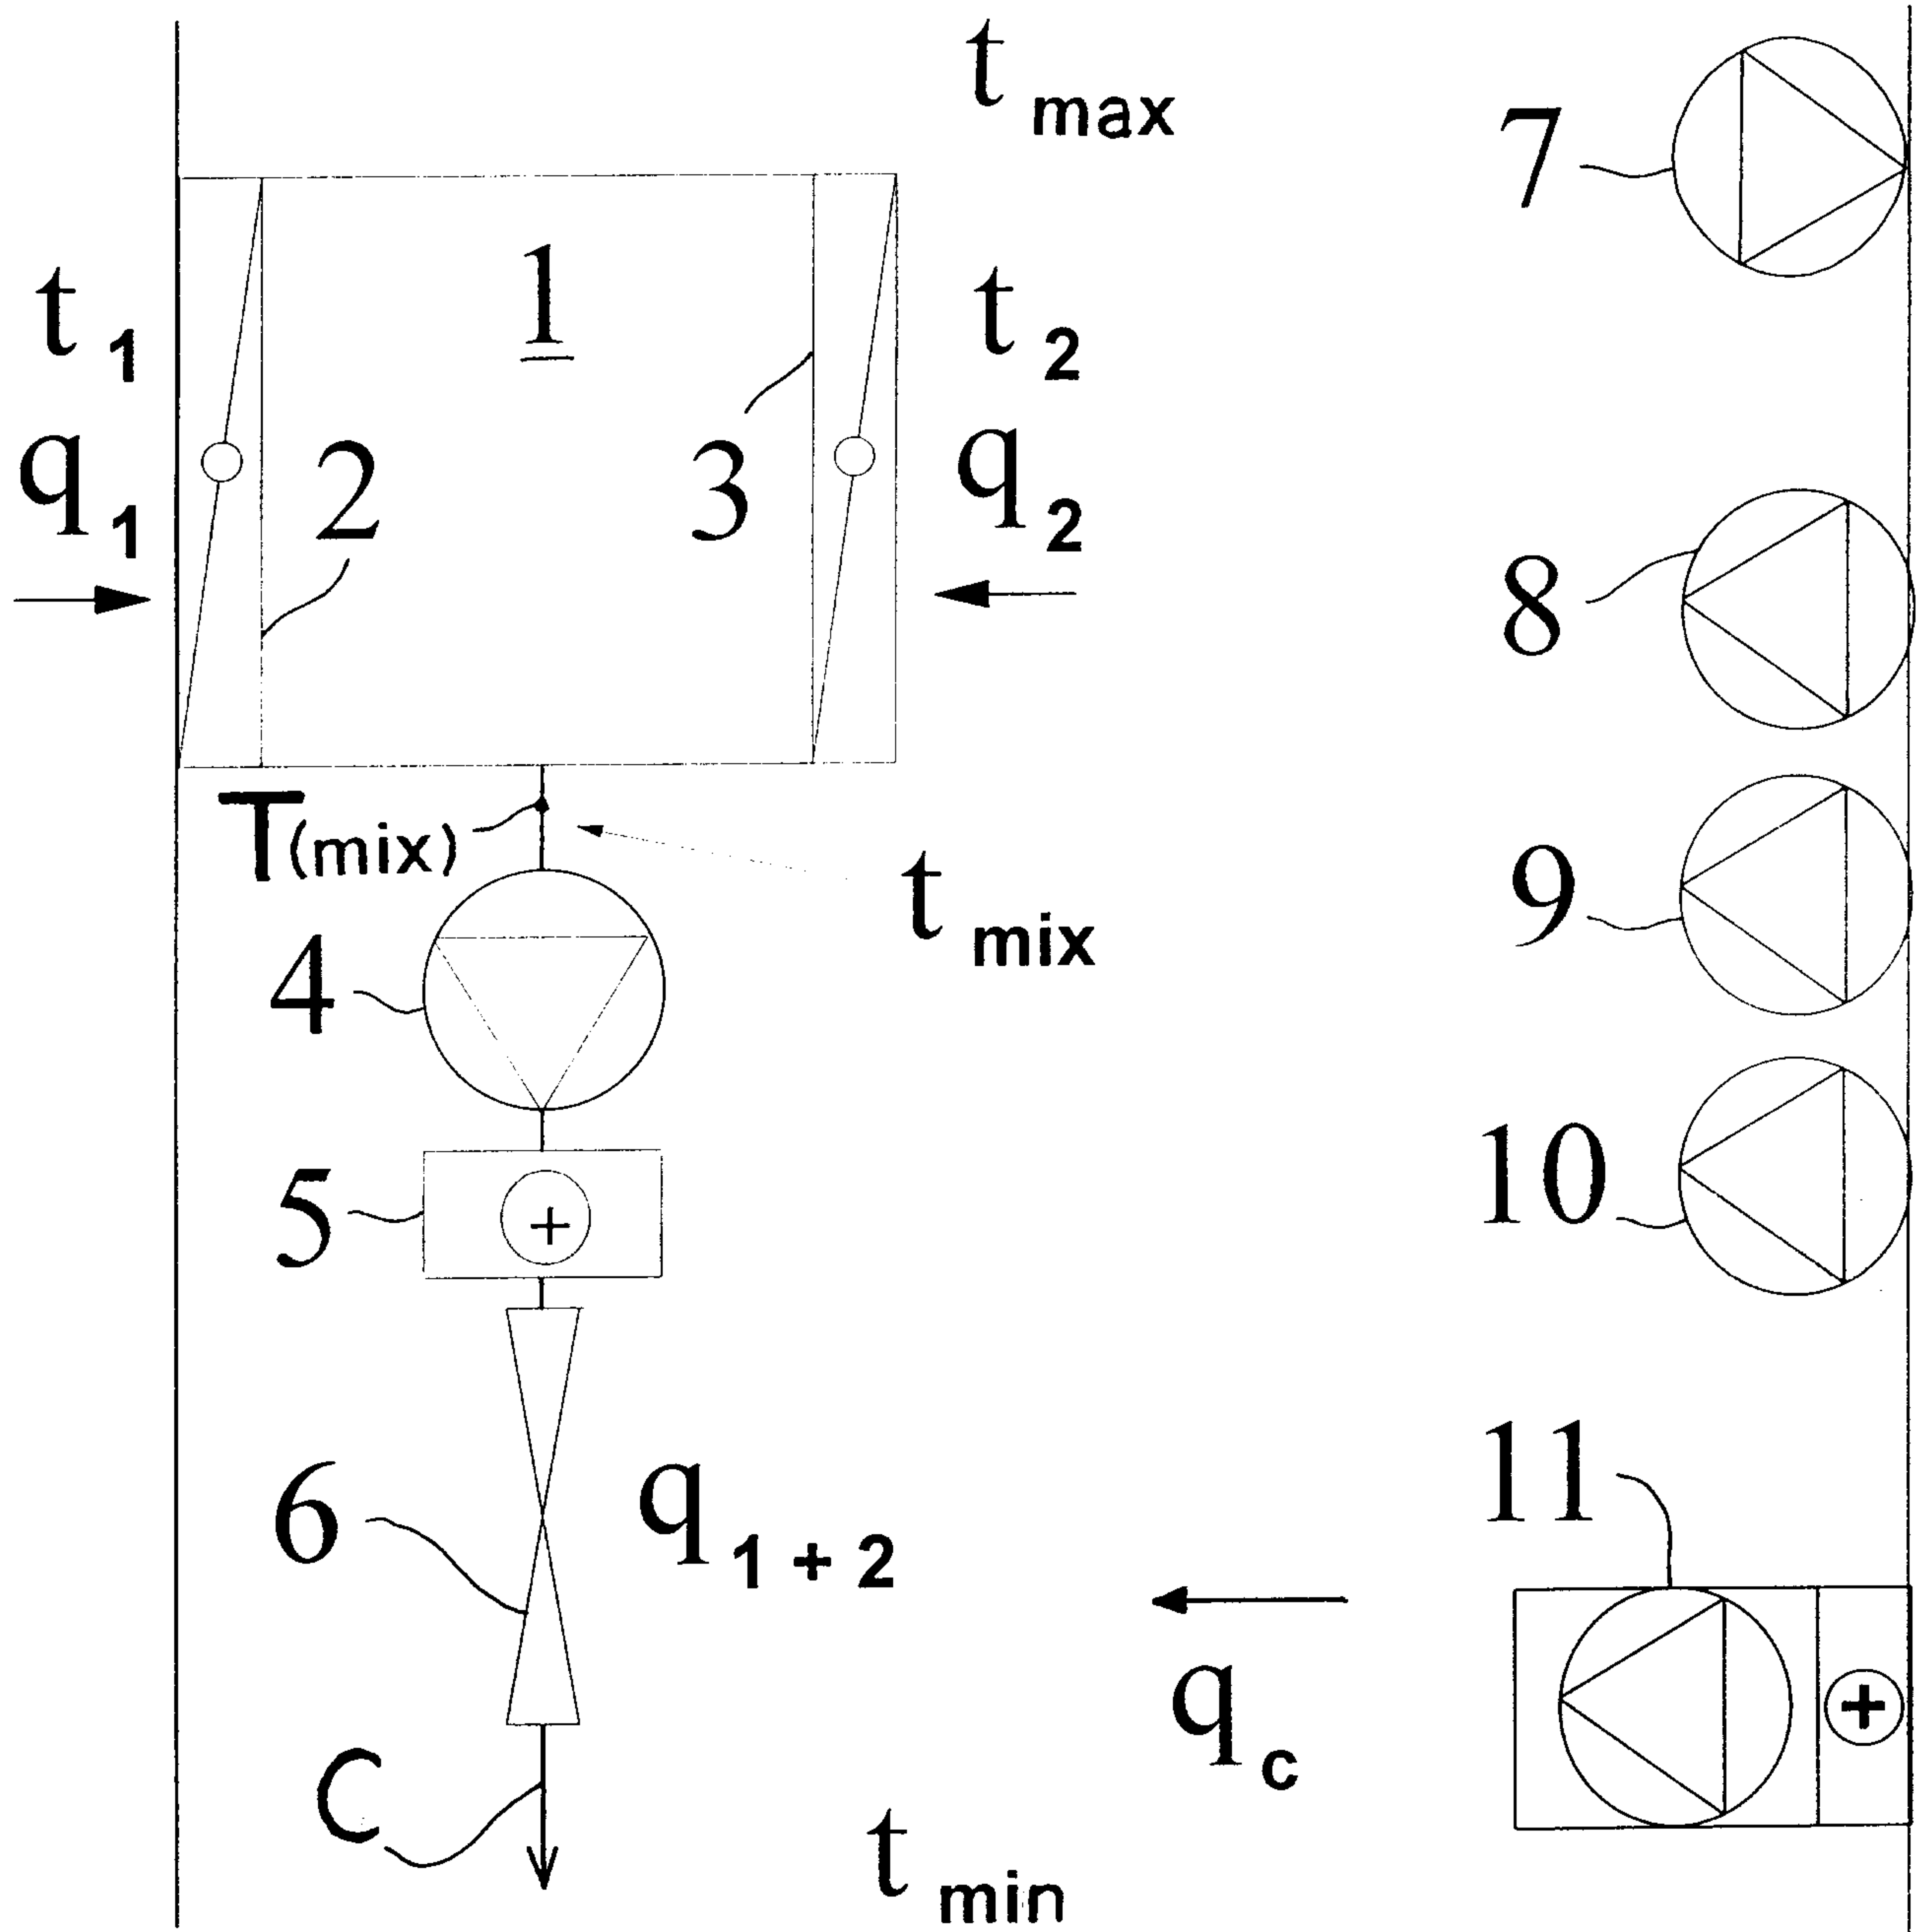
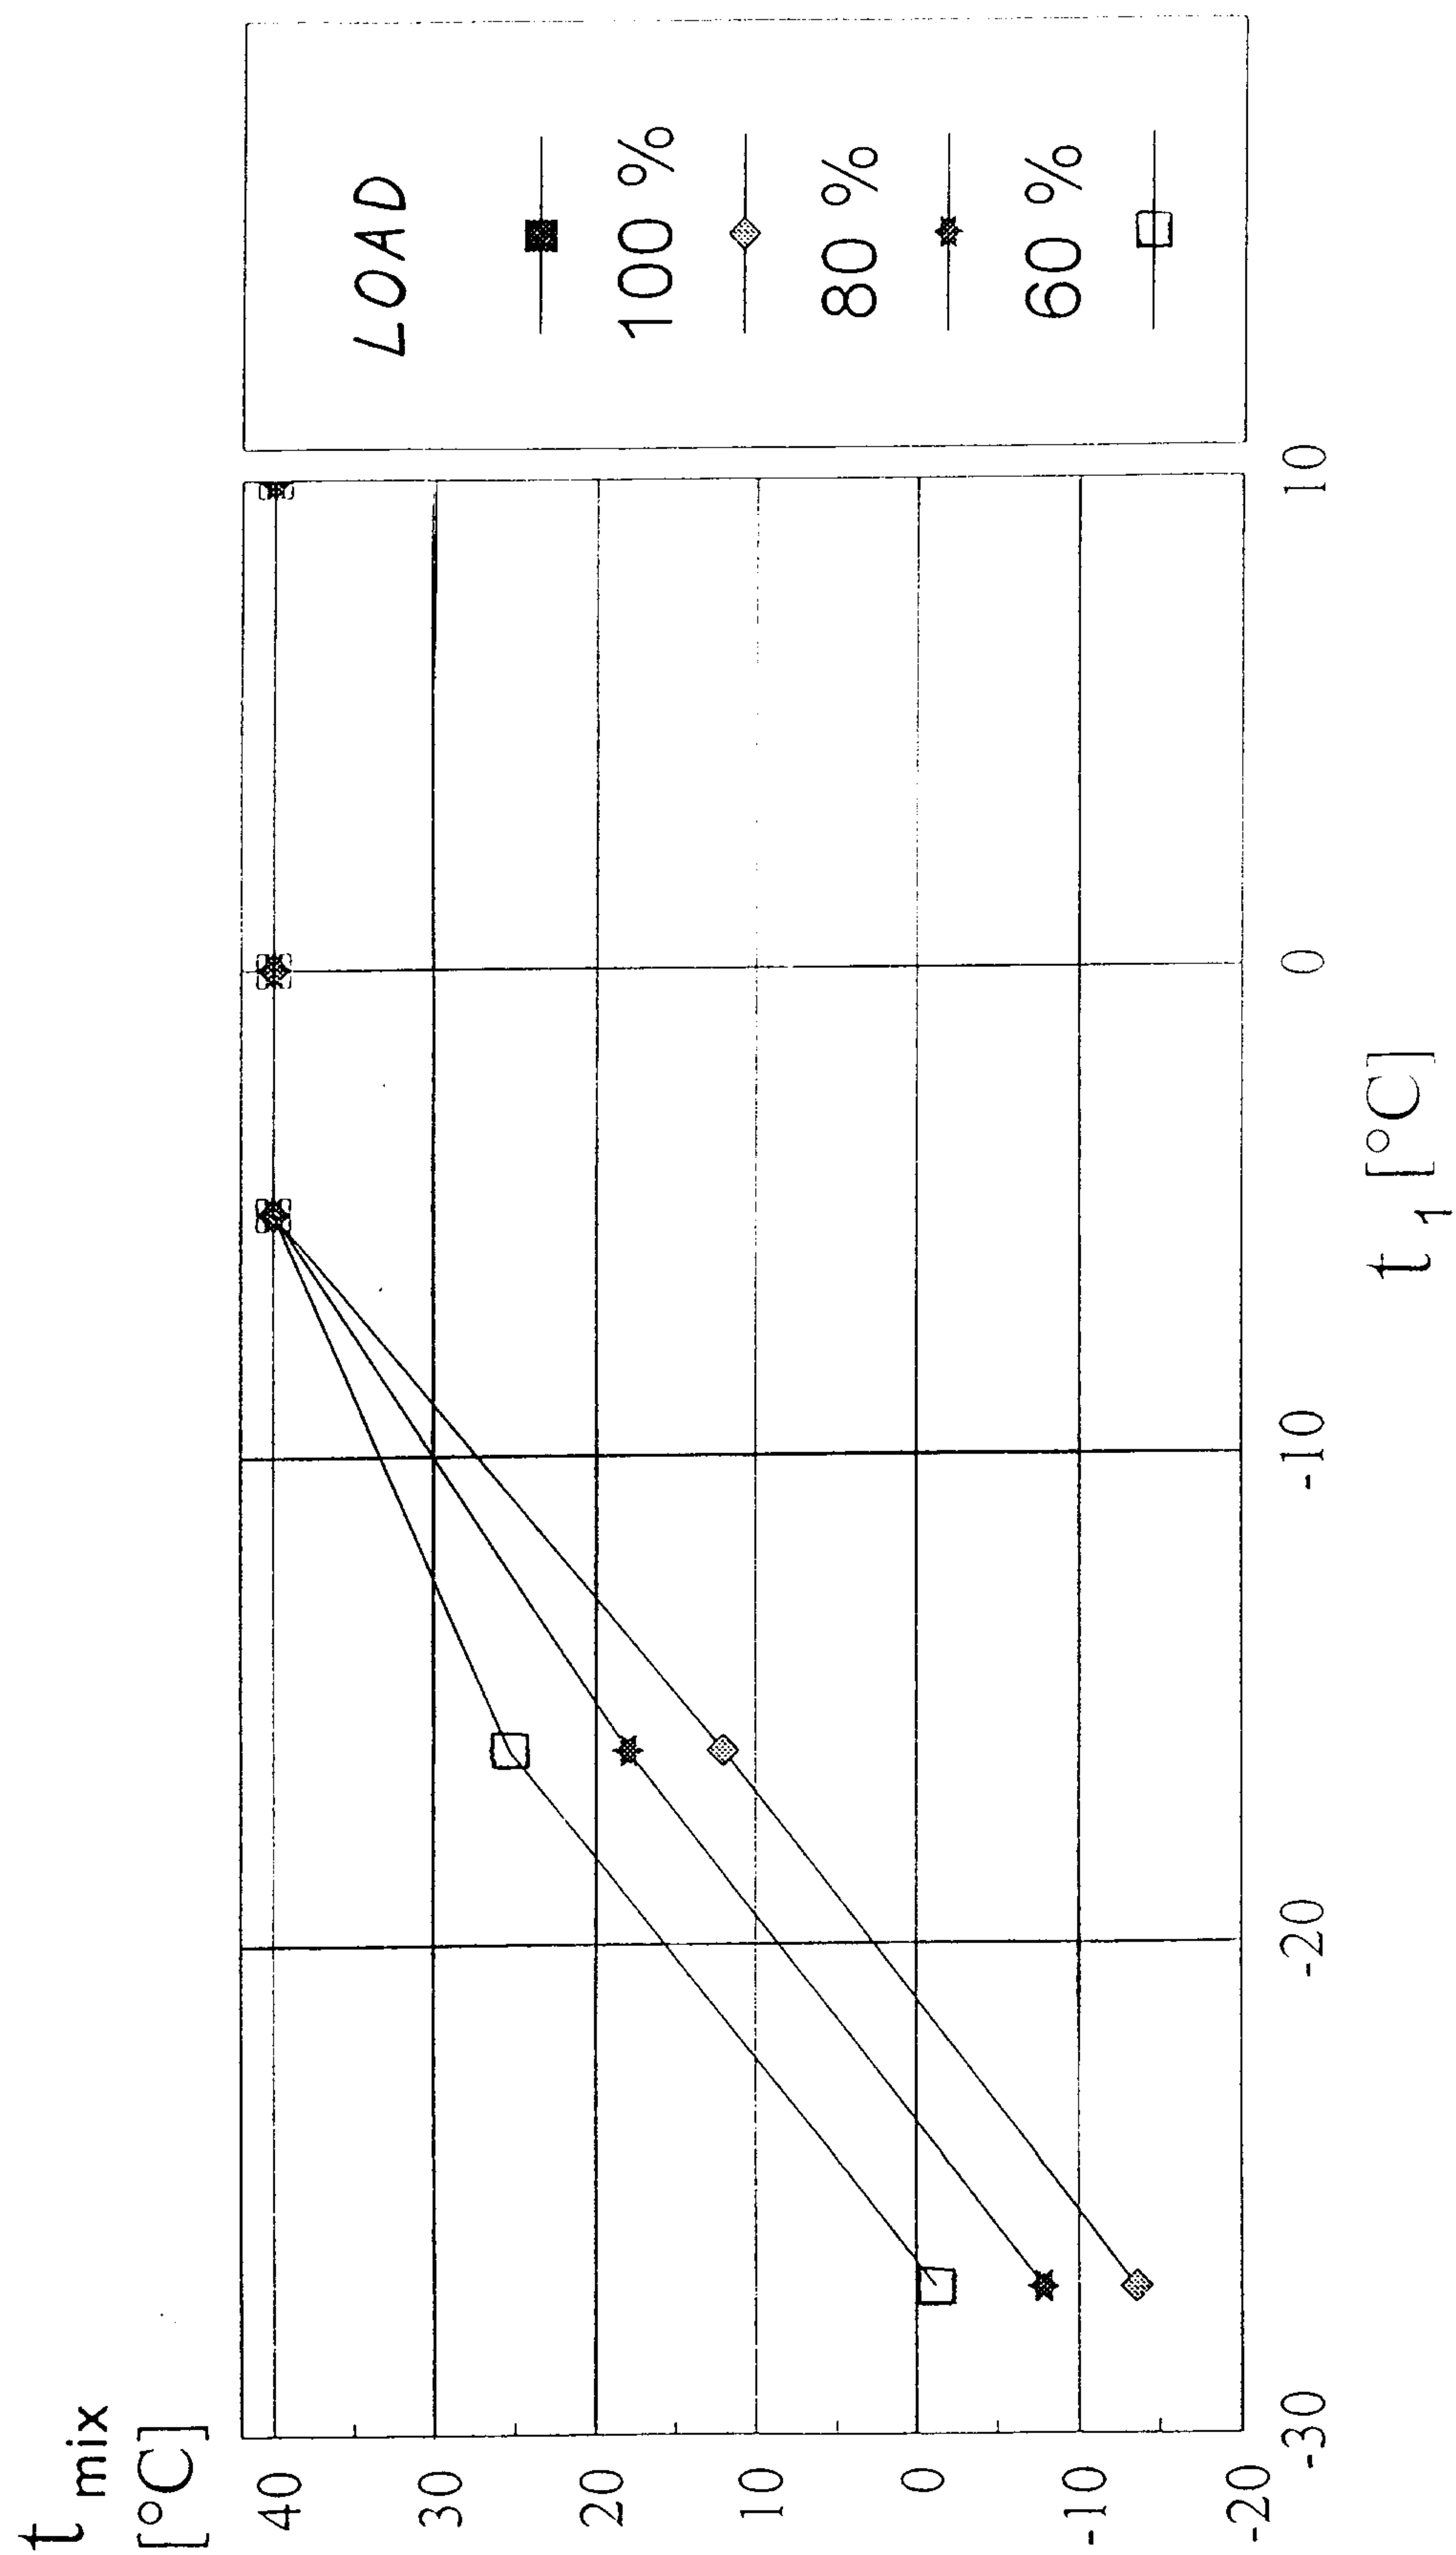


Fig. 1

Fig. 2



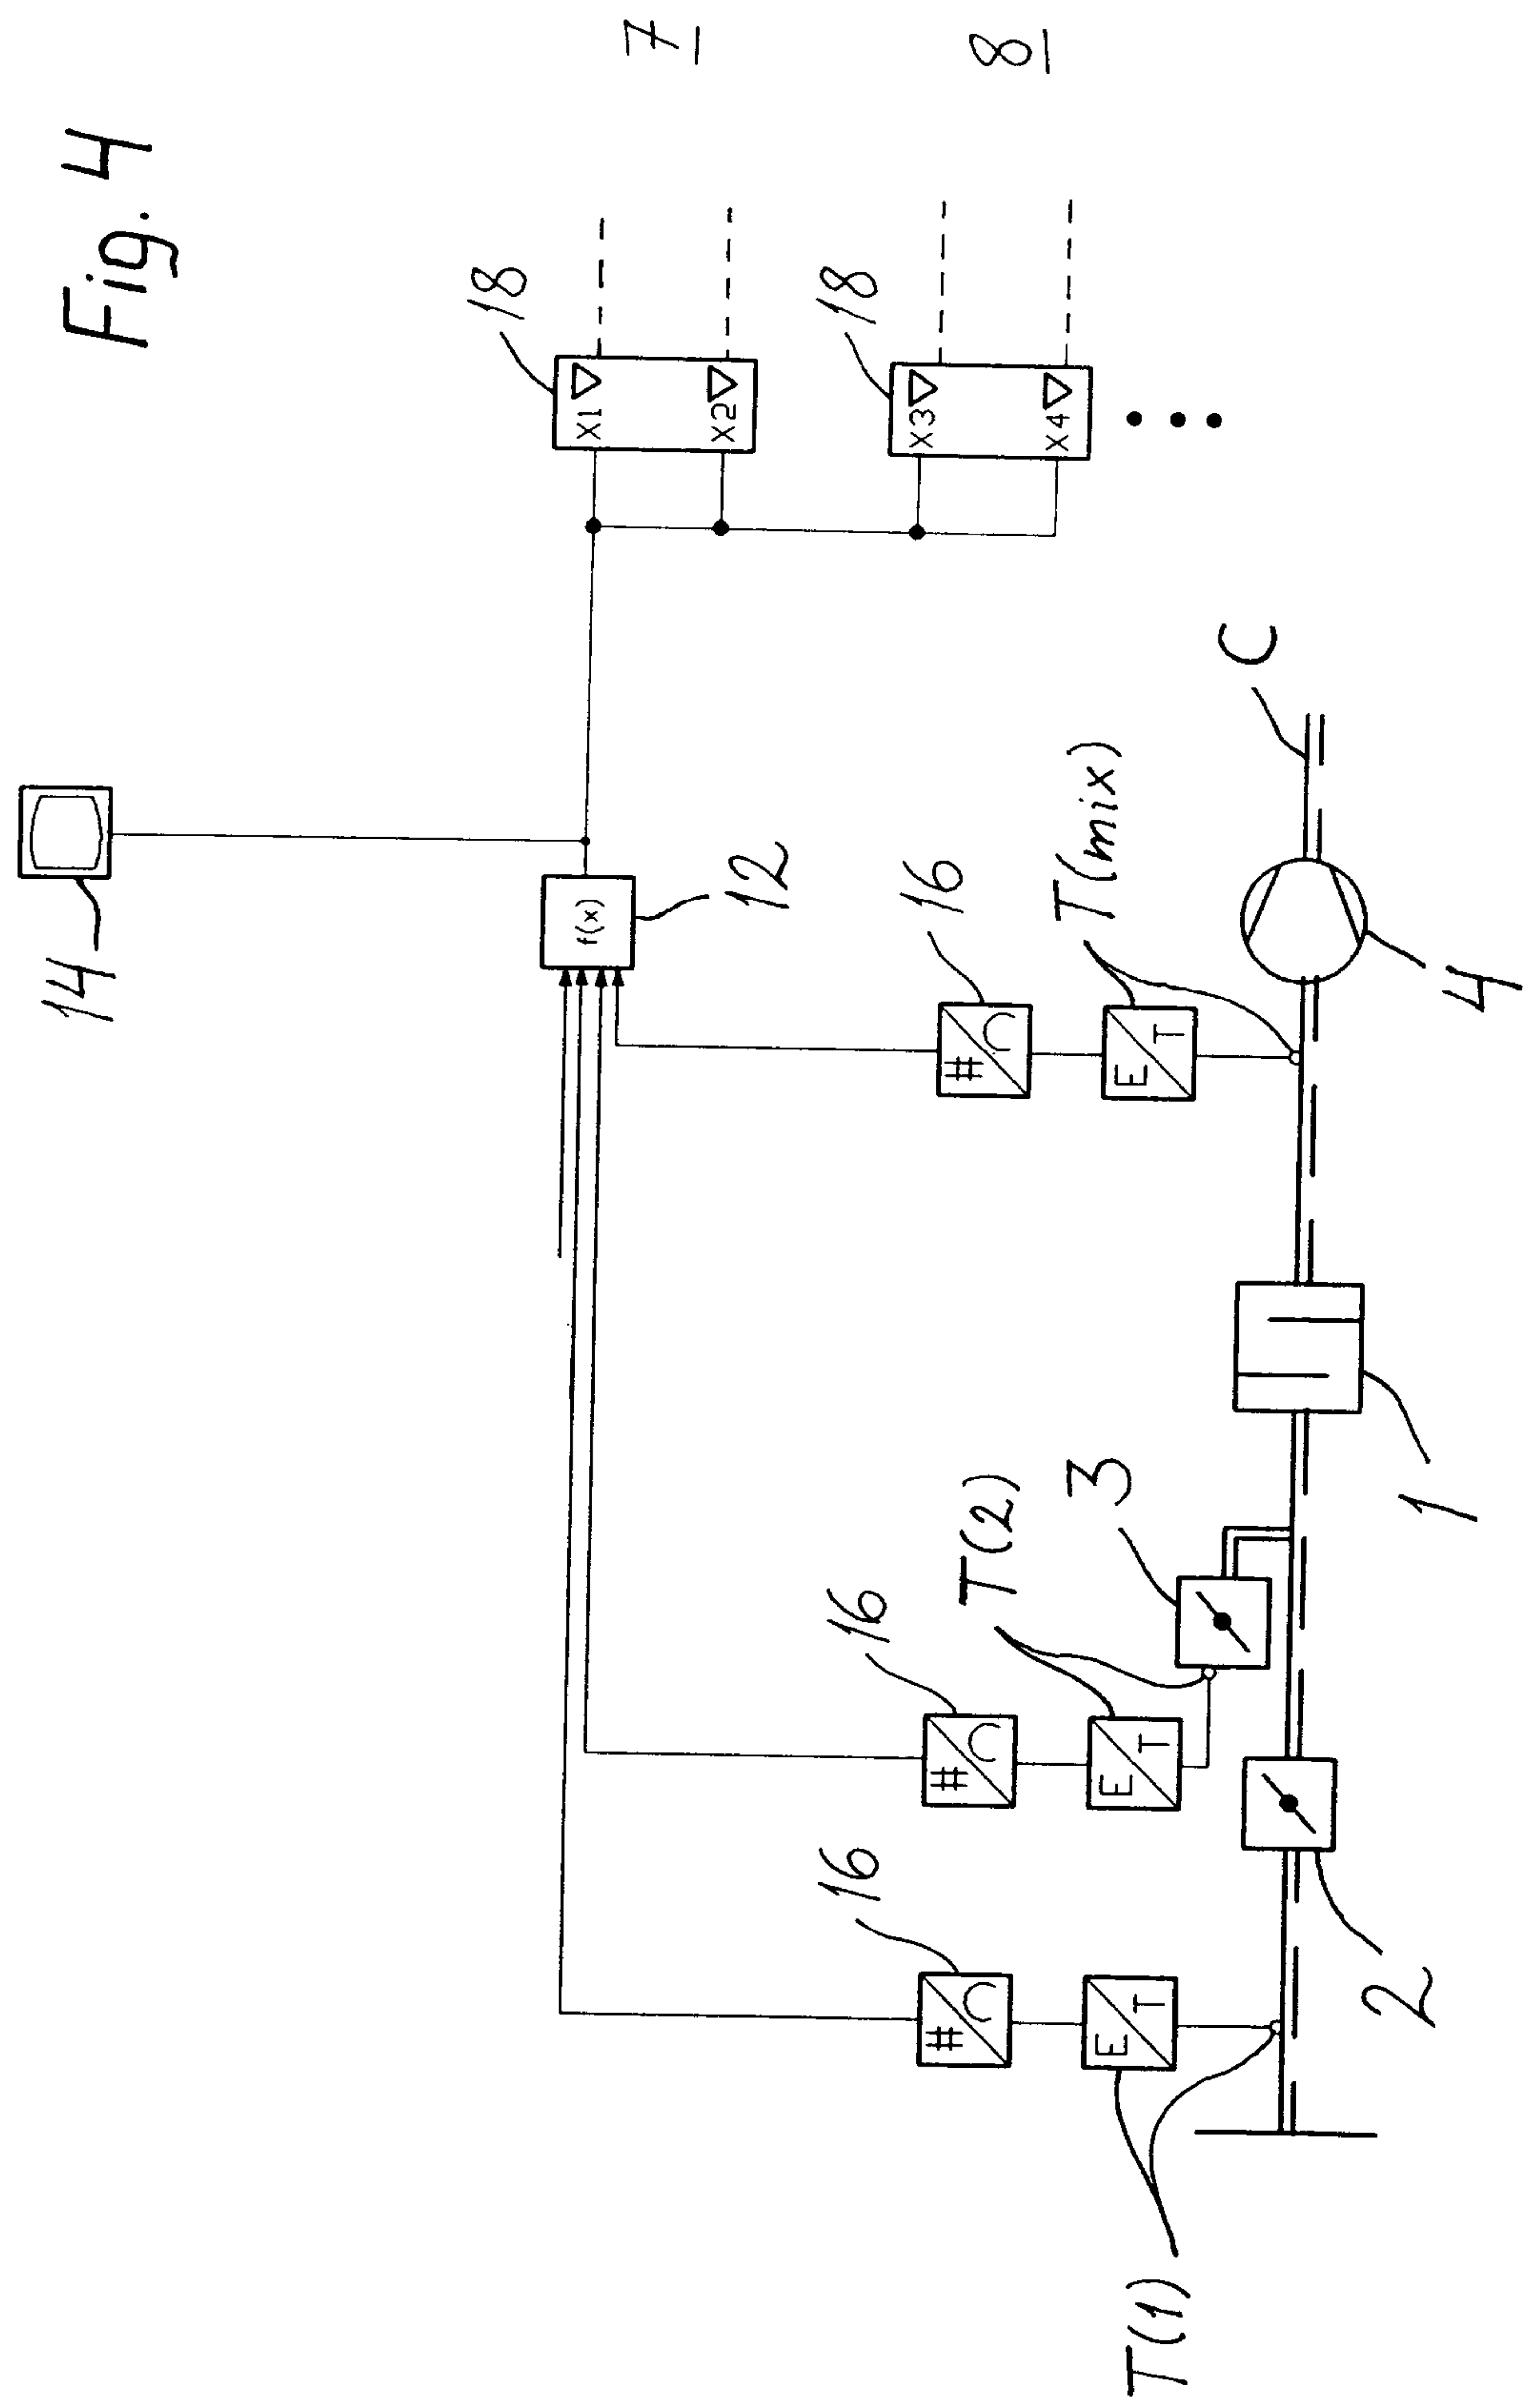


Fig. 4

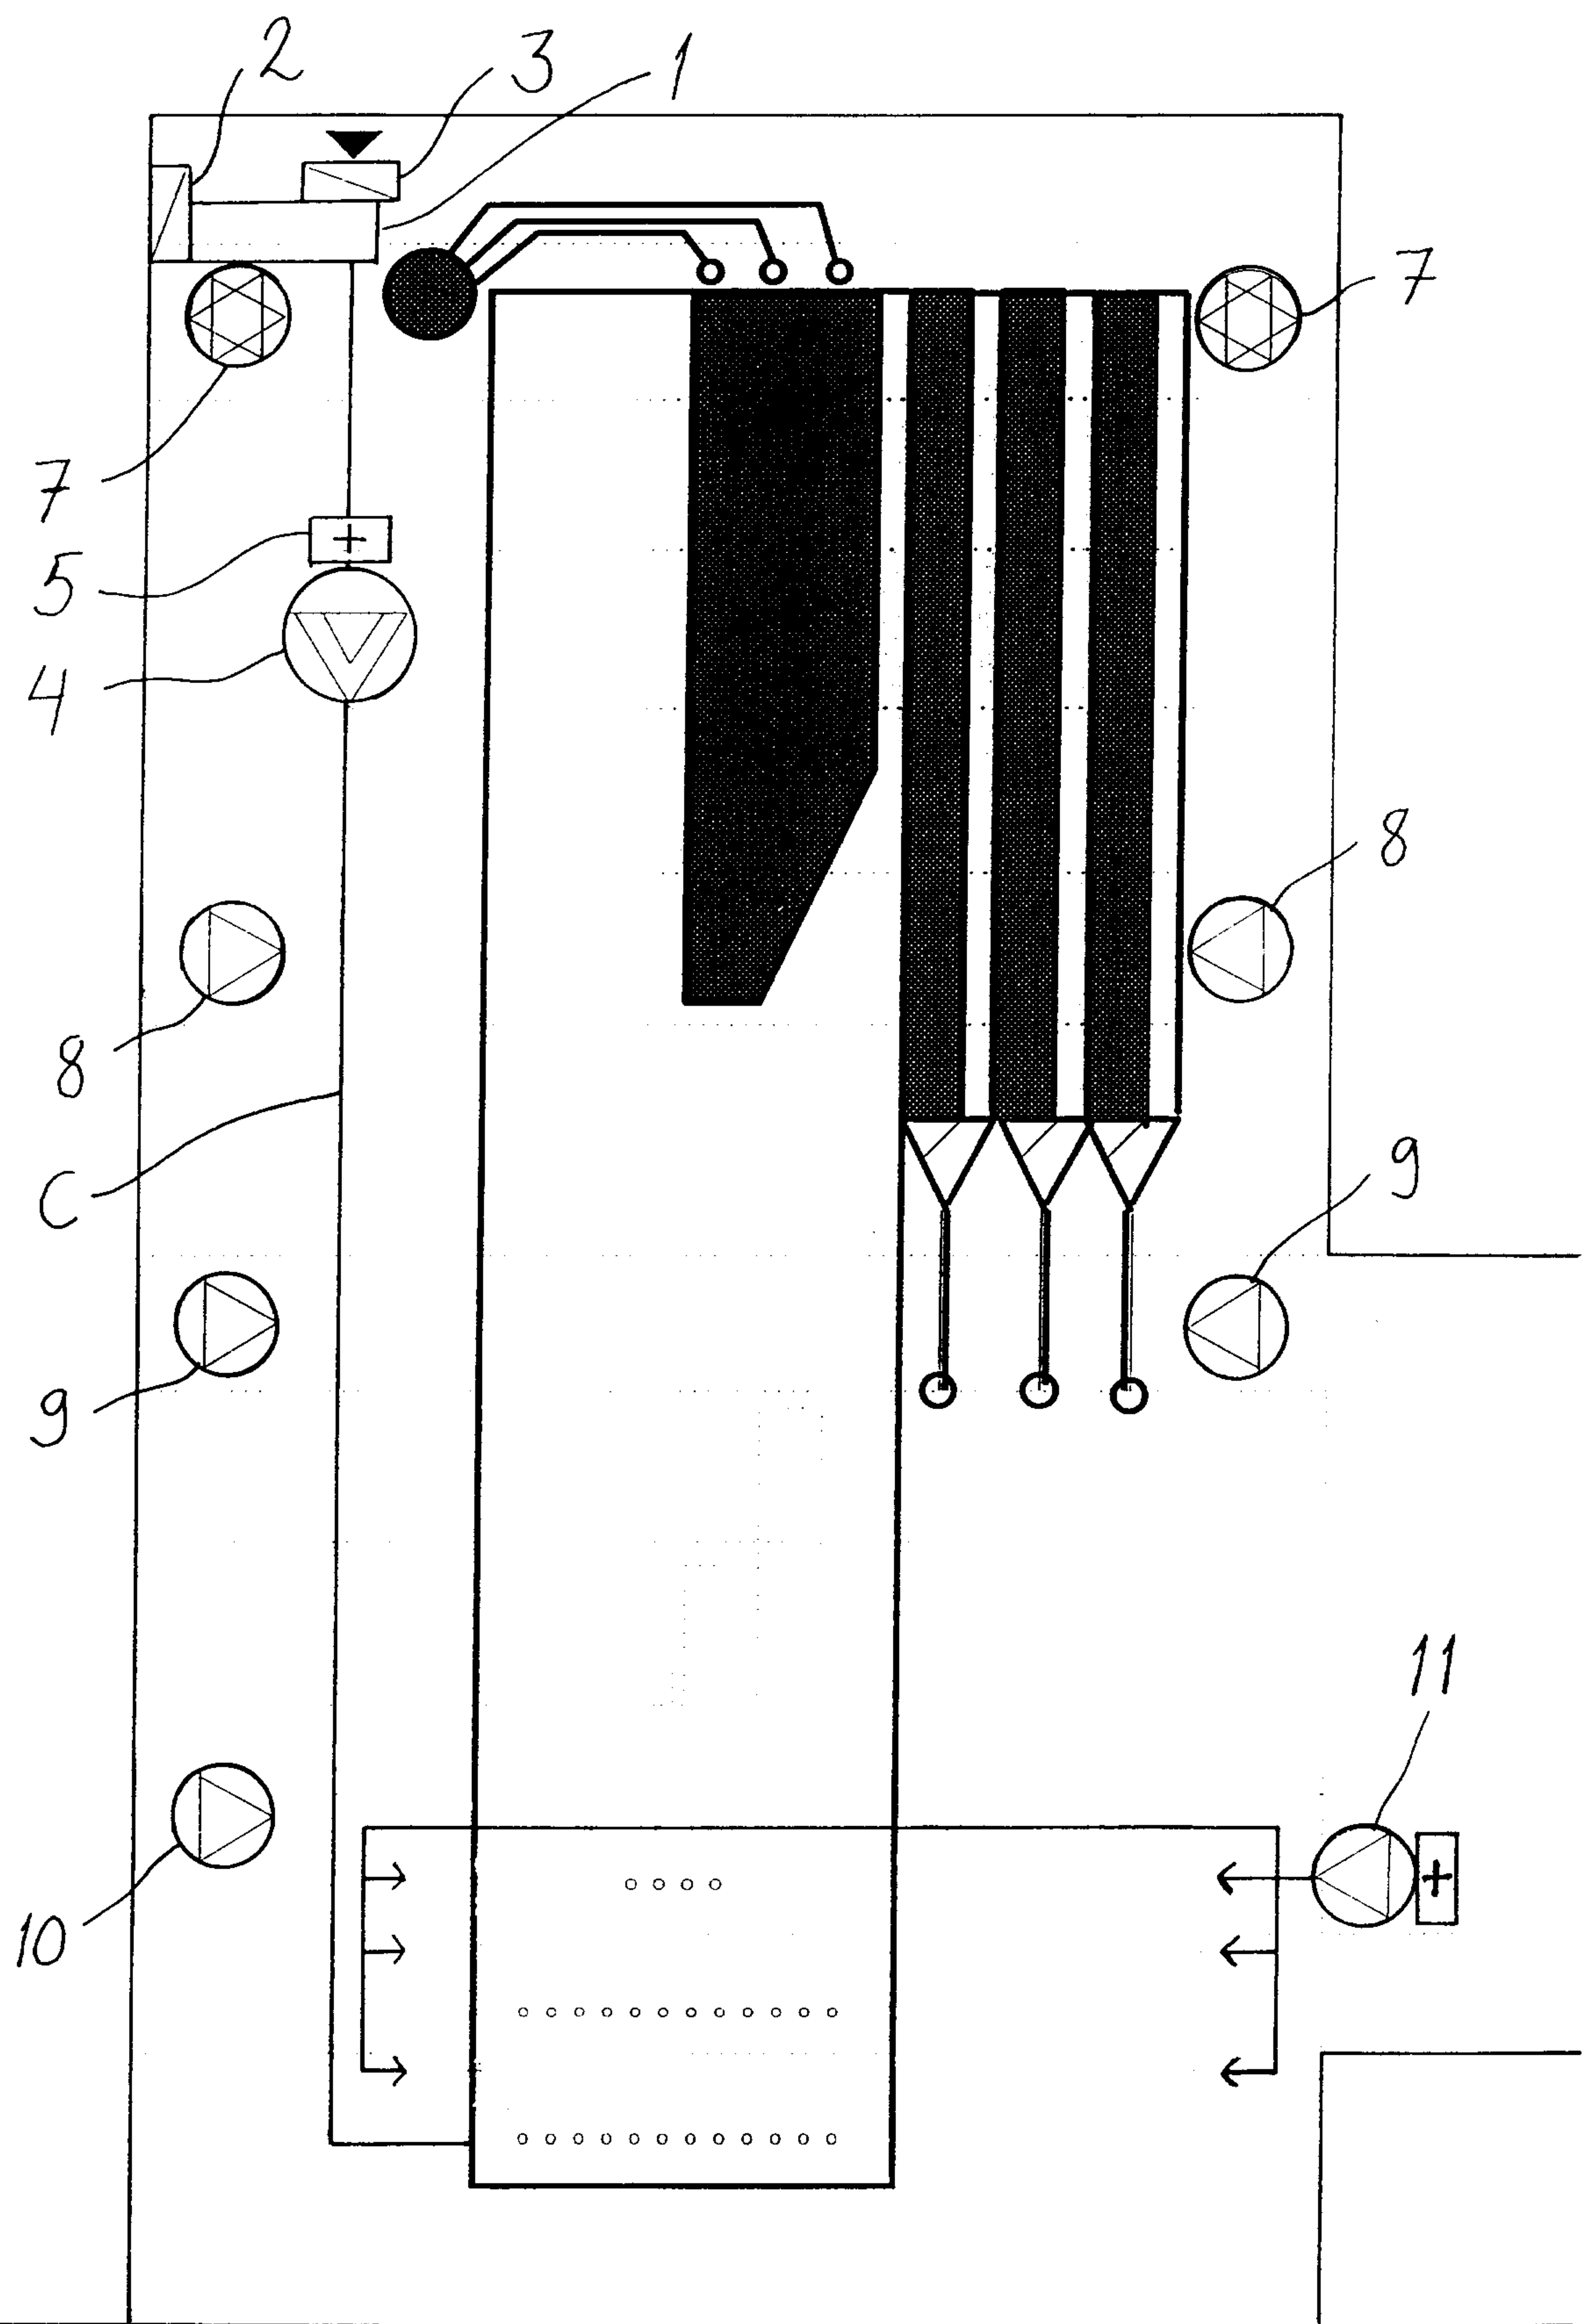


Fig. 5

