

(19)



(11)

EP 3 779 296 B1

(12)

EUROPEAN PATENT SPECIFICATION

(45) Date of publication and mention of the grant of the patent:

02.08.2023 Bulletin 2023/31

(21) Application number: **19776320.4**

(22) Date of filing: **26.02.2019**

(51) International Patent Classification (IPC):

F24F 1/0025 ^(2019.01) **F24F 1/0011** ^(2019.01)

F24F 1/0057 ^(2019.01) **F24F 13/10** ^(2006.01)

F24F 13/24 ^(2006.01)

(52) Cooperative Patent Classification (CPC):

F24F 1/0011; F24F 1/0025; F24F 1/0057;

F24F 13/10; F24F 13/24

(86) International application number:

PCT/JP2019/007257

(87) International publication number:

WO 2019/187895 (03.10.2019 Gazette 2019/40)

(54) **INDOOR UNIT OF AIR CONDITIONER**

INNENRAUMEINHEIT EINER KLIMAAANLAGE

UNITÉ D'INTÉRIEUR DE CLIMATISEUR

(84) Designated Contracting States:

**AL AT BE BG CH CY CZ DE DK EE ES FI FR GB
GR HR HU IE IS IT LI LT LU LV MC MK MT NL NO
PL PT RO RS SE SI SK SM TR**

(30) Priority: **30.03.2018 JP 2018070195**

(43) Date of publication of application:

17.02.2021 Bulletin 2021/07

(73) Proprietor: **DAIKIN INDUSTRIES, LTD.**

Osaka-Shi, Osaka 530-0001 (JP)

(72) Inventors:

- **TERAOKA Hironobu**
Osaka-shi, Osaka 530-8323 (JP)
- **TANAKA Hideshi**
Osaka-shi, Osaka 530-8323 (JP)
- **NAKAI Satoshi**
Osaka-shi, Osaka 530-8323 (JP)

• **HIGASHIDA Masahito**

Osaka-shi, Osaka 530-8323 (JP)

• **UDA Masafumi**

Osaka-shi, Osaka 530-8323 (JP)

• **MARUYAMA Kaname**

Osaka-shi, Osaka 530-8323 (JP)

• **CHEN Zuozhou**

Osaka-shi, Osaka 530-8323 (JP)

(74) Representative: **Hoffmann Eitle**

Patent- und Rechtsanwälte PartmbB

Arabellastraße 30

81925 München (DE)

(56) References cited:

EP-A1- 2 719 957 JP-A- H05 272 799

JP-A- H05 272 799 JP-A- 2007 292 356

JP-A- 2007 292 356 JP-A- 2007 292 405

JP-A- 2015 087 061 JP-A- 2015 087 062

JP-A- 2015 087 063 US-A1- 2002 172 588

Note: Within nine months of the publication of the mention of the grant of the European patent in the European Patent Bulletin, any person may give notice to the European Patent Office of opposition to that patent, in accordance with the Implementing Regulations. Notice of opposition shall not be deemed to have been filed until the opposition fee has been paid. (Art. 99(1) European Patent Convention).

Description

TECHNICAL FIELD

[0001] The present invention relates to an indoor unit of an air conditioner.

BACKGROUND ART

[0002] WO 2014/199590 A1 discloses one example of the structure of an indoor unit of an air conditioner in which a wall portion extends upward from a guide surface of a flap at each of two longitudinal ends of the flap.

[0003] JP H05 272799 A discloses diffuser prolonging members provided at an opening edge of a diffuser in an indoor unit. When an air conditioner is operated, the diffuser prolonging members advance so that the diffusing position is prolonged in the diffusing direction in order to improve the recovery of static pressure of diffusing air.

SUMMARY OF THE INVENTION

Problems that the Invention is to Solve

[0004] In the indoor unit in WO 2014/199590 A1, when the flap is located at a position such that air blown out of an outlet is directed downward from the indoor unit, a gap becomes large between the side walls of the flap and the outlet. This causes the blown-out air to flow backward between the side walls and the outlet, which results in surging.

[0005] One objective of the present disclosure is to provide an indoor unit of an air conditioner that reduces the occurrence of surging.

Means for Solving the Problems

[0006] The object above is solved by means of an indoor unit of an air conditioner according to independent claim 1. Distinct embodiments are derivable from the dependent claims.

[0007] According to the present invention, an indoor unit of an air conditioner includes an indoor unit main body, a heat exchanger, and a cross-flow fan. The indoor unit main body includes an inlet and an outlet. The heat exchanger performs heat exchange on air drawn in from the inlet. The cross-flow fan is configured to blow out air, which has undergone heat exchange performed by the heat exchanger, from the outlet. The cross-flow fan includes a blow-out flow path formed by a lower wall, left and right side walls, and an upper wall so that a cross-sectional area gradually increases downward. The blow-out flow path guides blown-out air to the outlet.

[0008] The indoor unit further includes a movement mechanism configured to switch between a stored state that does not project an element forming the blow-out flow path including the side walls out of the outlet and a projected state that projects at least the side walls out of

the outlet. The indoor unit further includes an indoor control unit configured to control the movement mechanism to switch between the stored state, in which the movable side walls do not project out of the outlet, and the projected state, in which the movable side walls project out of the outlet. The movement mechanism is in the projected state when an air conditioning operation is performed and in the stored state when an air conditioning operation is stopped. The side walls are configured to entirely cover the transverse sides of the outlet in the projected state.

[0009] With this structure, the side walls restrict the air blown out of the outlet from flowing sideward from the outlet. This allows the blow-out flow path to be extended from the outlet. In this manner, the static pressure in the blow-out flow path is increased to increase the air volume of the blow-out flow path is increased. Further, when the air flow resistance (internal pressure loss) in the indoor unit main body is high, backflow of air from the two side-ward ends of the outlet is restricted. Thus, surging is unlikely to occur.

[0010] With this structure, the blow-out flow path projects out of the indoor unit main body when an air conditioning operation is performed. Thus, surging is unlikely to occur. Further, the blow-out flow path is stored in the indoor unit main body when an air conditioning operation is stopped. Thus, the aesthetic appearance of the indoor unit is improved.

[0011] In the above-described indoor unit of an air conditioner, it is preferred that the lower wall be arranged to project out of the outlet at least when an air conditioning operation is performed.

[0012] With this structure, the lower wall projects out of the outlet with the two side walls. Thus, the two side walls and the lower wall restrict the air blown out of the outlet from flowing sideward and downward from the outlet. This allows the blow-out flow path to be extended from the outlet. In this manner, the blow-out flow path serving as a diffuser is lengthened compared to a structure that does not project the two side walls and the lower wall out of the outlet. This further increases the static pressure in the blow-out flow path and further increases the air volume of the blow-out flow path. Also, when the air flow resistance (internal pressure loss) in the indoor unit main body is high, backflow of air from the two side-ward ends and the lower part of the outlet is restricted. Thus, surging is even less likely to occur.

[0013] In the above-described indoor unit of an air conditioner, it is preferred that the upper wall be arranged to project out of the outlet at least when an air conditioning operation is performed.

[0014] With this structure, the upper wall projects out of the outlet with the two side walls. Thus, the two side walls and the upper wall restrict the air blown out of the outlet from flowing sideward and upward from the outlet. This allows the blow-out flow path to be extended from the outlet. In this manner, the blow-out flow path serving as a diffuser is lengthened compared to a structure that does not project the two side walls and the upper wall

out of the outlet. This further increases the static pressure in the blow-out flow path and further increases the air volume of the blow-out flow path. Also, when the air flow resistance (internal pressure loss) in the indoor unit main body is high, backflow of air from the two sideward ends and the upper part of the outlet is restricted. Thus, surging is even less likely to occur.

[0015] In the above-described indoor unit of an air conditioner, it is preferred that the blow-out flow path be formed to project out of the outlet so that a distance between the left and right side walls in a sideward direction in the blow-out flow path at a downstream side of the outlet is less than a sideward length of the outlet.

[0016] With this structure, the cross-sectional area of the blow-out flow path at a downstream side of the outlet is decreased so that the velocity of the air in the blow-out flow path at the downstream side of the outlet is increased. This restricts backflow of air from the outlet. Thus, surging is even less likely to occur.

[0017] In the above-described indoor unit of an air conditioner, it is preferred that the movement mechanism is configured to move the element to decrease a cross-sectional area of the blow-out flow path at a portion projecting from the outlet, when surging is detected.

[0018] With this structure, when surging occurs, the cross-sectional area of the blow-out flow path at a downstream side of the outlet is decreased so that the velocity in the air in the blow-out flow path at the downstream side of the outlet is increased. This restricts backflow of air from the outlet thereby impeding surging.

[0019] In the above-described indoor unit of an air conditioner, it is preferred that the indoor unit be configured so that a ratio (H/D) of height H of the indoor unit main body to outer diameter D of an impeller of the cross-flow fan is less than 2.2.

[0020] With this structure, the indoor unit main body uses the cross-flow fan including the impeller with a relatively large outer diameter. This allows noise and power consumption to be reduced when an air conditioning operation is performed.

[0021] In the above-described indoor unit of an air conditioner, it is preferred that the occurrence of surging is detected by the indoor control unit based on either the rotational speed of a fan motor of the cross-fan or based on the current supplied to the fan motor of the cross-flow fan, wherein the indoor control unit determines that surging has not occurred when the rotational speed of the fan motor is in a tolerable rotational speed range that has a predetermined width centered on the set rotational speed, or when the current supplied to the fan motor is in a tolerable current range that has a predetermined width centered on a current value corresponding to the set rotational speed, and the indoor control unit determines that surging has occurred when the rotational speed of the motor is outside the tolerable rotational speed range, or when the current supplied to the fan motor is outside the tolerable current range.

BRIEF DESCRIPTION OF THE DRAWINGS

[0022]

Fig. 1 shows diagrams of an indoor unit of an air conditioner in accordance with a first embodiment, in which Fig. 1A is a perspective view of the indoor unit in a stored state, and Fig. 1B is a perspective view of the indoor unit in a projected state.

Fig. 2 shows diagrams of the indoor unit in Fig. 1, in which Fig. 2A is a cross-sectional view of the indoor unit in the stored state, and Fig. 2B is a cross-sectional view of the indoor unit in the projected state.

Fig. 3 is a block diagram showing the electrical structure of the air conditioner.

Fig. 4 is a flowchart illustrating one example of a procedure for processing movement control executed by a control unit of the indoor unit.

Fig. 5 shows diagrams of an indoor unit of an air conditioner in accordance with a second embodiment not part of the invention, in which Fig. 5A is a perspective view of the indoor unit in a stored state, and Fig. 5B is a perspective view of the indoor unit in a projected state.

Fig. 6 shows diagrams of the indoor unit in Fig. 5, in which Fig. 6A is a cross-sectional view of the indoor unit in the stored state, and Fig. 6B is a cross-sectional view of the indoor unit in the projected state.

Fig. 7 shows diagrams of an indoor unit of an air conditioner in accordance with a third embodiment not part of the invention, in which Fig. 7A is a perspective view of the indoor unit in a stored state, and Fig. 7B is a perspective view of the indoor unit in a projected state.

Fig. 8 shows diagrams of the indoor unit in Fig. 7, in which Fig. 8A is a cross-sectional view of the indoor unit in the stored state, and Fig. 8B is a cross-sectional view of the indoor unit in the projected state.

Fig. 9 shows diagrams of an indoor unit of an air conditioner in accordance with a fourth embodiment not part of the invention, in which Fig. 9A is a cross-sectional view of the indoor unit, and Fig. 9B is an enlarged view of a blow-out flow path and its periphery shown in Fig. 9A.

Fig. 10 shows diagrams of an indoor unit of an air conditioner of a modified example, in which Fig. 10A is a perspective view of the indoor unit in a stored state, and Fig. 10B is a perspective view of the indoor unit in a projected state.

Fig. 11 shows diagrams of an indoor unit of an air conditioner of a modified example, in which Fig. 11A is a perspective view of the indoor unit in a stored state, and Fig. 11B is a perspective view of the indoor unit in a projected state.

Fig. 12 shows diagrams of an indoor unit of an air conditioner of a modified example, in which Fig. 12A is a perspective view of the indoor unit in a stored state, and Fig. 12B is a perspective view of the indoor

unit in a projected state.

Fig. 13 shows diagrams of an indoor unit of an air conditioner of a modified example, in which Fig. 13A is a cross-sectional view of the indoor unit in a stored state, and Fig. 13B is a cross-sectional view of the indoor unit in a projected state.

Fig. 14 shows diagrams of an indoor unit of an air conditioner of a modified example, in which Fig. 14A is a cross-sectional view of the indoor unit in a stored state, and Fig. 14B is a cross-sectional view of the indoor unit in a projected state.

Fig. 15 shows diagrams of an indoor unit of an air conditioner of a modified example, in which Fig. 15A is a perspective view of the indoor unit, and Fig. 15B is an enlarged view of part of Fig. 15A.

MODES FOR CARRYING OUT THE INVENTION

First Embodiment

[0023] An indoor unit 1 of an air conditioner in accordance with a first embodiment will now be described with reference to Figs. 1 and 4.

[0024] The indoor unit 1 of the present embodiment is of a wall-mounted type and includes a rear portion attached to an indoor wall WL. The indoor unit 1 is, for example, configured to perform a cooling operation that cools an indoor space and a heating operation that heats an indoor space.

[0025] As shown in Figs. 1 and 2, the indoor unit 1 includes an indoor unit main body 10. The indoor unit main body 10 has the form of a box, in which a lateral direction (sideward direction of indoor unit 1) coincides with the longitudinal direction, and includes an inner space surrounded by a top surface portion 11, a front surface portion 12, a rear surface portion 13, two side surface portions 14, and a bottom surface portion 15. The indoor unit 1 is mounted on the wall WL by coupling the rear surface portion 13 to a mounting panel (not shown) on the wall WL with screws or the like. The top surface portion 11 of the indoor unit main body 10 includes an inlet 16, and the bottom surface portion 15 includes an outlet 17. The inlet 16 and the outlet 17 are each arranged so that the lateral direction (sideward direction) coincides with the longitudinal direction. The inlet 16 is formed along the top surface portion 11. The outlet 17 is formed along the bottom surface portion 15.

[0026] As shown in Fig. 2, the indoor unit 1 includes an air filter 21, an indoor heat exchanger 22, a cross-flow fan 23, and a flap 24. The air filter 21, the indoor heat exchanger 22, and the cross-flow fan 23 are accommodated in the indoor unit main body 10.

[0027] The air filter 21 is coupled to the indoor unit main body 10 in a removable manner. The air filter 21 removes dust from indoor air drawn in from the inlet 16. In a state in which the air filter 21 is attached to the indoor unit main body 10, the air filter 21 is located between the top surface portion 11 and the indoor heat exchanger 22 of the indoor

unit main body 10. In this manner, the air filter 21 limits the collection of dust, which is suspended in the indoor air, on the surface of the indoor heat exchanger 22.

[0028] The indoor heat exchanger 22 includes a plurality of fins and a plurality of heat transfer tubes that extend through the fins. The indoor heat exchanger 22 serves as an evaporator or a condenser in accordance with an operation state of the indoor unit 1 and exchanges heat between a refrigerant flowing through the heat transfer tubes and air flowing through the indoor heat exchanger 22.

[0029] The indoor heat exchanger 22 is arranged so that its front end and rear end are bent downward in a side view. The indoor heat exchanger 22 is arranged to surround the cross-flow fan 23 from above.

[0030] The cross-flow fan 23 is located inside the indoor unit main body 10 at a substantially central portion. The cross-flow fan 23 includes an impeller 25 and a fan case 27. The impeller 25 is substantially cylindrical and has a lateral direction (sideward direction) that coincides with the longitudinal direction. The fan case 27 forms a blow-out flow path 26 that extends to the outlet 17. The blow-out flow path 26 is formed by a lower wall 26L, left and right side walls 26S, and an upper wall 26U in a manner so that its cross-sectional area gradually increases downward. In other words, the cross-sectional area of the blow-out flow path 26 increases toward the outlet 17. In this manner, the blow-out flow path 26 functions as a diffuser.

[0031] When the cross-flow fan 23 is being rotated and operated, the indoor air drawn in from the inlet 16 flows through the indoor heat exchanger 22 to the cross-flow fan 23. Then, the indoor air flows from the cross-flow fan 23 through the blow-out flow path 26 and is blown out of the outlet 17 into the room.

[0032] The impeller 25 of the cross-flow fan 23 has an outer diameter D, and the rear surface portion 13 of the indoor unit main body 10 has a vertical dimension (up-down dimension) that corresponds to a height H of the indoor unit main body 10. Preferably, the outer diameter D is 126 mm or greater and less than 150 mm. Further preferably, the outer diameter D is 135 mm or greater and less than 150 mm. Preferably, the height H of the indoor unit main body 10 is 295 mm or less. Further preferably, the height H of the indoor unit main body 10 is 250 mm or greater and 295 mm or less. Preferably, a ratio (H/D) of the height H of the indoor unit main body 10 to the outer diameter D is less than 2.2. Further preferably, the ratio (H/D) of the height H of the indoor unit main body 10 to the outer diameter D is 1.6 or greater and less than 2.2.

[0033] The flap 24 is arranged at a lower edge of the outlet 17 and is rotatable relative to the indoor unit main body 10. The flap 24 has the form of a flat plate and its lateral direction (sideward direction) coincides with the longitudinal direction. The flap 24 has a length in the longitudinal direction that is substantially the same as that of the outlet 17. The flap 24 is configured to be pivoted

by a flap driving motor 28 (refer to Fig. 3) about a rotation axis C1.

[0034] The indoor unit 1 of the present embodiment includes a movement mechanism 29 that is configured to move the two side walls 26S of the blow-out flow path 26. More specifically, the two side walls 26S each include a fixed side wall 26SF and a movable side wall 26SM. The fixed side wall SF and the movable side wall 26SM are arranged to be overlapped with each other in the lateral direction (sideward direction). The movable side wall 26SM is configured to be movable so as to slide relative to the fixed side wall SF and project out of the outlet 17. The movement mechanism 29 moves the movable side walls 26SM. The movement mechanism 29 includes a first motor (not shown), which serves a drive source, and a rotation-linear movement conversion mechanism (not shown), which converts rotation of the first motor into linear movement in a predetermined direction. One example of the movement mechanism 29 is a feed-screw mechanism. Further, in a state in which the movable side walls 26SM project out of the outlet 17, the movement mechanism 29 is configured to move the movable side walls 26SM so as to decrease the cross-sectional area between the left and right movable side walls 26SM. In one example, the movement mechanism 29 includes a second motor (not shown) that pivots each movable side wall 26SM about a rotation axis C2 (refer to Fig. 2B). This allows the distance between the left and right movable side walls 26SM in the sideward direction to be changed at a projected end side. In this manner, the movement mechanism 29 allows for switching between a restricted state, in which the cross-sectional area between the left and right movable side walls 26SM is decreased, and a normal state, in which the cross-sectional area between the left and right movable side walls 26SM is not decreased. In one example, in the restricted state, the distance between the left and right movable side walls 26SM in the sideward direction at the projected end side is less than the sideward length of the outlet 17.

[0035] As shown in Fig. 3, the air conditioner includes an outdoor control unit 7 that controls each of a compressor 3 of an outdoor unit 2, a four-way switching valve 4, an outdoor fan 5, and an expansion valve 6. In one example, the outdoor control unit 7 controls the operational frequency (Hz) of the compressor 3, the rotational speed (rpm) of a motor of the outdoor fan 5, and the open degree of the expansion valve 6. Further, the outdoor control unit 7 switches the four-way switching valve 4 between a first state, in which a refrigerant circuit of the air conditioner (not shown) is in a cooling cycle, and a second state, in which the refrigerant circuit is in a heating cycle.

[0036] The indoor unit 1 includes an indoor control unit 30. The indoor control unit 30 includes a processor and storage. The processor executes predetermined control programs, and the storage stores information used for various types of control programs and control processes. The processor includes, for example, a central processing unit (CPU) or a micro-processing unit (MPU). The

storage includes, for example, a nonvolatile memory and a volatile memory. The non-volatile memory includes, for example, a read-only memory (ROM), a hard disk, and a flash memory. The volatile memory includes, for example, a random-access memory (RAM). The indoor control unit 30 may include one or more microcomputers. The outdoor control unit 7 may be configured in the same manner as the indoor control unit 30.

[0037] The indoor control unit 30 is configured to establish wired or wireless communication with the outdoor control unit 7. Further, the indoor control unit 30 is configured to establish wireless communication with a remote controller 31. The indoor control unit 30 controls the cross-flow fan 23, the flap driving motor 28, and the movement mechanism 29 based on operation instructions from the remote controller 31. Further, the indoor control unit 30 transmits the contents of an operation instruction from the remote controller 31 to the outdoor control unit 7. Based on the operation instruction from the remote controller 31, the outdoor control unit 7 controls the operational frequency (Hz) of the compressor 3, the rotational speed (rpm) of the outdoor fan 5, the open degree of the expansion valve 6, and switching of the four-way switching valve 4 between the first state and the second state.

[0038] The indoor control unit 30 of the present embodiment controls the movement mechanism 29 to switch between the stored state, in which the movable side walls 26SM do not project out of the outlet 17 as shown in Figs. 1A and 2A, and the projected state, in which the movable side walls 26SM project out of the outlet 17 as shown in Figs. 1B and 2B. In one example, the indoor control unit 30 controls the movement mechanism 29 to be in the projected state when an air conditioning operation is performed and controls the movement mechanism 29 to be in the stored state when an air conditioning operation is stopped. According to the invention, as shown in Fig. 1B and 2B, in the projected state, the movable side walls 26SM are configured to entirely cover transverse sides (up-down sides) of the outlet 17 in the projected state.

[0039] Also, when an air conditioning operation is stopped, the indoor control unit 30 controls the flap driving motor 28 so that the flap 24 covers the outlet 17 as shown in Figs. 1A and 2A. Further, when an air conditioning operation is performed, the indoor control unit 30 controls the flap driving motor 28 so that the flap 24 opens the outlet 17 as shown in Figs. 1B and 2B. In this manner, when an air conditioning operation is stopped, the indoor unit 1 shown in Figs. 1A and 2A is in a state in which the movable side walls 26SM and the flap 24 do not project out of the indoor unit main body 10. Further, when an air conditioning operation is performed, the indoor unit 1 shown in Figs. 1B and 2B is in a state in which the movable side walls 26SM and the flap 24 project out of the indoor unit main body 10.

[0040] When an air conditioning operation is performed, the pivotal position of the flap 24 can be freely

changed. In one example, the pivotal position of the flap 24 is changeable by an instruction from the remote controller 31.

[0041] Further, when surging occurs, the indoor control unit 30 controls the movement mechanism 29 in the restricted state to decrease the cross-sectional area between the left and right movable side walls 26SM with the second motor that pivots each movable side wall 26SM about the rotation axis C2 (refer to Fig. 2B). In the restricted state, the cross-sectional area of the blow-out flow path 26 at a downstream side of the outlet 17 is smaller than the cross-sectional area of the outlet 17. This increases the velocity of the indoor air in the blow-out flow path 26 and impedes surging. Further, when surging is impeded, the indoor control unit 30 controls the movement mechanism 29 to switch from the restricted state to the normal state with the second motor. Here, surging refers to noise (for example, rustling noise) produced when the volume or pressure of the indoor air blown out of the outlet 17 becomes unstable and backflow forms at the outlet 17. Surging is likely to occur, for example, when the air filter 21 is clogged with dust and the air flow resistance is increased or when condensation is formed on the indoor heat exchanger 22.

[0042] In one example, surging is detected from the rotational speed (rpm) of a fan motor (not shown) of the cross-flow fan 23. More specifically, the indoor control unit 30 sets the rotational speed of the fan motor in accordance with the operation instruction from the remote controller 31. The rotational speed of the fan motor that is set will be referred to as the set rotational speed. The indoor control unit 30 determines whether the rotational speed of the fan motor is in a tolerable rotational speed range that has a predetermined width centered on the set rotational speed. When the rotational speed of the fan motor is in the tolerable rotational speed range, the rotational speed of the fan motor is stable and the volume and pressure of the indoor air are less likely to be unstable. Accordingly, the indoor control unit 30 determines that surging has not occurred. When the rotational speed of the motor is outside the tolerable rotational speed range, the rotational speed of the fan motor is unstable and the volume and pressure of the indoor air are likely to be unstable. Accordingly, the indoor control unit 30 determines that surging has occurred. In the above-described detection of surging, the predetermined width is used to determine whether surging has occurred due to variations in the rotational speed of the fan motor and is set in advance through tests or the like.

[0043] Alternatively, surging may be detected from the current supplied to the fan motor of the cross-flow fan 23. More specifically, the indoor control unit 30 determines whether the current supplied to the fan motor is in a tolerable current range that has a predetermined width centered on a current value corresponding to the set rotational speed. When the current supplied to the fan motor is in the tolerable current range, the volume and pressure of the indoor air are stable and the current supplied

to the fan motor is stable. Accordingly, the indoor control unit 30 determines that surging has not occurred. When the current supplied to the fan motor is outside the tolerable current range, the volume and pressure of the indoor air are unstable and the current supplied to the fan motor is unstable. Accordingly, the indoor control unit 30 determines that surging has occurred. The predetermined width is used to determine whether surging has occurred due to variations in the current supplied to the fan motor and is set in advance through tests or the like.

[0044] One example of a processing procedure for a movement control of the movement mechanism 29 executed by the indoor control unit 30 will now be described with reference to Fig. 4. This movement control is executed over a period of time from when an air conditioning operation starts to when it ends.

[0045] In step S11, the indoor control unit 30 determines whether to start an air conditioning operation. In one example, when an operation start instruction has been received from the remote controller 31, the indoor control unit 30 determines to start an air conditioning operation. Further, when an operation start instruction has not been received, the indoor control unit 30 determines not to start an air conditioning operation.

[0046] When the indoor control unit 30 determines not to start an air conditioning operation (step S11: NO), the indoor control unit 30 ends the process. In this case, the movable side walls 26SM are maintained to be in the stored state. When the indoor control unit 30 determines to start an air conditioning operation (step S11: YES), the indoor control unit 30 sets the movable side walls 26SM in the projected state in step 12. This projects the movable side walls 26SM out of the outlet 17. Subsequently, in step S13, the indoor control unit 30 determines whether surging has occurred.

[0047] When determining that surging has occurred (step S13: YES), the indoor control unit 30 controls the second motor of the movement mechanism 29 to switch to the restricted state, in which the cross-sectional area between the left and right movable side walls 26SM is decreased, in step S14. Then, in step S15, the indoor control unit 30 determines whether to end the air conditioning operation. In one example, when an operation end instruction has been received from the remote controller 31, the indoor control unit 30 determines to end the air conditioning operation. Further, when an operation end instruction has not been received, the indoor control unit 30 determines not to end the air conditioning operation.

[0048] When the indoor control unit 30 determines not to end the air conditioning operation (step S15: NO), the indoor control unit 30 proceeds to step S13. When the indoor control unit 30 determines to end the air conditioning operation (step S15: YES), the indoor control unit 30 sets the movable side walls 26SM in the stored state in step S16. This stores the movable side walls 26SM in the indoor unit main body 10.

[0049] Further, when surging has not occurred (step

S13: NO), the indoor control unit 30 determines whether the movable side walls 26SM are in the restricted state in step S17. When the movable side walls 26SM are in the restricted state (step S17: YES), the indoor control unit 30 changes the movable side walls 26SM to the normal state in step S18 and then proceeds to step S15. When the movable side walls 26SM are in the normal state (step S17: NO), the indoor control unit 30 maintains the movable side walls 26SM in the normal state and then proceeds to step S15.

[0050] The operation of the present embodiment will now be described.

[0051] If the outer diameter D of the impeller 25 of the cross-flow fan 23 is increased to lower power consumption and reduce noise without increasing the height H of the indoor unit main body 10 so as to limit decreases in the ease of installation of the indoor unit main body 10, the region that defines the blow-out flow path 26 of the cross-flow fan 23 in the indoor unit main body 10 would be decreased and the blow-out flow path 26 would be shortened. When the blow-out flow path 26 is shortened, the dynamic pressure of the indoor air will not be sufficiently converted into the static pressure in the blow-out flow path 26. This would decrease the air volume and pressure in the cross-flow fan 23.

[0052] Also, when the air flow resistance inside the indoor unit main body 10 is increased due to condensation on the indoor heat exchanger 22 or clogging of the air filter 21, the velocity of the indoor air in the blow-out flow path 26 will be decreased and backflow from the outlet 17 is likely to be generated. As a result, backflow of indoor air from the outlet 17 may cause surging that destabilizes the flow of the indoor air blown out of the cross-flow fan 23. Particularly, it is known that the velocity of indoor air at the two sideward ends of the outlet 17 is slower than that at a laterally central part of the outlet 17. Accordingly, backflow from the outlet 17 is more likely to be generated at the two sideward ends of the outlet 17.

[0053] In this respect, in the present embodiment, the movable side walls 26SM project out of the outlet 17 when an air conditioning operation is performed. This allows the blow-out flow path 26 to be extended by an amount corresponding to the length of the movable side walls 26SM. Furthermore, the movable side walls 26SM extend from the two sideward ends of the outlet 17 to project out of the outlet 17. This limits backflow of indoor air into the outlet 17 from an outer side of the two sideward ends of the outlet 17. Consequently, surging is impeded and changes in the air volume and pressure in the cross-flow fan 23 are limited.

[0054] The present embodiment has the following advantages.

(1-1) The movable side walls 26SM of the two side walls 26S are arranged to project out of the outlet 17 at least when an air conditioning operation is performed. With this structure, the movable side walls 26SM restrict the indoor air blown out of the outlet

17 from flowing sideward from the outlet 17. This allows the blow-out flow path 26 to be extended from the outlet 17. In this manner, the static pressure in the blow-out flow path 26 is increased to increase the air volume of the blow-out flow path 26. Further, when the air flow resistance (internal pressure loss) inside the indoor unit main body 10 is increased due to, for example, condensation on the indoor heat exchanger 22, clogging of the air filter 21, or the like, backflow of indoor air from the two ends of the outlet 17 is restricted. Thus, surging is unlikely to occur.

(1-2) When surging occurs, the movement mechanism 29 decreases the distance between the two movable side walls 26SM so that the distance is less than the sideward length of the outlet 17. With this structure, the cross-sectional area of the blow-out flow path 26 at a downstream side of the outlet 17 is decreased so that the velocity of indoor air in the blow-out flow path 26 at the downstream side of the outlet 17 is increased. This restricts backflow of indoor air from the outlet 17 and thereby impedes surging.

(1-3) The indoor unit 1 includes the movement mechanism 29 that switches to the projected state, in which the movable side walls 26SM project out of the outlet 17, when an air conditioning operation is performed and switches to the stored state, in which the movable side walls 26SM do not project out of the outlet 17, when an air conditioning operation is stopped. With this structure, the movable side walls 26SM project out of the indoor unit main body 10 when an air conditioning operation is performed. Thus, surging is unlikely to occur. Further, the movable side walls 26SM are stored in the indoor unit main body 10 when an air conditioning operation is stopped. Thus, the aesthetic appearance of the indoor unit 1 is improved.

(1-4) The indoor unit 1 is configured so that the ratio (H/D) of the height H of the indoor unit main body 10 to the outer diameter D of the impeller 25 of the cross-flow fan 23 is less than 2.2. With this structure, the indoor unit main body 10 uses the cross-flow fan 23 including the impeller 25 with a relatively large outer diameter D. This allows noise and power consumption to be reduced when the indoor unit 1 is operating.

(1-5) The indoor unit 1 is configured so that the ratio (H/D) of the height H of the indoor unit main body 10 to the outer diameter D of the impeller 25 of the cross-flow fan 23 is greater than or equal to 1.6 and less than 2.2. This structure limits decreases in the ease of setting of the indoor unit main body 10 in addition to obtaining advantage (1-4).

(1-6) The height H of the indoor unit main body 10 is less than or equal to 295 mm. This limits decreases in the ease of installation of the indoor unit main body 10. Particularly, the height H of the indoor unit main body 10 is greater than or equal to 250 mm and less than or equal to 295 mm. In this case, the cross-flow

fan 23 including the impeller 25 that has a relatively large outer diameter D can be used. This allows power consumption and noise to be reduced while limiting decrease in the ease of setting of the indoor unit main body 10.

Second Embodiment

[0055] An indoor unit 1 of an air conditioner in accordance with a second embodiment not part of the invention will now be described with reference to Figs. 5 and 6. The indoor unit 1 of the present embodiment differs from the indoor unit 1 of the first embodiment in that the lower wall 26L of the blow-out flow path 26 is projected out of the outlet 17 together with the two side walls 26S when an air conditioning operation is performed. In the description hereafter, same reference numerals are given to those elements that are the same as the indoor unit 1 of the first embodiment. Such elements will not be described in detail.

[0056] As shown in Figs. 5B and 6B, the lower wall 26L includes a fixed lower wall 26LF and a movable lower wall 26LM. The flap 24 is coupled to a distal end of the movable lower wall 26LM and is pivotal relative to the movable lower wall 26LM. The fixed lower wall 26LF and the movable lower wall 26LM are overlapped with each other in the vertical direction (up-down direction). The movable lower wall 26LM is configured to be movable so as to slide relative to the fixed lower wall 26LF and project out of the outlet 17.

[0057] The movement mechanism 29 of the present embodiment is configured to move the movable side walls 26SM and the movable lower wall 26LM. In one example, the movement mechanism 29 is configured to move and slide the movable side walls 26SM relative to the fixed side walls SF and move and slide the movable lower wall 26LM relative to the fixed lower wall 26LF. The movement mechanism 29 includes a first motor, a first rotation-linear movement conversion mechanism that converts rotation of the first motor into linear movement of the movable side walls 26SM, and a second rotation-linear movement conversion mechanism that converts rotation of the first motor into linear movement of the movable lower wall 26LM. In other words, the movement mechanism 29 of the present embodiment moves the movable side walls 26SM and the movable lower wall 26LM with a single drive source.

[0058] The indoor control unit 30 of the present embodiment (refer to Fig. 3) controls the movement mechanism 29 to switch between a stored state, in which the movable side walls 26SM and the movable lower wall 26LM do not project out of the outlet 17 as shown in Figs. 5A and 6A, and a projected state, in which the movable side walls 26SM and the movable lower wall 26LM project out of the outlet 17 as shown in Figs. 5B and 6B. In one example, the indoor control unit 30 controls the movement mechanism 29 in the projected state when an air conditioning operation is performed and controls the

movement mechanism 29 in the stored state when an air conditioning operation is stopped.

[0059] In the projected state, the movable side walls 26SM are located above the sideward ends of the movable lower wall 26LM. The movable side walls SM are arranged so that no gap is formed between the movable side walls 26SM and the movable lower wall 26LM in the vertical direction. Further, each movable side wall 26SM is pivotal about the rotation axis C2 between the upper wall 26U and the movable lower wall 26LM.

[0060] Also, the relationship of the outer diameter D of the impeller 25 of the cross-flow fan 23 and the height H of the indoor unit main body 10 of the present embodiment is the same as the relationship of the outer diameter D of the impeller 25 of the cross-flow fan 23 and the height H of the indoor unit main body 10 of the first embodiment.

[0061] The present embodiment has the following advantages in addition to the advantages of the first embodiment.

(2-1) The movable side walls 26SM of the two side walls 26S and the movable lower wall 26LM of the lower wall 26L are arranged to project out of the outlet 17 at least when an air conditioning operation is performed. With this structure, the movable side walls 26SM and the movable lower walls 26LM restrict the indoor air blown out of the outlet 17 from flowing sideward and downward from the outlet 17. This allows the blow-out flow path 26 to be extended from the outlet 17. In this manner, the blow-out flow path 26 serving as a diffuser is lengthened compared to a structure that does not project the two side walls 26S and the lower wall 26L out of the outlet 17. This further increases the static pressure in the blow-out flow path 26 and further increases the air volume of the blow-out flow path 26. Also, when the air flow resistance (internal pressure loss) in the indoor unit main body 10 is high, backflow of indoor air from the two sideward ends and the lower part of the outlet 17 is restricted. Thus, surging is even less likely to occur. (2-2) The indoor unit 1 includes the movement mechanism 29 that projects the movable side walls 26SM and the movable lower wall 26LM out of the outlet 17 in the projected state when an air conditioning operation is performed and does not project the movable side walls 26SM and the movable lower wall 26LM out of the outlet 17 in the stored state when an air conditioning operation is stopped. With this structure, the movable side walls 26SM and the movable lower wall 26LM project out of the indoor unit main body 10 when an air conditioning operation is performed. Thus, surging is unlikely to occur. Further, the movable side walls 26SM and the movable lower wall 26LM are stored in the indoor unit main body 10. Thus, the aesthetic appearance of the indoor unit 1 is improved.

Third Embodiment

[0062] An indoor unit 1 of an air conditioner in accordance with a third embodiment not part of the invention will now be described with reference to Figs. 7 and 8. The indoor unit 1 of the present embodiment differs from the indoor unit 1 of the second embodiment in that the upper wall 26U projects out of the outlet 17 together with the two side walls 26S and the lower wall 26L of the blow-out flow path 26 when an air conditioning operation is performed. In the description hereafter, same reference numerals are given to those elements that are the same as the indoor unit 1 of the second embodiment. Such elements will not be described in detail.

[0063] The upper wall 26U of the present embodiment includes a fixed upper wall 26UF and a movable upper wall 26UM. The fixed upper wall 26UF and the movable upper wall 26UM are overlapped with each other in the vertical direction (up-down direction). The movable upper wall 26UM is configured to be movable so as to slide relative to the fixed upper wall 26UF and project out of the outlet 17.

[0064] The movement mechanism 29 of the present embodiment is configured to move the movable side walls 26SM, the movable lower wall 26LM, and the movable upper wall 26UM. In one example, the movement mechanism 29 is configured to move and slide the movable side walls 26SM relative to the fixed side walls SF, move and slide the movable lower wall 26LM relative to the fixed lower wall 26LF, and move and slide the movable upper wall 26UM relative to the fixed upper wall 26UF. The movement mechanism 29 includes a first motor, a first rotation-linear movement conversion mechanism that converts rotation of the first motor into linear movement of the movable side walls 26SM, a second rotation-linear movement conversion mechanism that converts rotation of the first motor into linear movement of the movable lower wall 26LM, and a third rotation-linear movement conversion mechanism that converts rotation of the first motor into linear movement of the movable upper wall 26UM. In other words, the movement mechanism 29 of the present embodiment moves the movable side walls 26SM, the movable lower wall 26LM, and the movable upper wall 26UM with a single drive source.

[0065] The indoor control unit 30 of the present embodiment (refer to Fig. 3) controls the movement mechanism 29 and switches between a stored state, in which the movable side walls 26SM, the movable lower wall 26LM, and the movable upper wall 26UM do not project out of the outlet 17 as shown in Figs. 7A and 8A, and a projected state, in which the movable side walls 26SM, the movable lower wall 26LM, and the movable upper wall 26UM project out of the outlet 17 as shown in Figs. 7B and 8B. In one example, the indoor control unit 30 controls the movement mechanism 29 to be in the projected state when an air conditioning operation is performed and controls the movement mechanism 29 to be

in the stored state when an air conditioning operation is stopped.

[0066] In the present embodiment, as shown in Figs. 7B and 8B, the movable side walls 26SM are configured to entirely cover vertical sides (up-down sides) of the movable lower wall 26LM and the movable upper wall 26UM in the projected state. Specifically, in the projected state, the movable side walls 26SM are located between the movable lower wall 26LM and the movable upper wall 26UM in the vertical direction and at sideward ends of the movable lower wall 26LM and the movable upper wall 26UM. The movable side walls SM are arranged so that no gap is formed between the movable side walls 26SM and the movable lower wall 26LM in the vertical direction. Further, each movable side wall 26SM is pivotal about the rotation axis C2 between the movable upper wall 26UM and the movable lower wall 26LM.

[0067] Also, the relationship of the outer diameter D of the impeller 25 of the cross-flow fan 23 and the height H of the indoor unit main body 10 of the present embodiment is the same as the relationship of the outer diameter D of the impeller 25 of the cross-flow fan 23 and the height H of the indoor unit main body 10 of the first embodiment.

[0068] The present embodiment has the following advantages in addition to the advantages of the first and second embodiments.

(3-1) The movable side walls 26SM of the two side walls 26S, the movable lower wall 26LM of the lower wall 26L, and the movable upper wall 26UM of the upper wall 26U are arranged to project out of the outlet 17 at least when an air conditioning operation is performed. This allows the blow-out flow path 26, which is surrounded by wall portions at the sideward sides and the vertical sides, to be extended from the outlet 17. In this manner, the blow-out flow path 26 serving as a diffuser is lengthened compared to a structure that does not project the two side walls 26S, the lower wall 26L, and the upper wall 26U out of the outlet 17. This further increases the static pressure in the blow-out flow path 26 and further increases the air volume of the blow-out flow path 26. Also, when the air flow resistance (internal pressure loss) in the indoor unit main body 10 is high, backflow of indoor air from the two sideward ends, the upper end, and the lower end of the outlet 17 is restricted. Thus, surging is even less likely to occur.

(3-2) The indoor unit 1 includes the movement mechanism 29 that projects the movable side walls 26SM, the movable lower wall 26LM, and the movable upper wall 26UM project out of the outlet 17 in the projected state when an air conditioning operation is performed and does not project the movable side walls 26SM, the movable lower wall 26LM, and the movable upper wall 26UM out of the outlet 17 in the stored state when an air conditioning operation is stopped. With this structure, the movable side walls 26SM, the movable lower wall 26LM, and the mov-

able upper wall 26UM project out of the indoor unit main body 10 when an air conditioning operation is performed. Thus, surging is unlikely to occur. Further, the movable side walls 26SM, the movable lower wall 26LM, and the movable upper wall 26UM are stored in the indoor unit main body 10 when an air conditioning operation is stopped. This improves the aesthetic appearance of the indoor unit 1.

Fourth Embodiment

[0069] An indoor unit 1 of an air conditioner in accordance with a fourth embodiment not part of the invention will now be described with reference to Fig. 9. The indoor unit 1 of the present embodiment differs from the indoor unit 1 of the first embodiment in the structure of the cross-flow fan 23. In the description hereafter, same reference numerals are given to those elements that are the same as the indoor unit 1 of the first embodiment. Such elements will not be described in detail.

[0070] As shown in Figs. 9A and 9B, in the indoor unit 1, the cross-flow fan 23 includes a support 32 that pivotally supports the flap 24 about the rotation axis C1. The support 32 is coupled to the lower end of the indoor unit main body 10 in the vicinity of the outlet 17. In other words, the support 32 forms the lower end of the indoor unit main body 10. The support 32 has a portion located closer to the outlet 17 to form part of the blow-out flow path 26 (lower wall 26L). The support 32 is faced toward a tongue 26A of the upper wall 26U in a direction traversing the blow-out flow path 26.

[0071] As shown in Fig. 9B, the distance between an intersection point A, which is where a tangent VL inscribing the tongue 26A of the upper wall 26U orthogonally intersects a flow path formation surface 32X of the support 32 opposing the tongue 26A, and point B, which is the lower end of the indoor unit main body 10, is referred to as distance L. Further, the outer diameter of the impeller 25 of the cross-flow fan 23 is referred to as the outer diameter D. In the present embodiment, a ratio (L/D) of the distance L to the outer diameter D is set to less than 0.05. Point B is located at the downstream-most portion of the lower wall 26L of the blow-out flow path 26. In the present embodiment, as shown in Fig. 9B, point B is the lowermost point of the flow path formation surface 32X of the support 32.

[0072] In the present embodiment, the movable side walls 26SM are omitted from the two side walls 26S. Further, in the present embodiment, the movement mechanism 29 includes the flap driving motor 28 (refer to Fig. 3). The movement mechanism 29 is configured to allow for switching between a stored state, in which the flap 24 forming the blow-out flow path 26 covers the outlet 17, and a projected state, in which the flap 24 projects out of the outlet 17. In the same manner as the first embodiment, the movement mechanism 29 is in the projected state when an air conditioning operation is performed and in the stored state when an air conditioning operation

is stopped. In other words, as shown by the broken lines in Fig. 9A, the flap 24 is pivoted relative to the support 32 to cover the outlet 17 when an air conditioning operation is stopped. Further, as shown by the solid lines in Fig. 9A, the flap 24 is pivoted relative to the support 32 to open the outlet 17 when an air conditioning operation is performed. In the projected state, the flap 24 is faced toward a flow path formation surface 26X of the upper wall 26U.

[0073] The present embodiment has the following advantages.

(4-1) The flap 24 forming the lower wall of the blow-out flow path 26 is configured to project out of the outlet 17 at least when an air conditioning operation is performed. Further, the ratio (L/D) of the distance L from the tangent VL, which inscribes the tongue 26A of the cross-flow fan 23, to the point B, which is located at the lower end of the indoor unit main body 10, to the outer diameter D of the impeller 25 of the cross-flow fan 23 is less than 0.05. This limits decreases in the ease of installation of the indoor unit main body 10 and allows power consumption and noise to be reduced by increasing and the outer diameter D of the impeller 25 of the cross-flow fan 23. Also, the flap 24 projects out of the outlet 17 so that the blow-out flow path 26, or the diffuser, has a sufficient length. This maintains the functionality of the diffuser. Consequently, adverse effects on the performance of the indoor unit 1 will be limited.

(4-2) The indoor unit 1 includes the movement mechanism 29 that projects the flap 24 out of the outlet 17 in the projected state when an air conditioning operation is performed and does not project the flap 24 out of the outlet 17 in the stored state when an air conditioning operation is stopped. This projects the flap 24 out of the indoor unit main body 10 when an air conditioning operation is performed. Thus, surging is unlikely to occur. Further, the flap 24 is stored in the indoor unit main body 10 when an air conditioning operation is stopped. Thus, the aesthetic appearance of the indoor unit 1 is improved.

Modified Examples

[0074] The description related with the above embodiments exemplifies, without any intention to limit, applicable forms of an indoor unit of an air conditioner according to the present invention. In addition to the embodiments described above, the indoor unit of an air conditioner in accordance with the present invention is applicable to, for example, modified examples of the above embodiments that are described below and combinations of at least two of the modified examples that do not contradict each other, as long as in the scope of claim 1. In the modified examples described hereafter, same reference numerals are given to those components that are the same as the corresponding components of the above

embodiments. Such components will not be described in detail.

[0075] In the first to third embodiments, at least one of the two side walls 26S, the lower wall 26L, and the upper wall 26U of the blow-out flow path 26 may include a movable wall and a fixed wall. More specifically, the indoor unit 1 may be configured in any one of following manners (A1) to (A4).

(A1) The indoor unit 1 is configured so that each side wall 26S of the blow-out flow path 26 includes the movable side wall 26SM, the upper wall 26U includes the movable upper wall 26UM, and the lower wall 26L does not include the movable lower wall 26LM. With this structure, the movable side walls 26SM and the movable upper wall 26UM project out of the outlet 17. Thus, the movable side walls 26SM and the movable upper wall 26UM restrict the indoor air blown out of the outlet 17 from flowing sideward and upward from the outlet 17. This allows the blow-out flow path 26 to be extended from the outlet 17. In this manner, the blow-out flow path 26 serving as a diffuser is lengthened compared to a structure that does not project the two side walls 26S and the upper wall 26U out of the outlet 17. This increases the static pressure in the blow-out flow path 26 and increases the air volume of the blow-out flow path 26. Further, when the air flow resistance (internal pressure loss) in the indoor unit main body 10 is high, backflow of air from the two sideward ends and the upper part of the outlet 17 is restricted. Thus, surging is even less likely to occur.

(A2) The indoor unit 1 is configured so that the lower wall 26L of the blow-out flow path 26 includes the movable lower wall 26LM, the upper wall 26U includes the movable upper wall 26UM, and the two side walls 26S do not include the movable side walls 26SM. With this structure, the movable lower wall 26LM projects out of the outlet 17. Thus, the movable lower wall 26LM restricts the indoor air blown out of the outlet 17 from flowing downward from the outlet 17. This allows the blow-out flow path 26 to be extended from the outlet 17. In this manner, the blow-out flow path 26 serving as a diffuser is lengthened compared to a structure that does not project the lower wall 26L out of the outlet 17. This increases the static pressure in the blow-out flow path 26 and increases the air volume of the blow-out flow path 26. Further, when the air flow resistance (internal pressure loss) in the indoor unit main body 10 is high, backflow of air from the lower part of the outlet 17 is restricted. Thus, surging is even less likely to occur.

(A3) The indoor unit 1 is configured so that the lower wall 26L of the blow-out flow path 26 includes the movable lower wall 26LM, the two side walls 26S do not include the movable side walls 26SM, and the upper wall 26U does not include the movable upper wall 26UM. With this structure, the movable lower

wall 26LM projects out of the outlet 17. Thus, the movable lower wall 26LM restricts the indoor air blown out of the outlet 17 from flowing downward from the outlet 17. This allows the blow-out flow path 26 to be extended from the outlet 17. In this manner, the blow-out flow path 26 serving as a diffuser is lengthened compared to a structure that does not project the lower wall 26L out of the outlet 17. This increases the static pressure in the blow-out flow path 26 and increases the air volume of the blow-out flow path 26. Further, when the air flow resistance (internal pressure loss) in the indoor unit main body 10 is high, backflow of air from the lower part of the outlet 17 is restricted. Thus, surging is even less likely to occur.

(A4) The indoor unit 1 is configured so that the upper wall 26U of the blow-out flow path 26 includes the movable upper wall 26UM, the two side walls 26S do not include the movable side walls 26SM, and the lower wall 26L does not include the movable lower wall 26LM. With this structure, the movable upper wall 26UM projects out of the outlet 17. Thus, movable upper wall 26UM restricts the indoor air blown out of the outlet 17 from flowing upward from the outlet 17. This allows the blow-out flow path 26 to be extended from the outlet 17. In this manner, the blow-out flow path 26 serving as a diffuser is lengthened compared to a structure that does not project the upper wall 26U out of the outlet 17. This increases the static pressure in the blow-out flow path 26 and increases the air volume of the blow-out flow path 26. Further, when the air flow resistance (internal pressure loss) in the indoor unit main body 10 is high, backflow of air from the upper part of the outlet 17 is restricted. Thus, surging is even less likely to occur.

[0076] In the above-described first to third embodiments, the two side walls 26S may be changed to have following configurations in (B1) to (B3).

(B1) As shown in Figs. 10A and 10B, the two side walls 26S each include the movable side wall 26SM that is sectoral and extends about rotation axis C3. The movement mechanism 29 includes a driving motor that rotates the movable side walls 26SM about the rotation axis C3. An output shaft of the driving motor may be directly connected to the movable side walls 26SM. Alternatively, the output shaft of the driving motor may be connected to the movable side walls 26SM by a decelerator. The movement mechanism 29 moves and switches the movable side walls 26SM between a stored state shown in Fig. 10A and a projected state shown in Fig. 10B. As shown in Fig. 10A, in the stored state, the movable side walls 26SM are stored in the indoor unit main body 10, that is, the movable side walls 26SM do not project out of the outlet 17. As shown in Fig. 10B, in

the projected state, the movable side walls 26SM are in a state projected out of the indoor unit main body 10, that is, the movable side walls 26SM project out of the outlet 17. The movable side walls 26SM shown in Figs. 10A and 10B are arranged next to lateral (sideward) end surfaces of the flap 24. Preferably, no gap is formed between the movable side walls 26SM and the sideward end surfaces of the flap 24.

(B2) As shown in Figs. 11A and 11B, the two side walls 26S each include the movable side wall 26SM that is rotated about a rotation axis C4. The movement mechanism 29 includes a driving motor that rotates the movable side walls 26SM about the rotation axis C4. The output shaft of the driving motor may be directly connected to the movable side walls 26SM. Alternatively, the output shaft of the driving motor may be connected to the movable side walls 26SM by a decelerator. The movement mechanism 29 moves and switches the movable side walls 26SM between a stored state shown in Fig. 11A and a projected state shown in Fig. 11B. As shown in Fig. 11A, in the stored state, the movable side walls 26SM cover the lateral (sideward) ends of the outlet 17, that is, the movable side walls 26SM do not project out of the outlet 17. In the stored state, the flap 24 is moved by the flap driving motor 28 (refer to Fig. 3) to cover the outlet 17. In the stored state, the movable side walls 26SM are rotated to cover the lateral (sideward) ends of the flap 24. As shown in Fig. 11B, in the projected state, the movable side walls 26SM are in a state projected out of the indoor unit main body 10, that is the movable side walls 26SM project out of the outlet 17. In one example, when the stored state is changed to the projected state, the movable side walls 26SM are pivoted and moved to an outer side of the flap 24 in the lateral direction (sideward direction). Then, the flap 24 is pivoted to project out of the outlet 17.

(B3) As shown in Figs. 12A and 12B, the two side walls 26S each include the movable side wall 26SM that is expandable. The movable side wall 26SM has an accordion structure. The movement mechanism 29 includes a motor that serves as a drive source and a rotation-linear movement conversion mechanism that converts rotation of the motor into linear movement of the movable side walls 26SM in an expanding direction. The movement mechanism 29 moves and switches the movable side walls 26SM between a stored state shown in Fig. 12A and a projected state shown in Fig. 12B. As shown in Fig. 12A, in the stored state, the movable side walls 26SM are retracted to be stored in the indoor unit main body 10, that is, the movable side walls 26SM do not project out of the outlet 17. As shown in Fig. 12B, in the projected state, the movable side walls SM are expanded to project out of the indoor unit main body 10, that is, the movable side walls SM are in a state

projected out of the outlet 17. The movable side walls 26SM in Figs. 12A and 12B are arranged adjacent to the flap 24 in the lateral direction (sideward direction). Preferably, no gap is formed between the movable side walls 26SM and the sideward end surfaces of the flap 24.

[0077] In the first to third embodiments, the movable side walls 26SM do not have to be configured to be rotated about the rotation axis C2. In this case, the movable side walls 26SM may be configured so that the distance between the movable side walls 26SM in the sideward direction decreases toward the downstream side in the blow-out flow path 26.

[0078] In the second and third embodiments, as shown in Figs. 13A and 13B, the movable lower wall 26LM of the lower wall 26L arranged at the distal end of the fixed lower wall 26LF, which is the lower end of the indoor unit main body 10, may be pivotal about a rotation axis C5. The flap 24 is pivotally arranged at the distal end of the movable lower wall 26LM. As shown in Fig. 13A, when an air conditioning operation is stopped, the movement mechanism 29 pivots the movable lower wall 26LM to cover the outlet 17 in the stored state. In this case, the outlet 17 is covered by the movable lower wall 26LM and the flap 24. As shown in Fig. 13B, when an air conditioning operation is performed, the movement mechanism 29 pivots and projects the movable lower wall 26LM out of the outlet 17 in the projected state. In this case, the outlet 17 is not covered by the movable lower wall 26LM or the flap 24. In the projected state, the flap driving motor 28 (refer to Fig. 3) may freely change a pivotal position of the flap 24 relative to the movable lower wall 26LM.

[0079] In the third embodiment, as shown in Figs. 14A and 14B, the movable upper wall 26UM of the upper wall 26U arranged at the distal end of the fixed upper wall 26UF may be rotatable about a rotation axis C6. As shown in Fig. 14A, when an air conditioning operation is stopped, the movement mechanism 29 pivots the movable upper wall 26UM to cover the outlet 17 in the stored state. When an air conditioning operation is stopped, the flap driving motor 28 (refer to Fig. 3) moves the flap 24 so that the flap 24 also covers the outlet 17. In this manner, the movable upper wall 26UM and the flap 24 entirely cover the outlet 17. As shown in Fig. 14B, when an air conditioning operation is performed, the movement mechanism 29 pivots and projects the movable upper wall 26UM out of the outlet 17 in the projected state. In this case, the outlet 17 is not covered by the movable upper wall 26UM or the flap 24.

[0080] In the second embodiment, the movement mechanism 29 may include a first movement mechanism that moves the movable side walls 26SM and a second movement mechanism that moves the movable lower wall 26LM. The first movement mechanism and the second movement mechanism each include a motor and a rotation-linear movement conversion mechanism that converts rotation of the corresponding motor into linear

movement. This allows the movable side walls 26SM to be controlled separately from the movable lower wall 26LM.

[0081] In the second and third embodiments, when surging occurs, the movement mechanism 29 may rotate the flap 24 to decrease the cross-sectional area of the blow-out flow path 26 at a downstream side of the outlet 17.

[0082] In the third embodiment, the movement mechanism 29 may include a first movement mechanism that moves the movable side walls 26SM, a second movement mechanism that moves the movable lower wall 26LM, and a third movement mechanism that moves the movable upper wall 26UM. The first to third movement mechanisms each include a motor and a rotation-linear movement conversion mechanism that converts rotation of the corresponding motor into linear movement. This allows for separate control of the movable side walls 26SM, the movable lower wall 26LM, and the movable upper wall 26UM.

[0083] In the third embodiment, the movement mechanism 29 may include a first movement mechanism that moves the movable side walls 26SM and the movable lower wall 26LM and a second movement mechanism that moves the movable upper wall 26UM. The first and second movement mechanisms each include a motor and a rotation-linear movement conversion mechanism that converts rotation of the corresponding motor into linear movement. This allows the movable side walls 26SM and the movable lower wall 26LM to be controlled separately from the movable upper wall 26UM.

[0084] In third embodiment, the movement mechanism 29 may include a first movement mechanism that moves the movable side walls 26SM and a second movement mechanism that moves the movable lower wall 26LM and the movable upper wall 26UM. The first and second movement mechanisms each include a motor and a rotation-linear movement conversion mechanism that converts rotation of the corresponding motor into linear movement. This allows the movable side walls 26SM to be controlled separately from the movable lower wall 26LM and the movable upper wall 26UM.

[0085] In the third embodiment, the movement mechanism 29 may include a first movement mechanism that moves the movable side walls 26SM and the movable upper wall 26UM and a second movement mechanism that moves the movable lower wall 26LM. The first and second movement mechanisms each include a motor and a rotation-linear movement conversion mechanism that converts rotation of the corresponding motor into linear movement. This allows the movable side walls 26SM and the movable upper wall 26UM to be controlled separately from the movable lower wall 26LM.

[0086] In the third embodiment, the blow-out flow path 26 may be formed to project out of the outlet 17 so that the cross-sectional area of the blow-out flow path 26 at a downstream side of the outlet 17 is smaller than the cross-sectional area of the outlet 17. In one example, at

least one of the movable side walls 26SM, the movable lower wall 26LM, and the movable upper wall 26UM is moved by the movement mechanism 29 so that the cross-sectional area surrounded by the movable side walls 26SM, the movable lower wall 26LM, and the movable upper wall 26UM, which are elements of the blow-out flow path 26, is smaller than the cross-sectional area of the outlet 17. This increases the velocity in the blow-out flow path 26 at a downstream side and restricts backflow of indoor air from the outlet 17. Thus, surging is even less likely to occur.

[0087] In the fourth embodiment, the indoor unit 1 may be changed in any one of following manners (C1) to (C4).

(C1) The indoor unit 1 further includes the movable side walls 26SM and the movement mechanism 29 that moves the movable side walls 26SM. In one example, the movable side walls 26SM and the movement mechanism 29 have the same structure as the movable side walls 26SM and the movement mechanism 29 of the first embodiment. With this structure, the movable side walls 26SM project out of the outlet 17. Thus, the movable side walls 26SM and the movable upper wall 26UM restrict the indoor air blown out of the outlet 17 from flowing sideward from the outlet 17. This allows the blow-out flow path 26 to be extended from the outlet 17. In this manner, the blow-out flow path 26 is lengthened compared to a structure that does not project the two side walls 26S and the upper wall 26U out of the outlet 17. This increases the static pressure in the blow-out flow path 26 and increases the air volume of the blow-out flow path 26. Further, when the air flow resistance (internal pressure loss) in the indoor unit main body 10 is high, backflow of air from the two sideward ends of the outlet 17 is restricted. Thus, surging is even less likely to occur.

(C2) The indoor unit 1 further includes the movable lower wall 26LM and the movement mechanism 29 that moves the movable lower wall 26LM. In one example, the movable lower wall 26LM and the movement mechanism 29 have the same structure as the movable lower wall 26LM and the movement mechanism 29 of the second embodiment. In this case, the flap 24 is rotatably arranged at the distal end of the movable lower wall 26LM. With this structure, the movable lower wall 26LM projects out of the outlet 17. Thus, the movable lower wall 26LM restricts the indoor air blown out of the outlet 17 from flowing downward from the outlet 17. This allows the blow-out flow path 26 to be extended from the outlet 17. In this manner, the blow-out flow path 26 serving as a diffuser is lengthened compared to a structure that does not project the lower wall 26L out of the outlet 17. This increases the static pressure in the blow-out flow path 26 and increases the air volume of the blow-out flow path 26. Further, when the air flow resistance (internal pressure loss) in the indoor unit

main body 10 is high, backflow of air from the lower part of the outlet 17 is restricted. Thus, surging is even less likely to occur.

(C3) The indoor unit 1 further includes the movable upper wall 26UM and the movement mechanism 29 that moves the movable upper wall 26UM. In one example, the movable upper wall 26UM and the movement mechanism 29 have the same structure as the movable upper wall 26UM and the movement mechanism 29 of the third embodiment. With this structure, the movable upper wall 26UM projects out of the outlet 17 and thus the movable upper wall 26UM restricts the indoor air blown out of the outlet 17 from flowing upward from the outlet 17. This allows the blow-out flow path 26 to be extended from the outlet 17. In this manner, the blow-out flow path 26, which functions as a diffuser, is lengthened compared to a structure that does not project the upper wall 26U out of the outlet 17. This increases the static pressure in the blow-out flow path 26 and increases the air volume of the blow-out flow path 26. Further, when the air flow resistance (internal pressure loss) in the indoor unit main body 10 is high, backflow of air from the upper part of the outlet 17 is restricted. Thus, surging is even less likely to occur.

(C4) The indoor unit 1 further includes at least one of the movable side walls 26SM, the movable lower wall 26LM, and the movable upper wall 26UM and the movement mechanism 29 that moves at least one of the movable side walls 26SM, the movable lower wall 26LM, and the movable upper wall 26UM. This structure has an advantage of at least one of the above-described modified examples (C1) to (C3).

[0088] In the first to fourth embodiments, the movement mechanism 29 may be omitted. In this case, the elements of the blow-out flow path 26 are constantly in the projected state. In other words, at least one of the two side walls 26S, the upper wall 26U, and the lower wall 26L is arranged to project out of the outlet 17. In one example, in the indoor unit 1 shown in Figs. 15A and 15B, the two side walls 26S, the upper wall 26U, and the lower wall 26L, which are the elements of the blow-out flow path 26, are arranged to project out of the outlet 17. In this case, for example, a projection 26P may be arranged on each side wall 26S at a downstream side of the outlet 17 so that the distance between the two side walls 26S in the sideward direction at a downstream side of the outlet 17 in the blow-out flow path 26 is less than the sideward length of the outlet 17. In one example, as shown in Figs. 15A and 15B, each projection 26P has the form of a substantially three-sided pyramid such that the distance between the two side walls 26S (distance between projections 26P in sideward direction) decreases from the upper wall 26U toward the lower wall 26L. Further, the projections 26P include surfaces 26PA opposed toward each other in the sideward direction. The

surfaces 26PA are formed so that the distance between the projections 26P in the sideward direction decreases toward a downstream side in the blow-out flow path 26. The projection 26P may have any shape as long as the distance between the two side walls 26S in the blow-out flow path 26 at a downstream side of the outlet 17 is less than the sideward length of the outlet 17.

[0089] In the first to third embodiments, the projections 26P may be arranged so that the distance between the two side walls 26S in the sideward direction at a downstream side in the blow-out flow path 26, which is extended by the two side walls 26S projected out of the outlet 17, is constantly smaller than the distance between the two side walls 26S in the sideward direction in the blow-out flow path 26 at the side of the outlet 17 (upstream side). Thus, the velocity in the blow-out flow path 26 at a downstream side is increased. This restricts backflow of indoor air from the outlet 17 and thus surging is even less likely to occur.

[0090] It should be understood that the above-described disclosure of the indoor unit of an air conditioner may be embodied in many other specific forms within the scope of the present invention described in the appended claims.

Claims

1. An indoor unit (1) of an air conditioner, comprising:

an indoor unit main body (10) including an inlet (16) and an outlet (17);

a heat exchanger (22) that performs heat exchange on air drawn in from the inlet (16); and
a cross-flow fan (23) configured to blow out air, which has undergone heat exchange performed by the heat exchanger (22), from the outlet (17), wherein

the cross-flow fan (23) includes a blow-out flow path (26) formed by a lower wall (26L), left and right side walls (26S), and an upper wall (26U) so that a cross-sectional area gradually increases downward, with the blow-out flow path (26) guiding blown-out air to the outlet (17),

a movement mechanism (29) configured to switch between a stored state that does not project an element (26S, 26L, 26U) forming the blow-out flow path (26) including the side walls (26S) out of the outlet (17) and a projected state that projects at least the side walls (26S) out of the outlet (17),

an indoor control unit (30) configured to control the movement mechanism (29) to switch between the stored state, in which the movable side walls (26S) do not project out of the outlet (17), and the projected state, in which the movable side walls (26S) project out of the outlet (17) wherein the movement mechanism (29) is fur-

ther configured to be in the projected state when an air conditioning operation is performed, and the movement mechanism (29) is configured to be in the stored state when an air conditioning operation is stopped, and

characterized in that

the side walls (26S) are configured to entirely cover transverse sides of the outlet (17) in the projected state.

2. The indoor unit (1) of an air conditioner according to claim 1, wherein the lower wall (26L) is arranged to project out of the outlet (17) at least when an air conditioning operation is performed.
3. The indoor unit (1) of an air conditioner according to claim 1 or 2, wherein the upper wall (26U) is arranged to project out of the outlet (17) at least when an air conditioning operation is performed.
4. The indoor unit (1) of an air conditioner according to any one of claims 1 to 3, wherein the blow-out flow path (26) is formed to project out of the outlet (17) and so that a distance between the two side walls (26S) in a sideward direction in the blow-out flow path (26) at a downstream side of the outlet (17) is less than a sideward length of the outlet (17).
5. The indoor unit (1) of an air conditioner according to any one of claims 1 to 4, wherein the indoor unit (1) is configured so that a ratio (H/D) of height H of the indoor unit main body (10) to outer diameter D of an impeller (25) of the cross-flow fan (23) is less than 2.2.
6. The indoor unit (1) of an air conditioner according to any one of claims 1 to 5,

wherein the occurrence of surging is detected by the indoor control unit (30) based on either the rotational speed of a fan motor of the cross-fan (23) or based on the current supplied to the fan motor of the cross-flow fan (23),

wherein the indoor control unit (30) determines that surging has not occurred when the rotational speed of the fan motor is in a tolerable rotational speed range that has a predetermined width centered on the set rotational speed, or when the current supplied to the fan motor is in a tolerable current range that has a predetermined width centered on a current value corresponding to the set rotational speed, and the indoor control unit (30) determines that surging has occurred when the rotational speed of the motor is outside the tolerable rotational speed range, or when the current supplied to the fan motor is outside the tolerable current range.

7. The indoor unit (1) of an air conditioner according to claim 6, wherein the movement mechanism (29) is configured to move the element (26S, 26L, 26U) to decrease a cross-sectional area of the blow-out flow path (26) at a portion projecting from the outlet (17) when surging is detected.

Patentansprüche

1. Innenraumeinheit (1) einer Klimaanlage, umfassend:

einen Innenraumeinheit-Hauptkörper (10), der einen Einlass (16) und einen Auslass (17) einschließt;

einen Wärmetauscher (22), der an aus dem Einlass (16) eingezogener Luft Wärmetausch durchführt; und

einen Querstromlüfter (23), der konfiguriert ist, um Luft, die Wärmetausch unterzogen wurde, der von dem Wärmetauscher (22) durchgeführt wurde, aus dem Auslass (17) auszublasen, wobei

der Querstromlüfter (23) einen Ausblas-Strömungsweg (26) einschließt, der durch eine untere Wand (26L), linke und rechte Seitenwände (26S) und eine obere Wand (26U) so geformt ist, dass eine Querschnittsfläche nach unten schrittweise zunimmt, wobei der Ausblas-Strömungsweg (26) ausgeblasene Luft zu dem Auslass (17) leitet,

einen Bewegungsmechanismus (29), der konfiguriert ist, um zwischen einem gespeicherten Zustand, in dem kein Element (26S, 26L, 26U), das den Ausblas-Strömungsweg (26) formt, einschließlich der Seitenwände (26S), aus dem Auslass (17) vorsteht, und einem vorstehenden Zustand, in dem mindestens die Seitenwände (26S) aus dem Auslass (17) vorstehen, umzuschalten,

eine Innenraumsteuereinheit (30), die konfiguriert ist, um den Bewegungsmechanismus (29) zu steuern, um zwischen dem gespeicherten Zustand, in dem die beweglichen Seitenwände (26S) nicht aus dem Auslass (17) vorstehen, und dem vorstehenden Zustand, in dem die beweglichen Seitenwände (26S) aus dem Auslass (17) vorstehen, umzuschalten,

wobei der Bewegungsmechanismus (29) weiter konfiguriert ist, um in dem vorstehenden Zustand zu sein, wenn ein Klimaanlagebetrieb durchgeführt wird, und der Bewegungsmechanismus (29) konfiguriert ist, um in dem gespeicherten Zustand zu sein, wenn ein Klimaanlagebetrieb angehalten ist, und

dadurch gekennzeichnet, dass

die Seitenwände (26S) konfiguriert sind, um in

dem vorstehenden Zustand Querseiten des Auslasses (17) vollständig abzudecken.

2. Innenraumeinheit (1) einer Klimaanlage nach Anspruch 1, wobei die untere Wand (26L) angeordnet ist, um aus dem Auslass (17) mindestens dann vorzustehen, wenn ein Klimaanlagebetrieb durchgeführt wird.
3. Innenraumeinheit (1) einer Klimaanlage nach Anspruch 1 oder 2, wobei die obere Wand (26U) angeordnet ist, um aus dem Auslass (17) mindestens dann vorzustehen, wenn ein Klimaanlagebetrieb durchgeführt wird.
4. Innenraumeinheit (1) einer Klimaanlage nach einem der Ansprüche 1 bis 3, wobei der Ausblas-Strömungsweg (26) geformt ist, um aus dem Auslass (17) vorzustehen, und so, dass ein Abstand zwischen den zwei Seitenwänden (26S) in eine seitwärtige Richtung in dem Ausblas-Strömungsweg (26) an einer stromabwärtigen Seite des Auslasses (17) weniger ist als eine seitwärtige Länge des Auslasses (17).
5. Innenraumeinheit (1) einer Klimaanlage nach einem der Ansprüche 1 bis 4, wobei die Innenraumeinheit (1) so konfiguriert ist, dass ein Verhältnis (H/D) von Höhe H des Innenraumeinheit-Hauptkörpers (10) zum Außendurchmesser D eines Laufrad (25) des Querstromlüfters (23) weniger ist als 2,2.
6. Innenraumeinheit (1) einer Klimaanlage nach einem der Ansprüche 1 bis 5, wobei das Auftreten von Überspannungsstößen von der Innenraumsteuereinheit (30) erkannt wird basierend auf entweder der Rotationsgeschwindigkeit eines Lüftermotors des Querstromlüfters (23) oder basierend auf dem Strom, der an den Lüftermotor des Querstromlüfters (23) abgegeben wird,

wobei die Innenraumsteuereinheit (30) bestimmt, dass Überspannungsstöße nicht eingetreten sind, wenn die Rotationsgeschwindigkeit des Lüftermotors in einem tolerierbaren Rotationsgeschwindigkeitsbereich ist, der eine vorbestimmte Breite aufweist, die auf der eingestellten Rotationsgeschwindigkeit zentriert ist, oder wenn der Strom, der an den Lüftermotor abgegeben wird, in einem tolerierbaren Strombereich ist, der eine vorbestimmte Breite aufweist, die auf einem Stromwert zentriert ist, der der eingestellten Rotationsgeschwindigkeit entspricht, und

die Innenraumsteuereinheit (30) bestimmt, dass Überspannungsstöße eingetreten sind, wenn die Rotationsgeschwindigkeit des Motors außerhalb des tolerierbaren Rotationsgeschwin-

digkeitsbereichs ist, oder wenn der Strom, der an den Lüftermotor abgegeben wird, außerhalb des tolerierbaren Strombereichs ist.

7. Innenraumeinheit (1) einer Klimaanlage nach Anspruch 6, wobei der Bewegungsmechanismus (29) konfiguriert ist, um das Element (26S, 26L, 26U) zu bewegen, um die Querschnittsfläche des Ausblas-Strömungswegs (26) an einem aus dem Auslass (17) vorstehenden Abschnitt zu verringern, wenn Überspannungsstöße erkannt werden.

Revendications

1. Unité intérieure (1) d'un climatiseur, comprenant :

un corps principal d'unité intérieure (10) incluant une entrée (16) et une sortie (17) ;

un échangeur de chaleur (22) qui réalise un échange de chaleur sur de l'air aspiré par l'entrée (16) ; et

un ventilateur à flux transversal (23) configuré pour souffler de l'air, qui a subi un échange de chaleur réalisé par l'échangeur de chaleur (22), depuis la sortie (17), dans laquelle

le ventilateur à flux transversal (23) inclut une voie d'écoulement d'air par la force de soufflerie (26) formée par une paroi inférieure (26L), des parois latérales droite et gauche (26S) et une paroi supérieure (26U) de sorte qu'une surface de section transversale augmente progressivement vers le bas, avec la voie d'écoulement d'air par la force de soufflerie (26) guidant de l'air soufflé vers la sortie (17),

un mécanisme de mouvement (29) configuré pour basculer entre un état stocké qui ne fait pas saillie avec un élément (26S, 26L, 26U) formant la voie d'écoulement d'air par la force de soufflerie (26) incluant les parois latérales (26S) hors de la sortie (17) et un état faisant saillie qui fait saillie au moins avec les parois latérales (26S) hors de la sortie (17),

dans une unité de commande intérieure (30) configurée pour commander le mécanisme de mouvement (29) pour basculer entre l'état stocké, dans lequel les parois latérales mobiles (26S) ne font pas saillie hors de la sortie (17), et l'état faisant saillie, dans lequel les parois latérales mobiles (26S) font saillie hors de la sortie (17)

dans laquelle le mécanisme de mouvement (29) est configuré en outre pour être à l'état faisant saillie lorsqu'une opération de climatisation est réalisée, et le mécanisme de mouvement (29) est configuré pour être à l'état stocké lorsqu'une opération de climatisation est arrêtée, et

caractérisée en ce que

les parois latérales (26S) sont configurées pour recouvrir entièrement les côtés transversaux de la sortie (17) à l'état faisant saillie.

2. Unité intérieure (1) d'un climatiseur selon la revendication 1, dans laquelle la paroi inférieure (26L) est agencée de manière à faire saillie hors de la sortie (17) au moins lorsqu'une opération de climatisation est réalisée. 5
3. Unité intérieure (1) d'un climatiseur selon la revendication 1 ou 2, dans laquelle la paroi supérieure (26U) est agencée de manière à faire saillie hors de la sortie (17) au moins lorsqu'une opération de climatisation est réalisée. 10 15
4. Unité intérieure (1) d'un climatiseur selon l'une quelconque des revendications 1 à 3, dans laquelle la voie d'écoulement d'air par la force de soufflerie (26) est formée pour faire saillie hors de la sortie (17) et de sorte qu'une distance entre les deux parois latérales (26S) dans une direction latérale dans la voie d'écoulement d'air par la force de soufflerie (26) sur un côté en aval de la sortie (17) est inférieure à une longueur latérale de la sortie (17). 20 25
5. Unité intérieure (1) d'un climatiseur selon l'une quelconque des revendications 1 à 4, dans laquelle l'unité intérieure (1) est configurée de sorte qu'un rapport (H/D) de la hauteur H du corps principal d'unité intérieure (10) sur le diamètre externe D d'une turbine (25) du ventilateur à flux transversal (23) est inférieur à 2,2. 30
6. Unité intérieure (1) d'un climatiseur selon l'une quelconque des revendications 1 à 5, dans laquelle l'apparition d'une poussée est détectée par l'unité de commande intérieure (30) en fonction de soit la vitesse de rotation d'un moteur de ventilateur du ventilateur à flux transversal (23), soit en fonction du courant fourni au moteur de ventilateur du ventilateur à flux transversal (23), 35 40

dans laquelle l'unité de commande intérieure (30) détermine si une poussée n'a pas eu lieu lorsque la vitesse de rotation du moteur de ventilateur se situe dans une plage de vitesse de rotation admissible qui présente une largeur prédéterminée centrée sur la vitesse de rotation définie, ou lorsque le courant fourni au moteur de ventilateur se situe dans une plage de courant admissible qui présente une largeur prédéterminée centrée sur une valeur actuelle correspondant à la vitesse de rotation définie, et l'unité de commande intérieure (30) détermine si une poussée a eu lieu lorsque la vitesse de rotation du moteur est en dehors de la plage de vitesses de rotation admissible, ou lorsque le 45 50 55

courant fourni au moteur de ventilateur est en dehors de la plage de courant admissible.

7. Unité intérieure (1) d'un climatiseur selon la revendication 6, dans laquelle le mécanisme de mouvement (29) est configuré pour déplacer l'élément (265, 26L, 26U) afin de diminuer une surface de section transversale de la voie d'écoulement d'air par la force de soufflerie (26) sur une partie faisant saillie depuis la sortie (17) lorsqu'une poussée est détectée.

Fig.1A

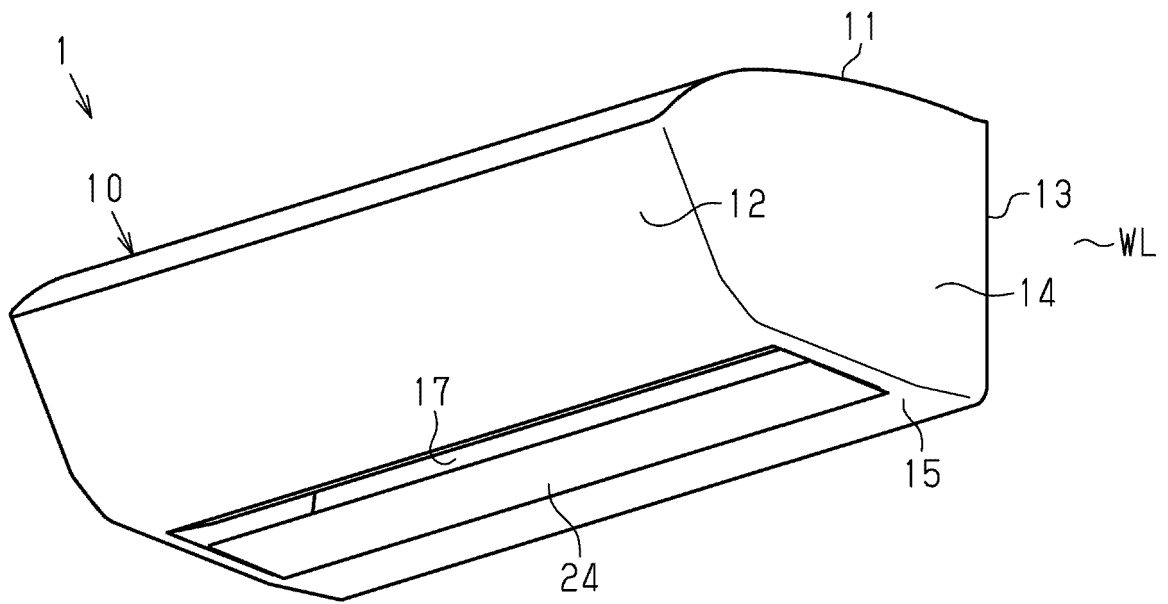


Fig.1B

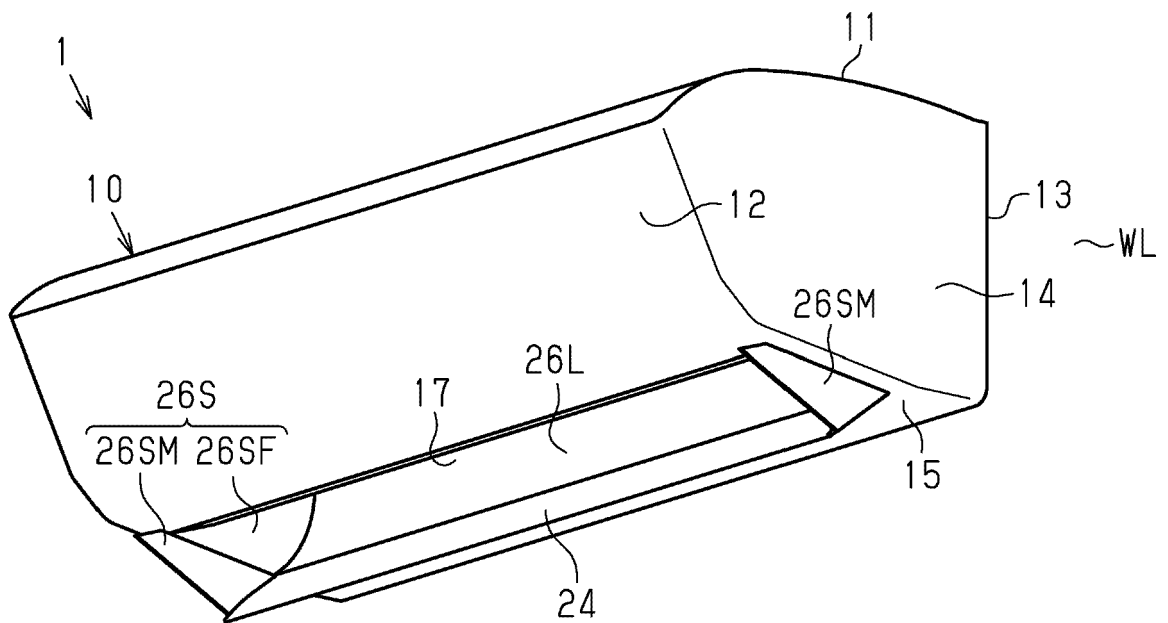


Fig.2A

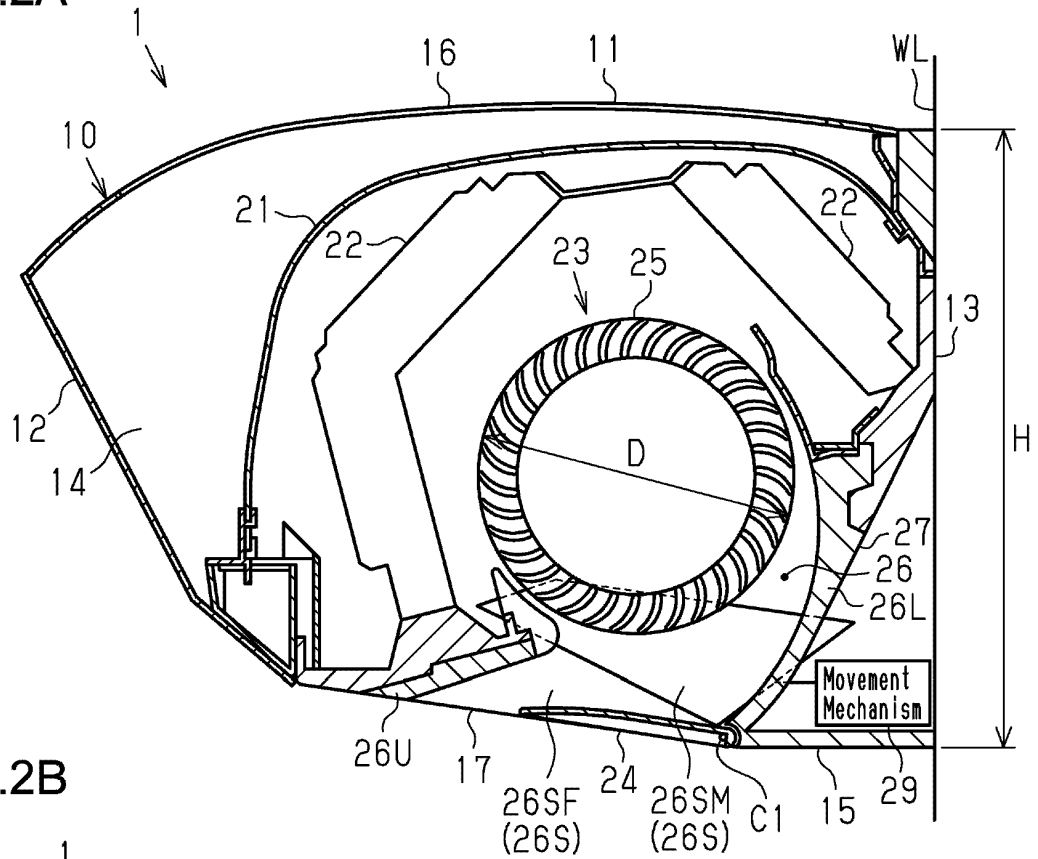


Fig.2B

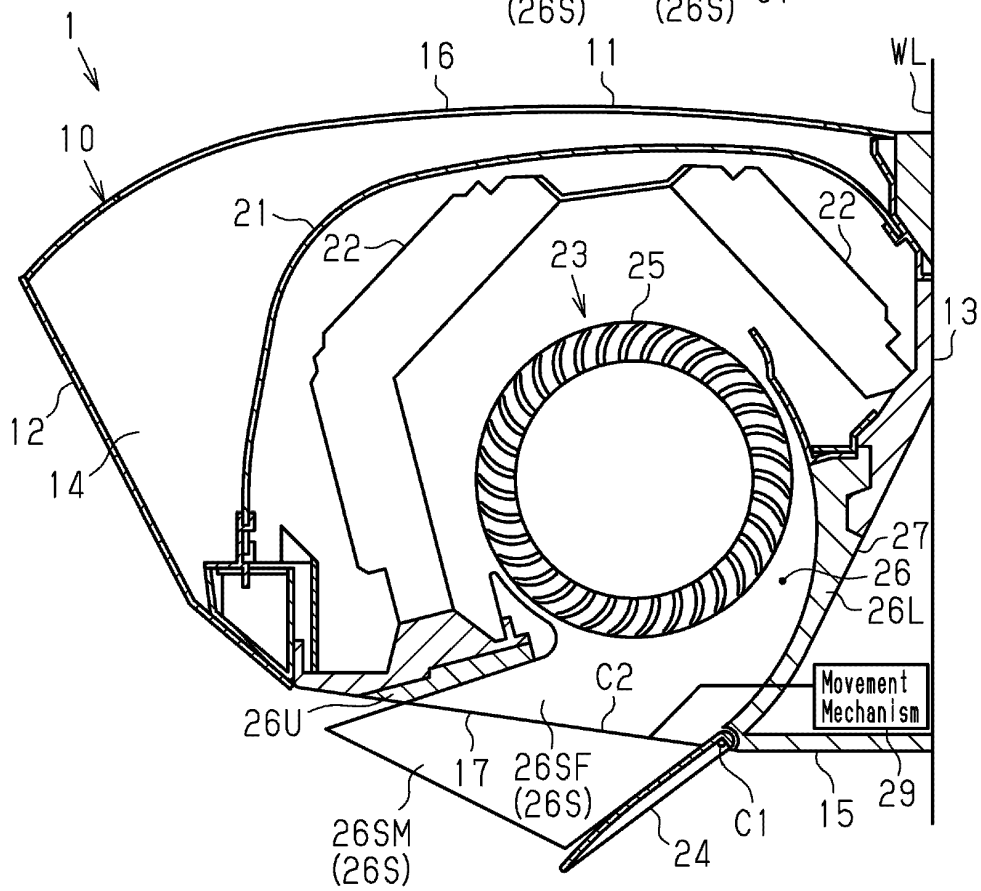


Fig.3

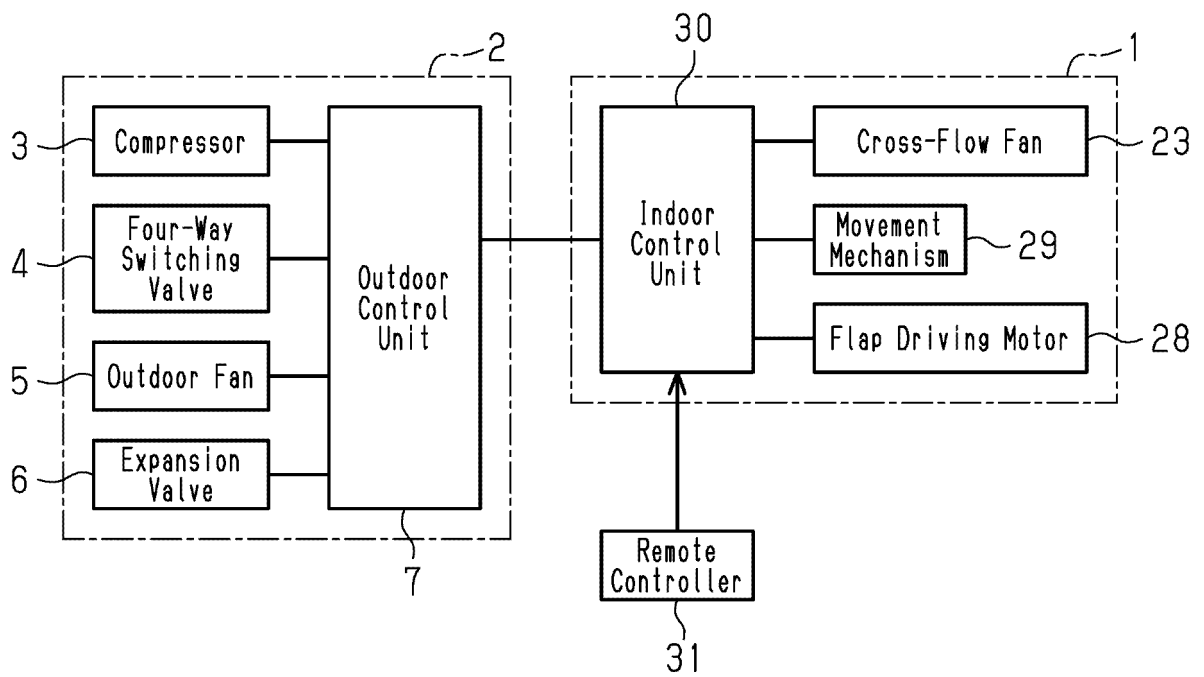


Fig.4

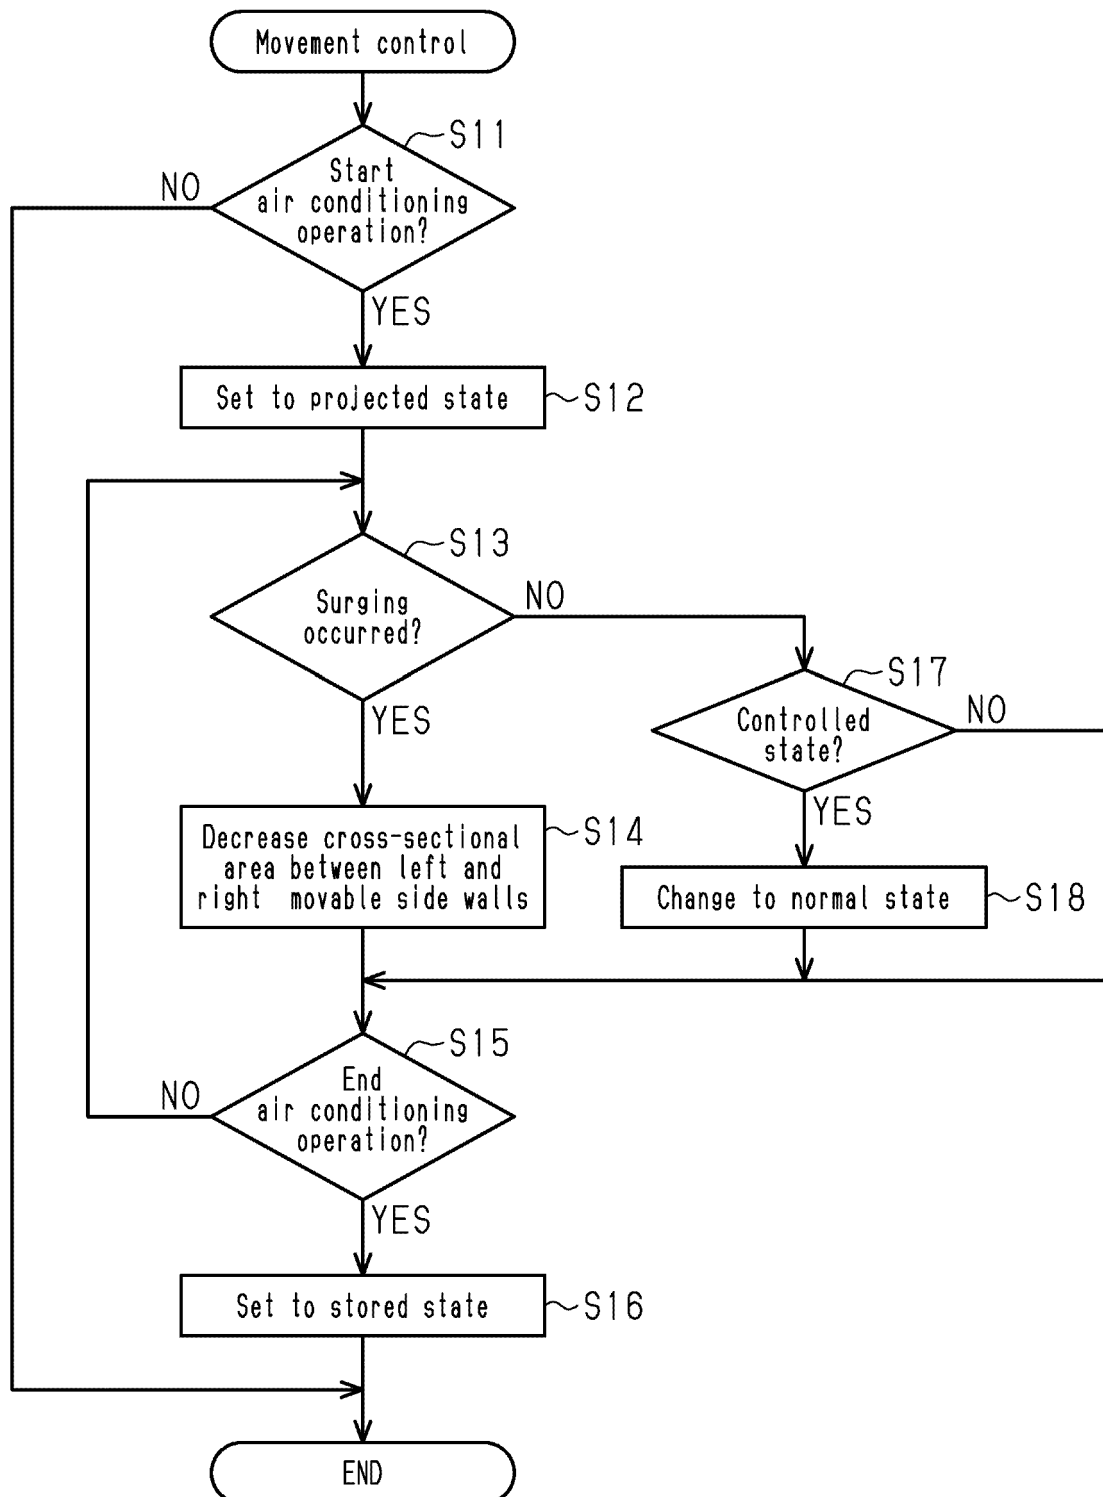


Fig.5A

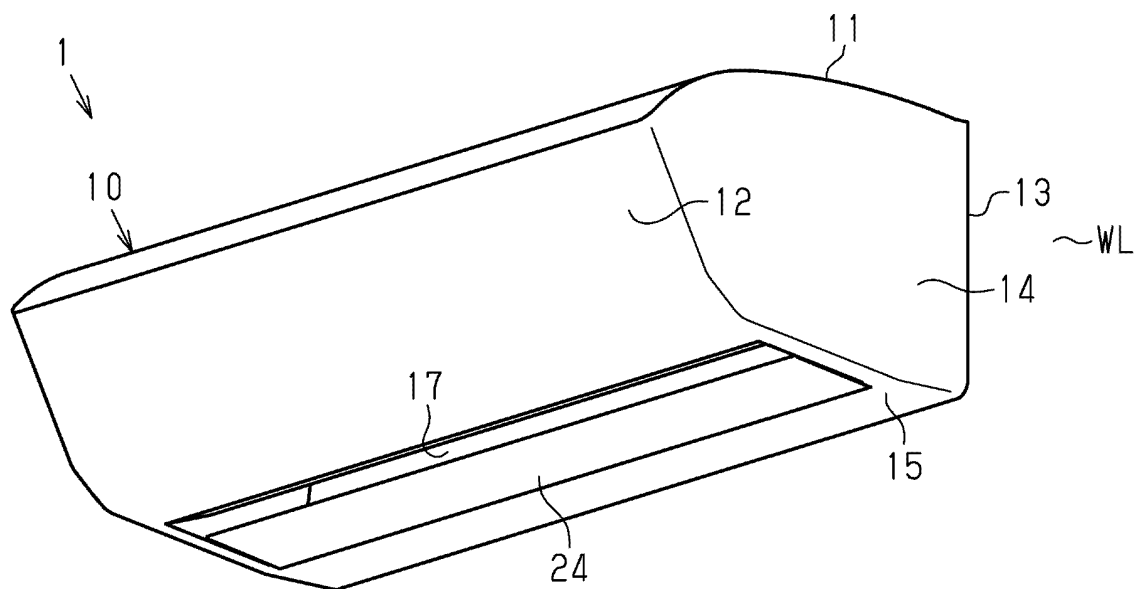


Fig.5B

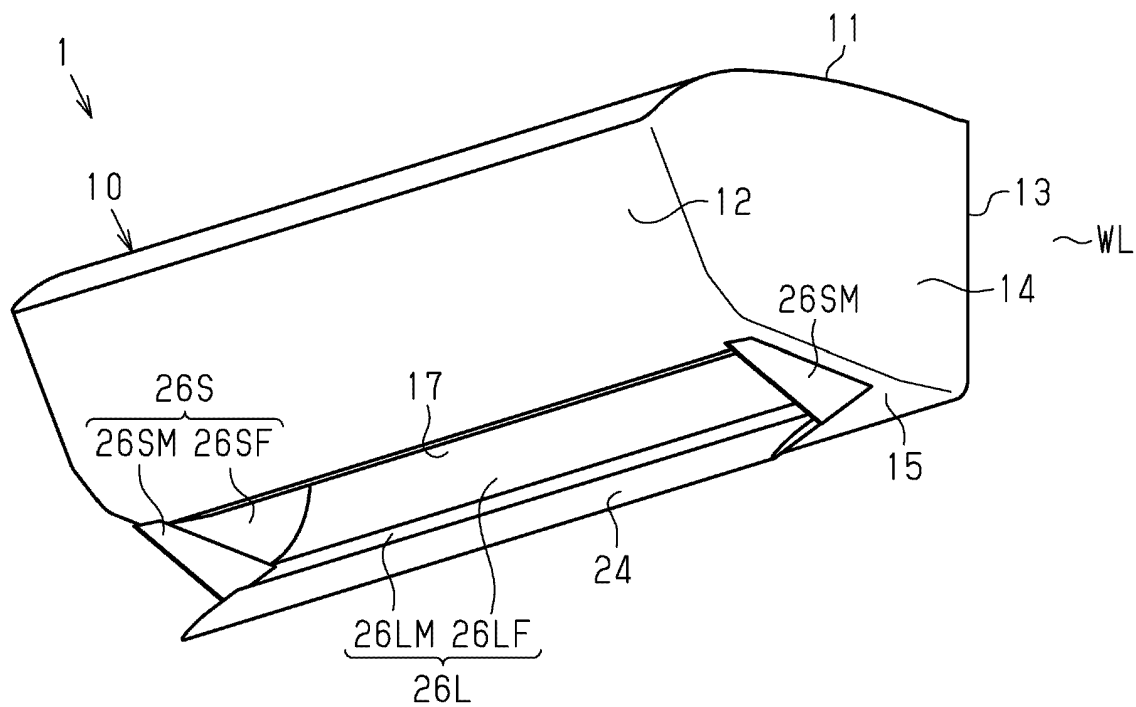


Fig.6A

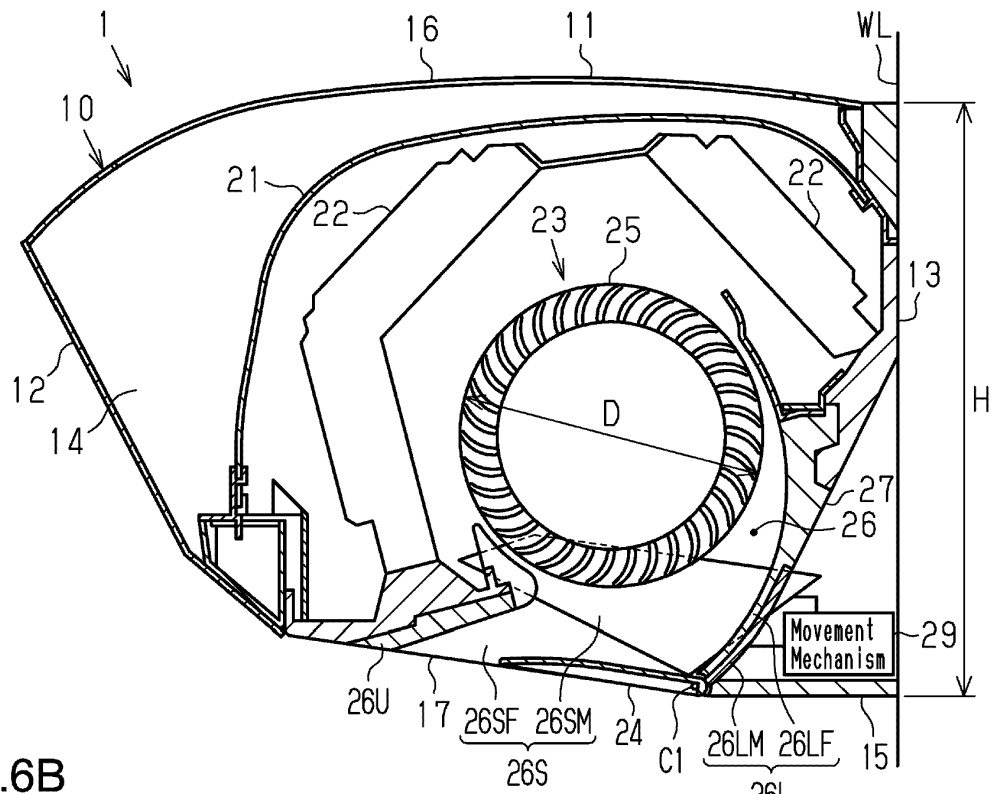


Fig.6B

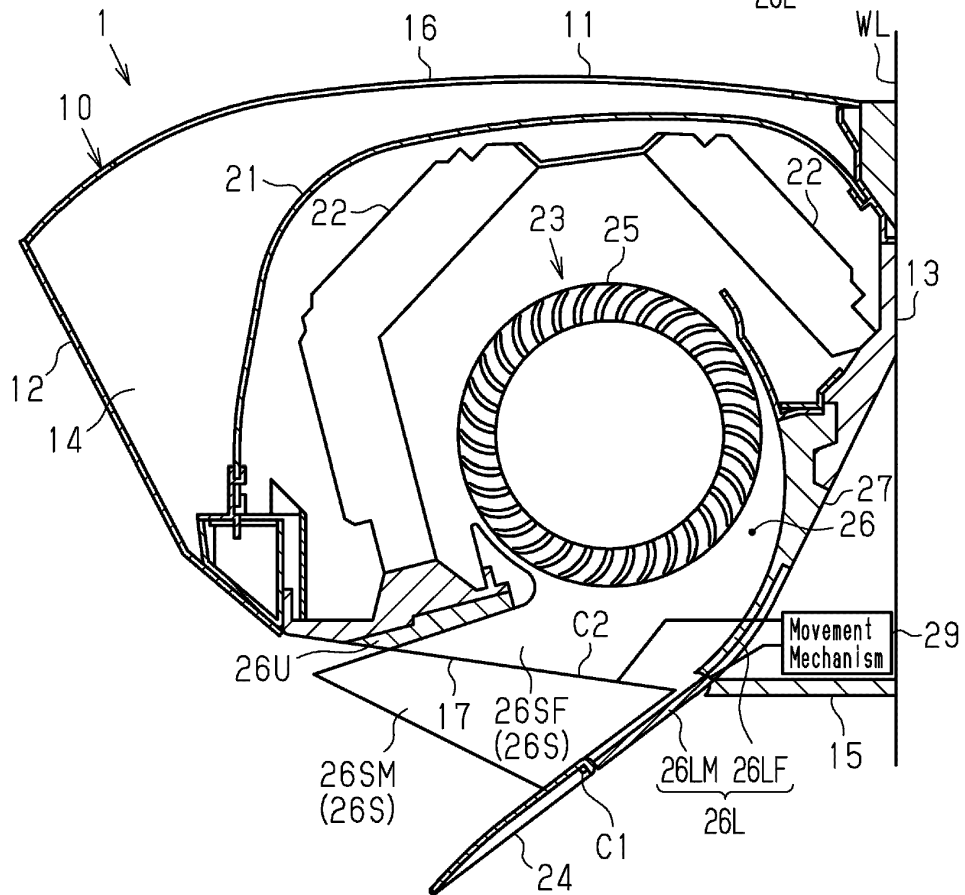


Fig.7A

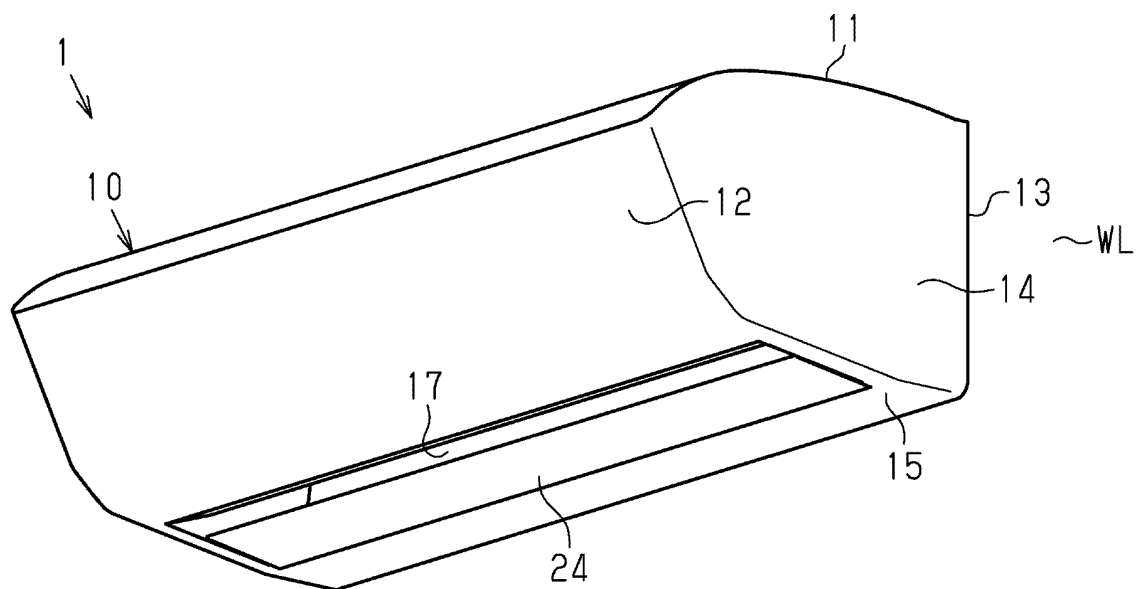


Fig.7B

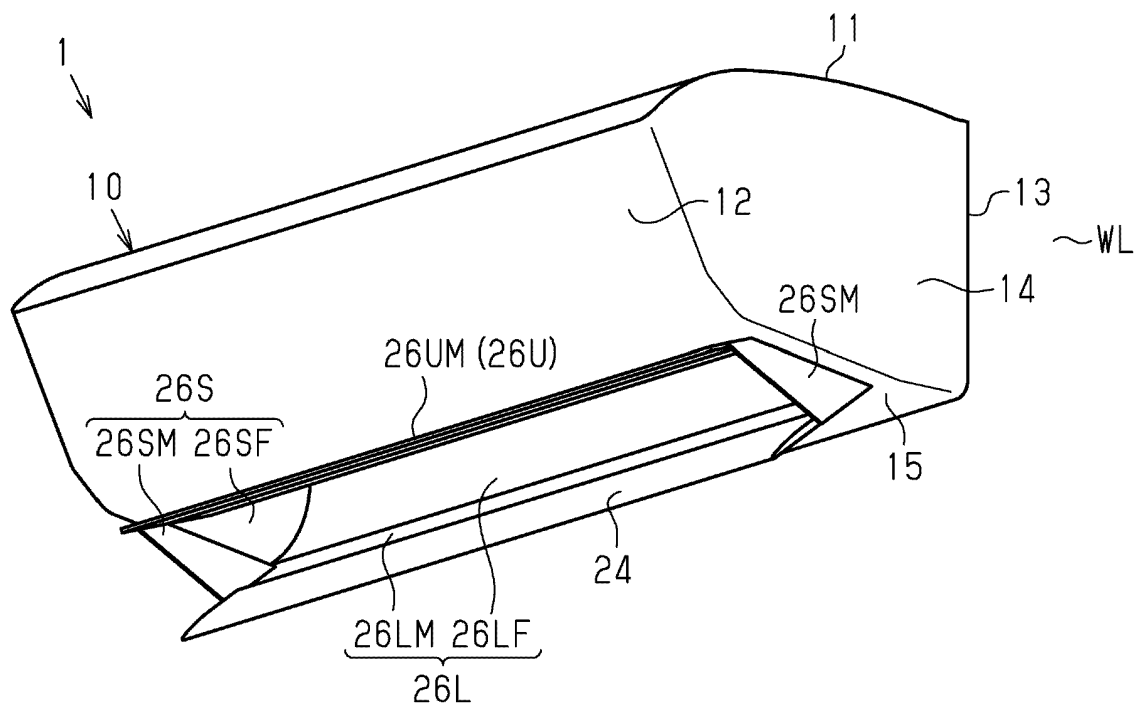


Fig.8A

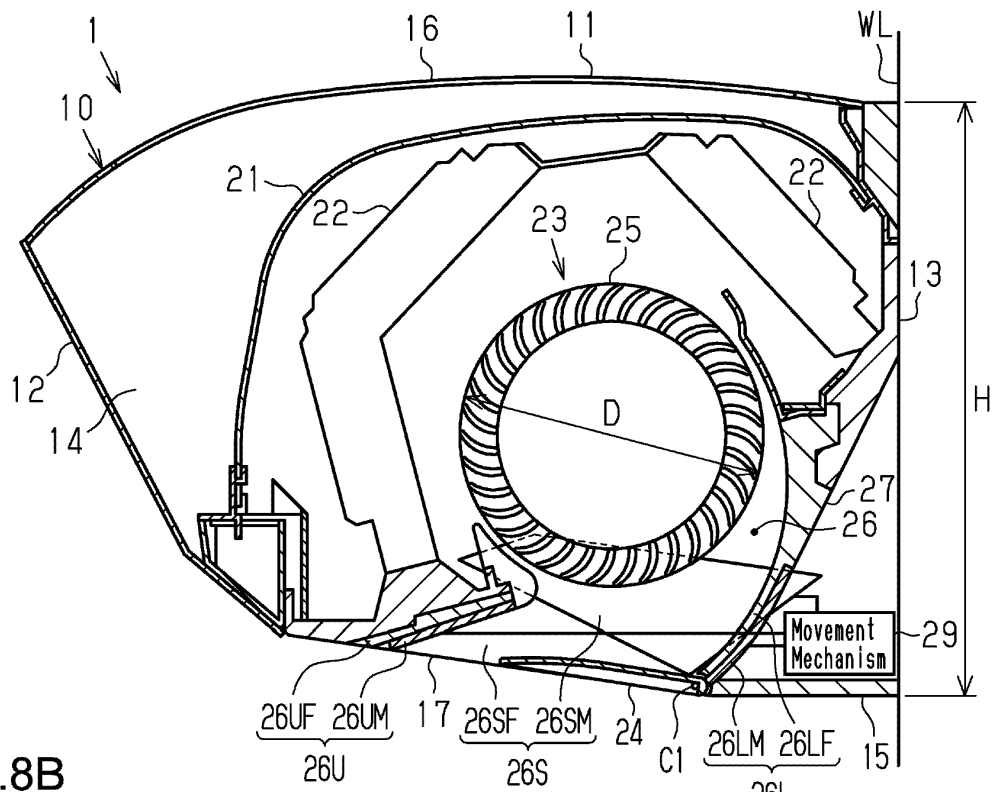


Fig.8B

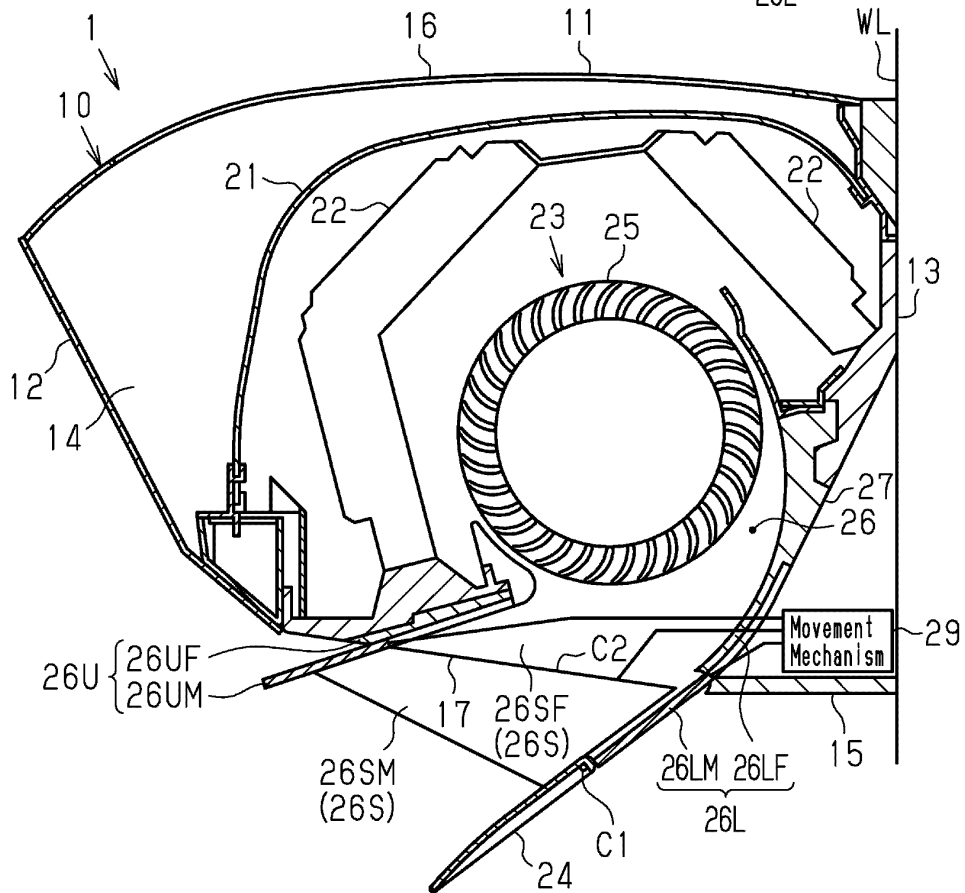


Fig.9A

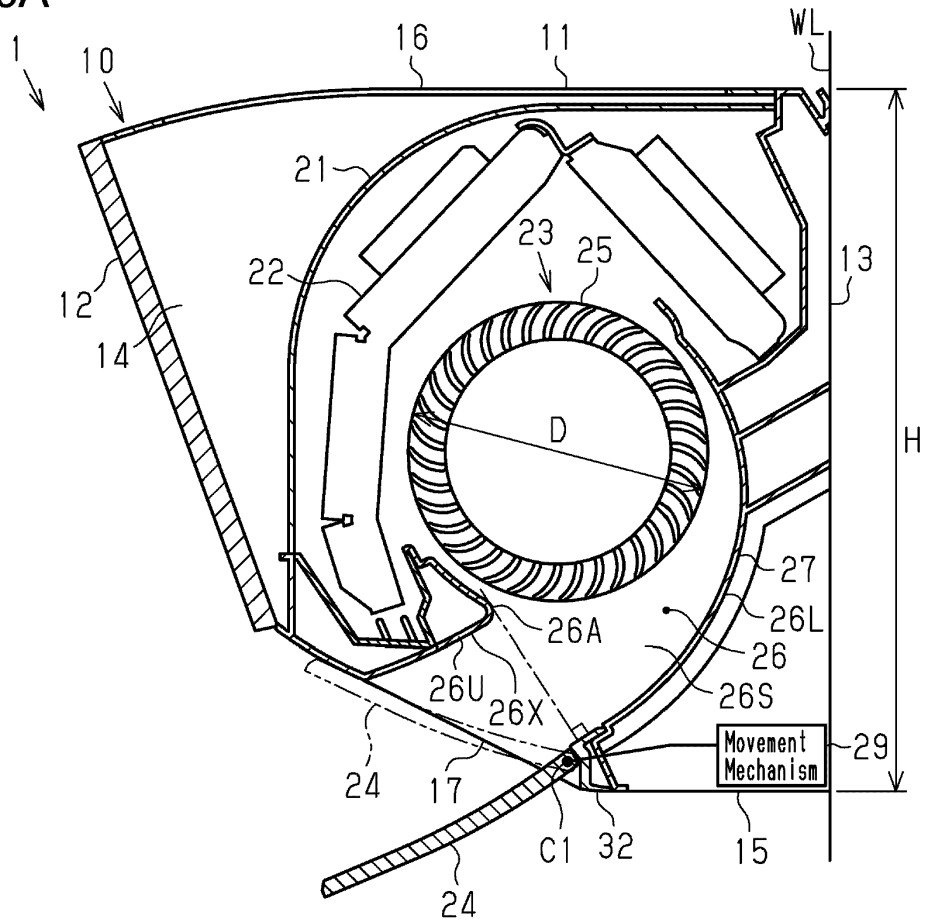


Fig.9B

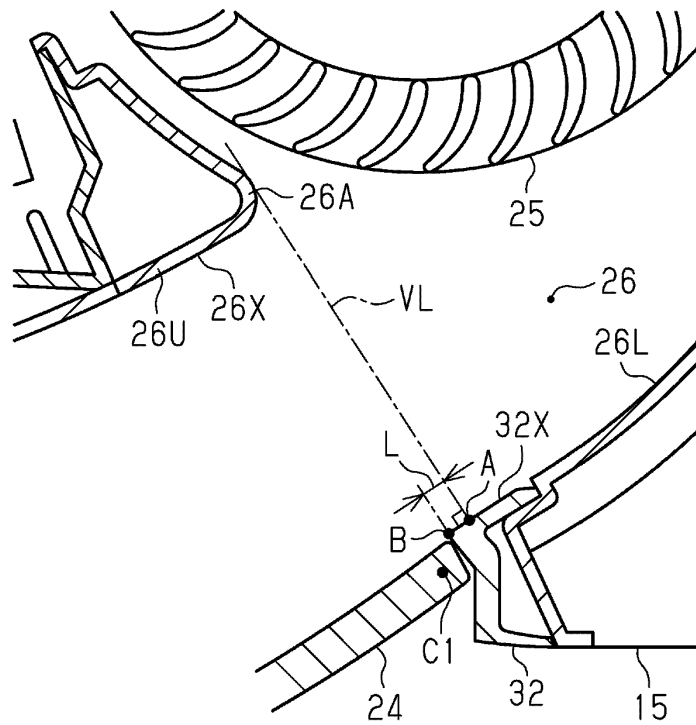


Fig.10A

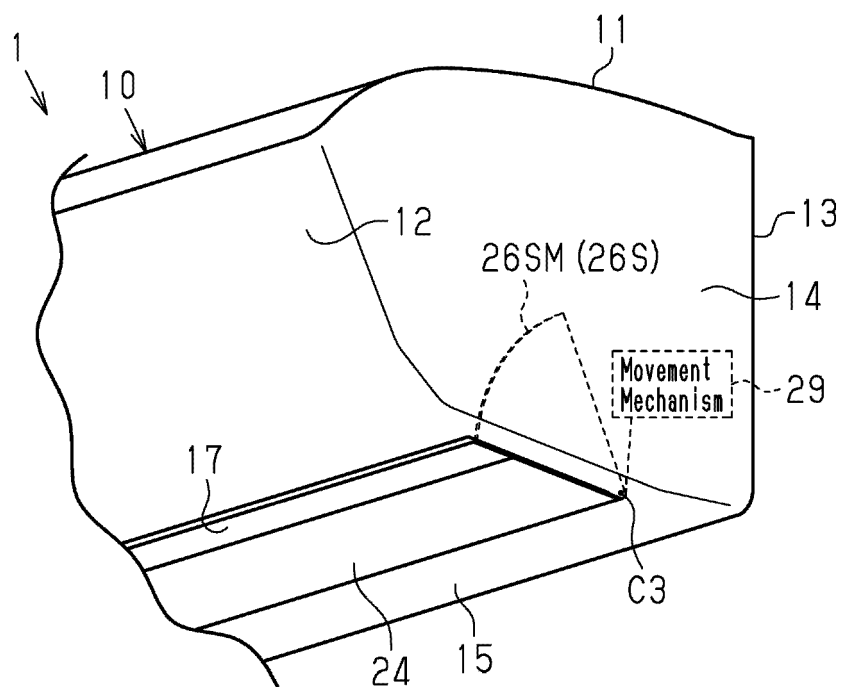


Fig.10B

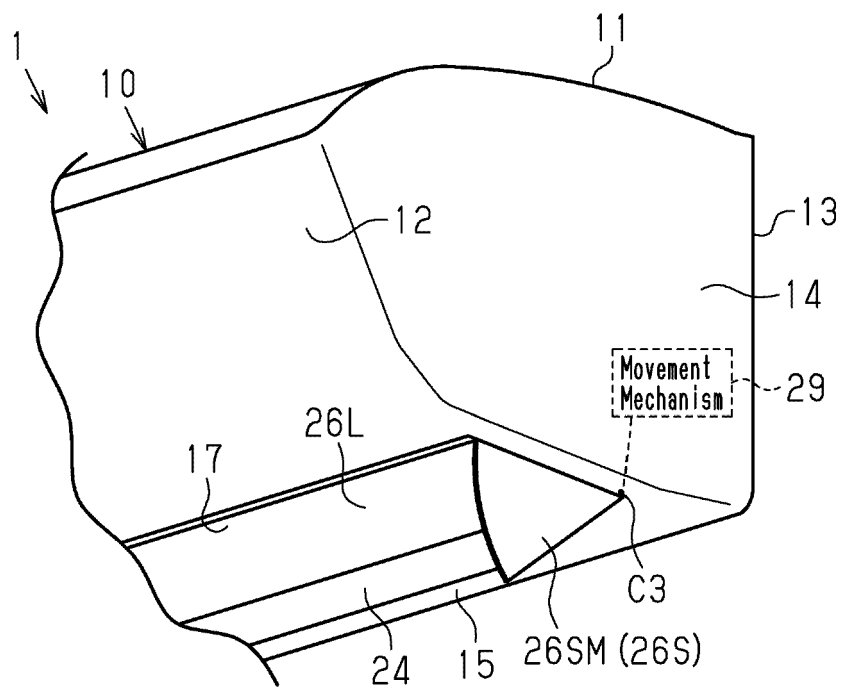


Fig.11A

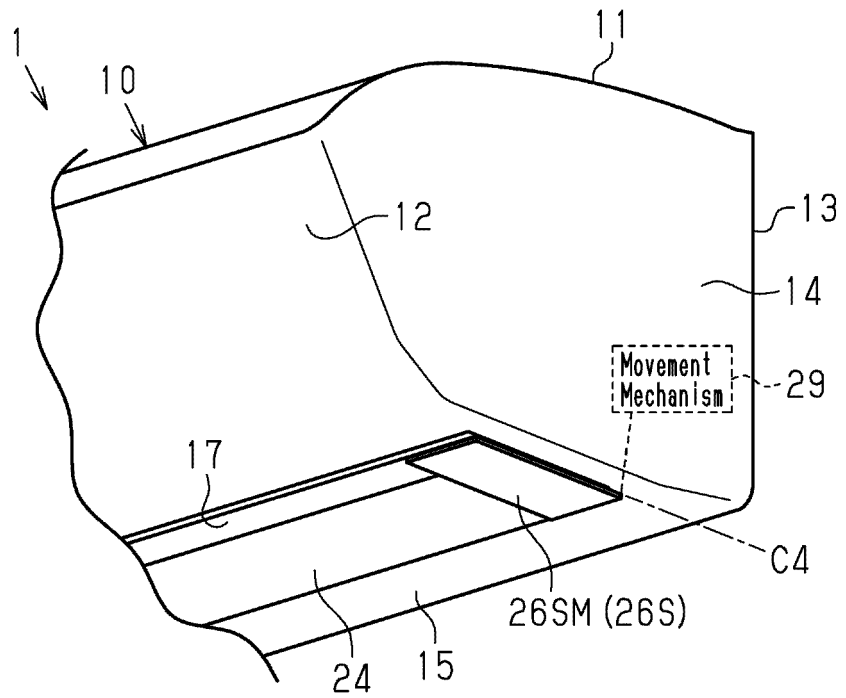


Fig.11B

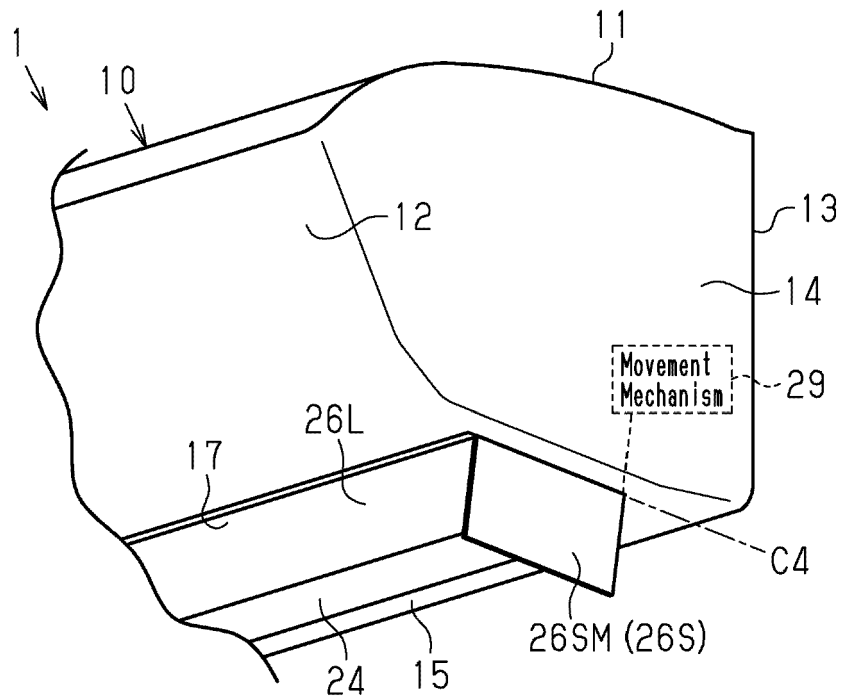


Fig.12A

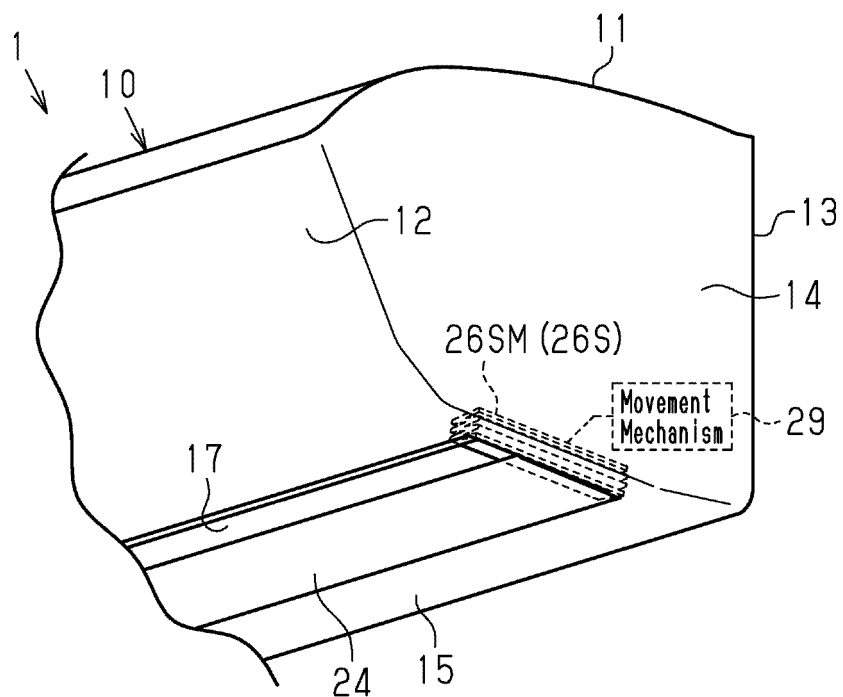


Fig.12B

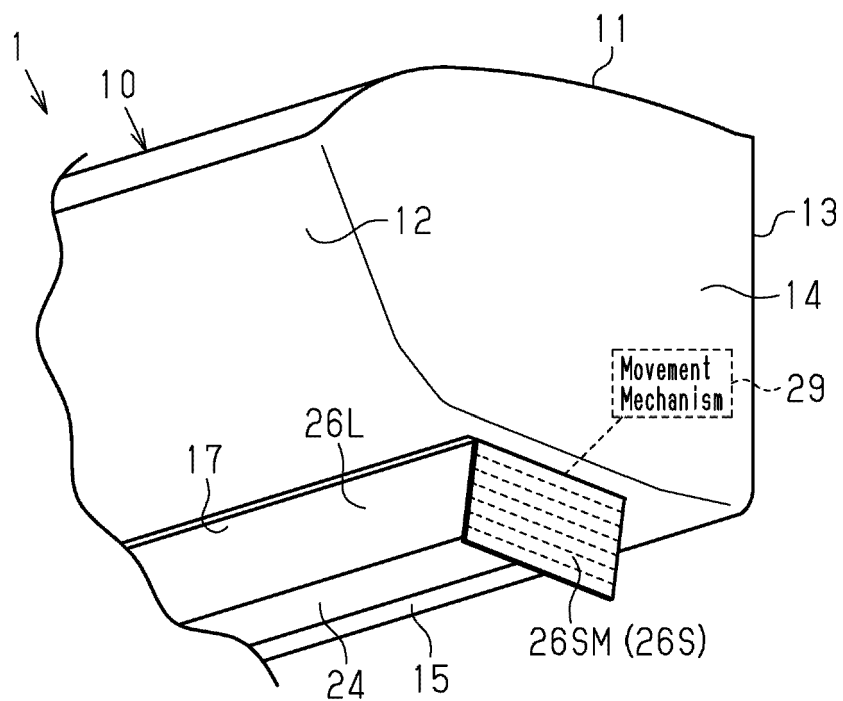


Fig.13A

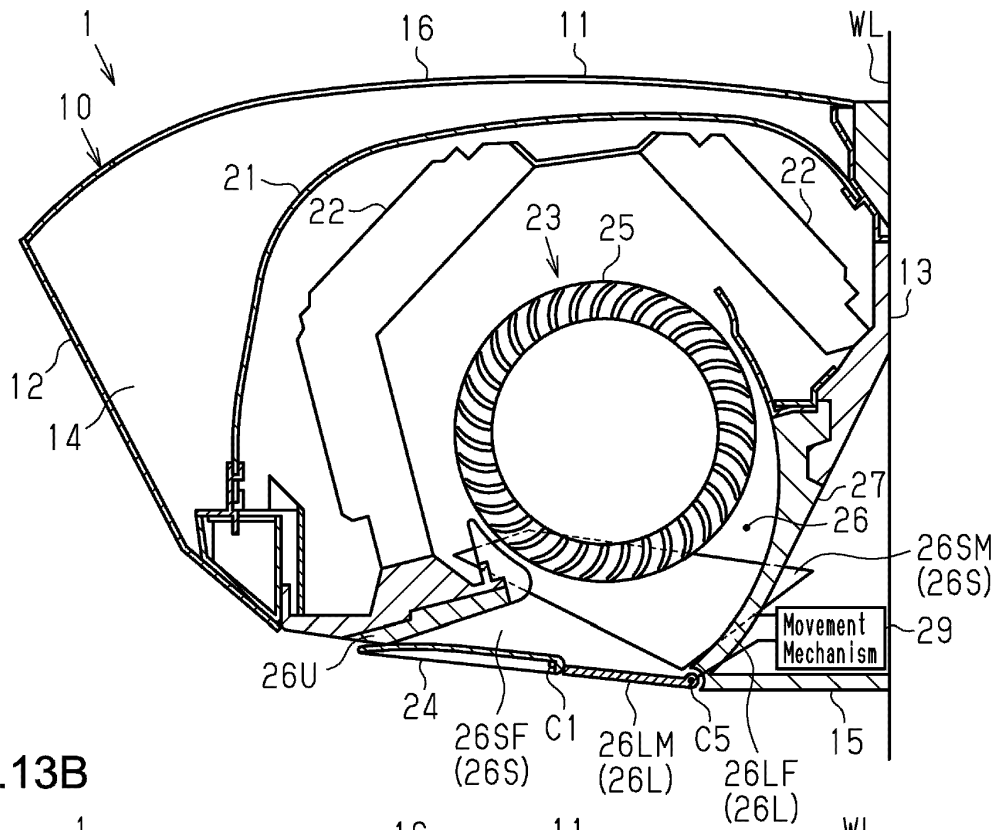


Fig.13B

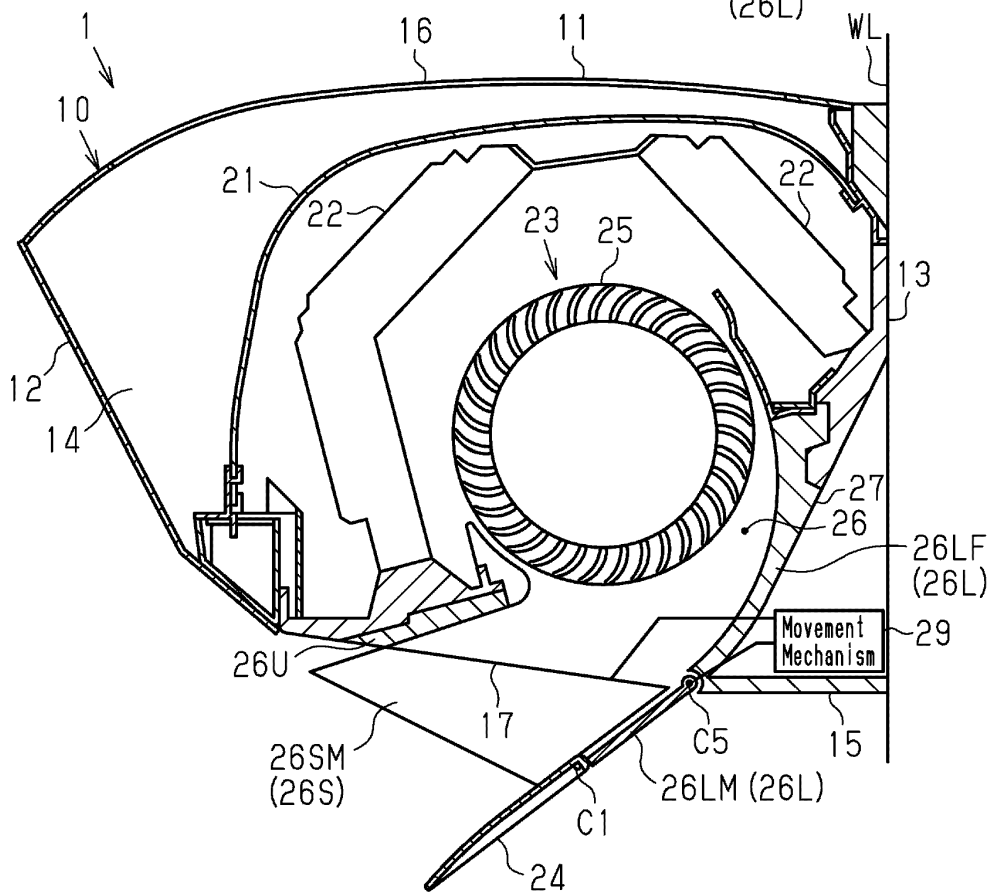


Fig.14A

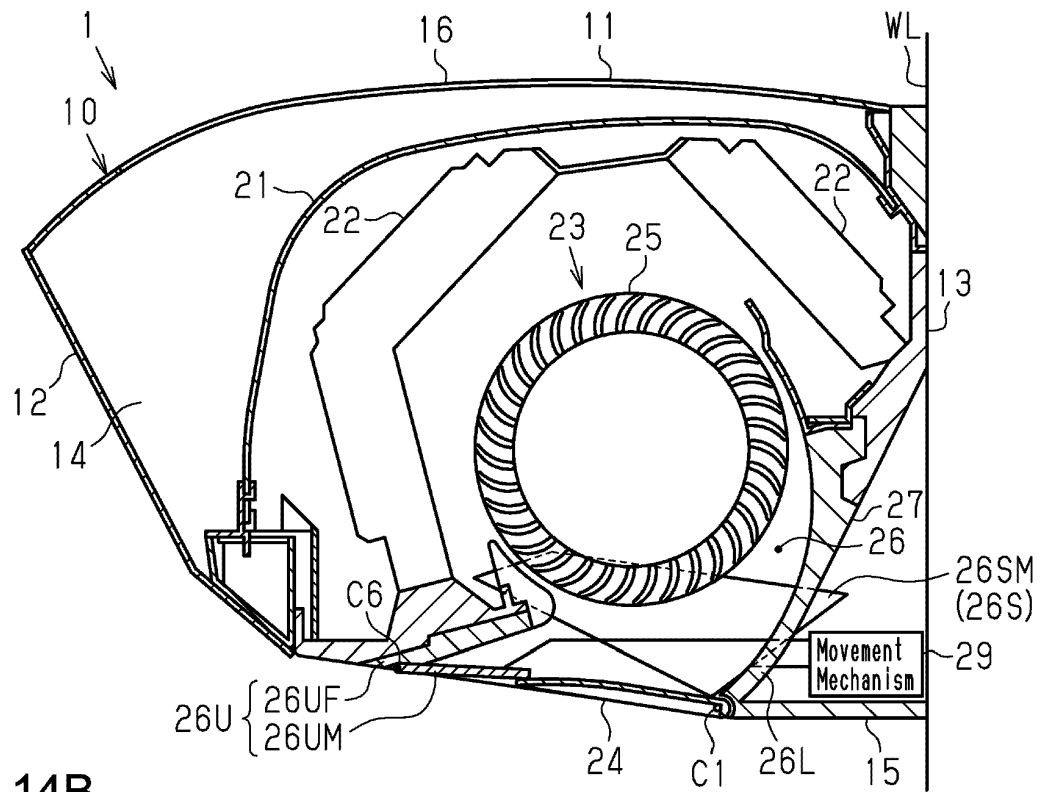


Fig.14B

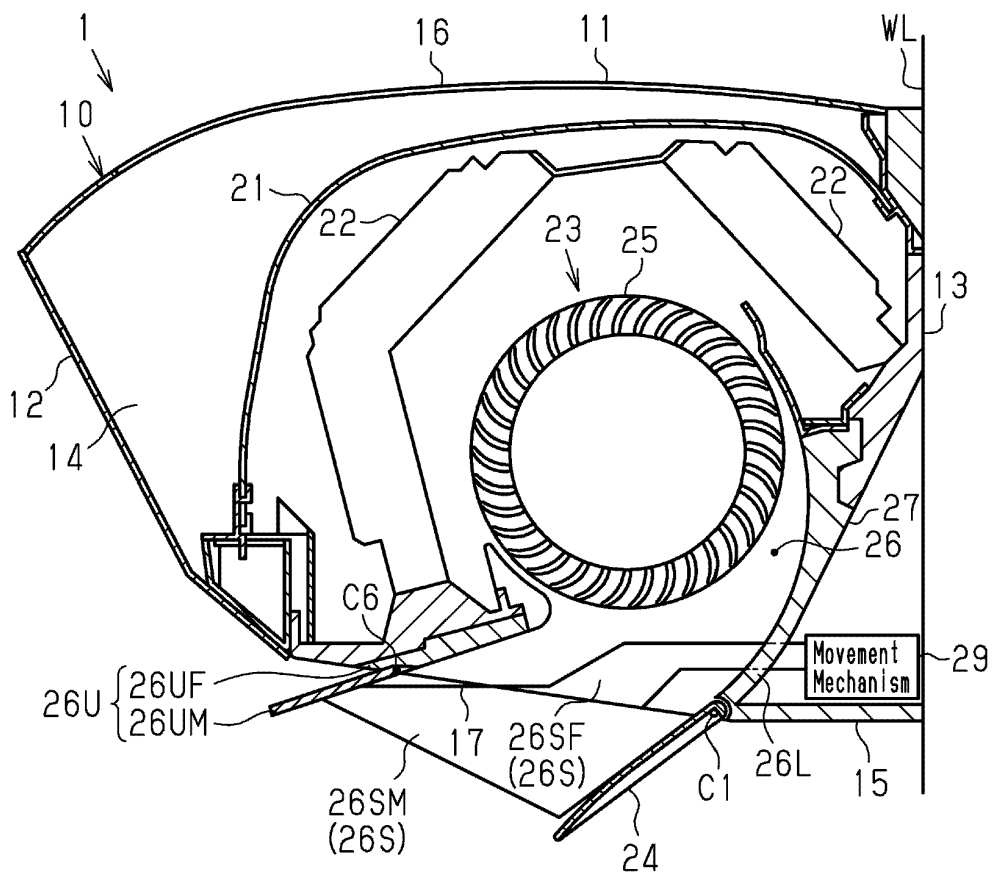


Fig.15A


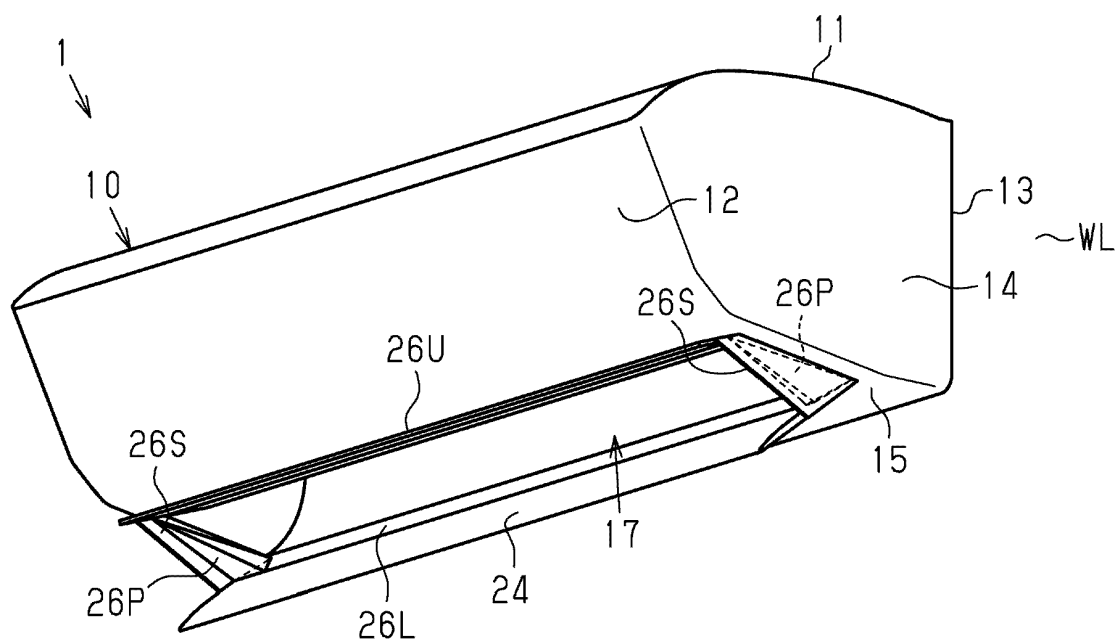


Fig.15B

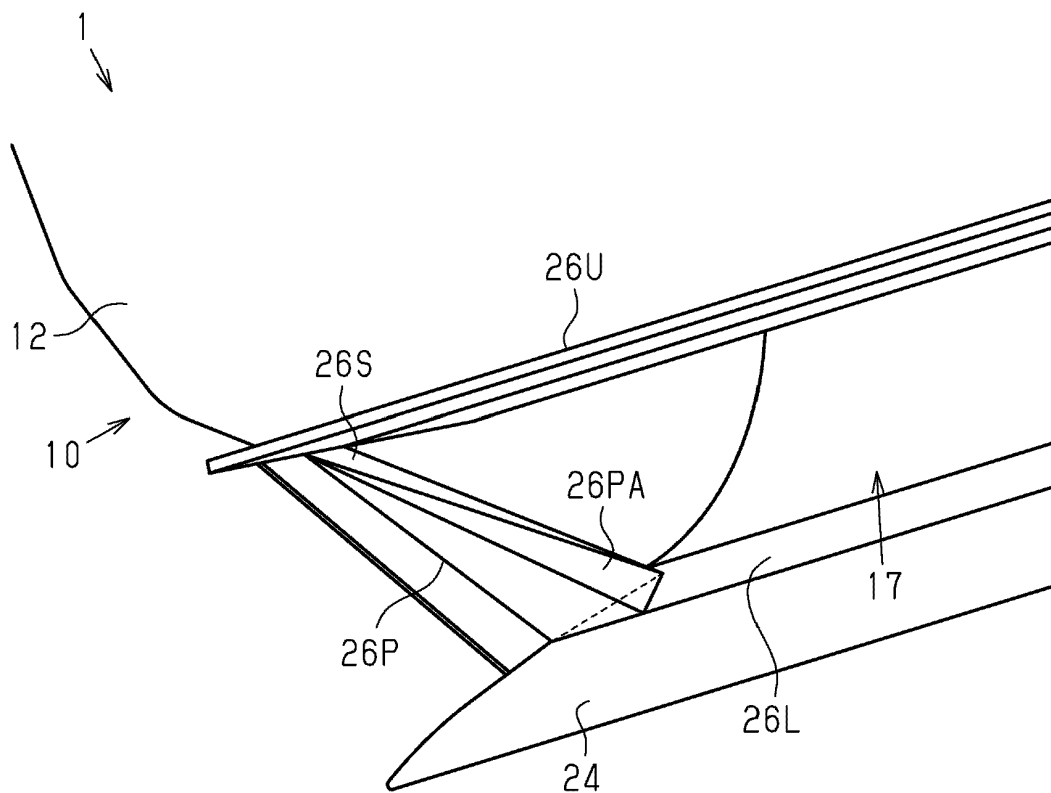

REFERENCES CITED IN THE DESCRIPTION

This list of references cited by the applicant is for the reader's convenience only. It does not form part of the European patent document. Even though great care has been taken in compiling the references, errors or omissions cannot be excluded and the EPO disclaims all liability in this regard.

Patent documents cited in the description

- WO 2014199590 A1 [0002] [0004]
- JP H05272799 A [0003]