



(86) Date de dépôt PCT/PCT Filing Date: 2011/10/06
(87) Date publication PCT/PCT Publication Date: 2012/04/19
(85) Entrée phase nationale/National Entry: 2013/04/09
(86) N° demande PCT/PCT Application No.: US 2011/055079
(87) N° publication PCT/PCT Publication No.: 2012/051042
(30) Priorité/Priority: 2010/10/12 (US61/392,139)

(51) Cl.Int./Int.Cl. *H02J 3/32* (2006.01),
H02J 3/16 (2006.01), *H02J 3/18* (2006.01),
H02J 3/38 (2006.01)
(71) Demandeur/Applicant:
AMERICAN SUPERCONDUCTOR CORPORATION, US
(72) Inventeurs/Inventors:
SCHUGART, PERRY S., US;
VAREKA, WILLIAM, US;
REDDY, NARENDRA, US
(74) Agent: GOWLING LAFLEUR HENDERSON LLP

(54) Titre : CONDITIONNEMENT DE COURANT CENTRALISE
(54) Title: CENTRALIZED POWER CONDITIONING

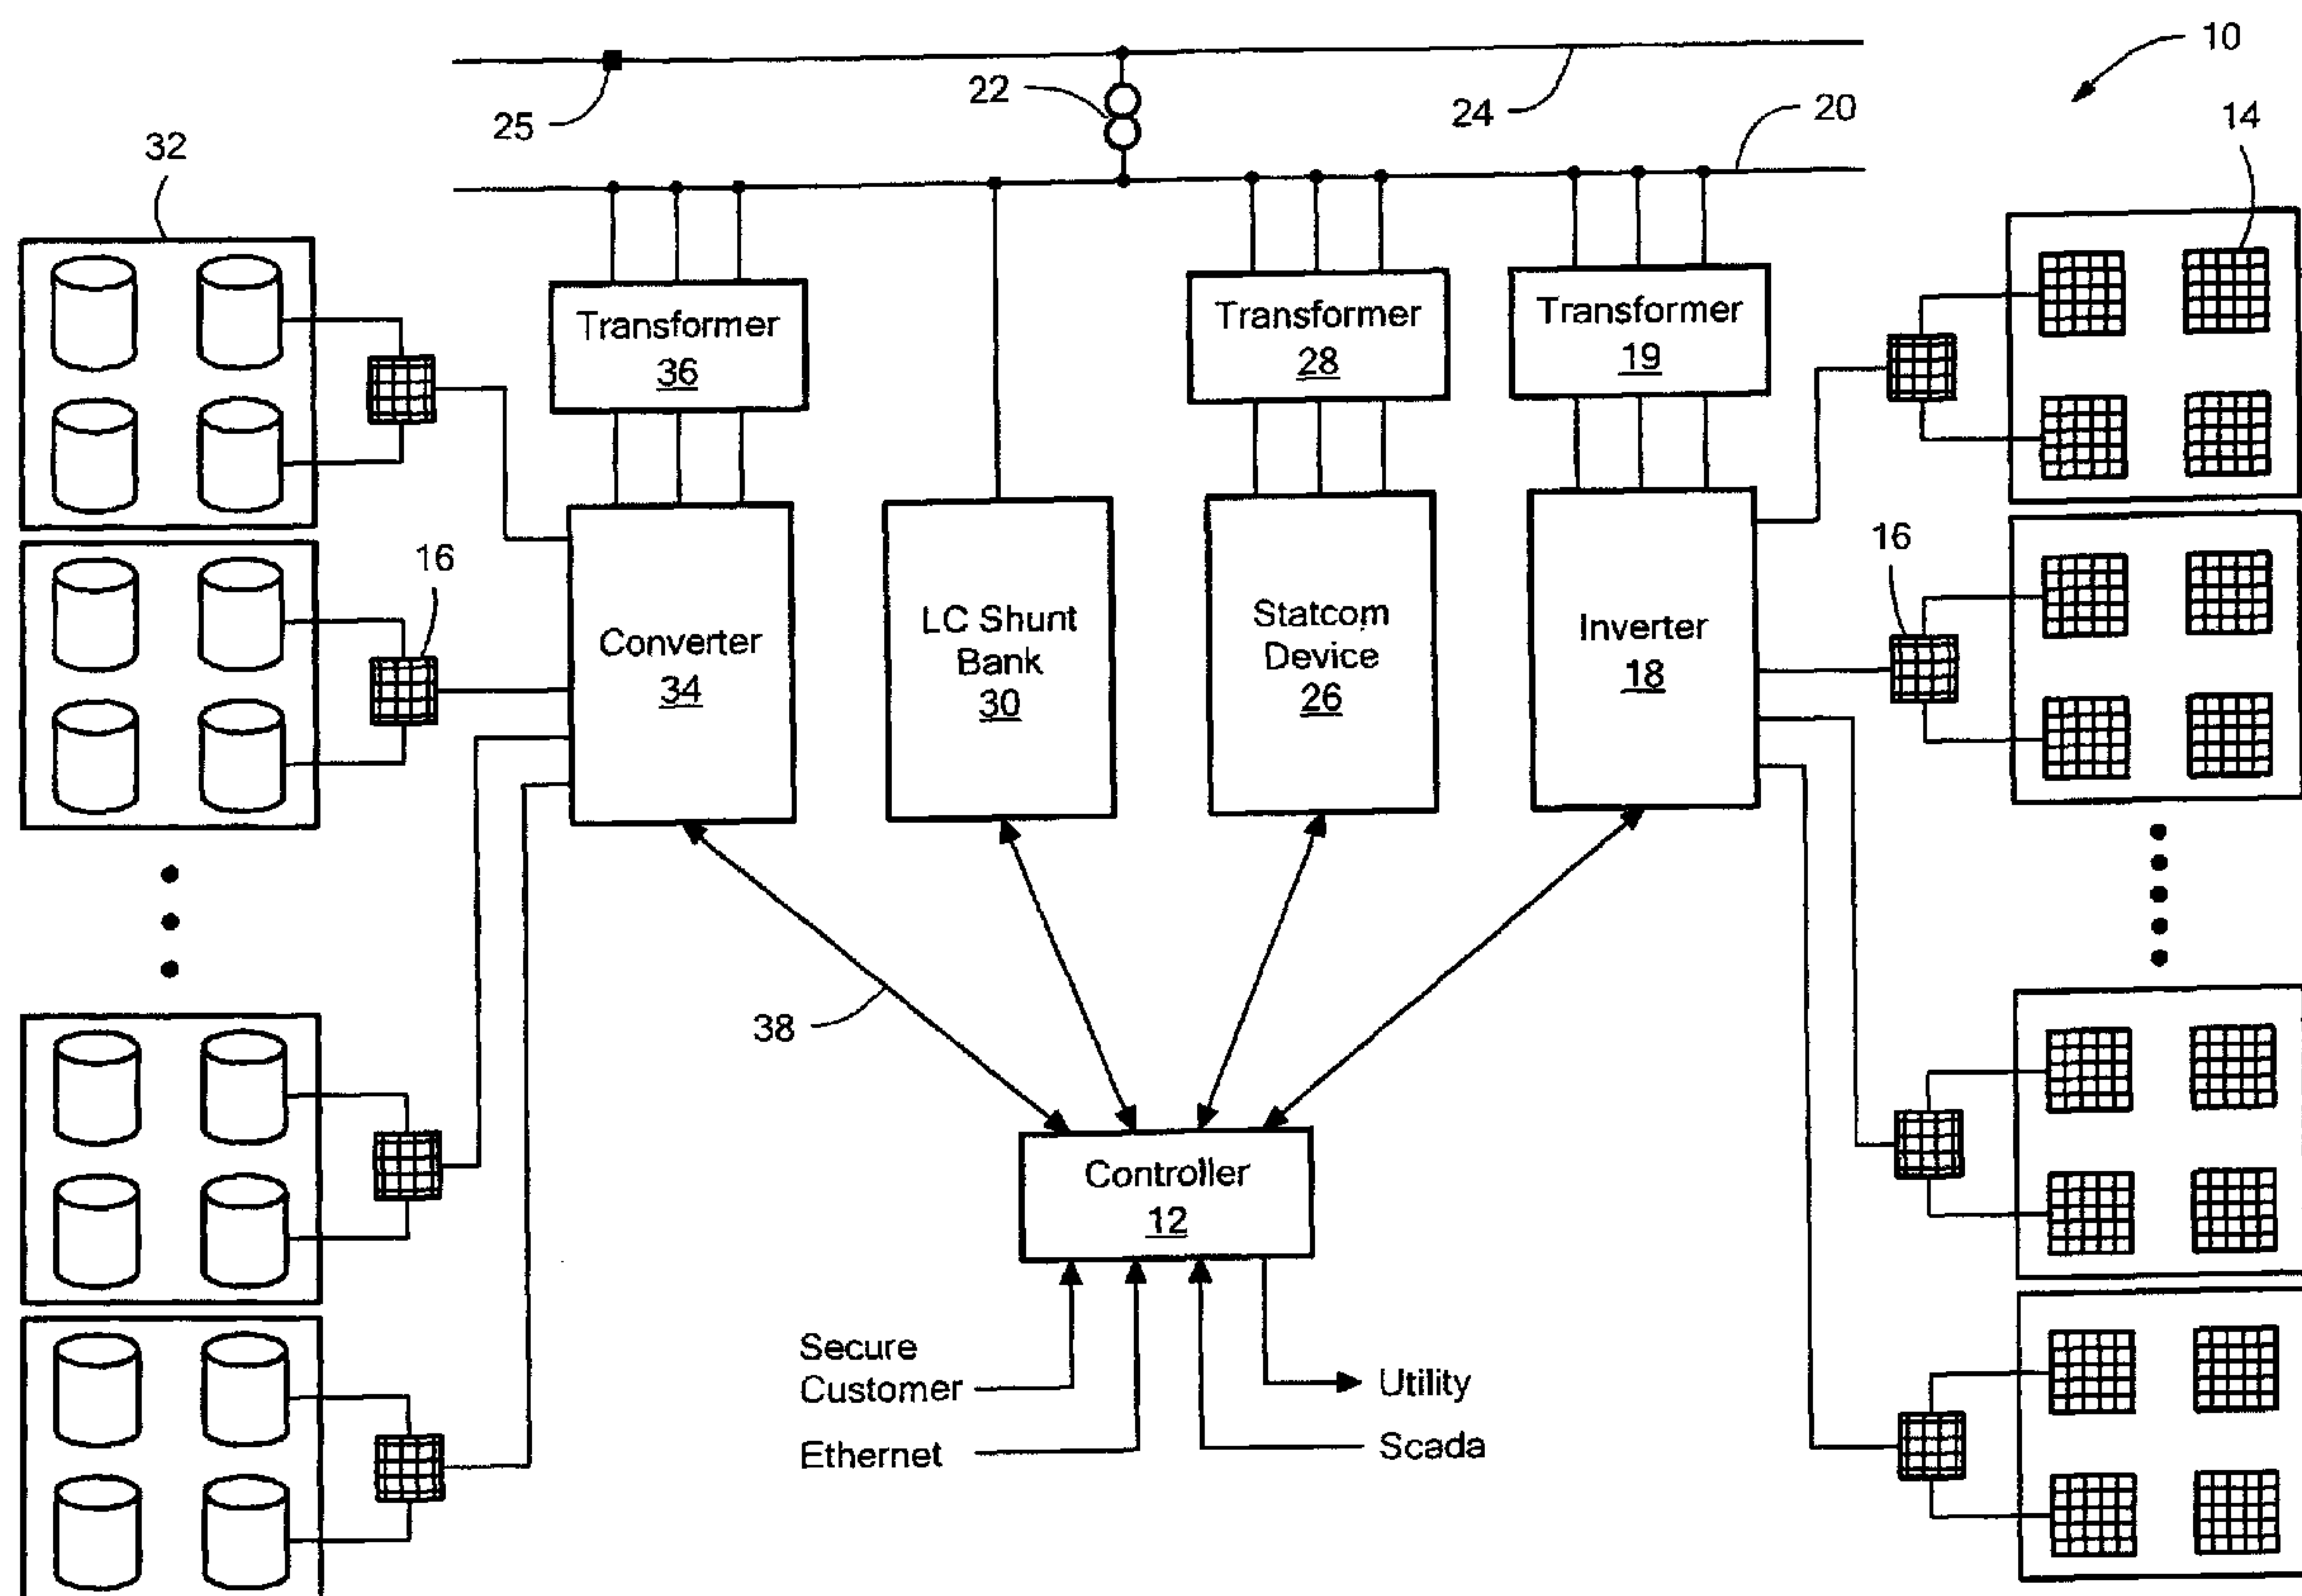


FIG. 1

(57) **Abrégé/Abstract:**

A power plant for providing electric power to a power grid includes energy sources; power conditioning units and a controller configured to cause power provided to the grid to have selected electrical characteristics. The controller is in high speed real-time communication with the power conditioning units and programmed to provide instructions to the power conditioning units.



(12) INTERNATIONAL APPLICATION PUBLISHED UNDER THE PATENT COOPERATION TREATY (PCT)

(19) World Intellectual Property
Organization
International Bureau(43) International Publication Date
19 April 2012 (19.04.2012)(10) International Publication Number
WO 2012/051042 A3

(51) International Patent Classification:

H02J 3/32 (2006.01) *H02J 3/18* (2006.01)
H02J 3/16 (2006.01) *H02J 3/38* (2006.01)

(21) International Application Number:

PCT/US2011/055079

(22) International Filing Date:

6 October 2011 (06.10.2011)

(25) Filing Language:

English

(26) Publication Language:

English

(30) Priority Data:

61/392,139 12 October 2010 (12.10.2010) US

(71) Applicant (for all designated States except US): AMER-

ICAN SUPERCONDUCTOR CORPORATION
 [US/US]; 64 Jackson Road, Devens, Massachusetts 01432
 (US).

(72) Inventors; and

(75) Inventors/Applicants (for US only): SCHUGART, Perry

S. [US/US]; 304 Blue Water Ct., Dousman, Wisconsin
 53118 (US). VAREKA, William [US/US]; 536 Daisy Ct.,
 Verona, Wisconsin 53593 (US). REDDY, Narendra
 [US/US]; 6103 Pine Cone Way, Fitchburg, Wisconsin
 53719 (US).

(74) Agent: LICHAUCO, Faustino; 10 Fawcett Street, Cam-

bridge, Massachusetts 02138 (US).

(81) Designated States (unless otherwise indicated, for every kind of national protection available): AE, AG, AL, AM, AO, AT, AU, AZ, BA, BB, BG, BH, BR, BW, BY, BZ, CA, CH, CL, CN, CO, CR, CU, CZ, DE, DK, DM, DO, DZ, EC, EE, EG, ES, FI, GB, GD, GE, GH, GM, GT, HN, HR, HU, ID, IL, IN, IS, JP, KE, KG, KM, KN, KP, KR, KZ, LA, LC, LK, LR, LS, LT, LU, LY, MA, MD, ME, MG, MK, MN, MW, MX, MY, MZ, NA, NG, NI, NO, NZ, OM, PE, PG, PH, PL, PT, QA, RO, RS, RU, RW, SC, SD, SE, SG, SK, SL, SM, ST, SV, SY, TH, TJ, TM, TN, TR, TT, TZ, UA, UG, US, UZ, VC, VN, ZA, ZM, ZW.

(84) Designated States (unless otherwise indicated, for every kind of regional protection available): ARIPO (BW, GH, GM, KE, LR, LS, MW, MZ, NA, RW, SD, SL, SZ, TZ, UG, ZM, ZW), Eurasian (AM, AZ, BY, KG, KZ, MD, RU, TJ, TM), European (AL, AT, BE, BG, CH, CY, CZ, DE, DK, EE, ES, FI, FR, GB, GR, HR, HU, IE, IS, IT, LT, LU, LV, MC, MK, MT, NL, NO, PL, PT, RO, RS, SE, SI, SK, SM, TR), OAPI (BF, BJ, CF, CG, CI, CM, GA, GN, GQ, GW, ML, MR, NE, SN, TD, TG).

Declarations under Rule 4.17:

- as to applicant's entitlement to apply for and be granted a patent (Rule 4.17(ii))
- as to the applicant's entitlement to claim the priority of the earlier application (Rule 4.17(iii))

[Continued on next page]

(54) Title: CENTRALIZED POWER CONDITIONING

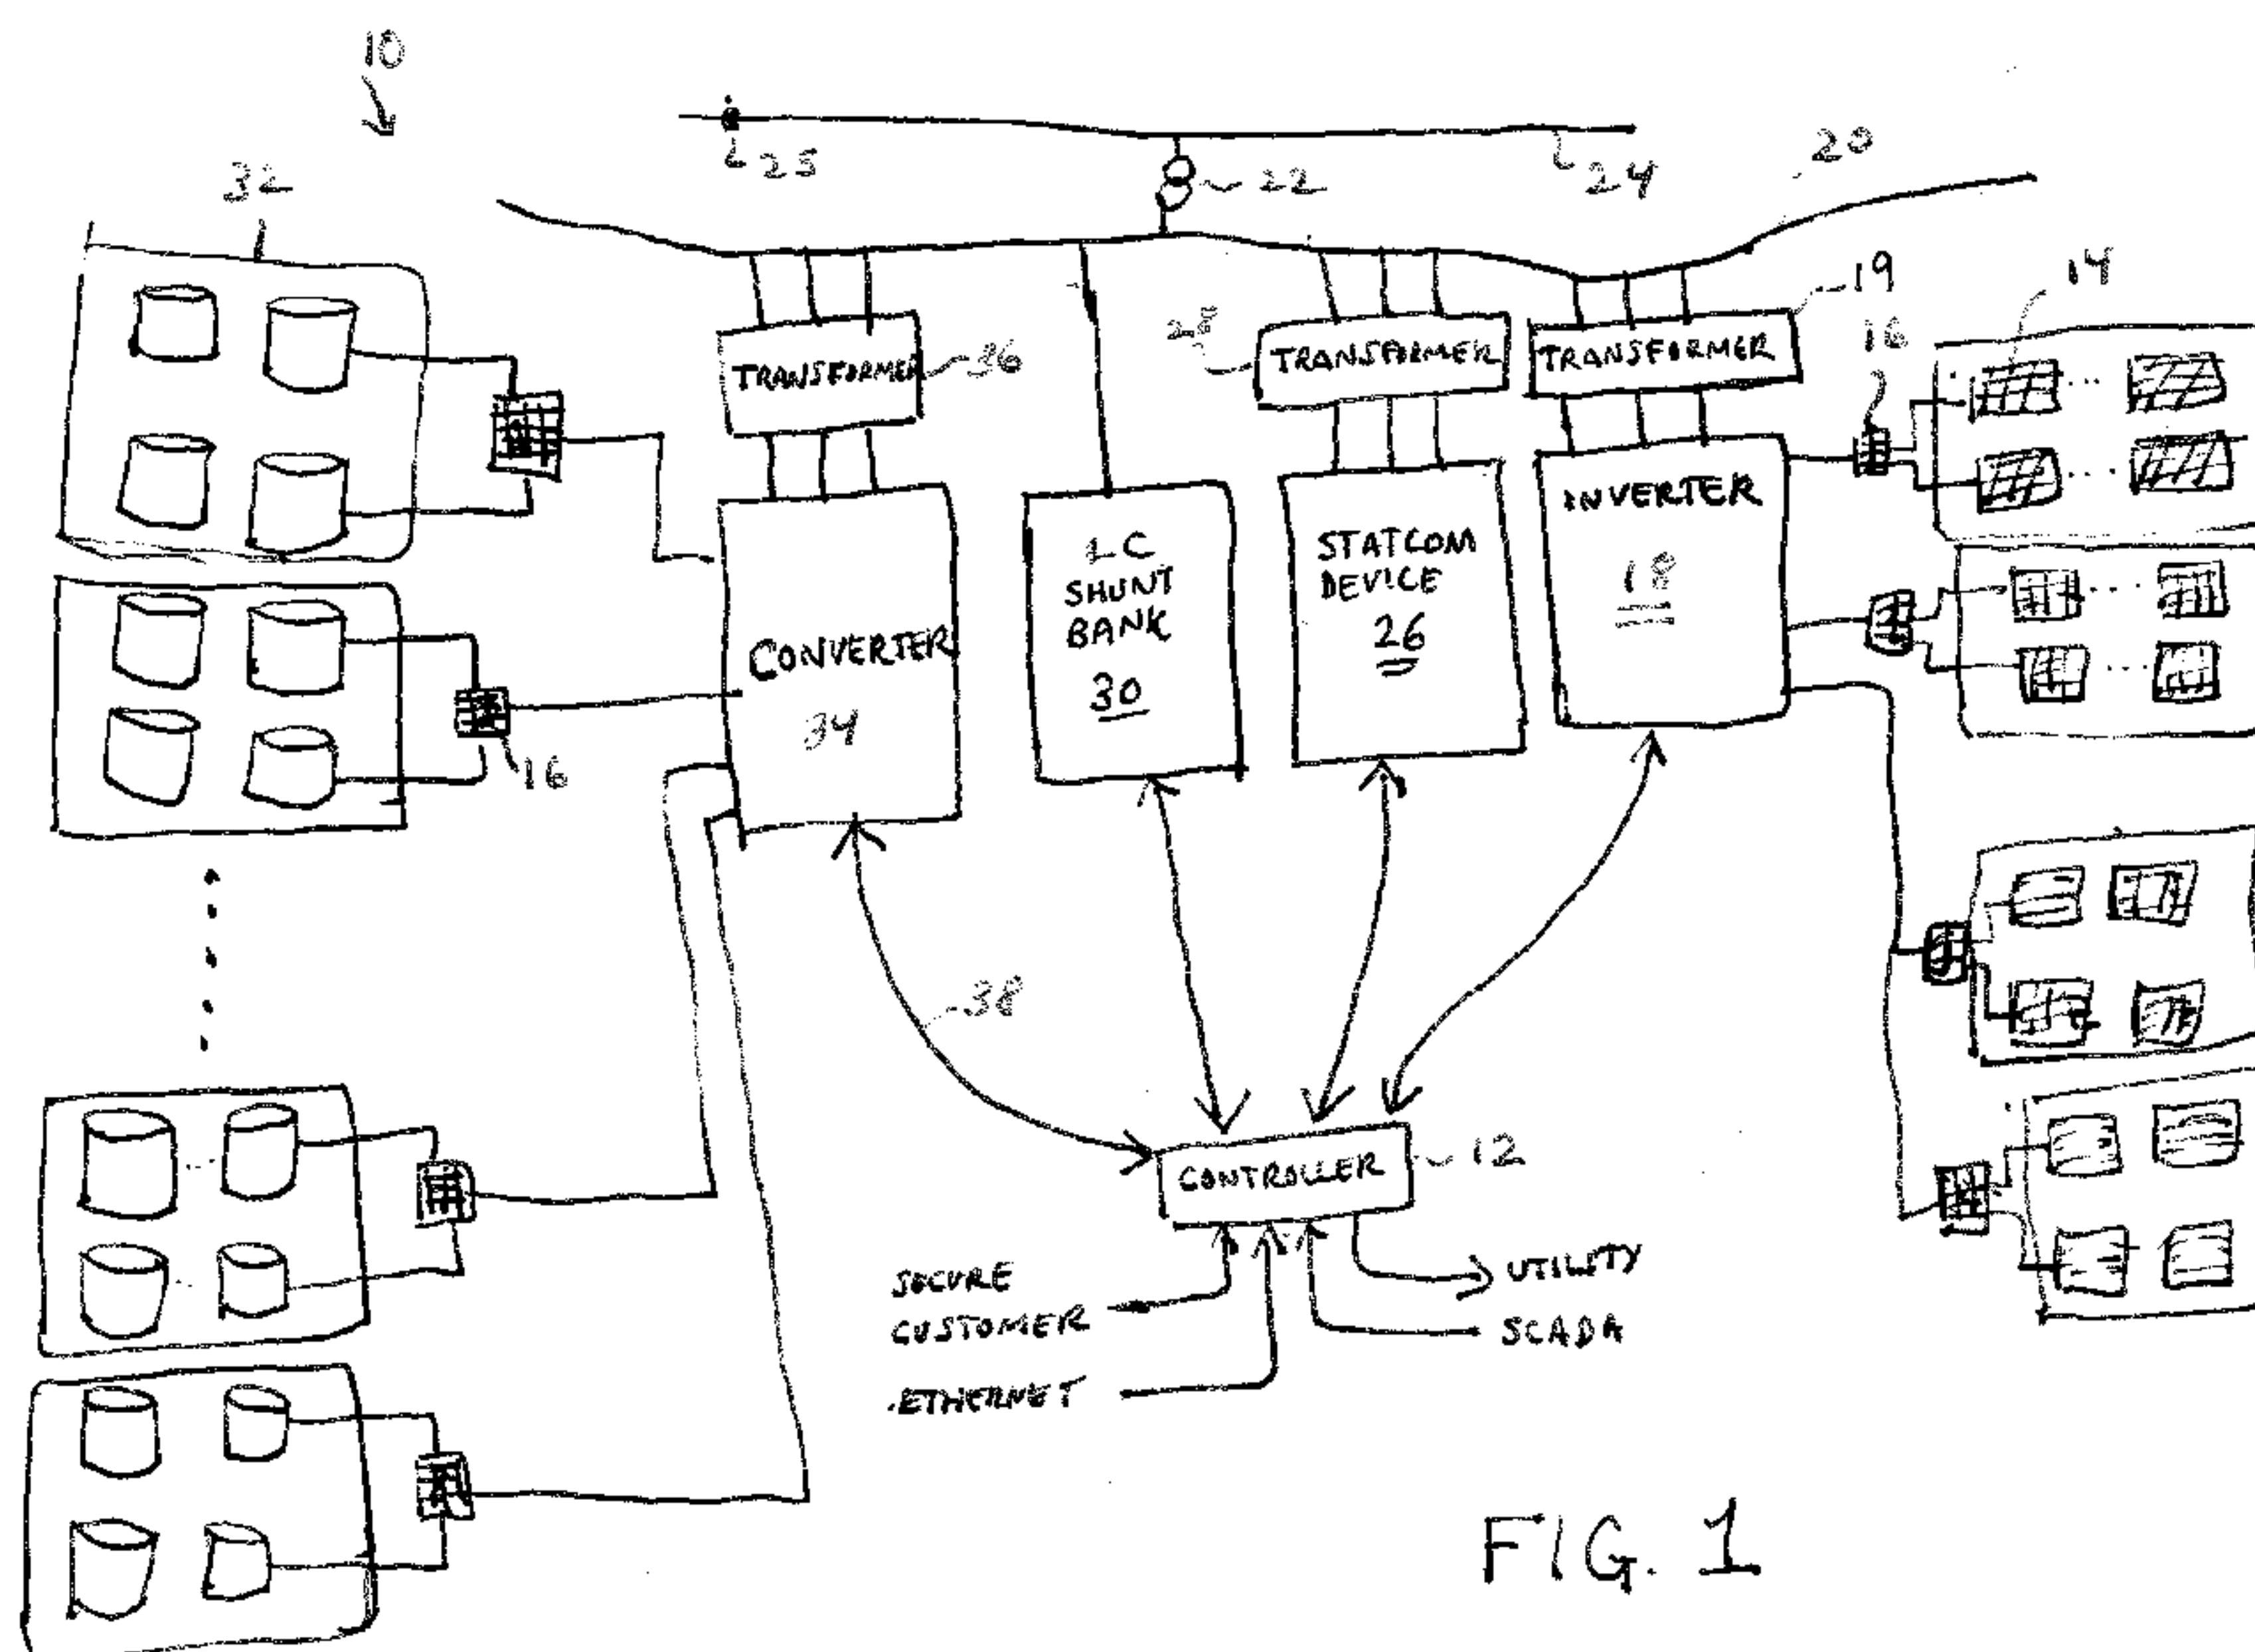


FIG. 1

(57) Abstract: A power plant for providing electric power to a power grid includes energy sources; power conditioning units and a controller configured to cause power provided to the grid to have selected electrical characteristics. The controller is in high speed real-time communication with the power conditioning units and programmed to provide instructions to the power conditioning units.

WO 2012/051042 A3



Published:

(88) Date of publication of the international search report:

14 February 2013

- *with international search report (Art. 21(3))*
- *before the expiration of the time limit for amending the claims and to be republished in the event of receipt of amendments (Rule 48.2(h))*

CENTRALIZED POWER CONDITIONING

CROSS-REFERENCE TO RELATED APPLICATIONS

This application claims the priority of U.S. Provisional Application No. 61/392,139, filed on October 12, 2010, the contents of which are hereby incorporated by reference.

FIELD OF INVENTION

This disclosure relates to electric power distribution, and in particular, to power conditioning.

BACKGROUND

An electric utility typically purchases power from numerous power plants. These power plants are all connected to a power grid maintained and operated by the electric utility. The power plant makes electricity and delivers it to the grid.

Between a power plant and an electric utility lies a “point of interconnection.” This is the point at which electrical power actually changes hands, from being under control of the power plant to being in control of the grid. Thus, by the time power reaches this point of interconnection, it is expected to be ready for distribution. This means the utility expects the delivered power to have certain electrical characteristics that render it suitable for distribution.

In addition, the electric utility expects the power plant to assist in supporting the grid in times of stress. For example, there may be electrical disturbances that require a rapid injection of reactive power or additional voltage to stabilize the voltage on the grid. The electric utility expects the power plant to be ready, willing, and able to provide reactive power or voltage support during such a disturbance. A power plant capable of functioning in this way is said to be “grid friendly.”

Because of their years of experience with rotating machines, such as those used in conventional thermal power plants and hydroelectric power plants, electric power utilities have come to expect power plants to behave as if their power were generated using a conventional rotating machine. This expectation imposes a burden on purveyors of electricity produced by unconventional devices, such as fuel cells, photovoltaic cells, and

wind turbines. Power produced by such devices does not always behave as if it were
2 produced by a rotating machine. For example, photovoltaic cells naturally produce DC,
whereas rotating machines naturally produce AC.

4 Requirements for grid connection have grown even more stringent over the years.
In North America, the current trend is toward more rigid standards for wind and solar
6 power supplies. An example of the evolving standards is the “Interconnection Standards
Review Initiative, Draft Straw Proposal” as set forth by CAISO (California Independent
8 System Operator) in the spring of 2010.

As a result of such standards, there is a growing need to provide ways for
10 unconventional power sources to more closely match the electrical characteristics of
rotating machines in order to participate in power distribution on a utility grid.

12 SUMMARY

In one aspect, the invention features a power plant for providing electric power to
14 a power grid. Such a power plant includes energy sources; power conditioning units; and
a controller configured to cause power provided to the grid to have selected electrical
16 characteristics. The controller is in high speed real-time communication with the power
conditioning units and programmed to provide instructions to the power conditioning
18 units for execution within one cycle of line voltage.

Embodiments of the invention include those in which the energy sources include
20 energy storage elements, those in which the energy sources include photovoltaic arrays,
those in which the energy sources include wind turbines, and those in which the energy
22 sources include fuel cells.

In other embodiments, the power inventers can include an inverter, a converter, an
24 ancillary STATCOM device, a shunt bank, or any combination thereof.

In yet other embodiments, the power conditioning unit is connected to receive
26 energy from an energy source.

Additional embodiments of the power plant include those in which the controller
2 is configured to maintain an electrical condition at a point of interconnection with the
grid, and wherein the controller is configured to instruct power conditioning units so as to
4 cause the power conditioning units to cooperate in maintaining the electrical condition.

Also among the embodiments are those in which the controller is configured to
6 instruct a power conditioning unit connected to an energy source to operate in a manner
that worsens power factor as measured at the output of the power conditioning unit.

8 In yet other embodiments, the controller is configured to determine an optimal
response to a transient voltage event.

10 Additional embodiments include those in which the controller is configured to
cause the power conditioning units to provide unbalanced reactive power, and those in
12 which the controller is configured to cause the power conditioning units to provide
balanced reactive power.

14 In some embodiments, the power conditioning unit includes an inverter
configured to receive electrical power generated by a wind turbine and to generate, from
16 the electrical power, a voltage waveform having specified electrical characteristics.

In another aspect, the invention features a controller for controlling power
18 conditioning units in a power plant, the controller being configured to cause power
provided to the grid to have selected electrical characteristics, the controller being in high
20 speed real-time communication with the power conditioning units and being programmed
to provide instructions to the power conditioning units for execution within one cycle of
22 line voltage.

Another aspect of the invention features a computer-readable medium having
24 encoded thereon software for controlling power conditioning units in a power plant, the
software including instructions for determining a response to a voltage event providing
26 instructions to power conditioning units in response to the voltage event within one cycle
of line voltage.

In some embodiments, the instructions further include instructions for causing the
2 at least one of the power conditioning units to supply unbalanced reactive power.

In other embodiments, the instructions further include instructions for responding
4 to a voltage event at a point-of-interconnection with a power grid.

These and other features of the invention will be apparent from the following
6 detailed description and the accompanying figures, in which:

BRIEF DESCRIPTION OF THE FIGURES

8 FIGS. 1-3 show embodiments of a power plant; and

FIG. 4 shows a wind-turbine having a converter.

DETAILED DESCRIPTION

The power plant described herein is described as using photovoltaic cells.
12 However, the control system described herein for controlling the power plant does not
rely on any particular form of power generation. Accordingly, the power plant could
14 include wind turbines, fuel cells, hydroelectric generators, or conventional rotating
machines driven by fossil fuel or nuclear energy.

A power plant **10** controlled by a central controller **12**, shown in FIG. 1, includes
16 arrays **14** of photovoltaic modules. The outputs of each array **14** are fed into a combiner
18 **16**, which then feeds into an inverter **18**. Alternatives to a combiner **16** include a DC-to-
DC module for localized Maximum Power Point Tracking (MPPT) and/or boosting
20 voltage in response to, for example, passage of a cloud over the corresponding portion of
the solar array **14**, thus keeping the DC voltage level delivered to the inverter **18** constant.

The inverter **18** accepts a DC input and provides an AC output. In the resulting
22 AC output, the inverter **18** can also control the phase angle between the output voltage
24 and current waveforms. Accordingly, by controlling this angle, the inverter **18** outputs
either purely real power, purely reactive power, or anything in between. A suitable
26 inverter **18** is the SolarTie™ inverter **18** rated at 1.4 MW and manufactured by American
Superconductor Corporation, of Devens, Massachusetts.

The output of the inverter **18** is then provided to a first transformer **19** for
coupling onto a medium-voltage transmission line **20**. In some embodiments, the
medium-voltage transmission line **20** carries 34.5 kilovolts. A second transformer **22**
couples the medium-voltage transmission line **20** to a high-voltage transmission line **24** at
138 kilovolts. The point-of-interconnection **25** with the power grid lies on this high-
voltage transmission line **24**.

Although FIG. 1 shows solar arrays connected to the inverter **18**, the inverter **18**
can accept power from other energy sources. Accordingly, the solar plant can be replaced
with a wind plant, arrays of fuel cells, energy storage elements, such as batteries, or any
combination thereof.

The power plant **10** also includes an ancillary reactive current source, such as a
STATCOM (“static synchronous compensator” device **26**, that provides only reactive
power. An ancillary STATCOM **26** imposes dynamically changing reactive current on the
circuit to which it connects. The STATCOM device **26** changes this reactive current
quickly in response to changes in the circuit. The output of the ancillary STATCOM
device **26** is then provided to a third transformer **28** for distribution onto the medium-
voltage transmission line **20**. A suitable ancillary STATCOM device is the D-VAR®,
manufactured by American Superconductor Corporation, of Devens, Massachusetts.

In some power plants, additional reactive power can be provided by a bank of
capacitors and/or inductors, herein referred to as a “shunt banks” **30** that can be
selectively switched into the transmission line **20** to either absorb or inject reactive
power. The shunt bank **30** can thus be viewed as functioning like an ancillary reactive
device **26**, though with slower response.

In some power plants, arrays of energy storage elements **32**, such as batteries,
connect to a converter **34**, the output of which connects to a fourth transformer **36** for
coupling onto the medium-voltage transmission line **20**. The converter **34** converts DC
power from the energy storage elements **32** into AC power for distribution on the grid.
Conversely, the converter **34** absorbs AC power from the grid and stores it in the energy
storage elements **32**.

Although FIG. 1 shows one inverter **18** with an associated set of photovoltaic arrays **14**, a power plant **10** can have many inverters **18** and many photovoltaic arrays **14** spread over a large area. Similarly, a power plant **10** can also have many converters **34** and energy storage elements **32**, shunt banks **30** and ancillary STATCOM devices **26** distributed over a large area.

In a power plant **10**, the various inverters **18**, ancillary STATCOM devices **26**, shunt banks **30**, converters **34**, and DC-to-DC modules **16**, hereafter referred to collectively as “power conditioning units,” cooperate to condition power at the point-of-interconnection **25**. A pair of optical fibers **38** connects each power conditioning unit to the central controller **12**. This enables full duplex communication between the controller **12** and each power conditioning unit, and avoids delays caused by two or more power conditioning units having to share the same physical transmission medium.

Typically, the central controller **12** is installed in a substation control building. From there, it monitors substation and transmission voltages and currents. Based on the instantaneous state of the grid, which it derives from measurements of voltages and currents, the controller **12** issues instructions to the power conditioning units. It does so by communicating on the fibers **38** using a high speed real-time protocol.

Rapid communication between the central controller **12** and the power conditioning units can be achieved using known high-speed communication networks, such as EtherCAT™, PROFINET™, and RTnet™. Other communication protocols can be used provided they permit a controller **12** to broadcast updates to numerous nodes, often in excess of 100 nodes, at rates that are sub-line cycle.

The power conditioning unit includes a local controller that can receive and process the communication data, and that, in some cases, can determine what needs to be done to achieve any requested output. If necessary, the local controller can override a request in order to protect the power conditioning unit from unacceptably high or low voltage, or other damaging conditions. Status information can be communicated back from the local controllers at the power conditioning units to the central controller **12** to be used in further refining outputs requested by the central controller **12**.

The local controller can control injection of reactive power by controlling any one or more of the following: several switch-stages of which are often present in an induction-based wind turbine generators; a line-side converter typically found in double-fed induction generators, any excess capacity of which can be used to generate reactive power; a small additional inverter-based ancillary reactor associated with, for example, an inverter in a wind-turbine or a solar inverter; or by controlling a full converter, such as that typically found in a permanent magnet generator. In the case of inverter generated reactive currents, the output can be directed to be either balanced or unbalanced so as to address transient and/or steady-state unbalanced voltage conditions.

As used herein, a high speed network is one that permits essentially real-time control with instructions being executed within the span of less than one cycle of a 60 Hz voltage waveform. The use of such high-speed networks permits power conditioning units throughout the power plant to cooperate in achieving both global steady state voltage regulation and rapid dynamic transient response at the point-of-interconnection. Power conditioning units such as inverters, which formerly could only be used to provide local power factor control, can participate in achieving system wide power factor or voltage control for both steady-state operation and for responding to transients or post fault support of grid voltage.

The central controller **12** also communicates with points outside the power plant **10** through a communication port. For example, the controller **12** can provide diagnostic and operational data to a remotely located maintenance office, and can also receive instructions for that office. In addition, the controller **12** can exchange data with the electric utility.

The central controller **12** provides instructions to each power conditioning unit for controlling its operation. It does so in part on the basis of data received from the various power-conditioning units themselves, through a SCADA (Supervisory Control and Data Acquisition) interface, and also in part on the basis of data representing the conditions at the point-of-interconnection **25**. The controller **12** also collects any local diagnostic data and system control data, as well as historical data.

The central controller **12** can thus adaptively orchestrate the manner in which the various power conditioning units cooperate with each other in an effort to cause the power plant **10** to meet the utility's expectations. For example, the central controller **12** chooses, from among the many possible sources of reactive power within the plant, the particular source or sources of reactive power that are to be used to correct a condition at the point-of-interconnection **25**. This choice changes dynamically as circumstances change.

For example, if an inverter **18** becomes unavailable because it is busy supplying real power, the controller **12** can determine what other power conditioning units are available. It can then instruct a suitable power conditioning unit, such as a static shunt or static VAR, to supply the reactive power. In some cases, multiple sources of reactive power are needed, in which case the controller **12** seamlessly coordinates the operation of the various power conditioning units in a way that meets the utility's expectations.

As an example, the inverters **18** may suddenly be called upon to use all their capacity to produce real power. In such a case, the controller **12** can adaptively instruct another power conditioning unit, such as a static shunt or static VAR, to contribute its efforts toward maintaining a suitable power factor. Or in other cases, the inverters **18** may have capacity to spare, in which case the controller **12** can call upon them to supply either balanced or unbalanced reactive power, thus saving the STATCOM devices **26**, shunt banks **30**, and converters **34** for different purposes or for emergencies. All settings for these and other operations are available through the SCADA interface.

In addition to its role in controlling reactive power, the controller **12** also plays a role in voltage regulation. Precise voltage regulation at the point-of-interconnection **25** is not easy. Such voltage regulation requires careful orchestration of multiple reactive power sources on the power plant **10**. If improperly carried out, this can cause negative interactions between power-conditioning units. As a result, the power plant **10** may fail to meet interconnection requirements. In extreme cases, an improper attempt at voltage regulation can damage the solar power plant components or the utility equipment.

The problem becomes more difficult in the case of photovoltaic arrays **14**, in large part because of transient power loss caused by passing clouds. Since a photovoltaic array **14** does not store any energy, as is the case in a spinning rotor, changes in solar output power can be abrupt and severe. These abrupt voltage changes can disturb the voltage at the point-of-interconnection **25**.

A central controller **12** as described herein carries out transient voltage control. To do so, the controller **12** monitors the voltage at the point-of-interconnection **25** and calculates the effect of additional reactive power on the voltage at the point-of-interconnection **25**. In the event of balanced and unbalanced voltage sags or swells, the central controller **12** can determine the correct amount of balanced and/or unbalanced reactive response and instruct an inverter **18** associated with in inverter-based component to respond accordingly in a way that best addresses the event as seen at the point-of-interconnection **25**. If that voltage changes, for example, as a result of a passing cloud, the controller **12** determines the amount of reactive power needed to regulate the voltage. It also determines whether real power is required and if there are any underutilized photovoltaic arrays **14** or any energy storage elements **32** that can provide such power. Having done so, the controller **12** communicates with a subset of conditioning units on the power plant **10** and causes one or more of those conditioning units to provide the requisite reactive power. The controller **12** also monitors frequency at the point-of-interconnection **25**, and instructs the appropriate power conditioning units to correct the frequency as needed. These steps are executed multiple times within a cycle of the desired electrical output. Once the transient voltage event is complete, the controller **12** sends a message to the power conditioning units to instruct them to resume normal operation.

Conventional solar inverters lack the ability to ride through voltage disturbances. Although many inverters include a software switch to disable automatic tripping during transient voltage events of limited swing, such conventional inverters lack the ability to not only stay on line but to also to support and stabilize system voltage by injecting or absorbing reactive power as needed. Unlike conventional inverters, the inverter **18** described herein provides both real power and reactive power. Accordingly, the solar

inverters **18** disclosed herein participates in stabilizing grid voltage, and in part as a result of the high speed network connecting them to the controller **12**, does so with control loop speeds that are sub-line cycle.

The controller **12** in communication with the power conditioning units as described herein provides the system operator with sufficient flexibility to provide reactive power to assist in stabilizing the grid and to switch back to real power production when the grid voltage has stabilized.

The system described herein also avoids many undesirable effects of switched shunt devices, such as the shunt bank **30**, that are commonly used for managing supply of reactive power. Such shunt devices function as reservoirs of reactive power that are switched into the grid at strategic times to inject or absorb reactive power on an as-needed basis. However, switching leads to transients, which in turn can give rise to flicker.

To avoid or reduce such flicker, the controller **12** implements procedures disclosed in one or more of U.S. Patent Nos. 7,091,703; RE41,170; 7,265,521; 7,091,703; 6,987,331; 6,906,434 6,900,619; 6,600,973; 6,577,108; and 6,414,853 the contents of all of which are herein incorporated by reference. Using the procedure, the controller **12** recognizes when a shunt bank **30** will be switched into or out of the grid and uses ancillary reactive power units to offset the effect of the switching. This results in smoother and more flicker-free voltage.

In another embodiment, shown in FIG. 2, a plurality of combined inverter/converter units **40** is connected to a corresponding plurality of energy sources **14**. The energy sources **14** can be any combination of solar energy sources, wind turbines, fuel cells, rotating machines, and energy storage elements such as batteries. The operation of the embodiment shown in FIG. 2 is substantially along the lines discussed in connection with FIG. 1.

In yet another embodiment, shown in FIG. 3, both power sources **14** and energy storage elements **32** are connected, via a common bus **41**, to a central inverter **42** that

provides both real and reactive power. Unlike the embodiments shown in FIGS. 1 and 2, the embodiment in FIG. 3 omits an ancillary reactor and relies exclusively on the central inverter **42** to generate appropriate reactive power.

In some embodiments, as shown in FIG. 4, one can avoid providing ancillary STATCOM devices reactors **26** and/or shunt banks **30**, or reduce the number of ancillary STATCOM devices **26** and/or shunt banks **30**, by using inverters **44** that are already associated with wind turbines **46**. These wind-turbine converters **44** respond to instructions from the controller **12** to function as ancillary reactors **26** in an effort to cause a particular condition, or to contribute to causing a particular condition, at the point-of-interconnection **25**. Moreover, since these wind-turbine converters **44** can receive power from the grid, they can function as ancillary STATCOM devices **26** even when the wind turbine **46** is not operating.

Operation intended to cause or contribute to causing a particular condition at the point-of-interconnection **25** is different from simply operation intended to optimize conditions at the wind turbine itself. Since the point-of-interconnection **25** is on the high-voltage transmission line **24**, and the converter **44** is isolated from the high-voltage transmission line **24** by a transformer **18**, the wind-turbine converter **44** has no way of knowing how it could contribute to achieving a particular condition at the point-of-interconnection **25**.

It is in part for this reason that the central controller **12** becomes useful. The central controller **12** has information concerning the voltage at the point-of-interconnection **25**, as well as conditions throughout the power plant **10**. On the basis of such information, and on the basis of its knowledge about the capabilities of the various power conditioning units on the power plant **10**, the central controller **12** instructs the wind-turbine converter **44** on exactly what it should do to contribute towards achieving the goal of having specified conditions at the point-of-interconnection **25**.

Having described the invention, and a preferred embodiment thereof, what is claimed as new, and secured by letters patent is:

CLAIMS

- 2 **1.** A power plant for providing electric power to a power grid, said power
plant comprising:
- 4 energy sources;
- power conditioning units;
- 6 a controller configured to cause power provided to the grid to
have selected electrical characteristics, said controller being in
8 high speed real-time communication with said power
conditioning units and being programmed to provide
10 instructions to said power conditioning units for execution
within one cycle of line voltage.
- 12 **2.** The power plant of claim 1, wherein the energy sources comprise energy
storage elements.
- 14 **3.** The power plant of claim 1, wherein the energy sources comprise
photovoltaic arrays.
- 16 **4.** The power plant of claim 1, wherein the energy sources comprise wind
turbines.
- 18 **5.** The power plant of claim 1, wherein the energy sources comprise fuel
cells.
- 20 **6.** The power plant of claim 1, wherein the power conditioning unit
comprises an inverter.
- 22 **7.** The power plant of claim 1, wherein the power conditioning unit
comprises a converter.
- 24 **8.** The power plant of claim 1, wherein the power conditioning unit
comprises an ancillary STATCOM device.

- 2 **9.** The power plant of claim 1, wherein the power conditioning unit
 comprises a shunt bank.
- 4 **10.** The power plant of claim any one of the preceding claims, wherein the
 power conditioning unit is connected to receive energy from an energy
 source.
- 6 **11.** The power plant of any one of the preceding claims, wherein the controller
 is configured to maintain an electrical condition at a point of
8 interconnection with the grid, and wherein said controller is configured to
 instruct power conditioning units so as to cause the power conditioning
10 units to cooperate in maintaining the electrical condition.
- 12 **12.** The power plant of any one of the preceding claims, wherein the controller
 is configured to instruct a power conditioning unit connected to an energy
 source to operate in a manner that worsens power factor as measured at
14 the output of the power conditioning unit.
- 16 **13.** The power plant of claim 1, wherein the controller is configured to
 determine an optimal response to a transient voltage event.
- 18 **14.** The power plant of claim 1, where the controller is configured to cause a
 power conditioning unit to provide unbalanced reactive power.
- 20 **15.** The power plant of claim 1, where the controller is configured to cause a
 power conditioning unit to provide balanced reactive power.
- 22 **16.** The power plant of claim 1, wherein the power conditioning unit
 comprises an inverter configured to receive electrical power generated by
 a wind turbine and to generate, from said electrical power, a voltage
24 waveform having specified electrical characteristics.
- 26 **17.** A controller for controlling power conditioning units in a power plant, said
 controller being configured to cause power provided to the grid to have
 selected electrical characteristics, said controller being in high speed real-

time communication with said power conditioning units and being
2 programmed to provide instructions to said power conditioning units for
execution within one cycle of line voltage.

4 **18.** A computer-readable medium having encoded thereon software for
controlling power conditioning units in a power plant, said software
6 comprising instructions for determining a response to a voltage event, and
causing power conditioning units to respond to the voltage event within
8 one cycle of line voltage.

10 **19.** The computer readable medium of claim **18**, wherein the instructions
further comprise instructions for causing at least one of the power
conditioning units to supply unbalanced reactive power.

12 **20.** The computer readable medium of claim **18**, wherein the instructions
further comprise instructions for responding to a voltage event at a point-
14 of-interconnection with a power grid.

1/4


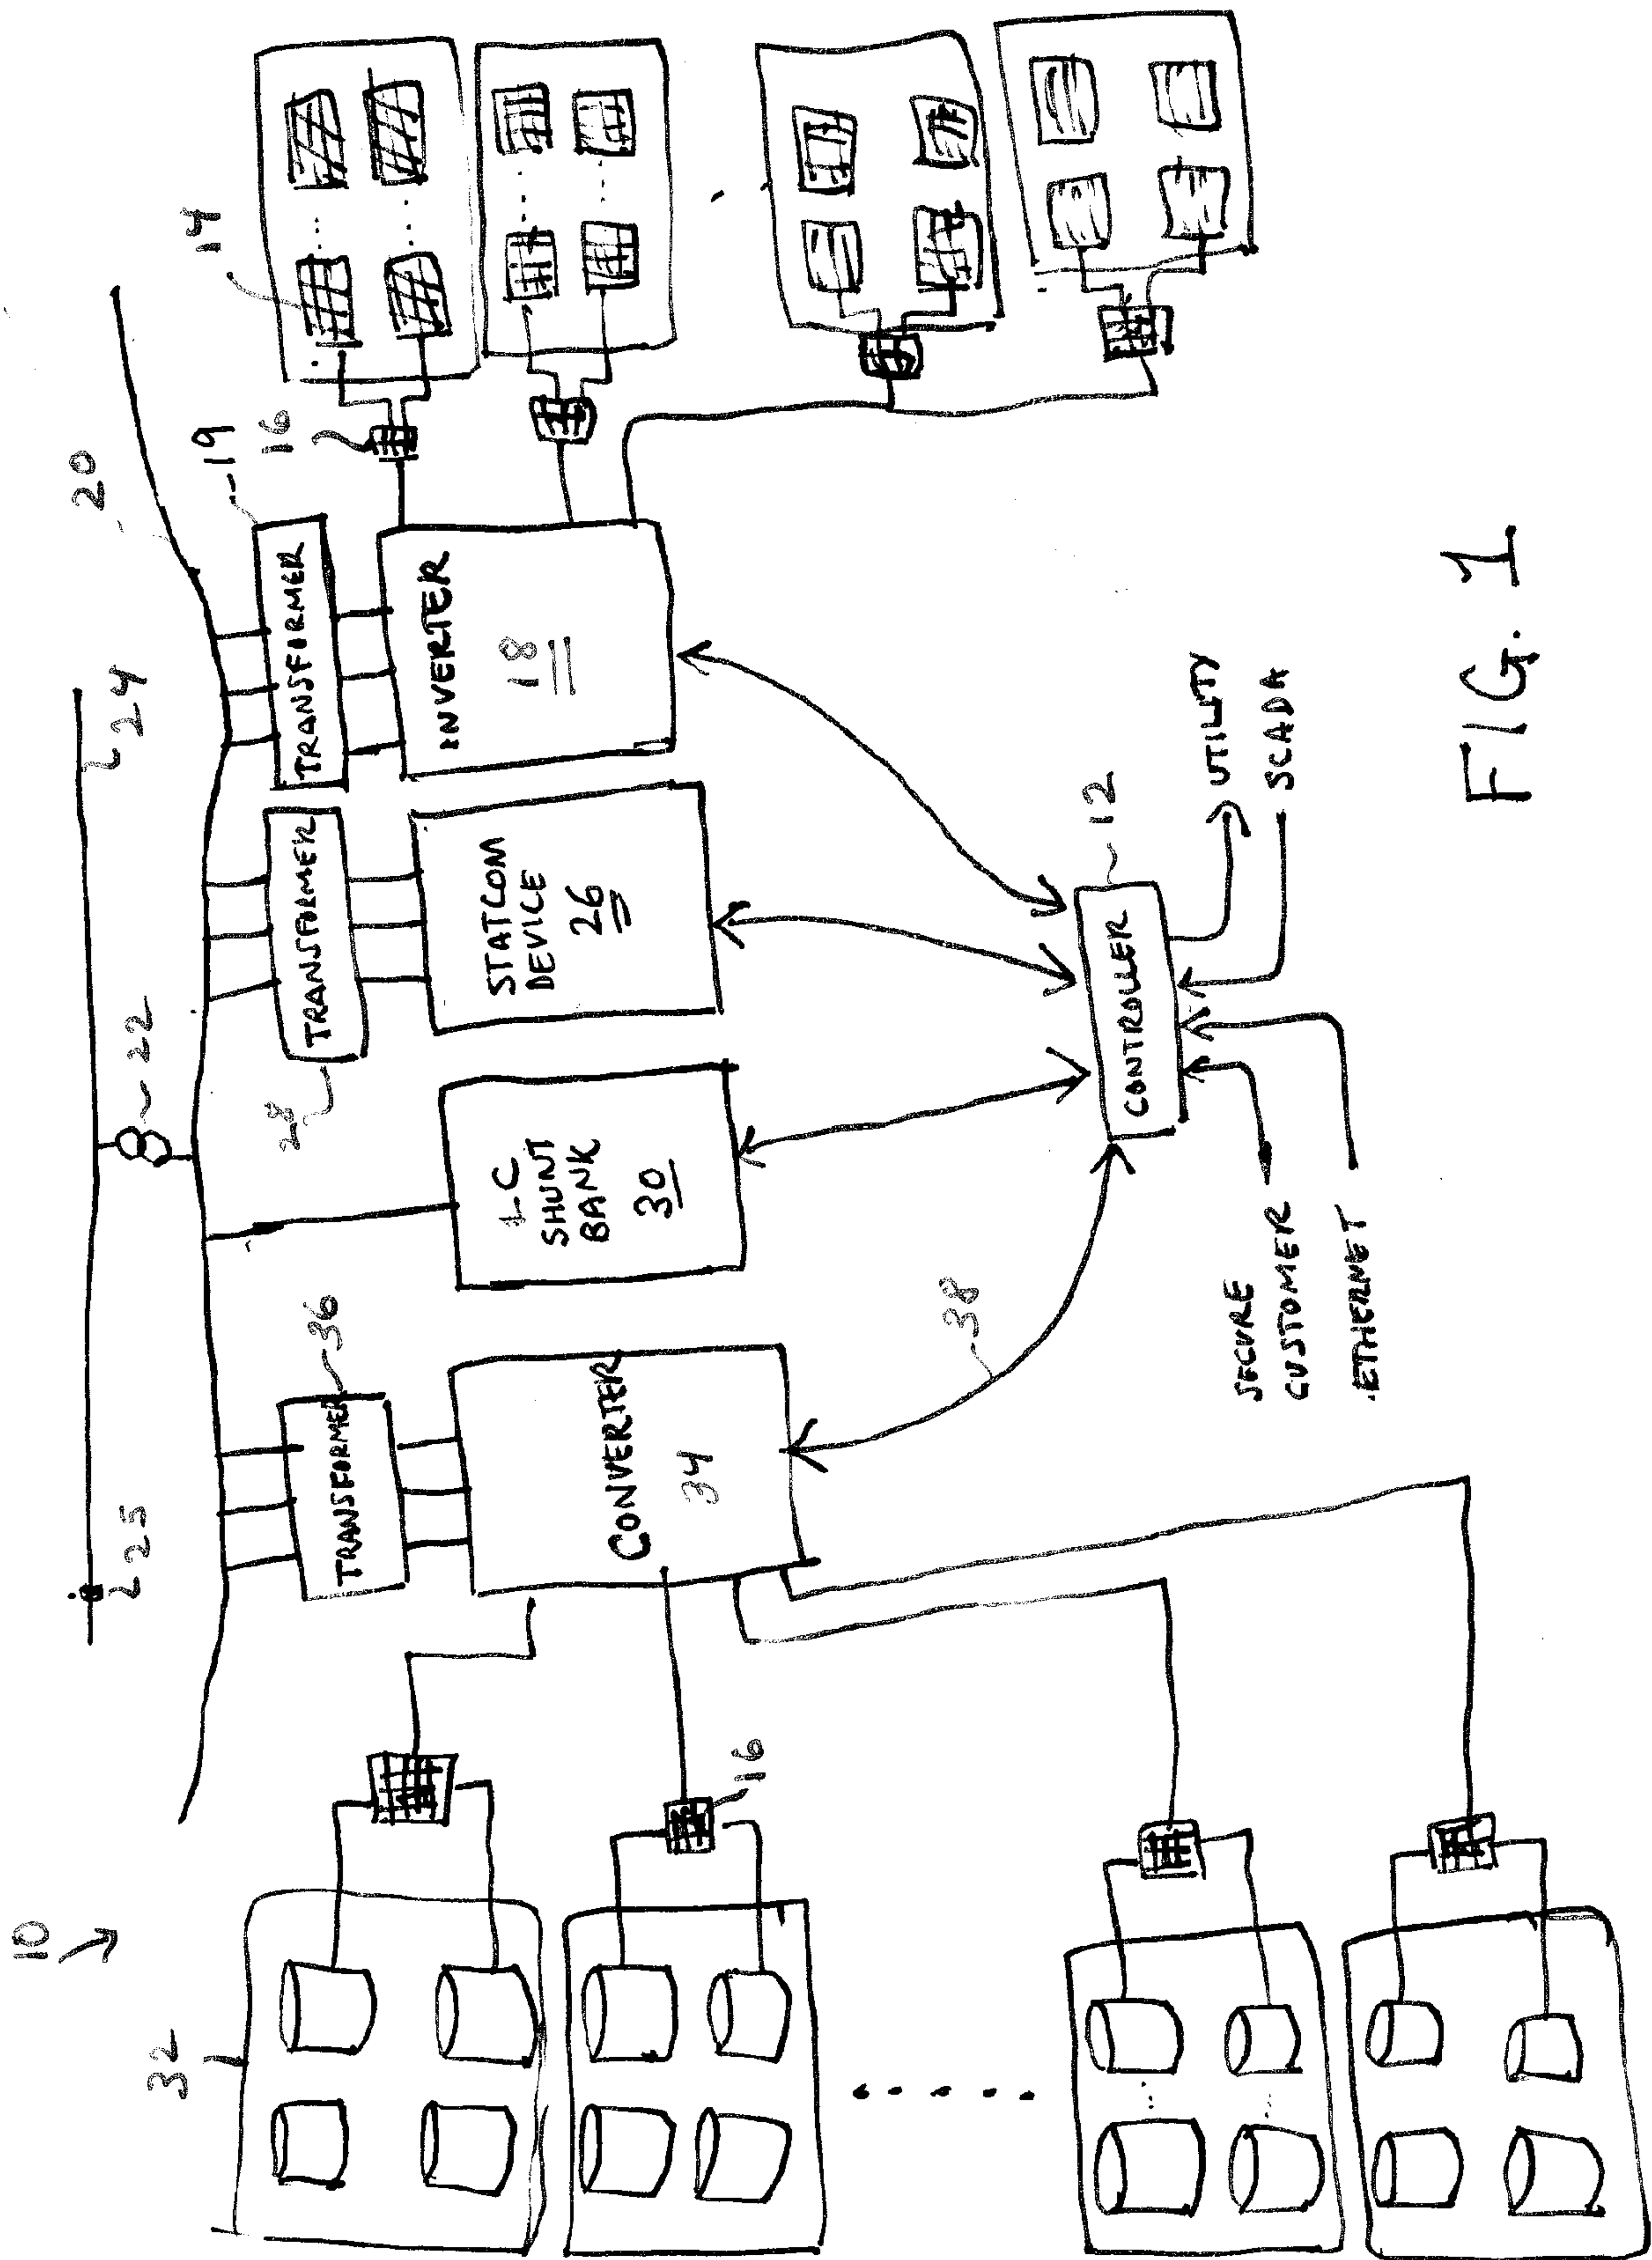


FIG. 1

2/4

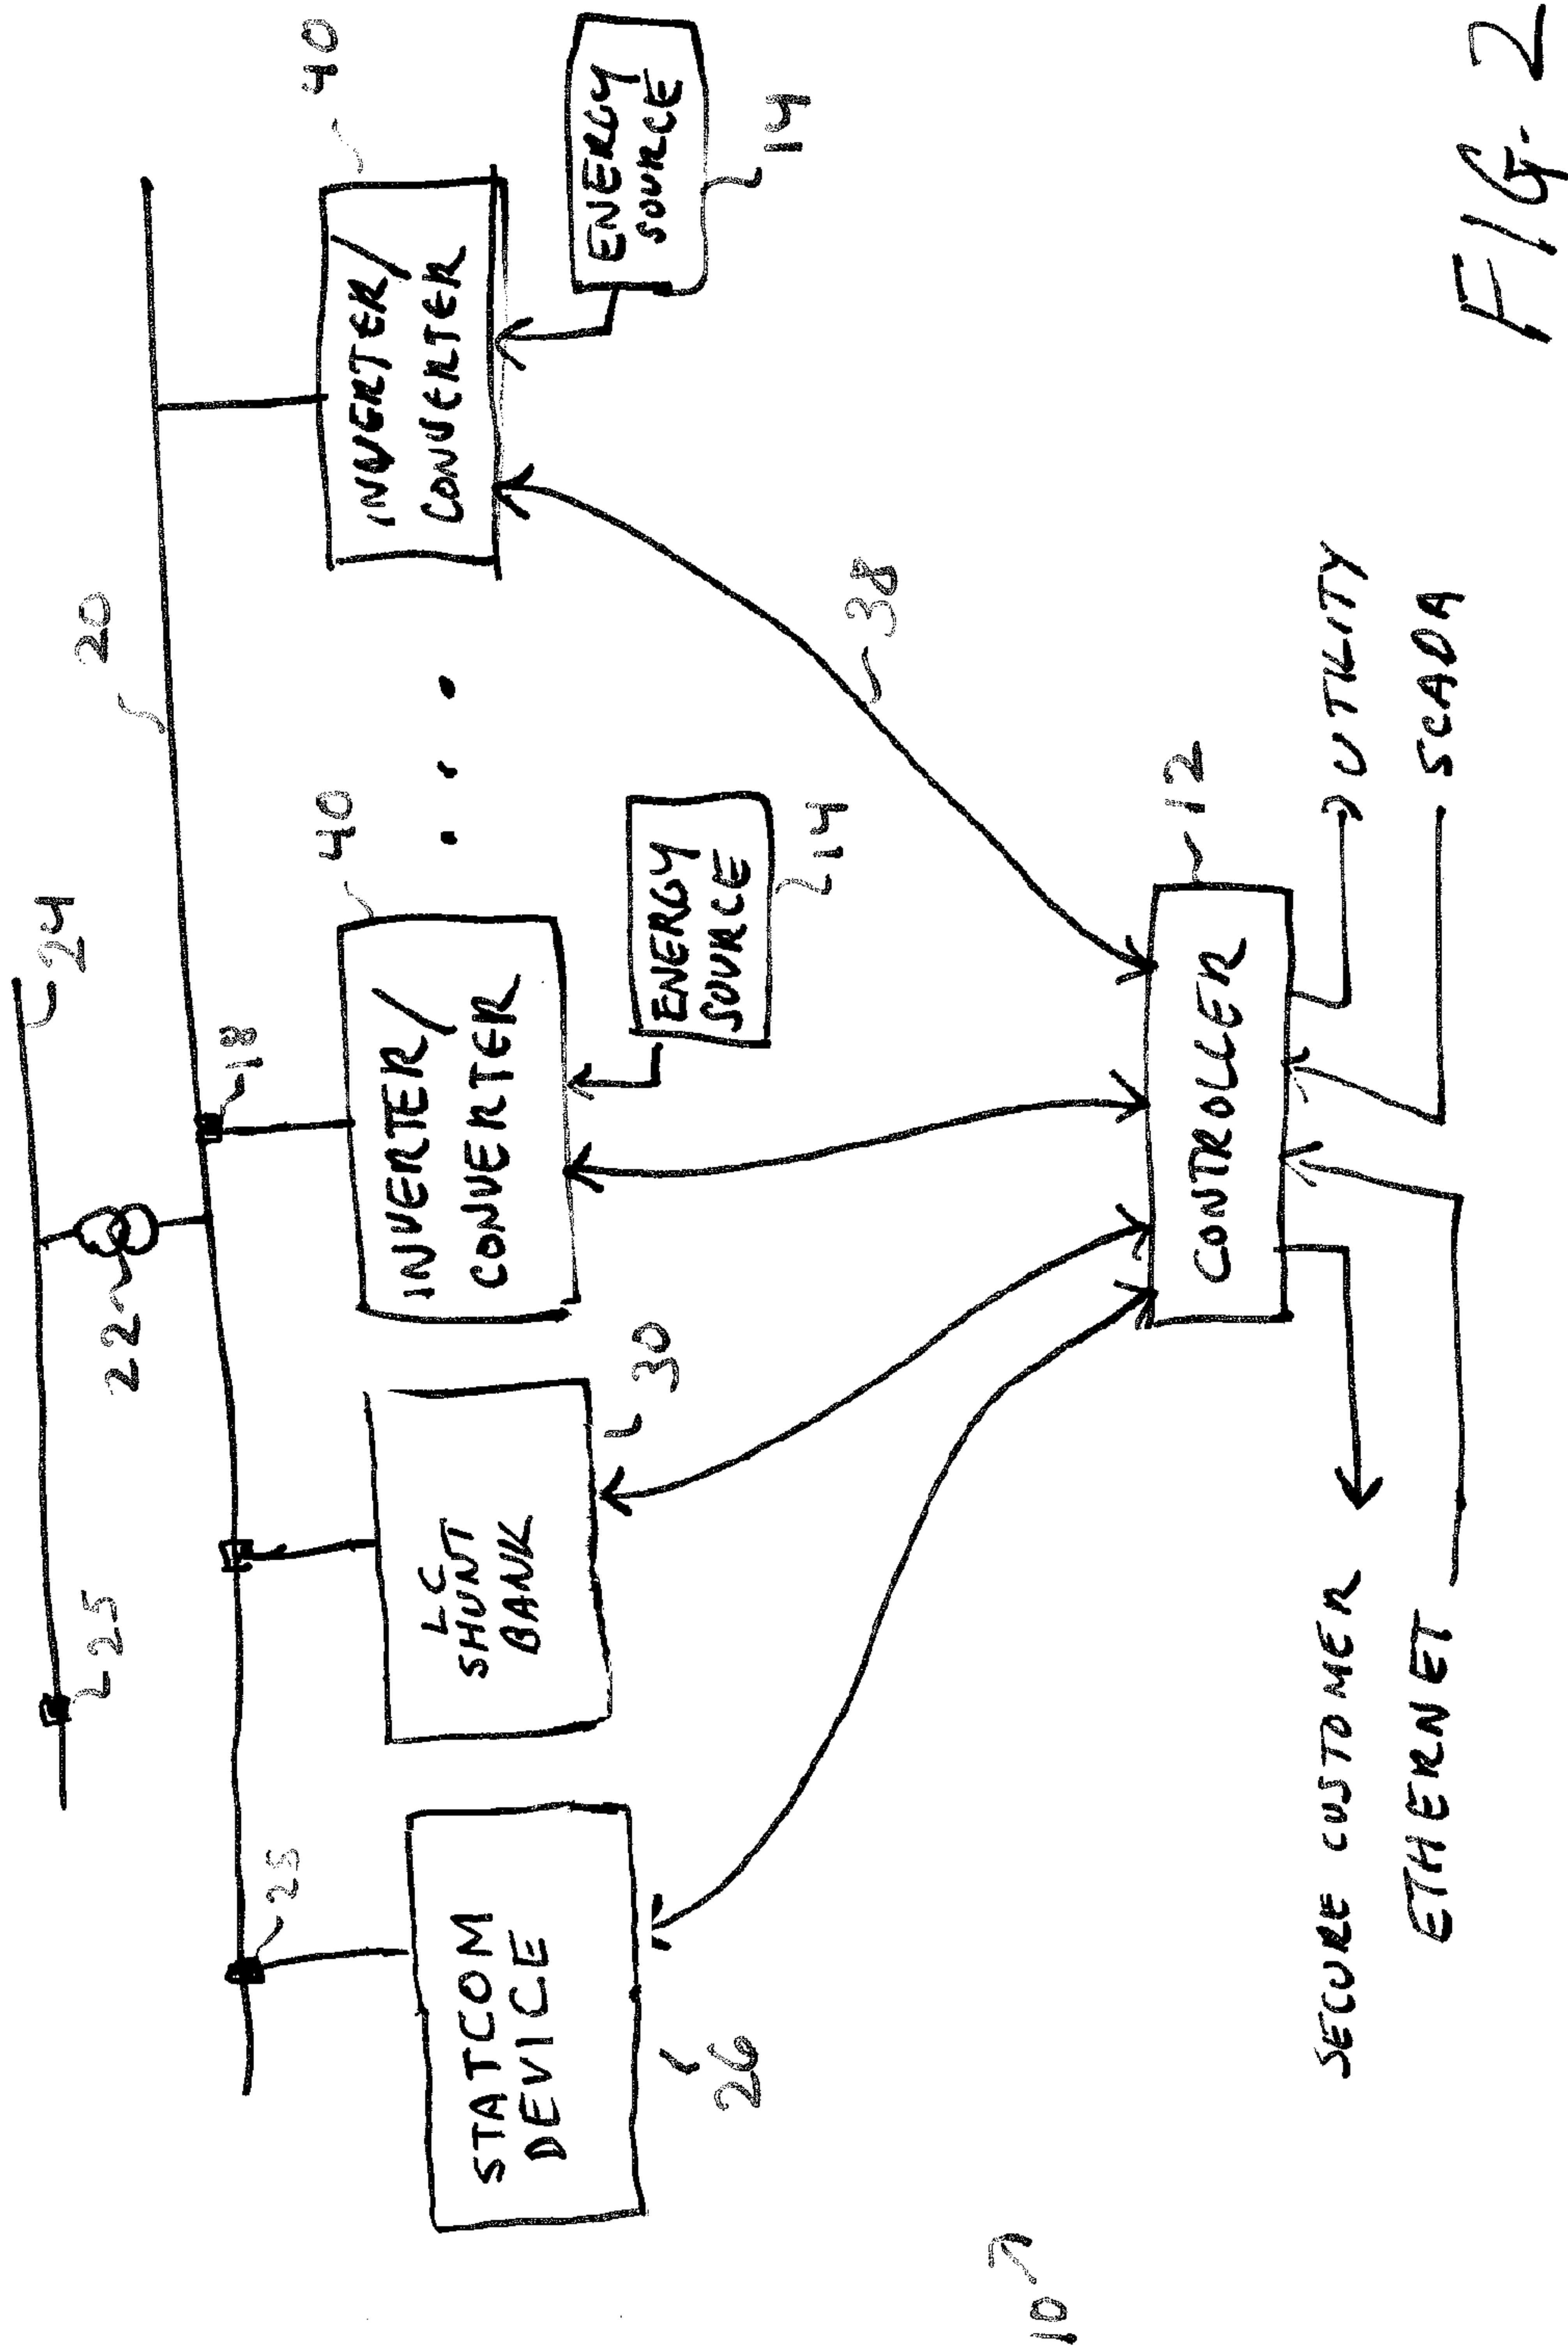

3/4

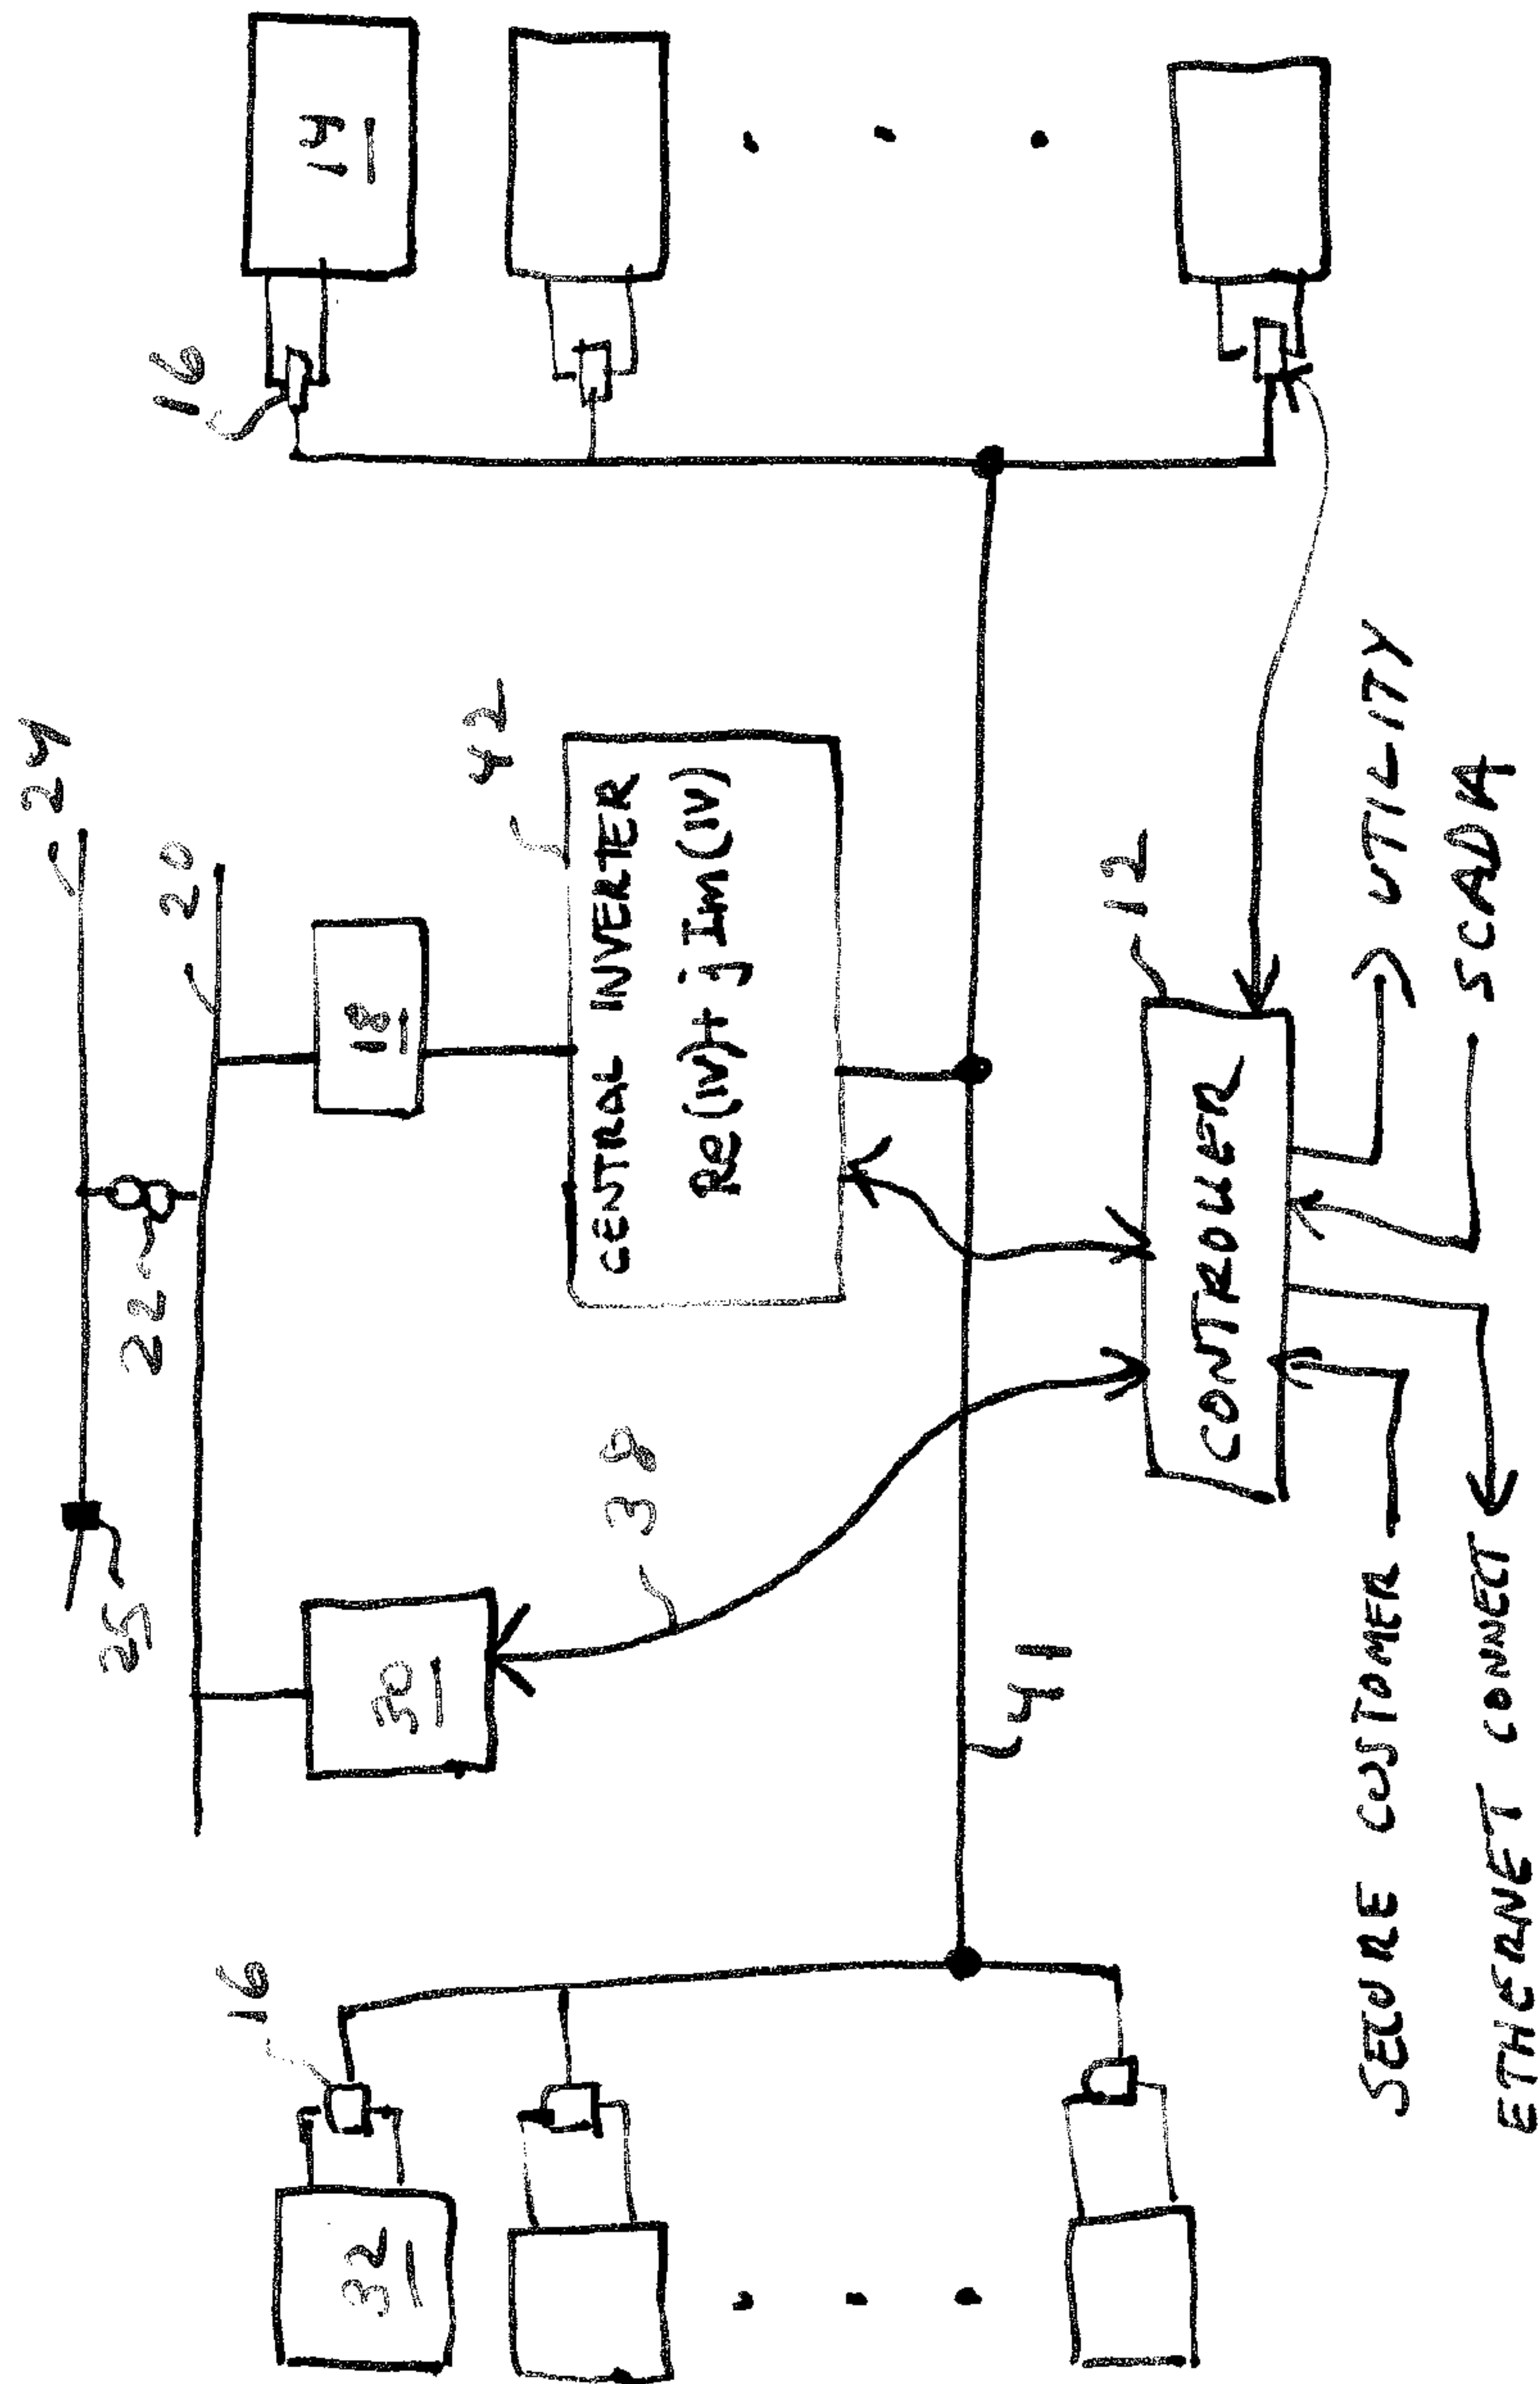


FIG. 3

4/4

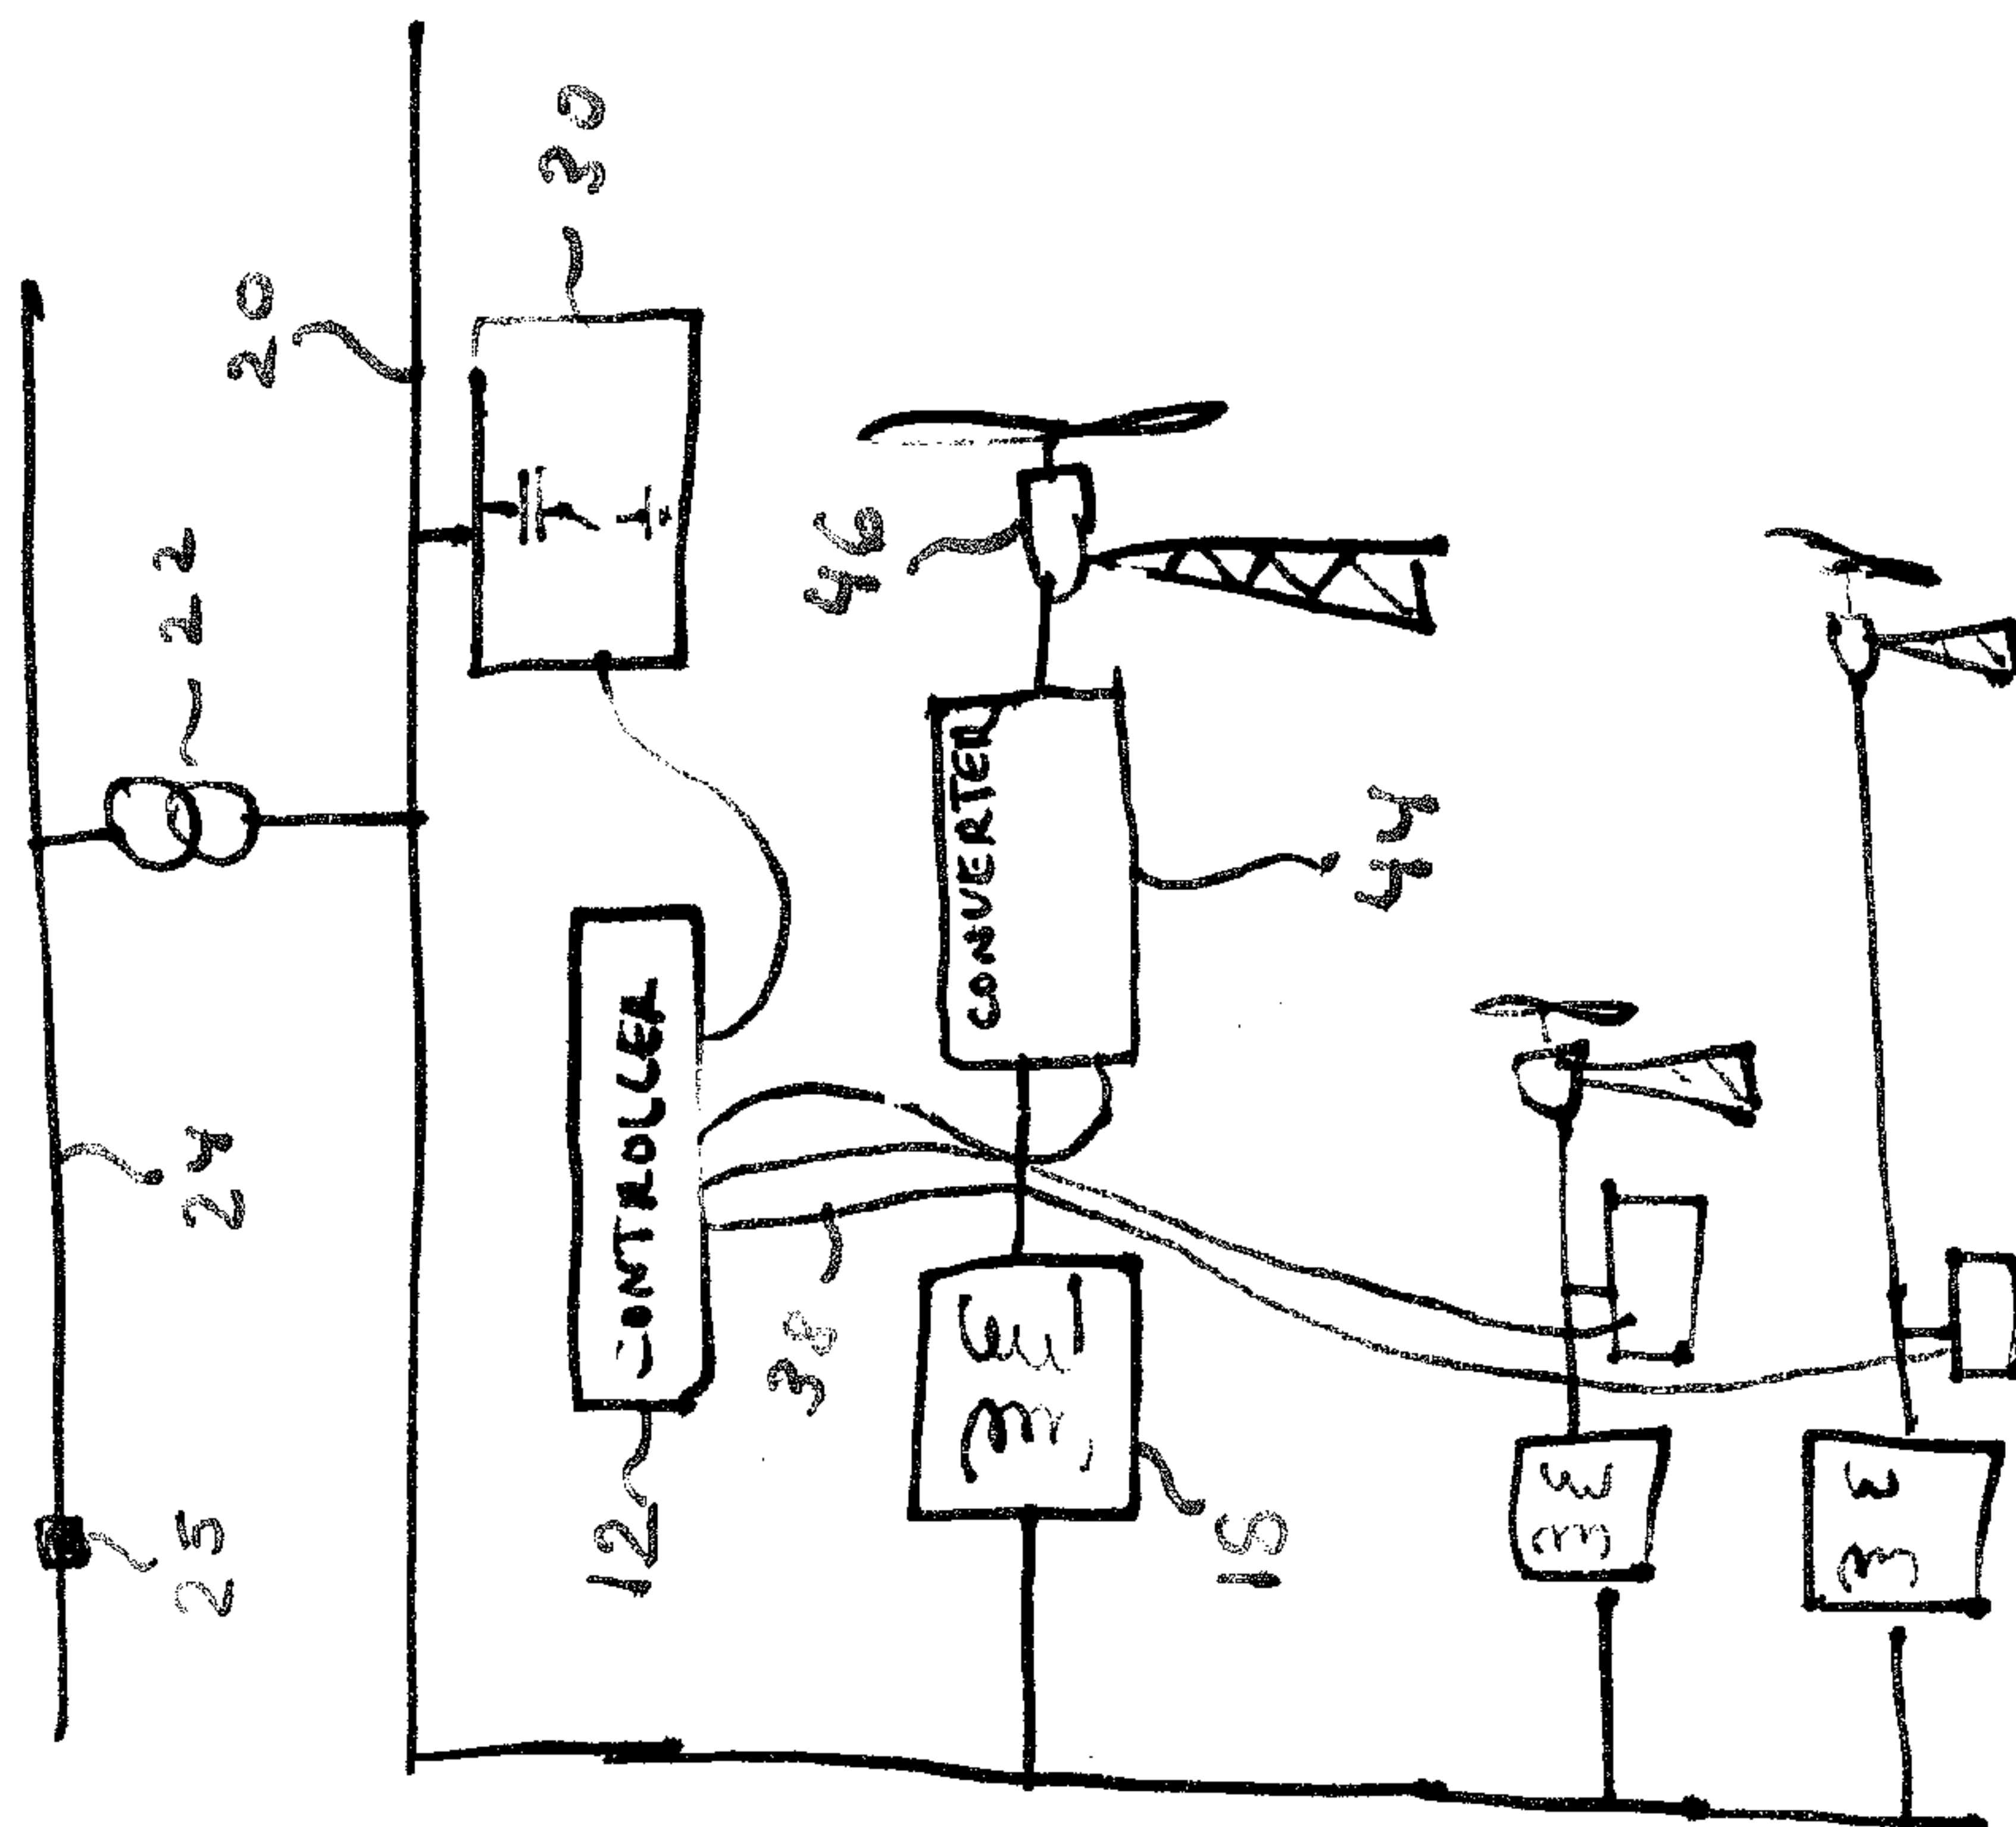


FIG. 4

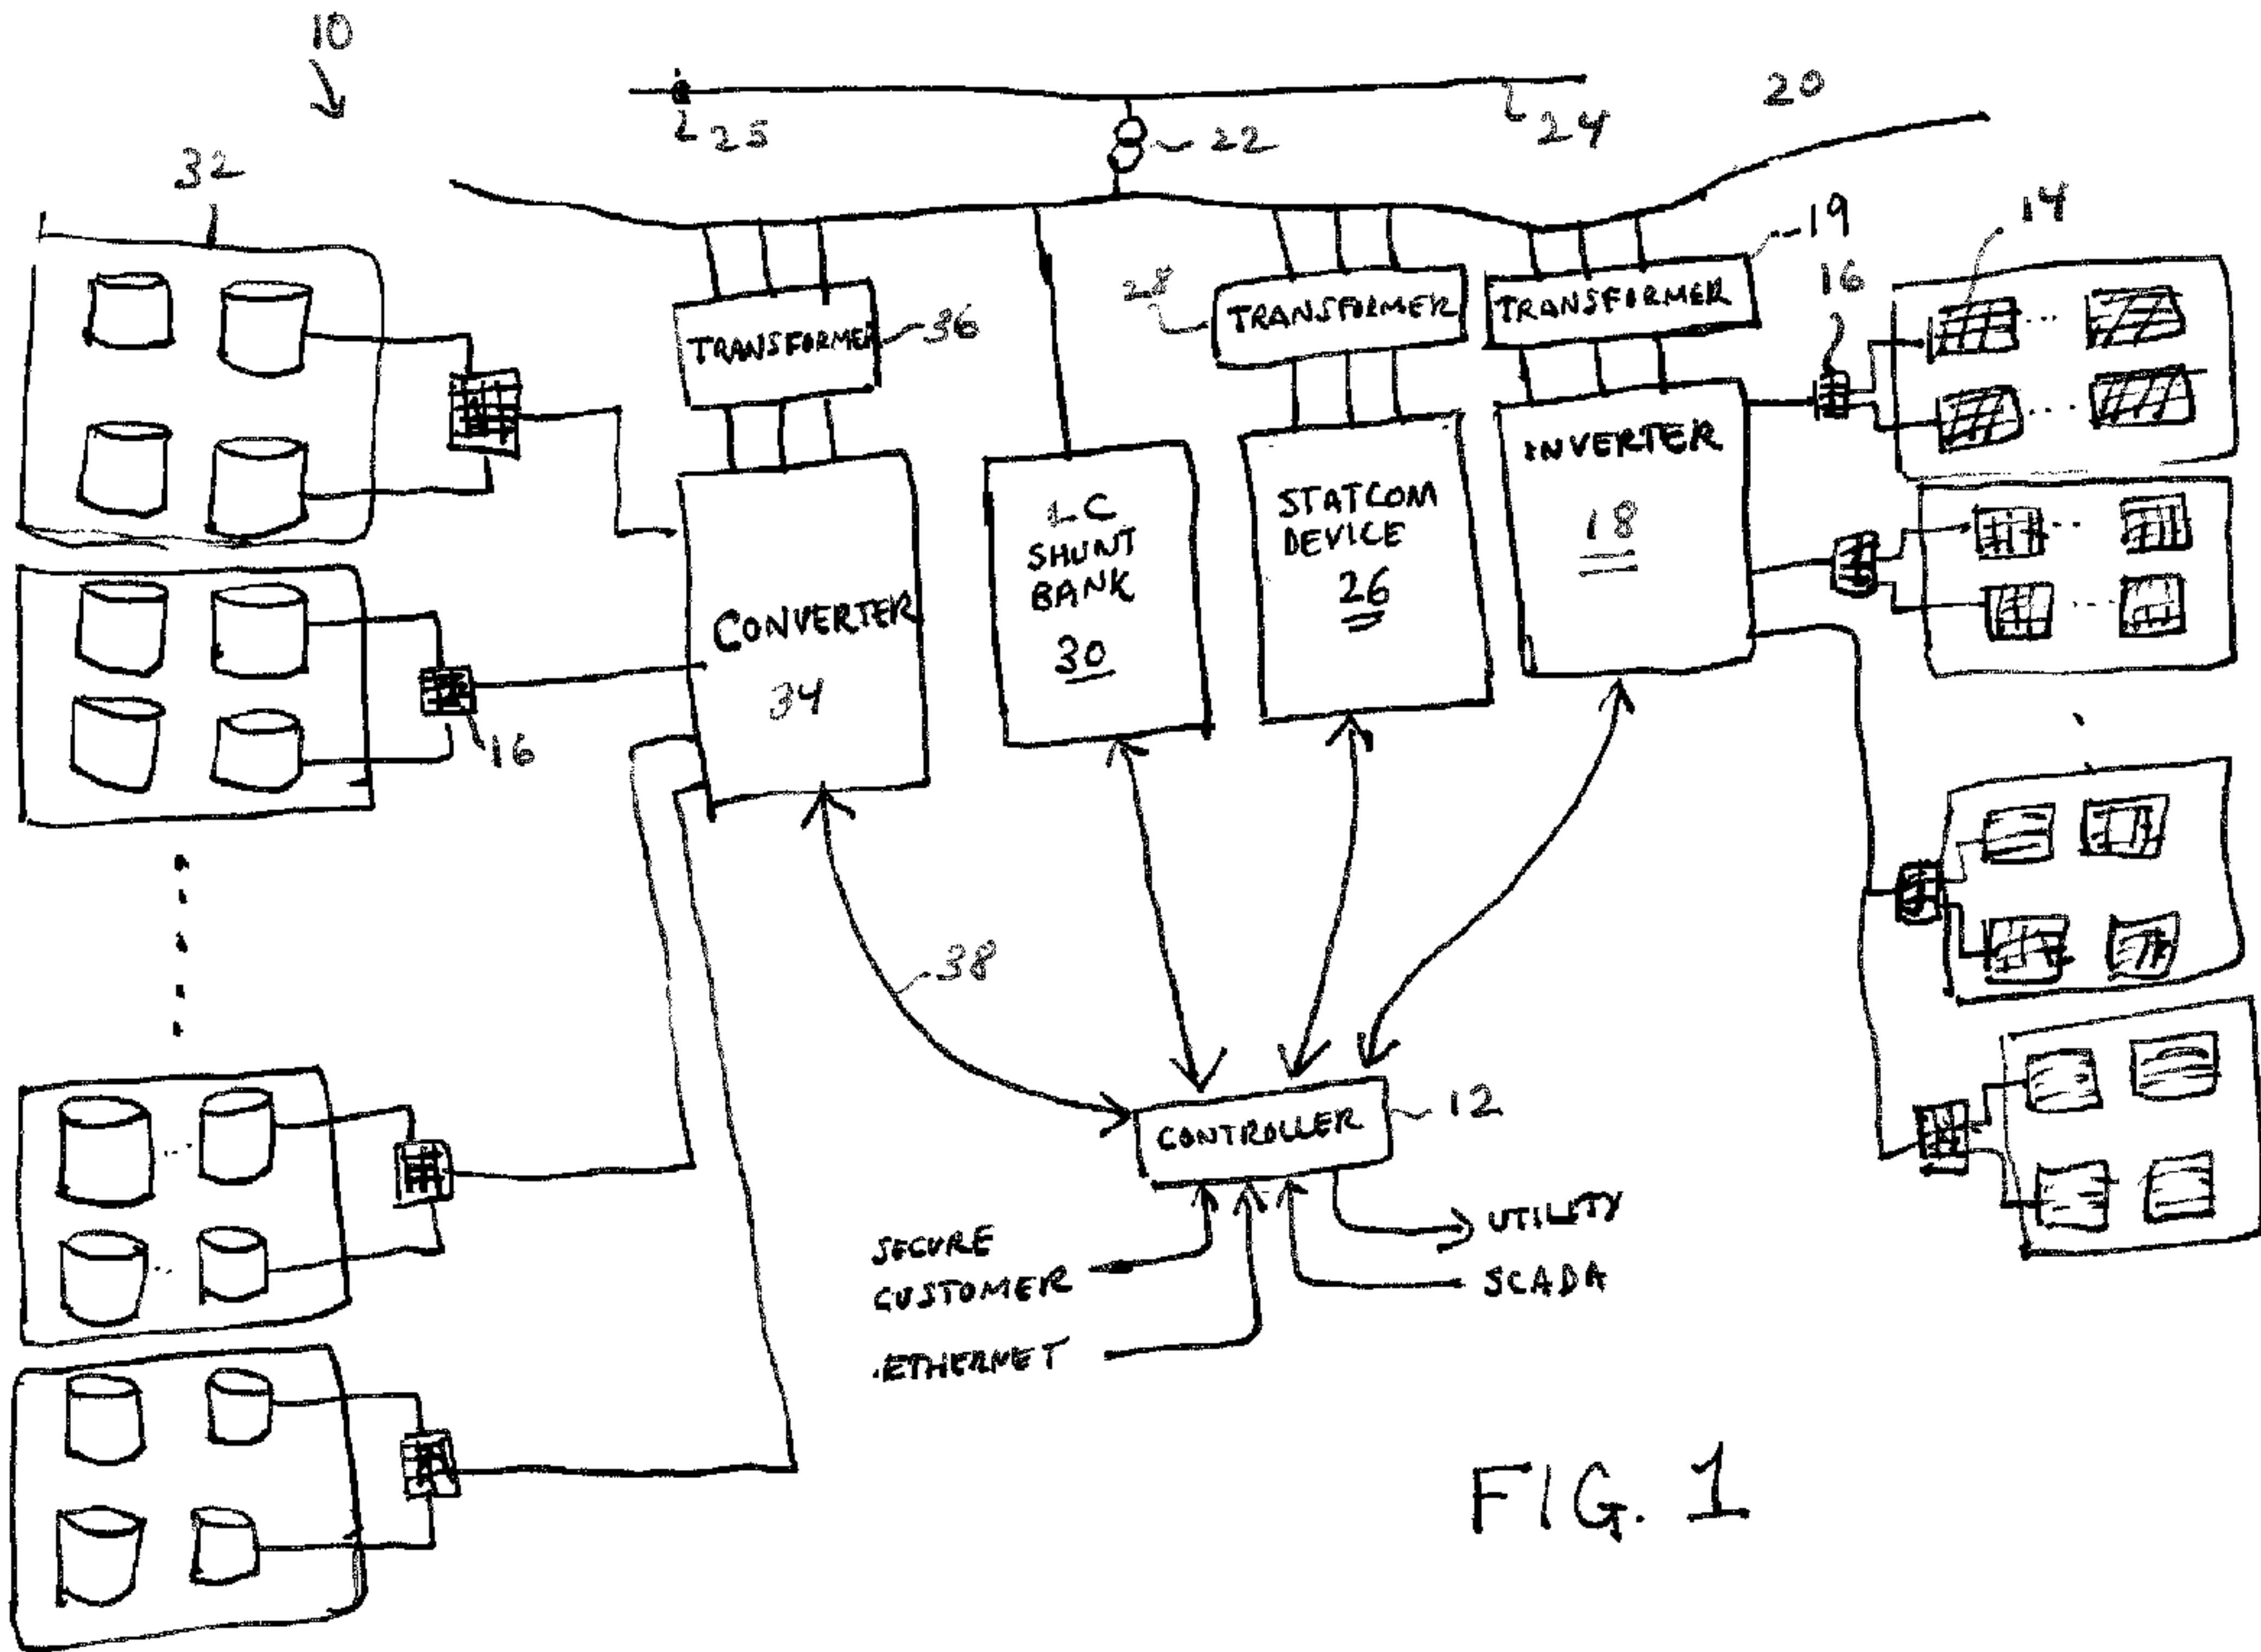


FIG. 1