



US 20150134313A1

(19) **United States**(12) **Patent Application Publication**
Maturana et al.(10) **Pub. No.: US 2015/0134313 A1**(43) **Pub. Date: May 14, 2015**(54) **TIME SYNCHRONIZATION OF SIGNAL
TRANSMISSION INTERVALS FOR
SIMULATING A MACHINE IN INDUSTRIAL
AUTOMATION****Publication Classification**


(51) **Int. Cl.**
G06F 17/50 (2006.01)
G06F 1/14 (2006.01)
G06F 9/54 (2006.01)

(52) **U.S. Cl.**
CPC **G06F 17/5009** (2013.01); **G06F 9/541**
(2013.01); **G06F 1/14** (2013.01)

(71) Applicant: **ROCKWELL AUTOMATION
TECHNOLOGIES, INC.**, Mayfield
Heights, OH (US)(72) Inventors: **Francisco Maturana**, Lyndhurst, OH
(US); **Haithem Mansouri**, Beachwood,
OH (US); **Jaroslav Kriz**, Usti nad
Labem (CZ)(21) Appl. No.: **14/303,172**(22) Filed: **Jun. 12, 2014****Related U.S. Application Data**(60) Provisional application No. 61/901,956, filed on Nov.
8, 2013.(57) **ABSTRACT**

Systems, methods, and software to facilitate simulating machines used in industrial automation are disclosed herein. In at least one implementation, an API is utilized to establish at least a communication link between a simulation model created in a simulation application and an industrial controller system outside of the simulation model, wherein the simulation model comprises definitions for a virtual representation of at least a portion of a machine used in an industrial automation environment. Data is then exchanged between the industrial controller system and the simulation model over the communication link.

101

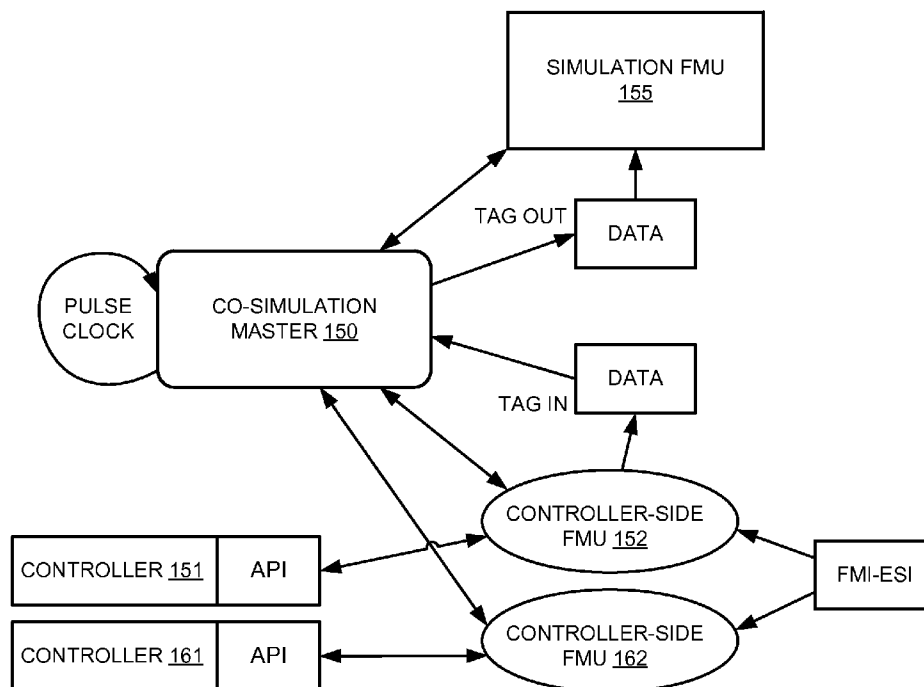

101

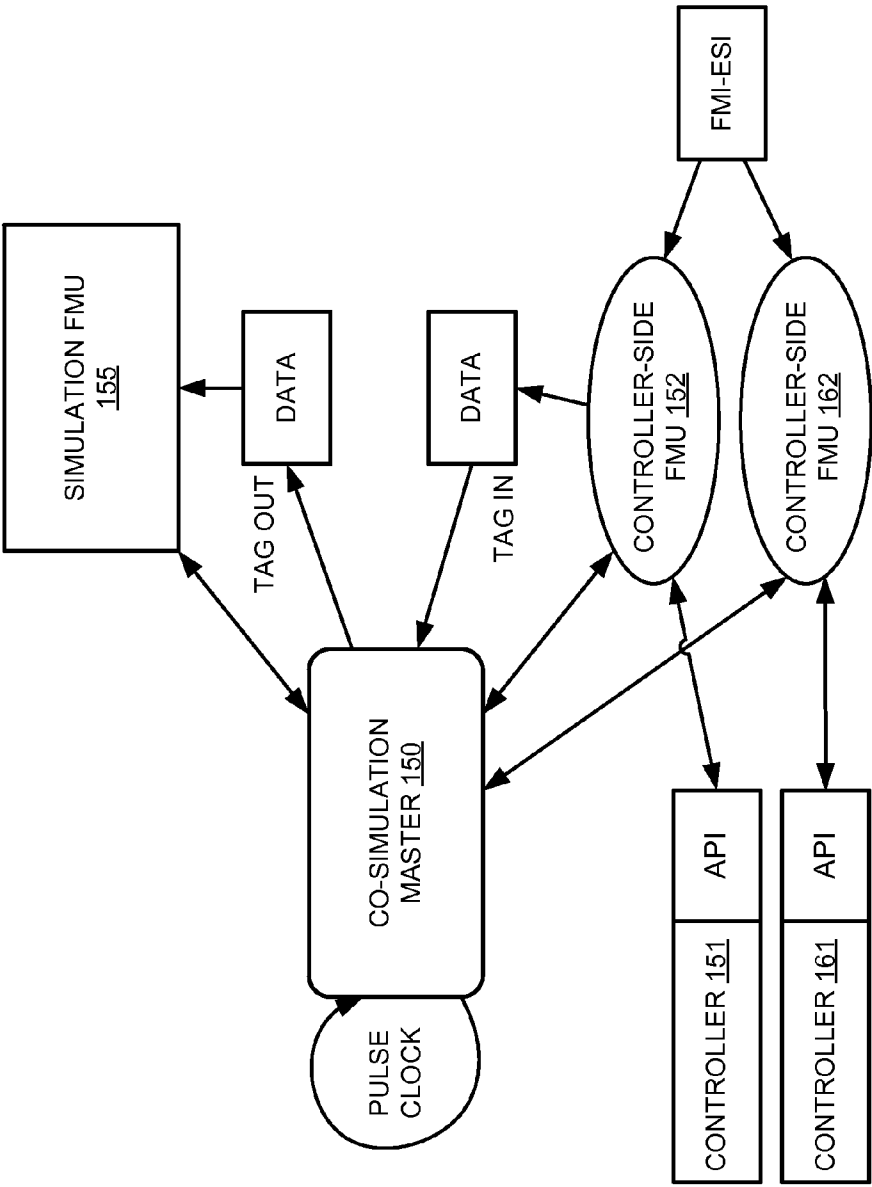


FIGURE 1A

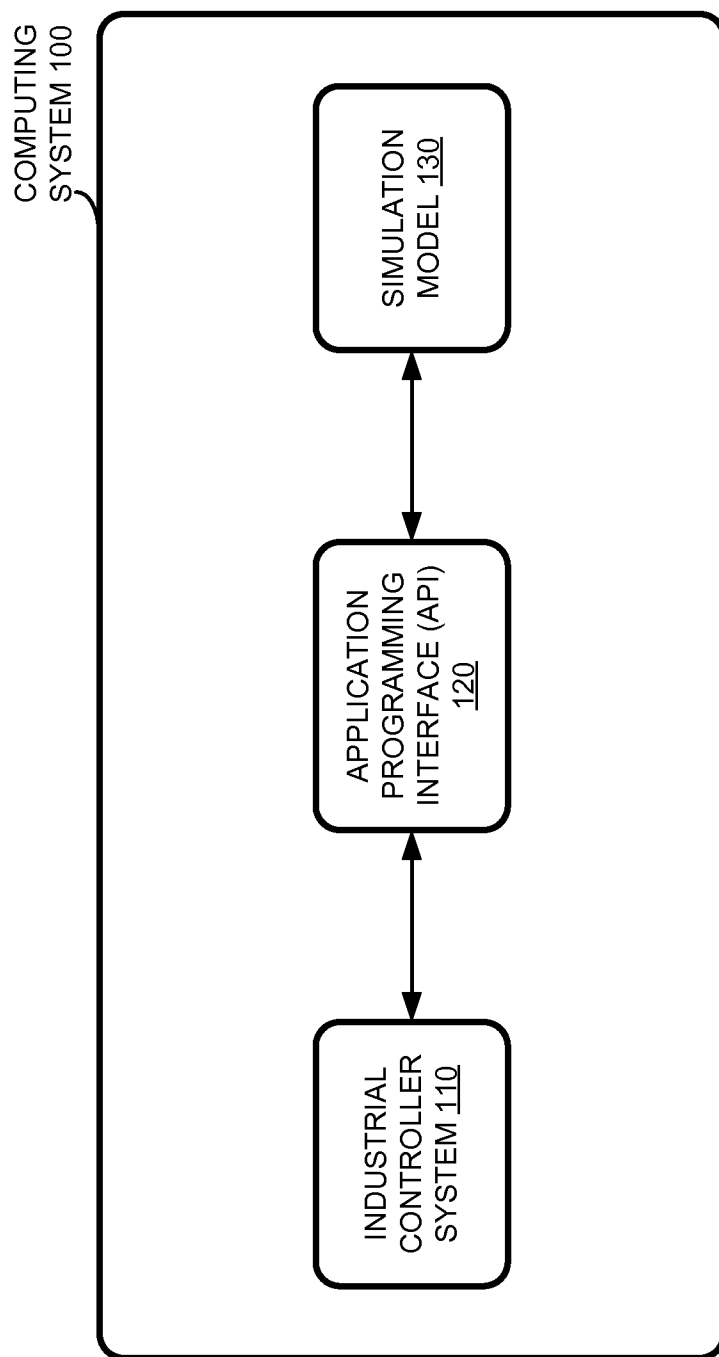


FIGURE 1B

200

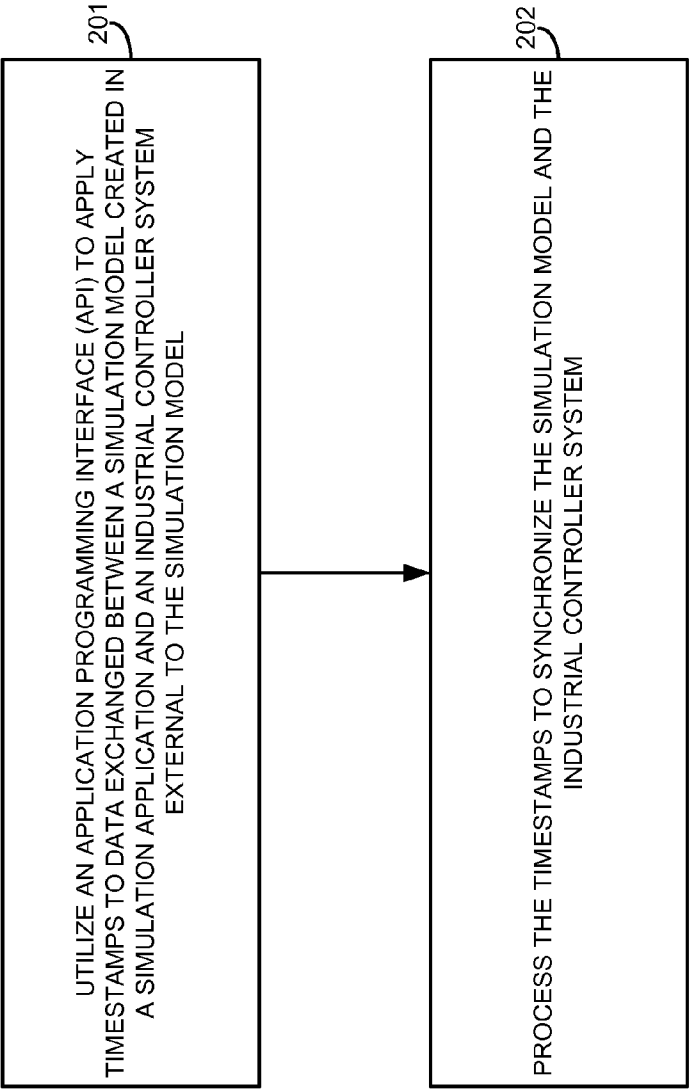


FIGURE 2

300

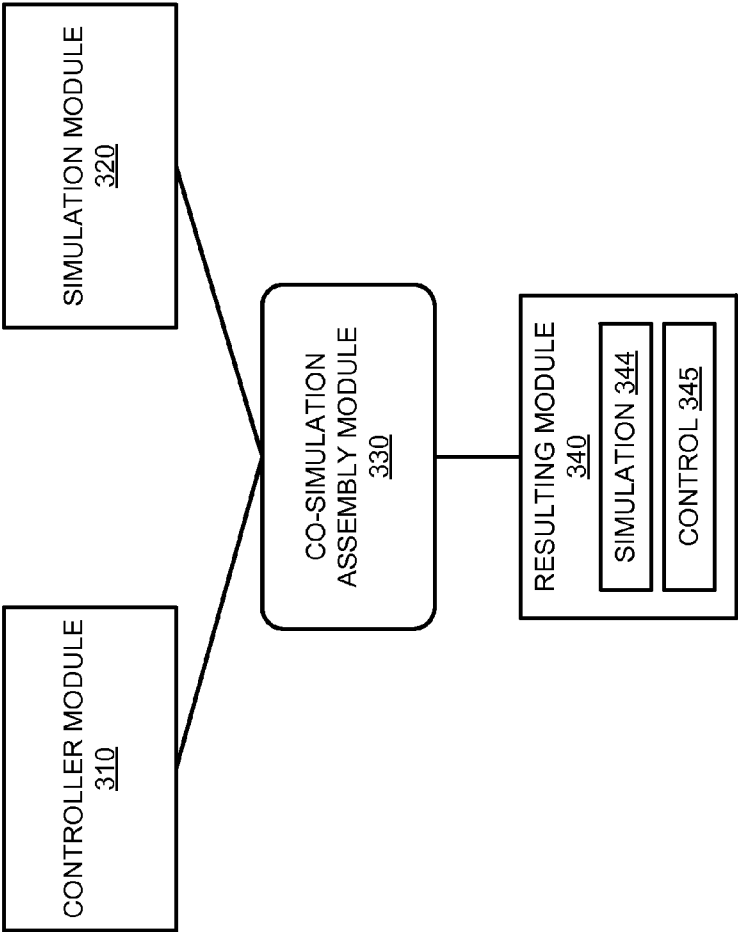


FIGURE 3

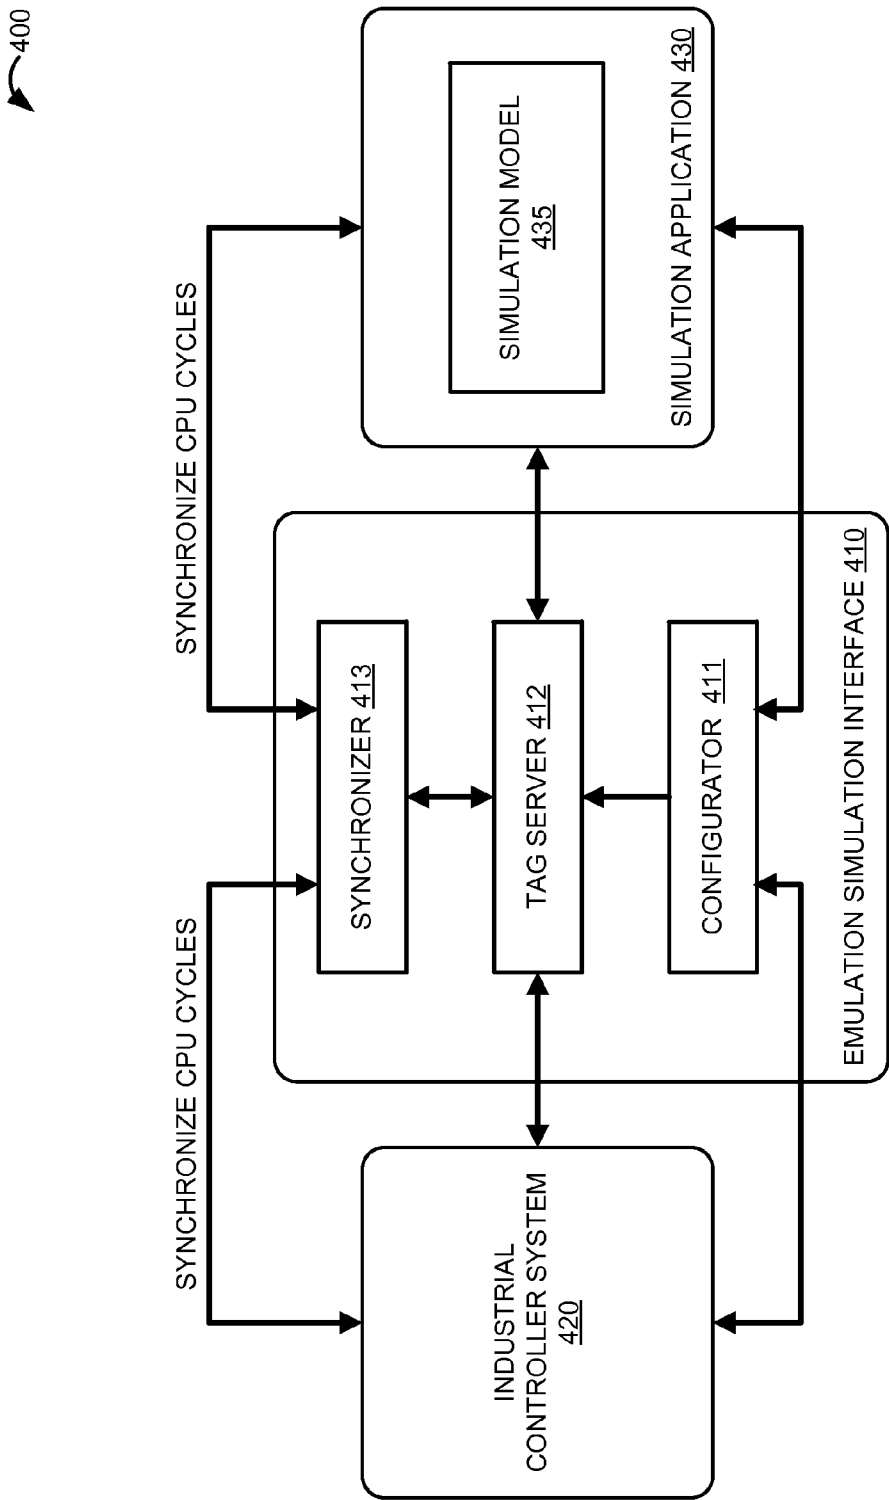


FIGURE 4

500

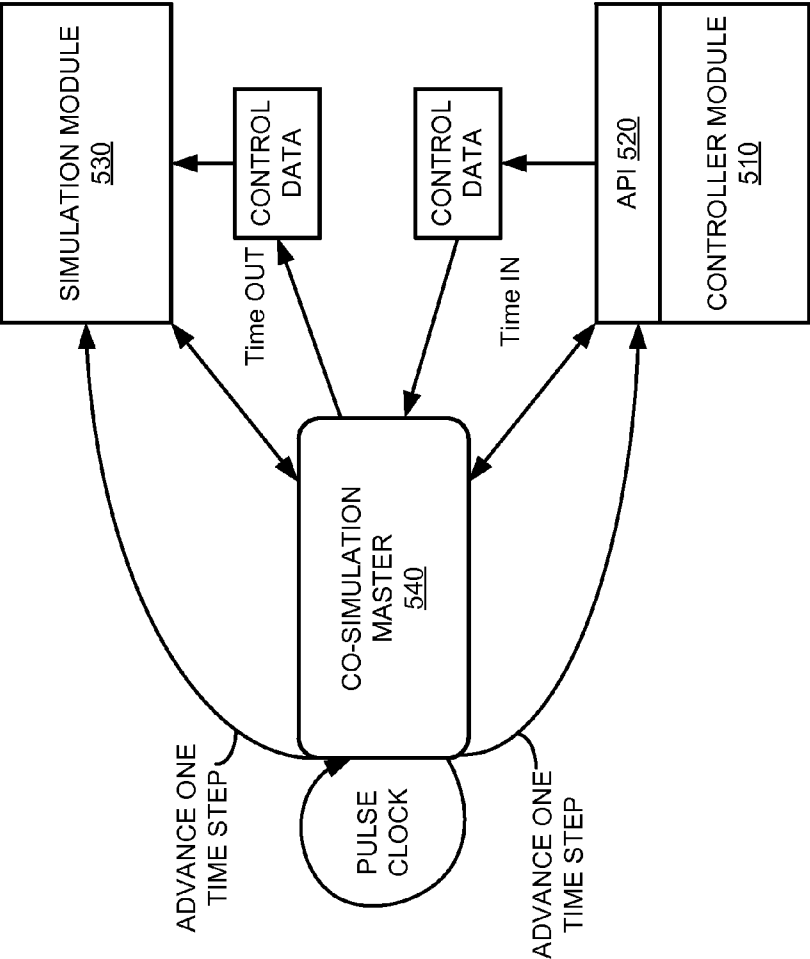


FIGURE 5

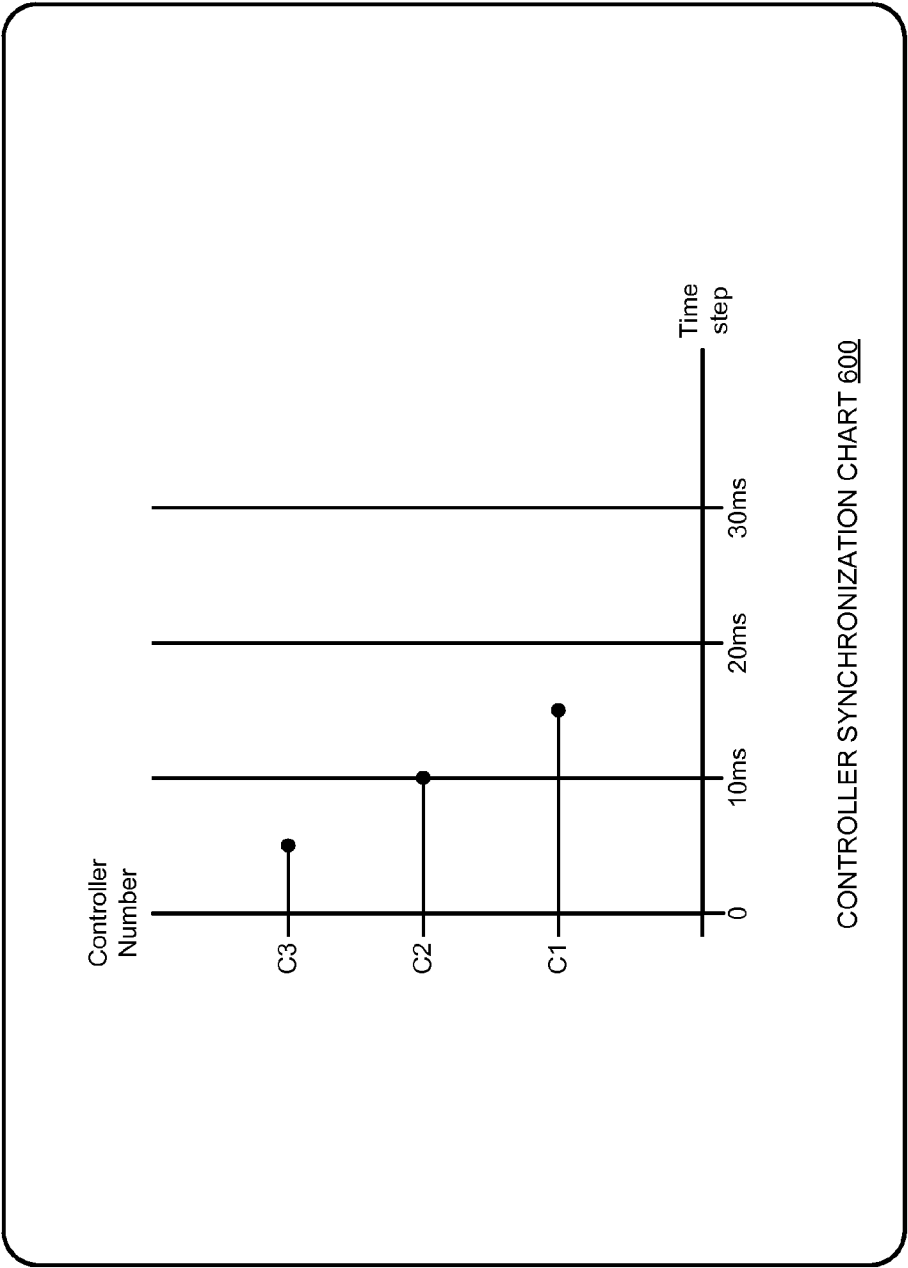


FIGURE 6

700

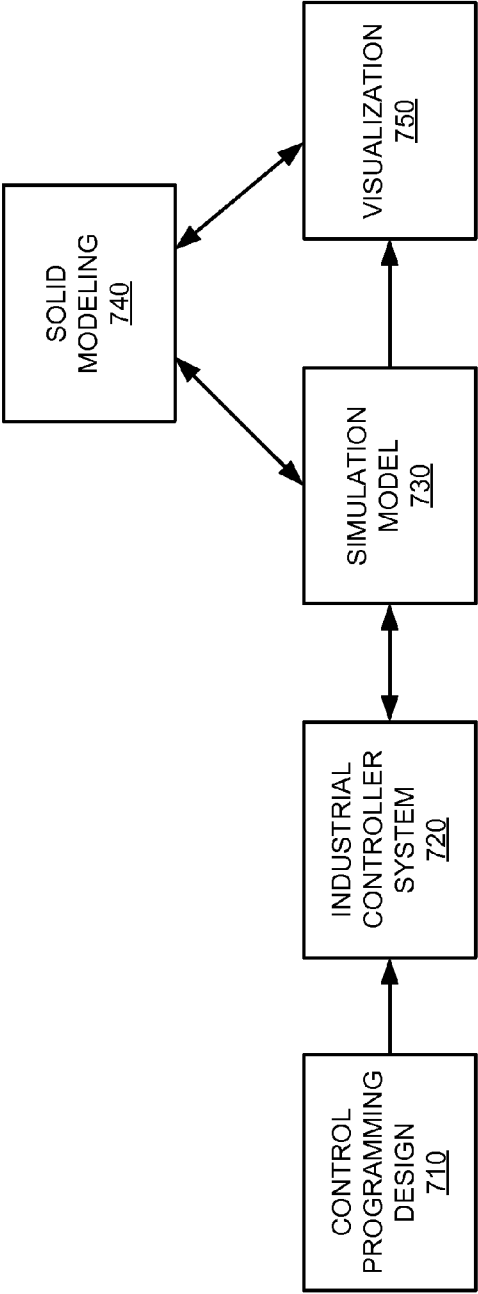


FIGURE 7

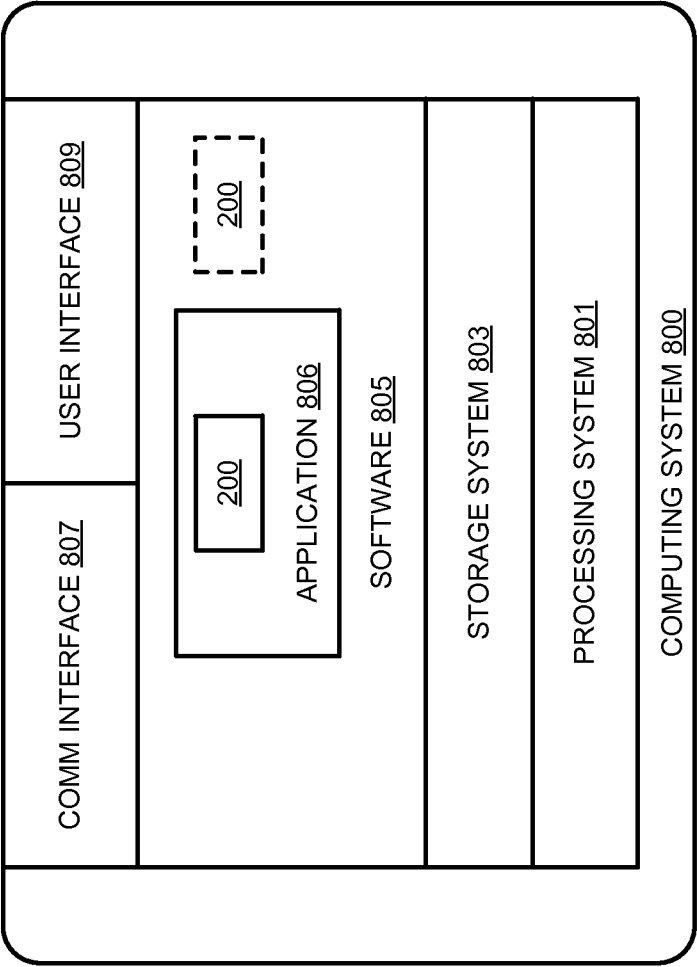


FIGURE 8

TIME SYNCHRONIZATION OF SIGNAL TRANSMISSION INTERVALS FOR SIMULATING A MACHINE IN INDUSTRIAL AUTOMATION

RELATED APPLICATIONS

[0001] This application hereby claims the benefit of, and priority to, U.S. Provisional Patent Application No. 61/901,956, entitled "INTEGRATING CONTROLLERS WITH SIMULATIONS", filed Nov. 8, 2013, and which is hereby incorporated by reference in its entirety for all purposes.

TECHNICAL BACKGROUND

[0002] Simulation of industrial equipment can be essential in designing, prototyping, and demonstrating the different design options to engineers, customers, and other interested parties. Such simulations can be utilized to emulate virtualized operation of their corresponding physical devices over time, and may be further used in providing visual representations of the various simulated devices. In some examples, simulation and modeling applications may be used to define parameters for simulated mechanical components. These parameters ensure that the emulated equipment performs in the same manner during a simulation as can be expected for their real-world counterparts.

[0003] In addition to the physical industrial equipment that provides the mechanical functionality to perform various industrial operations, controller systems are also essential components of an industrial automation environment. Industrial controller systems are typically utilized to provide control instructions to physical machines to accomplish various tasks in an industrial plant, such as product manufacturing, materials handling, batch processing, supervisory control, and other industrial functions. As a result, by combining industrial machinery with the proper controller, an industrial system can be created that is capable of performing various operations.

Overview

[0004] Systems, methods, and software to facilitate simulating machines used in industrial automation are disclosed herein. In at least one implementation, an API is utilized to apply timestamps to data exchanged between a simulation model created in a simulation application and an industrial controller system external to the simulation model. The timestamps are then processed to synchronize the simulation model and the industrial controller system.

[0005] This Overview is provided to introduce a selection of concepts in a simplified form that are further described below in the Technical Disclosure. It should be understood that this Overview is not intended to identify key features or essential features of the claimed subject matter, nor is it intended to be used to limit the scope of the claimed subject matter.

BRIEF DESCRIPTION OF THE DRAWINGS

[0006] Many aspects of the disclosure can be better understood with reference to the following drawings. While several implementations are described in connection with these drawings, the disclosure is not limited to the implementations disclosed herein. On the contrary, the intent is to cover all alternatives, modifications, and equivalents.

[0007] FIG. 1A is a block diagram that illustrates an overview of synchronizing multiple controllers with simulated industrial devices.

[0008] FIG. 1B is a block diagram that illustrates a computing system that may be used to facilitate simulating machines used in industrial automation.

[0009] FIG. 2 is a flow diagram that illustrates an operation of a computing system in an exemplary implementation.

[0010] FIG. 3 is a block diagram that illustrates an overview of implementing controllers with simulated industrial devices.

[0011] FIG. 4 is a block diagram that illustrates an operational scenario involving a computing system in an exemplary implementation.

[0012] FIG. 5 is a block diagram that illustrates an operational scenario for synchronizing a controller and a simulation in an exemplary implementation.

[0013] FIG. 6 is a controller synchronization chart that illustrates an exemplary technique of synchronizing multiple controllers.

[0014] FIG. 7 is a block diagram that illustrates an operational scenario involving a computing system in an exemplary implementation.

[0015] FIG. 8 is a block diagram that illustrates a computing system in an exemplary implementation.

DETAILED DESCRIPTION

[0016] The following description and associated drawings teach the best mode of the invention. For the purpose of teaching inventive principles, some conventional aspects of the best mode may be simplified or omitted. The following claims specify the scope of the invention. Some aspects of the best mode may not fall within the scope of the invention as specified by the claims. Thus, those skilled in the art will appreciate variations from the best mode that fall within the scope of the invention. Those skilled in the art will appreciate that the features described below can be combined in various ways to form multiple variations of the invention. As a result, the invention is not limited to the specific examples described below, but only by claims and their equivalents.

[0017] Industrial automation environments, such as automobile manufacturing factories, food processing plants, oil drilling operations, microprocessor fabrication facilities, and other types of industrial enterprises, typically employ several machines and other equipment to carry out their business operations. For example, an industrial automation enterprise could employ machines comprising sensors, drives, pumps, filters, drills, motors, robots, mills, printers, carousels, fabrication machinery, or any other industrial automation equipment. During the design, prototyping, and testing phases of product development, these machines and other devices used in industrial automation may be simulated using computing systems to provide virtual representations to engineers and customers of the end product. These simulations typically include physical attributes, parameters, and other aspects of the machine being simulated to ensure a proper emulation is furnished by the computing system. In some examples, a user may desire to have control over a simulated device to further illustrate the functionality and operation of the device as can be expected when physically implemented. As a result, the user may prefer to attach one or more real or emulated controllers to the simulated device to demonstrate and test the different controllable operations of the device.

[0018] FIG. 1A is a block diagram that illustrates an overview 101 of synchronizing multiple controllers 151-152 with simulated industrial devices. FIG. 1A shows a functional mock-up interface emulation simulation interface (FMI-ESI), controllers 151 and 161, controller-side functional mock-up unit (FMU) 152 and FMU 162, co-simulation master 150, and simulation FMU 155.

[0019] Controllers 151 and 161 typically each comprise an industrial controller, which could include automation controllers, programmable logic controllers (PLCs), or any other controllers used in automation control. Controllers 151 and 161 could comprise one or more physical and/or emulated controllers implemented in software—including combinations thereof. In this example, each controller 151 and 161 has an associated controller-side FMU 152 and 162, respectively. Each controller-side FMU 152 and 162 includes an application programming interface (API) that may be used to read and write tags and synchronize time between the controllers 151 and 162 and their respective controller-side FMUs 152 and 162.

[0020] Simulation FMU 155 comprises definitions for a virtual representation of at least a portion of a machine used in an industrial automation environment. Simulation FMU 155 is typically created, at least in part, using a simulation application that complies with the FMI standard, so that FMI may be used to wrap the simulation module inside of an FMU. For example, the simulation application could comprise a third-party simulation framework tool, such as MATLAB® Simulink™, although the simulation application could comprise any other suitable simulation application or combination of applications in some implementations. Each FMU provides an interface for exchanging data with other FMUs.

[0021] In operation, a tag server within the FMI-ESI provides distributed communication connectivity services for connecting the communicating parts on the controller side. The communication between controller-side FMUs 152 and 162 and the simulation FMU 155 is coordinated by the co-simulation master 150, which also complies with FMI. The clock synchronization is typically performed in two phases. First, the co-simulation master 150 coordinates global time among all the FMUs 152, 162, and 155, which involves sending a clock pulse to each FMU at each time step interval in order to inject the global time into each FMU. Second, the tag server service within the FMI-ESI coordinates controller-side FMU time among the controllers 151 and 161. In this example, since there is more than one controller-side FMU 152 and 162, the co-simulation master 150 handles the time synchronization among them.

[0022] The FMI-ESI tool may be used to expose the input/output (I/O) interface from the controller side into the FMU side, which necessitates the controller-side FMUs 152 and 162. Each controller-side FMU 152 and 162 typically has one or more controllers under its supervision. In this example, controller-side FMU 152 handles controller 151, and controller-side FMU 162 handles controller 161. The FMI-ESI tool used to configure each controller-side FMU 152 and 162.

[0023] When executing the simulation at runtime, the FMI co-simulation master 150 coordinates the data exchange and clocks among the FMUs 152, 162, and 155. The tag server within the FMI-ESI coordinates the clock and data exchange among the controllers 151 and 161 under each controller-side FMU 152 and 162. In other words, the FMI-ESI may be used to configure the controller-side FMUs 152 and 162 to interoperate with the simulation FMU 155 and other types of

FMUs (not shown). The co-simulation master 150 coordinates the data exchange and global time between the FMUs 152, 162, and 155, and the tag server portion of the FMI-ESI in this case grabs the local time of each controller-side FMU 152 and 162 to facilitate synchronizing the controllers 151 and 161 under their supervision.

[0024] FIG. 1B is a block diagram that illustrates computing system 100 that may be used to facilitate simulating machines used in industrial automation. Computing system 100 includes industrial controller system 110, application programming interface (API) 120, and simulation model 130. Computing system 100 is representative of any computing environment, which could include several different systems and devices located in geographically diverse areas and interconnected via communication networks in a distributed manner in some examples.

[0025] Industrial controller system 110 comprises, for example, an industrial controller, which could include automation controllers, programmable logic controllers (PLCs), or any other controllers used in automation control. Industrial controller system 110 could comprise one or more physical and/or emulated controllers implemented in software—including combinations thereof. Simulation model 130 comprises definitions for a virtual representation of at least a portion of a machine used in an industrial automation environment. Simulation model 130 is typically created, at least in part, using a simulation application. In some implementations, the simulation application employed may comply with the FMI standard, so that FMI may be used to wrap the simulation module inside of an FMU. For example, the simulation application could comprise a third-party simulation framework tool, such as MATLAB® Simulink™, although the simulation application could comprise any other suitable simulation application or combination of applications in some implementations. API 120 provides an interface that enables communication between industrial controller system 110 and simulation model 130, among other functionality. An operation of computing system 100 will now be described with respect to FIG. 2.

[0026] FIG. 2 is a flow diagram that illustrates an operation 200 of computing system 100 in an exemplary implementation. The operation 200 shown in FIG. 2 may also be referred to as synchronization process 200 herein. The steps of operation 200 are indicated below parenthetically. The following discussion of synchronization process 200 will proceed with reference to computing system 100 of FIG. 1B in order to illustrate its operations, but note that the details provided in FIG. 1B are merely exemplary and not intended to limit the scope of synchronization process 200 to the specific implementation shown in FIG. 1B.

[0027] Synchronization process 200 may be employed to operate computing system 100 to facilitate simulating machines used in industrial automation. As shown in the operational flow of synchronization process 200, computing system 100 utilizes an application programming interface (API) 120 to apply timestamps to data exchanged between a simulation model created in a simulation application and an industrial controller system external to the simulation model (201). In some implementations, the industrial controller system 110 could comprise one or more physical industrial controller devices, emulated industrial controllers implemented in software, or any other control system—including combinations thereof. The simulation model 130 may typically comprise definitions for a virtual representation of at least a

portion of a machine used in an industrial automation environment. For example, the simulation model **130** could define the design and parameters of an entire robot, or could define an individual component of the robot, such as an arm joint, drive motor, articulation mechanism, or some other portion of the robot. In some examples, the simulation model **130** could include information for rendering a three dimensional visualization of the machine, or at least a portion thereof.

[0028] Among other functionality, API **120** may facilitate data exchange between the simulation model **130** and the industrial controller system **110** in a bidirectional manner. For example, the data transferred from the industrial controller system **110** to the simulation model **130** could comprise control signals used to drive the simulation, and the data received by the industrial controller system **110** from the simulation model **130** could comprise feedback, operational status, and other information associated with the execution of the simulation model **130**. In some implementations, API **120** could be utilized to establish at least one communication link between the industrial controller system **110** and the simulation model **130** by linking ports associated with the industrial controller system **110** to the simulation model **130** to create an input and output interface between the industrial controller system **110** and the simulation model **130**. Data may then be exchanged over the communication link between the industrial controller system **110** and the simulation model **130** by utilizing the input and output interface to transfer control program parameters, control signals, and other information between the industrial controller system **110** and the simulation model **130**. The simulation model **130** may then utilize the data received from the industrial controller system **110** to generate an animated visualization of a machine being simulated. For example, the data from the industrial controller system **110** could direct the simulation model **130** to move and animate a three dimensional visualization of the simulated machine in the same manner that the industrial controller system **110** could drive the physical machine itself.

[0029] In some implementations, API **120** may be utilized to apply timestamps to any of the data exchanged between the industrial controller system **110** and the simulation model **130**. For example, API **120** could be utilized to apply a first timestamp to data as soon as it is transferred by the industrial controller system **110** for delivery to the simulation model **130**, and to apply a second timestamp immediately before providing the data to the simulation model **130**, and vice versa. Other techniques of utilizing API **120** to apply timestamps to data exchanged between the simulation model **130** and the industrial controller system **110** are contemplated and within the scope of this disclosure.

[0030] The timestamps are then processed to synchronize the simulation model **130** and the industrial controller system **110** (**202**). In some embodiments, the timestamps may be utilized to determine the timing of when to provide the data to the simulation model **130** or the industrial controller system **110** to achieve synchronization. In at least one implementation, processing the timestamps to synchronize the simulation model **130** and the industrial controller system **110** could comprise coordinating signal transmission intervals of the simulation model **130** and the industrial controller system **110** using the timestamps. Coordinating the signal transmission intervals between the simulation model **130** and the industrial controller system **110** is necessary in some examples because the signal transmission intervals could often comprise different rates. In some implementations, pro-

cessing the timestamps to synchronize the simulation model **130** and the industrial controller system **110** could comprise providing a periodic clock pulse to the simulation model **130** and the industrial controller system **110** to advance the simulation model **130** and the industrial controller system **110** ahead one time step. Note that the time step size for the simulation model **130** and the industrial controller system **110** could comprise different values, but would both be advanced by the appropriate amount responsive to the periodic clock pulse. Additionally, in implementations where the industrial controller system **110** comprises multiple controllers, each controller could have a different time step size, and each of these controllers could be further synchronized at each clock pulse by dynamically calculating the deltas for use in compensating for the differences in time step size between the multiple controllers.

[0031] Advantageously, the API **120** may be utilized to apply timestamps to data exchanged between the simulation model **130** and the industrial controller system **110**. The timestamps may then be processed in order to facilitate synchronization between the execution of the simulation model **130** and the industrial controller system **110**. In this manner, the simulation model **130** is able to receive and interpret control signals transmitted by the industrial controller system **110** at the appropriate timing to achieve smooth and harmonious operation of the simulation, thereby increasing the value and utility of the simulation model **130** through integration and synchronization with the industrial controller system **110**.

[0032] Turning now to FIG. 3, FIG. 3 is a block diagram that illustrates an overview **300** of implementing controllers with simulated industrial devices. Overview **300** includes controller module **310**, simulation module **320**, co-simulation assembly module **330**, and resulting module **340**. Controller module **310** may be any physical or emulated controller configured to manage one or more devices in an industrial automation system. In some implementations, controller module **310** may be configured to provide control instructions that direct physical and/or simulated machines, or their individual components, to move or perform some action in three-dimensional space, such as controlling the motion of a robot arm. Simulation module **320** may be configured to generate a simulation model comprising simulation files that define various properties, parameters, and physical attributes of a real-world industrial device to ensure that the simulated device looks and operates in the same manner as the physical device from which it is modeled.

[0033] Typically, the baseline controller is a physical hardware device in which a control program may be executed. A control program may then be loaded that is targeted to that specific controller hardware in order to retarget it to an emulation controller implemented in software. Thus, one workflow includes moving from physical to emulation control which allows for improved modeling versatility. Once in an emulation model, the emulation controller may interact with the simulation model. Another workflow considers a case in which the control program is fully designed in the emulation controller against the simulation. In this case, once the control program has been designed, it can be retargeted to the hardware controller. Notably, in both of the above transitions, the input/output (I/O) interface is preserved between the physical machine and the physical controller or the simulated machine and the emulation controller.

[0034] In operation, a user, an engineer, or some other entity may generate a simulation within simulation module 320. Such a simulation may be used to model various industrial equipment, including robotic, fabrication, assembly, and other types of equipment. In addition to generating the simulation, a user may further wish to control the simulation using an industrial controller from controller module 310. Controller module 310 as used herein is intended to represent a real, physical controller device or an emulated controller implemented in software that provides control instructions to the generated simulation. For example, if the simulation was used to emulate a robotic arm, one or more controllers could be used to manage and control the movement and articulation of the arm.

[0035] Once the controller and the simulation have been selected, the controller and simulation are then formatted using co-simulation assembly module 330. In some examples, co-simulation assembly module 330 can be used to format the controller and the simulation using a functional mock-up interface (FMI). FMI defines a standardized interface to be used in computer simulations to develop complex cyberphysical systems. These cyberphysical systems are represented in functional mock-up units (FMUs) that provide the functions necessary to generate the simulation. The functional mock-up units typically include an extensible markup language (XML) file comprising definitions of the variables used by the FMUs, equations used by the model, which may be defined as a set of functions, and other optional data, such as parameter tables, a user interface, and documentation which may be needed by the model, among other things.

[0036] In the present example, the FMI further includes information necessary to provide the control functions. As a result, necessary portions of the control functions are implemented in functional mock-up units to make the controls appear as simulation information within the FMI. The combination of the simulation functional mock-up units 344 and the control functional mock-up units 345 are used to provide resulting module 340. Although illustrated using a functional mock-up interface, it should be understood that resulting module 340 could take the form of any other similar standardized interface for simulation. An emulation simulation interface environment is used to provide for this interface which is unique to each specific control system vendor. Translators may be provided throughout the emulation simulation interface from industrial control space to FMI space and vice versa.

[0037] In some examples, a user may control the simulation directly from the control functional mock-up units. Thus, the control functional mock-up units include all of the necessary functions to both receive a control instruction and execute that function. In other implementations, the control functional mock-up units may contain only the portion of information necessary to control the simulation. As a result, an external controller that receives input from the user may communicate with the control functional mock-up units using an application programming interface (API), such as API 120 as shown in FIG. 1B.

[0038] Referring now to FIG. 4, FIG. 4 is a block diagram that illustrates an operational scenario 400 involving a computing system in an exemplary implementation. The computing system executes emulation simulation interface 410 and may execute some or all of the operations of industrial controller system 420 and simulation application 430. In some examples, the computing system could be a single device or

could be distributed across many different systems and devices separated over diverse geographic areas.

[0039] As shown in FIG. 4, the emulation simulation interface 410 includes a configurator module 411, a tag server 412, and a synchronizer 413. In this example, the industrial controller system 420 comprises a virtual controller emulator, such as RSLogix™ Emulate 5000 provided by Rockwell Automation, Inc. The simulation application 430 could comprise any third-party simulation framework tool that complies with the FMI standard, but the MATLAB® Simulink™ tool is used in this example. Thus, the simulation model 435 could comprise a .mdl file created in MATLAB® using library blocks for different systems.

[0040] The emulation simulation interface 410 is used to connect controller tags to the simulation model 435 in MATLAB®. To connect the virtual controller output signals to the simulation model 435, it is necessary to establish an interface between the simulation model 435 and the industrial controller system 420. To this end, the emulation simulation interface 410 will set up an interface between input/output (I/O) signals of the controller 420 with the simulation model 435. The interface established by the emulation simulation interface 410 enables connectivity and data exchange in a bidirectional manner between the simulation model 435 and the controller 420. In this example, the emulation simulation interface 410 uses a virtual controller emulator such as RSLogix™ Emulate 5000 to encapsulate the control programs. The controller emulator mimics the operation of a ControlLogix™ programmable logic controller (PLC) but in software only. The virtual controller 420 transfers data to the simulation using output tags and receives data from the simulation using input tags.

[0041] The configurator component 411 hosts the application-level information for connecting the virtual controller 420 with the simulation model 435. Tag server 412 coordinates the input and output tags for data exchange. In some implementations, tag server 412 provides distributed communication connectivity services for connecting the communicating parts in the controller side of the spectrum. The co-simulation master from FMI coordinates communication between the FMUs. Underneath the tag server service, the controllers and their respective communications are coordinated with simulations, which can become a very complex network of communicating units.

[0042] The synchronizer 413 coordinates the clock progression between the controller 420 and the simulation model 435 to keep them synchronized. The clock synchronization is typically carried out in two phases. First, the co-simulation master coordinates global time among FMUs. Second, the tag server service 412 coordinates control level FMU time among the controllers. In situations where there is more than one control level FMU, time synchronization among them may be handled by the co-simulation master. An example of how the execution of a controller and a simulation may be synchronized at runtime will now be discussed with respect to FIG. 5.

[0043] FIG. 5 is a block diagram that illustrates an operational scenario 500 for synchronizing a controller and a simulation in an exemplary implementation. Operational scenario 500 involves controller module 510, simulation module 530, and co-simulation master 540. Controller module 510 includes API 520. In this example, controller module 510 comprises a controller-side FMU and simulation module 530 comprises a simulation FMU.

[0044] In operation, API 520 of controller module 510 generally reads and writes tags for data exchanged between the controller module 510 and the simulation module 530, and functions to synchronize the timing associated with this data exchange and execution of the simulation. For example, the signal transmission intervals of the controller module 510 and the simulation model 530 may be exchanged at different time rates, and the co-simulation master 540 works in conjunction with API 520 to compensate for these different rates to achieve synchronization.

[0045] In this example scenario, controller module 510 is transferring control data to the simulation module 530. Co-simulation master 540 provides an interface to connect the controller module 510 FMU and the simulation module 530 FMU. As controller module 510 transfers the control data to simulation module 530, co-simulation master 540 utilizes API 520 to apply a first timestamp to the control data to mark the time in. Co-simulation master 540 then provides the control data to simulation module 530 and a second timestamp is applied to the data to mark the time out. In this manner, co-simulation master 540 is aware of what time the controller module 510 intended to provide the control data to the simulation module 530 based on the first timestamp noting the time in, and what time the simulation module 530 actually receives the control data based on the second timestamp noting the time out.

[0046] To ensure the controller module 510 and the simulation module 530 are operating in a synchronized manner, co-simulation master 540 calculates time offsets for the control data based on the timestamps to compensate for delay and other timing anomalies. The co-simulation master 540 then advances the master clock one clock cycle and sends a clock pulse to both the controller module 510 and the simulation module 530 to advance each module ahead one time step. Note that the time step size may not be the same size for the simulation module 530 and the controller module 510.

[0047] In some examples, the FMUs of both the simulation module 530 and the controller module 510 are configured to emit periodic pulses, such as every twenty milliseconds, into the simulation and controller, respectively, to advance in time at the appropriate time step sizes, since as noted above, the time step sizes may not be the same size for the simulation module 530 and the controller module 510. Also, in implementations where the controller module 510 includes multiple controllers, each of the controllers in the controller module 510 could be operating at different time step sizes. An example of how multiple controllers that operate at different time step sizes could be synchronized will now be discussed in greater detail with respect to FIG. 6.

[0048] FIG. 6 is a controller synchronization chart 600 that illustrates an exemplary technique of synchronizing multiple controllers. The multiple controllers could comprise several separate physical controller devices, multiple independent emulated controllers implemented in software, or combinations thereof. For example, multiple controllers could be used to control several separate components of a single machine being simulated, such as various drive motors, articulation mechanisms, and other parts of the machine. In this example, the controllers are numbered C1, C2, and C3. The time step size in this example is ten milliseconds, as shown along the horizontal x-axis of controller synchronization chart 600.

[0049] As shown in controller synchronization chart 600, after a first iteration, controller C1 has advanced fifteen milliseconds, C2 has advanced ten milliseconds, and C3 has

advanced five milliseconds. These different intervals are then processed to dynamically calculate time offsets from the time step size of ten milliseconds in order to compensate for the different signal transmission intervals of the controllers C1, C2, and C3. For controller C1, the time offset is calculated to be a plus five millisecond delta from the time step size, since C1 advanced fifteen milliseconds but the time step size is only ten milliseconds. The next time step for controller C1 is then calculated by subtracting the delta from the time step size, so with a time step size of ten milliseconds minus a plus five millisecond delta, C1 should only advance five milliseconds on the next time step to achieve synchronization with the other controllers and the ten millisecond time step size.

[0050] Controller C2 has a time step size of ten milliseconds, which matches the time step size of the simulation. Thus, no offset needs to be calculated and no compensation of the time step size of controller C2 is necessary for synchronization. Controller C3 has a time step size of only five milliseconds, so the time offset is calculated to be a negative five millisecond delta from the time step size of ten milliseconds. The next time step for controller C3 is then calculated by subtracting the delta from the time step size, so with a time step size of ten milliseconds minus a negative five millisecond delta, C3 should advance fifteen milliseconds on the next time step to achieve synchronization with the other controllers and the overall ten millisecond time step size. As the simulation advances, the offsets for each of the controllers C1, C2, and C3 are then continually recalculated dynamically at each time step to ensure synchronization persists. In this manner, the simulation model proceeds to learn the amplitude and frequency of the sinusoidal time progression of each of the controllers C1, C2, and C3.

[0051] FIG. 7 is a block diagram that illustrates an operational scenario 700 involving a computing system in an exemplary implementation. Operational scenario 700 is capable of creating and operating a machine simulation in an industrial automation environment. To integrate design, control, simulation, and visualization, the following system and work flow may be used. According to an example, the system architecture may consist generally of five main parts: control program design 710, industrial controller system 720, simulation modeling 730, computer-aided design (CAD) solid modeling 740, and visualization 750. Various industry-based tools and open source software may be used to implement these design goals.

[0052] In an example, control programming design 710 may be carried out using a control programming tool, such as the Studio5000™ programming tool by Rockwell Automation, Inc. Control program execution is handled by industrial controller system 720, which could comprise an emulated virtual controller implemented in software, such as RSLogix™ Emulate 5000 by Rockwell Automation, Inc. Simulation modeling 730 can be performed by any simulation framework tool, such as the MATLAB® Simulink™ tool. Solid modeling 740 may be handled by any CAD software, such as Solidworks™ or the like. Finally, visualization 750 may be performed by any suitable visualization tool, such as a Scalable Vector Graphics (SVG) tool, Virtual Reality Modeling Language (VRML) tool, and others. Each of the above tools brings its own data structures and information formats into the design process. The challenge for the integrated design and validation environment is to combine the pieces of information into a common information exchange structure that can be used to harmonize the components into a rapid prototyping environment.

[0053] In FIG. 7, an example information flow of the integrated system is shown. The solid modeling phase 740 produces a three dimensional representation of the mechanical system to be controlled. The solid model may be converted into two information elements: a kinematics simulation and a graphical assembly. The Solidworks™ tool provides plugins to generate both data files as MATLAB® simulation and VRML export files.

[0054] The Studio5000™ tool by Rockwell Automation is an industrial control programming design tool 710 that is used to create control algorithms written in an International Electrotechnical Commission (IEC) 61131-based programming language. The control program is deployed in the virtual controller within industrial controller system 720.

[0055] The kinematics simulation is downloaded to the MATLAB® tool for simulating the machine under specific load conditions. The simulation model 730 interacts with the controller 720 at runtime to stimulate the controlling algorithms with the responses of the machine that is put under stress with dynamic loading and control profiles. Graphical assemblies will be further processed to become a hierarchical data structure of graphical description that can be animated in the visualization tool 750. The visualization tool collects the real-time data that is generated in the controller-to-simulation interaction.

[0056] Different techniques may be used to connect each phase of this information flow. In one implementation, control program parameters are transferred between the simulation model 730 and the controller 720 using an I/O interface. MATLAB® provides a SimMechanicsLinks plugin for CAD software Solidworks™ to transfer the CAD model produced in the solid modeling phase 740 into the simulation model 730. The simulation model 730 contains mass and inertial properties of each of the component parts of a machine described in the CAD drawings. This information is essential to generate accurate animation of the mechanical system.

[0057] Kinematics and dynamical information of the simulation model 530 can be used to generate realistic model conditions since the actual physical properties of the model are included in the simulation calculations. As discussed above, visualization 550 may be performed by any suitable visualization tool, such as a Scalable Vector Graphics (SVG) tool, Virtual Reality Modeling Language (VRML) tool, or any other simulation modeling tool. In at least one implementation, a high quality and realistic animation can be produced in any VRML-compatible tool using the exported VRML models. VRML provides an open source, platform-independent graphical language to create and view three dimensional models. VRML is a text-based language so it can be easily edited using any text editor. To bring the VRML tool into this workflow, it is necessary to attach an API to it so it can communicate with the other parts of the system. Of course, other tools besides VRML may be utilized for this purpose and are within the scope of this disclosure.

[0058] Based on this work flow, an application can be created using these different systems under one platform. Robots are widely used in industrial automation applications and their control algorithms are developed by system engineers. In an example, a six-axis articulated robot model may be used. A desired motion profile for the robot's end effector position is established in the controlling program 710 using command position profiles.

[0059] The command positions are points of desired motion trajectory for the end effector. To achieve a desired

position of the end effector, different parts (links) of the robot must be placed in a position by the driving motors at the link joints. These motors are driven by torque signals that are to be calculated by the controlling drivers. However, the controlling torque depends on knowledge of the system response to the torque and the load at the end effector. In the classical design approach, these pieces of information are known by trial and error or by experienced designers. The intent here is to capture the information flow for automating the process of generating the feedback information for the drivers and controllers. Based on the drivers' torque signal, each joint will move and the end effector will move in the space to a target location. Current position is the feedback to the drivers and controllers for close loop control.

[0060] A work flow, validation framework, and process to enable a virtual design engineering environment have been presented. The environment enables interoperability of solid model design, controllers, simulation, and visualization tools into an integrated development environment. Results showed that the selected work flow and information exchange could be assembled in an automated system. The deployment of the virtual design engineering environment permitted observing in real-time the effect of the controlling algorithm on the machine prototype which was simulated and controlled by motion instructions. This disclosure enables early validation of controlling logic for complex industrial automation projects and manufacturing plants. The benefits include the reduction of engineering cost, time, and resources during the design and prototyping of industrial automation machinery. In addition, the virtual design engineering environment opens new opportunities to train engineers and operators in controlling machines, without the need for the physical presence of the actual machine.

[0061] It must be noted that the invention can be used in two main phases: design phase runtime and commissioned phase runtime. During design phase runtime, the industrial control device can be real or emulated. Either encapsulation is connected to the simulation. In commissioned phase runtime, the industrial control device and the simulation execute in parallel with a real controller. Additionally, another benefit of the system is to aid system engineers to create optimized industrial control programs. For example, the Studio5000™ tool by Rockwell Automation allows for online editing of the control program, and the design may be incrementally improved in virtual design.

[0062] FIG. 8 is a block diagram that illustrates computing system 800 in an exemplary implementation. Computing system 800 provides an example of computing system 100 or any system that may be used to facilitate simulating machines used in industrial automation, although other systems capable of performing the techniques disclosed herein could use alternative configurations, including computing system 100. Computing system 800 is representative of a computing system that may be employed in any computing apparatus, system, or device, or collections thereof. For example, computing system 800 may be employed in server computers, cloud computing platforms, data centers, any physical or virtual computing machine, and any variation or combination thereof. In addition, computing system 800 may be employed in desktop computers, laptop computers, tablets, smartphones, or the like.

[0063] Computing system 800 includes processing system 801, storage system 803, software 805, communication interface 807, and user interface 809. Processing system 801 is

operatively coupled with storage system **803**, communication interface **807**, and user interface **809**. Processing system **801** loads and executes software **805** from storage system **803**. Software **805** includes application **806** which itself includes synchronization process **200**. Synchronization process **200** may optionally be implemented separately from application **806**. When executed by computing system **800** in general, and processing system **801** in particular, software **805** directs computing system **800** to operate as described herein for synchronization process **200** or variations thereof. Computing system **800** may optionally include additional devices, features, or functionality not discussed here for purposes of brevity.

[0064] Computing system **800** may be representative of any computing apparatus, system, or systems on which application **806** and synchronization process **200** or variations thereof may be suitably implemented. Examples of computing system **800** include mobile computing devices, such as cell phones, tablet computers, laptop computers, notebook computers, and gaming devices, as well as any other type of mobile computing devices and any combination or variation thereof. Note that the features and functionality of computing system **800** may apply as well to desktop computers, server computers, and virtual machines, as well as any other type of computing system, variation, or combination thereof.

[0065] Referring still to FIG. 8, processing system **801** may comprise a microprocessor and other circuitry that retrieves and executes software **805** from storage system **803**. Processing system **801** may be implemented within a single processing device but may also be distributed across multiple processing devices or sub-systems that cooperate in executing program instructions. Examples of processing system **801** include general purpose central processing units, application specific processors, and logic devices, as well as any other type of processing device, combinations, or variations thereof.

[0066] Storage system **803** may comprise any non-transitory computer-readable media or storage media readable by processing system **801** and capable of storing software **805**, such as a disk drive, flash drive, data storage circuitry, or some other hardware memory apparatus. In some examples, a computer apparatus could comprise storage system **803** and operating software **805**. Storage system **803** may include volatile and nonvolatile, removable and non-removable media implemented in any method or technology for storage of information, such as computer readable instructions, data structures, program modules, or other data. Storage system **803** may be implemented as a single storage device but may also be implemented across multiple storage devices or sub-systems co-located or distributed relative to each other—including devices in different geographic areas. Storage system **803** may also be embedded in various types of equipment. Storage system **803** may comprise additional elements, such as a controller, capable of communicating with processing system **801**. Examples of storage media include random access memory, read only memory, magnetic disks, optical disks, flash memory, virtual memory and non-virtual memory, magnetic cassettes, magnetic tape, magnetic disk storage or other magnetic storage devices, or any other medium which can be used to store the desired information and that may be accessed by an instruction execution system, as well as any combination or variation thereof, or any other type of storage media. In no case is the storage media a propagated signal.

[0067] In operation, processing system **801** loads and executes portions of software **805**, such as synchronization process **200**, in order to operate as described herein. In particular, software **805** may be implemented in program instructions and among other functions may, when executed by computing system **800** in general or processing system **801** in particular, direct computing system **800** or processing system **801** to utilize an application programming interface (API) to apply timestamps to data exchanged between a simulation model created in a simulation application and an industrial controller system external to the simulation model, and process the timestamps to synchronize the simulation model and the industrial controller system. Software **805** may include additional processes, programs, or components, such as operating system software or other application software. Examples of operating systems include Windows®, iOS®, and Android®, as well as any other suitable operating system. Software **805** may also comprise firmware or some other form of machine-readable processing instructions executable by processing system **801**.

[0068] In general, software **805** may, when loaded into processing system **801** and executed, transform computing system **800** overall from a general-purpose computing system into a special-purpose computing system customized to facilitate simulating machines used in industrial automation as described herein for each implementation. Software **805** may also transform the physical structure of storage system **803**. The specific transformation of the physical structure may depend on various factors in different implementations of this description. Examples of such factors may include, but are not limited to, the technology used to implement the storage media of storage system **803**, whether the computer-storage media are characterized as primary or secondary storage, and the like. For example, if the computer-storage media are implemented as semiconductor-based memory, software **805** may transform the physical state of the semiconductor memory when the software is encoded therein. For example, software **805** may transform the state of transistors, capacitors, or other discrete circuit elements constituting the semiconductor memory. A similar transformation may occur with respect to magnetic or optical media. Other transformations of physical media are possible without departing from the scope of the present description, with the foregoing examples provided only to facilitate this discussion.

[0069] Communication interface **807** may include communication connections and devices that allow for communication between computing system **800** and other computing systems (not shown) or services, over a communication network or collection of networks. Examples of connections and devices that together allow for inter-system communication may include network interface cards, antennas, power amplifiers, RF circuitry, transceivers, and other communication circuitry. The aforementioned network, connections, and devices are well known and need not be discussed at length here.

[0070] User interface **809** may include a voice input device, a touch input device for receiving a gesture from a user, a motion input device for detecting non-touch gestures and other motions by a user, and other comparable input devices and associated processing elements capable of receiving user input from a user. Output devices such as a display system, speakers, haptic devices, and other types of output devices may also be included in user interface **809**. The aforementioned user input devices are well known in the art and need

not be discussed at length here. User interface **809** may also include associated user interface software executable by processing system **801** in support of the various user input and output devices discussed above. Separately or in conjunction with each other and other hardware and software elements, the user interface software and devices may provide a graphical user interface, a natural user interface, or any other kind of user interface.

[0071] The functional block diagrams, operational sequences, and flow diagrams provided in the Figures are representative of exemplary architectures, environments, and methodologies for performing novel aspects of the disclosure. While, for purposes of simplicity of explanation, methods included herein may be in the form of a functional diagram, operational sequence, or flow diagram, and may be described as a series of acts, it is to be understood and appreciated that the methods are not limited by the order of acts, as some acts may, in accordance therewith, occur in a different order and/or concurrently with other acts from that shown and described herein. For example, those skilled in the art will understand and appreciate that a method could alternatively be represented as a series of interrelated states or events, such as in a state diagram. Moreover, not all acts illustrated in a methodology may be required for a novel implementation.

[0072] The above description and associated drawings teach the best mode of the invention. The following claims specify the scope of the invention. Some aspects of the best mode may not fall within the scope of the invention as specified by the claims. Also, while the preceding discussion describes embodiments employed specifically in conjunction with the monitoring and analysis of industrial processes, other applications, such as the mathematical modeling or monitoring of any man-made or naturally-existing system, may benefit from use of the concepts discussed above. Further, those skilled in the art will appreciate that the features described above can be combined in various ways to form multiple variations of the invention. As a result, the invention is not limited to the specific embodiments described above, but only by the following claims and their equivalents.

What is claimed is:

1. One or more computer-readable storage media having program instructions stored thereon to facilitate simulating machines used in industrial automation, wherein the program instructions, when executed by a computing system, direct the computing system to at least:

utilize an application programming interface (API) to apply timestamps to data exchanged between a simulation model created in a simulation application and an industrial controller system external to the simulation model; and

process the timestamps to synchronize the simulation model and the industrial controller system.

2. The one or more computer-readable storage media of claim 1 wherein, to process the timestamps to synchronize the simulation model and the industrial controller system, the program instructions direct the computing system to provide a periodic clock pulse to the simulation model and the industrial controller system to advance the simulation model and the industrial controller system ahead one time step.

3. The one or more computer-readable storage media of claim 1 wherein, to process the timestamps to synchronize the simulation model and the industrial controller system, the program instructions direct the computing system to coordi-

nate signal transmission intervals of the simulation model and the industrial controller system using the time stamps.

4. The one or more computer-readable storage media of claim 1 wherein the data exchanged between the simulation model and the industrial controller system comprises control signals transferred from the industrial controller system to the simulation model.

5. The one or more computer-readable storage media of claim 1 wherein the simulation model comprises definitions for a virtual representation of at least a portion of a machine used in an industrial automation environment.

6. The one or more computer-readable storage media of claim 5 wherein the simulation model utilizes the data to generate an animated visualization of the machine.

7. The one or more computer-readable storage media of claim 1 wherein the industrial controller system comprises an emulated industrial controller implemented in software.

8. A method of operating a computing system to facilitate simulating machines used in industrial automation, the method comprising:

utilizing an application programming interface (API) to apply timestamps to data exchanged between a simulation model created in a simulation application and an industrial controller system external to the simulation model; and

processing the timestamps to synchronize the simulation model and the industrial controller system.

9. The method of claim 8 wherein processing the timestamps to synchronize the simulation model and the industrial controller system comprises providing a periodic clock pulse to the simulation model and the industrial controller system to advance the simulation model and the industrial controller system ahead one time step.

10. The method of claim 8 wherein processing the timestamps to synchronize the simulation model and the industrial controller system comprises coordinating signal transmission intervals of the simulation model and the industrial controller system using the timestamps.

11. The method of claim 8 wherein the data exchanged between the simulation model and the industrial controller system comprises control signals transferred from the industrial controller system to the simulation model.

12. The method of claim 8 wherein the simulation model comprises definitions for a virtual representation of at least a portion of a machine used in an industrial automation environment.

13. The method of claim 12 wherein the simulation model utilizes the data to generate an animated visualization of the machine.

14. The method of claim 8 wherein the industrial controller system comprises an emulated industrial controller implemented in software.

15. A computer apparatus to operate a computing system to facilitate simulating machines used in industrial automation, the apparatus comprising:

software instructions configured, when executed by the computing system, to direct the computing system to utilize an application programming interface (API) to apply timestamps to data exchanged between a simulation model created in a simulation application and an industrial controller system outside of the simulation model, and process the timestamps to synchronize the simulation model and the industrial controller system, wherein the simulation model comprises definitions for

a virtual representation of at least a portion of a machine used in an industrial automation environment and wherein the simulation model utilizes the data to generate an animated visualization of the machine; and at least one non-transitory computer-readable storage medium storing the software instructions.

16. The computer apparatus of claim **15** wherein the software instructions configured to direct the computing system to process the timestamps to synchronize the simulation model and the industrial controller system comprises the software instructions configured to direct the computing system to provide a periodic clock pulse to the simulation model and the industrial controller system to advance the simulation model and the industrial controller system ahead one time step.

17. The computer apparatus of claim **15** wherein the software instructions configured to direct the computing system

to process the timestamps to synchronize the simulation model and the industrial controller system comprises the software instructions configured to direct the computing system to coordinate signal transmission intervals of the simulation model and the industrial controller system using the timestamps.

18. The computer apparatus of claim **17** wherein the signal transmission intervals of the simulation model and the industrial controller system are different rates.

19. The computer apparatus of claim **15** wherein the data exchanged between the simulation model and the industrial controller system comprises control signals transferred from the industrial controller system to the simulation model.

20. The computer apparatus of claim **15** wherein the industrial controller system comprises an emulated industrial controller implemented in software.

* * * * *