



(51) International Patent Classification:

*H01F 27/14* (2006.01)    *H02H 5/04* (2006.01)  
*H02H 7/04* (2006.01)    *G01M 3/02* (2006.01)  
*H02H 5/08* (2006.01)

(21) International Application Number:

PCT/BR2010/000422

(22) International Filing Date:

20 December 2010 (20.12.2010)

(25) Filing Language:

English

(26) Publication Language:

English

(30) Priority Data:

US 12/649,741 30 December 2009 (30.12.2009)    US

(72) Inventor; and

(71) Applicant : **SANTOS, Eduardo Pedrosa** [BR/BR];  
Praça Claudino Alves, 141 - Centro, Atibaia - SP, Brasil,  
Cep: 12.940-800 (BR).

(74) Agent: **VILAGE MARCAS E PATENTES LTDA.;**

Rua XV de Novembro, 3171 - 16º andar, conj. 161. Centro.,  
Sao Jose do Rio Preto - SP, Brasil, CEP: 15.015-110  
(BR).

(81) Designated States (unless otherwise indicated, for every

kind of national protection available): AE, AG, AL, AM, AO, AT, AU, AZ, BA, BB, BG, BH, BR, BW, BY, BZ, CA, CH, CL, CN, CO, CR, CU, CZ, DE, DK, DM, DO, DZ, EC, EE, EG, ES, FI, GB, GD, GE, GH, GM, GT, HN, HR, HU, ID, IL, IN, IS, JP, KE, KG, KM, KN, KP, KR, KZ, LA, LC, LK, LR, LS, LT, LU, LY, MA, MD, ME, MG, MK, MN, MW, MX, MY, MZ, NA, NG, NI, NO, NZ, OM, PE, PG, PH, PL, PT, RO, RS, RU, SC, SD, SE, SG, SK, SL, SM, ST, SV, SY, TH, TJ, TM, TN, TR, TT, TZ, UA, UG, US, UZ, VC, VN, ZA, ZM, ZW.

(84) Designated States (unless otherwise indicated, for every


kind of regional protection available): ARIPO (BW, GH, GM, KE, LR, LS, MW, MZ, NA, SD, SL, SZ, TZ, UG, ZM, ZW), Eurasian (AM, AZ, BY, KG, KZ, MD, RU, TJ, TM), European (AL, AT, BE, BG, CH, CY, CZ, DE, DK, EE, ES, FI, FR, GB, GR, HR, HU, IE, IS, IT, LT, LU, LV, MC, MK, MT, NL, NO, PL, PT, RO, RS, SE, SI, SK, SM, TR), OAPI (BF, BJ, CF, CG, CI, CM, GA, GN, GQ, GW, ML, MR, NE, SN, TD, TG).

Published:

— with international search report (Art. 21(3))

(54) Title: SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR.

FIG 1

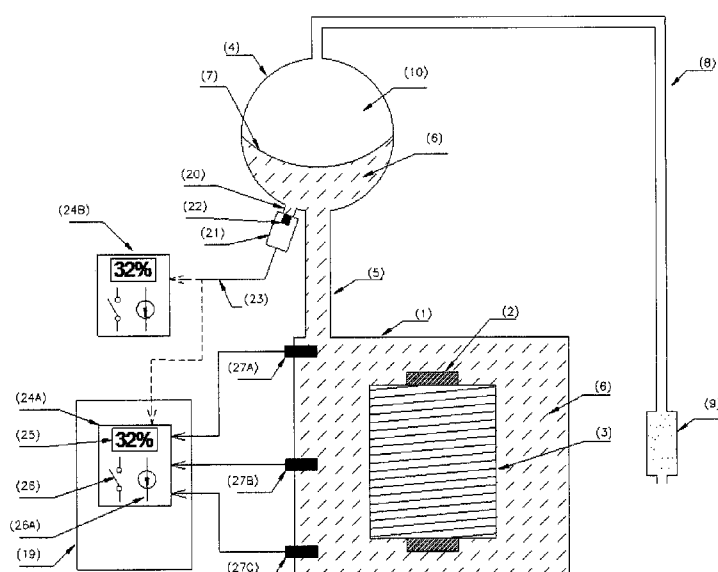

(57) Abstract: System for monitoring oil level and detecting leaks in power transformers, reactors, current and potential transformers, high voltage bushings and similar, notably for a system that through the use of sensors and other electronic components measures and monitors transformers and similar equipment in real time, filled with insulating oil, with greater precision and without need for floats or mobile mechanical parts, while presenting countless facilities in the sense of making level monitoring more reliable and safer, highlighting the level error calculations, oil leak detection alarm, excess oil detection alarm during the equipment filling process and calculation of tendencies of evolution for levels among other facilities.

**“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”**

5 **BRIEF PRESENTATION**

This petition for a patent is for an original **“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”**; namely a system that uses sensors and other electronic components to  
10 measure and monitor, in real time, transformers and similar equipment filled with insulating oil with greater precision and without any need for floats or other movable, mechanical parts, while also presenting countless facilities in terms of making level monitoring more reliable and safer, highlighting level error calculations, an alarm when detecting oil leaks, or detecting excess oil during the equipment filling process and the calculation of tendencies of evolution  
15 for levels, among other facilities.

**BRIEF INTRODUCTION**

Power transformers and reactors are pieces of equipment widely used in medium, high and extra-high voltage electric power generation, transmission and distribution systems. These devices frequently use for insulation and heat removal some type of oil, which  
20 can be mineral (petroleum byproduct), vegetal (from soy bean, sunflower or other) or silicon, for example.

Transformers and reactors have copper coils that are wrapped in paper. The entire active part – comprised of a core and coils – is then immersed in insulating oil to impregnate the paper and thus ensure the electric isolation of the assembly, and to cool the  
25 coils with the oil circulating in heat radiators.

Thus, for safe operation of the equipment, it is essential for the active part to be permanently immersed in insulating oil. However, temperature variations during equipment operation due to variations in ambient temperature and heating caused by the electric current, make the oil dilate and contract, thus making its volume vary and increasing and reducing oil  
30 level.

In order to guarantee the active part is permanently immersed in insulating oil during all operating conditions, the transformer or reactor is equipped with an oil expansion

tank, also called a conservation tank, installed above the equipment's main tank and connected to it by piping. The function of the conservation tank is to provide room for the oil level to vary in its interior, rising with increases in temperature and falling with decreases. The volume of the conservation tank is calculated in such a manner that the main tank, where the active part is located, will always be completely full of oil, even at the lowest temperatures, and the oil will never overflow, even at the highest expected temperatures.

Therefore, given the importance of oil level for safe operation of the equipment, it is necessary to continuously measure it in order to readily detect any level lower than minimum tolerances, thus preventing a short circuit due to lack of oil in the active part, and to warn of environmental contamination with oil due to eventual leaking. Likewise, measuring the oil level permits detecting higher than expected levels due to filling equipment with excess oil; for example, warning of overflow risks and contamination of the environment.

In modern transformers and reactors, the expansion tank is also equipped with a rubber membrane or bag that impedes the oil's direct contact with the air; however, without impeding any variation in oil level, since the membrane or bag is flexible, rising and falling in accordance with the oil level. The upper part of the rubber membrane or bag is in contact with the external environment through air piping and an air dehumidifying mechanism. This avoids pressure or vacuum in the equipment tank due to expansion or contraction of oil.

### **STATE OF THE ART**

In the current state of the art, the oil level measuring system is comprised of an oil level indicator that operates using a float located in the lower part of the rubber membrane or bag, so that the float rises and falls accompanying the movement of the membrane or bag, which in turn accompanies the increase or reduction in oil level. The float is coupled to an oil level indicator by a rod that moves a mechanism, which in turn activates the pointer, indicating current oil level at a graduated scale.

This arrangement can be observed for example in US Patents 7,191,648 and 6,708,562.

When the oil level reaches critical conditions, such as low, very low, high or very high levels, movement of the mechanism closes one or more electrical contacts, which are used to activate a visual or sonorous alarm in the installation control room.

The state of the art for the oil level indication system presents some disadvantages observed in practice, which are:

☐ Because it is a mechanically activated system, it is subject to mechanical failures such as jamming of the mechanism;

☐ In order to prevent mechanical failures, it is necessary to have preventive maintenance for lubrication, for example;

5 ☐ With the up and down movement of the oil level, the rubber of the membrane or bag may present undulations or folds in which the float may get caught, leading to the imprecise indication of oil level;

☐ In extreme cases, the above described fact may cause the float and/or its rod to perforate the membrane or bag, putting the oil in contact with oxygen and humidity in the air  
10 and causing the accelerated aging of the isolation paper on the coils by oxidation and hydrolysis;

☐ Leak detection cannot be conducted immediately since the loss of oil to the environment may be masked by an increase in level due to temperature increases, so the alarm contacts for low levels will only be activated after a considerable volume of oil has been  
15 disposed of in nature;

☐ Likewise, detection of a transformer that has been overfilled with oil cannot be done immediately since the existence of excess oil can be masked by the reduction in oil level due to low temperatures when the transformer is shut off. Thus, the contacts will only be activated some time after the transformer has been energized, when the temperature rises, causing the  
20 forced shut down of the equipment for removal of oil or the leaking of excess oil into the environment.

### **OF THE NEW INVENTION**

Aware of the state of art, its inconveniences and limitations, the inventor, active in the segment of matters in hand, studies and research, created the “**SYSTEM FOR  
25 MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR**” in question, which makes the real time measuring and monitoring of oil levels in transformers and similar equipment filled with isolation oil more reliable and without the use of floats and mechanical parts, solving the  
30 current deficiencies amply referred to and illustrated in the state of the art.

### **ADVANTAGES OF THE INVENTION**

The oil monitoring system in question has the following advantages in relation to the state of the art:

- Since it does not have moving mechanical parts, problems associated with mechanical failure and maintenance needs are eliminated;
- Since it does not have a float or other parts in contact with the rubber membrane or bag, the risk of the level measuring system to damage or perforate those items is eliminated;
- Greater precision in measuring the oil level since it does not use a mechanical system;
- Able to integrate with other already existing protection or monitoring equipment in the transformer or reactor, such as the gas accumulation relay (buchholz relay) and temperature monitor, reducing costs and facilitating installation and maintenance;
- Improved monitoring of eventual oil leaks, permitting their detection even before the oil level reaches the minimum limit. It thus provides less risk of failure for the transformer or reactor and a reduction in environmental impact in case of a leak;
- Permits detecting excess filling of the transformer or reactor with oil, even if the oil level does not reach the maximum limit due to low temperature.

The invention will now be explained in detail through the drawings listed below:

Figure 1 – Schematic view of the newly invented monitoring system applied in a transformer;

Figure 2 – Schematic view of the newly invented monitoring system applied in a transformer with a gas accumulation relay attached;

Figure 3 – Schematic view of the newly invented monitoring system applied in a transformer with only one or two temperature sensors in the main tank;

Figure 4 – Electric diagram showing oil level measurement and indication without availability of auxiliary power supply.

### **DETAILED DESCRIPTION**

The “SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”, for measuring and monitoring insulating oil levels of transformers and similar equipment, using an oil level

monitor (24A, 24B) to which a pressure sensor (21), to measure internal oil column pressure (6), and a temperature sensor (22), arranged to measure oil temperature (6) in the expansion tank (4), are connected, so that the level monitor (24A, 24B) calculates oil column height, which corresponds to the oil level, from the oil pressure and takes into account the change in oil density with temperature, precisely indicating the oil level (6) on the display (25).

The system, as shown in Figure 1, is comprised of an electronic pressure sensor (21) installed in an access opening (20), which normally already exists in the lower part of the expansion tank (4) for draining. The sensor (21) measures oil pressure (6) at access opening (20) in relation to atmospheric pressure. Since the air (10) in the expansion tank (4) is also at atmospheric pressure, by means of the piping (8), the pressure measured by the sensor (21) equals the oil column pressure (6) in the expansion tank (4). Therefore, the measurement from the pressure sensor (21) is proportional to the oil level (6), which permits measuring the level without using floats or any mechanical parts.

The signals (23) from pressure (21) and temperature (22) sensor measurements are then taken to a level monitor (24A) located in the transformer control panel (19) or a level monitor (24B) located in the expansion tank (4), adjacent to the pressure and temperature sensors (21, 22), so that it can form a mechanical unit with them.

As shown in Figure 2, the gas relay (32), also called a Buchholz relay, is installed in the piping (5) that connects the transformer tank (1) and the expansion tank (4). The gas relay (32) permits oil (6) to pass through it, aimed at collecting eventual gas bubbles in the oil. Since the gas relay (32) is in direct contact with the oil (6) and is installed near the expansion tank (4), the oil level monitor (24C) can be integrated to the gas relay (32), with the pressure sensor (21) installed in the gas relay (32) and in contact with the oil, just like the temperature sensor (22).

With the information from the pressure (21) and oil temperature (22) sensors in the tank (4), the level monitor (24A, 24B) corrects the measured pressure value considering the change in oil (6) density with its temperature, thus obtaining the correct height of the oil column (6) and consequently, the exact level of oil (6), which is indicated on the display (25) of the level monitor (24A, 24B). The display (25) can show the oil level information in numerical as well as bar graph format to permit easy visualization from a distance.

The level monitor permits the user to program upper and lower limits for the oil level. If the level falls below the lower limit, the level monitor generates a low oil level alarm. Likewise, if the level goes above the upper limit, the level monitor generates a high oil level alarm. The alarms generated may activate one or more electrical alarm contacts (26) depending on the contact (26) selection programmed previously by the user for each of the alarms individually, which may be used by the user to activate a visual or sonorous alarm in the installation's control room (not represented).

As explained, the expansion and contraction of insulating oil occurs as a result of changes in temperature, so that, if there are no leaks, the oil level (6) in the expansion tank (4) will be determined by the oil temperature along the height of the transformer tank (1). Since oil temperature (6) changes at each different point along tank (1) height, the level monitoring system described has several temperature sensors (27A, 27B, 27C), in various numbers, distributed along tank (1) height, which are connected to oil level monitor inputs (24A, 24B). Using these temperature measurements, the level monitor (24A, 24B) calculates temperature distribution along the entire transformer tank (1), even in locations where no temperature sensors have been installed, through interpolation and/or extrapolation, using mathematical functions that can be selected from among linear, polynomial and exponential types, among others. With the distribution of temperatures along the tank (1), the level monitor (24A, 24B) calculates oil expansion or contraction (6) along the tank (1), thus obtaining the expected oil level in the expansion tank (4).

Since the installation of a large number of oil temperature sensors (27A, 27B, 27C) along the transformer tank (1) may not be feasible in practice, the level monitor (24A, 24B) permits the installation of only 2 oil temperature sensors at different heights of the tank (1), then calculates the temperatures at the intermediate heights between sensors by interpolation and calculates the temperatures above the highest sensor (27A) and below the lowest sensor (27C) by extrapolation. The mathematical functions of interpolation and extrapolation used by the level monitor may be selected from among the linear, polynomial and exponential types, among others.

In applications where only one temperature sensor (27A) is available at the top of transformer tank oil (1), as shown in Figure 3, the level monitor (24A) can calculate the temperature at the bottom of the tank (1) by measuring the temperature of the available sensor (27A), of the current that circulates through the transformer, measured by a current transformer

(31), and characteristics the transformer cooling system radiators (28), thus obtaining a “virtual temperature sensor” (27V) for the bottom of the tank (1). With the information from the real temperature sensor (27A) and the “virtual sensor” (27V), the already described mathematics interpolation processes can be used to interpolate and extrapolate temperatures along tank height (1). This possibility is especially interesting when considering that oil temperature measurement (27A) at the top of the tank (1) and from the current transformer (31) are already available in temperature monitors (29) that normally equip power transformers, which permits the integration of oil level monitor (24A) and transformer temperature monitor (29) functions in the same monitoring system.

The oil level monitor (24A, 24B) then calculates the difference between the real oil level, obtained from pressure (21) and temperature (22) sensors, and expected oil level, calculated from temperature sensors (27A, 27B, 27C) in the tank (1), with the difference called Level Error. The level monitor permits the user to program upper and lower limits for the Level Error. If the Level Error falls below the lower limit, the level monitor generates a low oil level alarm. Likewise, if the Error Level goes above the upper limit, the level monitor generates a high oil level alarm. The alarms generated may activate one or more electrical alarm contact (26) depending on the contact (26) selection programmed previously by the user for each of the alarms individually.

Given that the Level Error is subject to oscillations over time, caused by imprecision inherent to sensors (21, 22, 27A, 27B, 27C), the level monitor calculates the Level Error’s average in a moving window with a time frame that can be adjusted by the user. The result is called Average Level Error. The level monitor permits the user to program upper and lower limits for the Average Level Error. If the Average Level Error falls below the lower limit, the level monitor generates a low oil level alarm. Likewise, if the Average Error Level goes above the upper limit, the level monitor generates a high oil level alarm. The alarms generated may activate one or more electrical alarm contact (26) depending on the contact (26) selection programmed previously by the user for each of the alarms individually.

Alternatively, with the temperature distribution along the tank (1) height, obtained from the interpolation and extrapolation processes described above, the level monitor (24A, 24B) continuously calculates the oil level in the expansion tank (4) if the oil is at a uniform temperature, equal to a reference temperature scheduled by the user, such as 25°C, and where this result is called the Standardized Level. The level monitor permits the user to

program upper and lower limits for the Standardized Level. If the Standardized Level falls below the lower limit, the level monitor generates a low oil level alarm. Likewise, if the Standardized Level goes above the upper limit, the level monitor generates a high oil level alarm. The alarms generated may activate one or more electrical alarm contact (26) depending on the contact (26) selection programmed previously by the user for each of the alarms individually.

Given that the Standardized Level is subject to oscillations over time, caused by imprecision inherent to sensors (21, 22, 27A, 27B, 27C), the level monitor calculates the Standardized Level's average in a moving window with a time frame that can be adjusted by the user. The result is called the Average Standardized Level. The level monitor permits the user to program upper and lower limits for the Average Standardized Level. If the Average Standardized Level falls below the lower limit, the level monitor generates a low oil level alarm. Likewise, if the Average Standardized Level goes above the upper limit, the level monitor generates a high oil level alarm. The alarms generated may activate one or more electrical alarm contact (26) depending on the contact (26) selection programmed previously by the user for each of the alarms individually.

Since one of the main purposes of a level monitoring system is to detect oil loss from leaks into the environment, and considering that leaks with little oil flow may persist over a long time before any of the aforementioned alarm limits are reached, the level monitor (24A, 24B) calculates the tendencies of evolution by unit of time for the Level Error, Average Level Error, Standardized Level and Average Standardized Level parameters. From the calculated tendencies of evolution, and supposing that the same remain constant, the level monitor (24A, 25B) calculates the number of days left for each of these parameters to reach their own lower limit. The level monitor permits the user to program a lower limit, in days, for the number of calculated days remaining. If any of these is less than or equal to the programmed limit, the level monitor (24A, 24B) generates an alarm by tendency or reduction in the oil level, which activates one or more electrical contacts (26) according to the selection of contacts (26) previously programmed by the user for each of the alarms individually.

In order to permit the remote indication of Oil Level, Error Level, Average Error Level, Standardized Level and Average Standardized Level information, as well as tendencies of evolution in these same parameters in the installation's control room or SCADA type supervisory systems, the level monitor (24A, 24B) has analog outputs (26A). These analog

outputs (26A) can adopt a current output standard, such as 0 to 1 mA; 0 to 5mA; 4 to 20mA or others, or a standard voltage standard, such as 0 to 1V; 0 to 5V; 0 to 10V or others. The starting and ending values for analog output scales (26A) can be programmed by the user, according to the variable being indicated by the output; for example, if the output is 4 to 20mA and it is  
5 indicating oil level, the beginning of the scale can correspond to a level of 0%, generating a 4mA signal at the output, and the end of the scale can correspond to a level of 100%, generating a signal of 20mA at the output.

In certain situations, it may be necessary for oil level measurement and indication to be available without any auxiliary power voltage (40) available for the level  
10 monitor (24A, 24B). This is the case, for example, during the transformer filling process with oil, when the electrical connections that would take power to the level monitor (24A, 24B) are not yet available. In order to permit operation in this situation, as shown in Figure 4, the level monitor (24A) is equipped with an energy accumulator device (33) that may be a battery, a supercapacitor or other, with sufficient charge to operate the pressure (21) and temperature (22)  
15 sensors, as well as the reading circuits for these sensors (34), the microcontroller (35) and display (25). In order to maximize the duration of the energy accumulated in the accumulator device (33), the level monitor (24A) normally remains turned off and out of operation.

Whenever it is necessary to measure the level, the user can request the measurement by activating the button (36) on the level monitor (24A). By activating the button  
20 (36) a timing circuit is triggered (37) that sends power to the sensors (21, 22), the reading circuit (34), the microcontroller (35) and the display (25) for just enough time for the user to make the reading, automatically turning off these same elements after just a few seconds. The accumulator (33) is dimensioned so that it has sufficient energy for a large number of readings, and for enough time so that auxiliary power can be brought by cables to the level monitor  
25 (24A).

However, there are applications where the level monitor is installed out of user reach, along ground level, as shown in Figures 1 and 2, in which the level monitor (24B, 24C) is near the expansion tank (4) or integrated to the gas relay (32). As shown in Figure 4, for these applications, the activation button (36A) can be installed separately from the level  
30 monitor (24A), so that it can be reached by the user at the ground level.

Alternatively, the level monitor (24A) can be equipped with a device for remote activation, without contact, consisting of a photo-detector (38) installed and pointing in the

direction of the ground, so that when excited by a beam of light sent by the user, by means of a flashlight, for example, it sends an electric signal to the timing circuit (37), which then begins to operate in an identical manner as when activated by the button (36). In order to avoid improper activation, a light filter (39) is installed in front of the photo-detector (38), in a  
5 manner that permits the photo-detector (38) to be excited only by light of a predetermined wavelength, such as infrared, for example, and blocking out all other wavelengths.

Other remote activation systems, without contact, can be employed in replacement of the photo-detector (38), such as audible or inaudible sounds, radiofrequency waves, laser beams, visible or invisible light or others, which will operate in a similar manner,  
10 allowing the user to send a request from a distance.

## CLAIMS

- 1) **“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”**, characterized by an oil level monitor (24A, 24B) to which a pressure sensor (21), installed at an access opening (20) in the lower part of the expansion tank (4) to measure internal oil (6) column pressure, and a temperature sensor (22), arranged in a manner to measure oil (6) temperature in the tank (4) are connected; the level monitor (24A, 24B) calculates oil column height, which corresponds to oil level, from the oil pressure and taking into account the change in oil density with temperature, obtaining a precise oil level (6) measurement and indicating it on the display (25); the level monitor (24A, 24B) generates a low oil level alarm when the programmed lower limit is reached or a high oil level alarm when the upper programmed limit has been reached.
- 2) **“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”**, according to claim 1 characterized by the level monitor (24A, 24B) to present oil level information on a display (25), in numerical as well as bar graph format to permit easy visualization from a distance.
- 3) **“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”**, according to claim 1 characterized by installation of a pressure sensor (21) and a temperature sensor (22) that can be done in the gas accumulation relay (32), in contact with the oil (6), permitting integration of the oil level monitor (24C) and gas relay (32) functions in the same system.
- 4) **“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”**, according to claims 1 and 3 characterized by permitting the option to use the level monitor (24A) in the transformer’s control panel (19), or the level monitor (24B) in the expansion tank (4), adjacent to the pressure (21) and temperature (22) sensors, forming a mechanical unit with them, or using the level monitor (24C) integrated to the gas relay (32).

5) **“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”**, according to claims 1 and 4 characterized by the oil level monitor (24A, 24B) having inputs to connect several temperature sensors (27A, 27B, 27C) distributed along the height of the transformer tank (1) and using these temperature measurements calculate the distribution of temperatures along the entire transformer tank (1) by interpolation and/or extrapolation; with the distribution of temperatures along the tank (1), the level monitor (24A, 24B) calculates the expansion or contraction of the oil (6) along the tank (1), thus obtaining the expected oil level in the expansion tank (4).

6) **“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”**, according to claim 5 characterized by using the expected oil, the oil level monitor (24A, 24B) can then calculate the Level Error by the difference between the real oil level and the expected oil level, generating a low oil level alarm if the Level Error is less than the lowest programmed limit, or a high oil level alarm if the Level Error is greater than the programmed upper limit.

7) **“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”**, according to claim 5 and 6 characterized by the oil level monitor (6, 24A) which can calculate the Average Level Error by a moving window average of the Level Error in a window of time that can be adjusted by the user, generating a low oil level alarm if the Average Level Error is less than the lowest programmed limit, or a high oil level alarm if the Average Level Error is greater than the programmed upper limit.

8) **“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”** according to claim 5 characterized by the oil level monitor (24A, 24B) permitting the installation of only two oil temperature sensors at different heights of the tank (1), then calculating the temperatures at the intermediate heights between the sensors using interpolation and calculating the temperatures above the upper sensor (27A) and below the lower sensor (27C) by extrapolation.

9) **“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”** according to claims

5 5 and 8 characterized by the oil level monitor (24A, 24B) permitting the installation of just one temperature sensor (27A) at the top of the transformer tank (1) and calculating the temperature at the bottom of the tank (1) by measuring the temperature of the available sensor (27A), of the current that flows through the transformer, measured using a current transformer (31), and the characteristics of the radiators (28) in the transformer's cooling system, thus obtaining a virtual  
10 temperature sensor (27V) at the lower part of the tank (1); with the information from the real (27A) and virtual (27V) temperature sensors the already described mathematical interpolation processes are used to interpolate and extrapolate the temperatures along the height of the tank (1).

10) **“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”** according to claim  
15 9 characterized by the oil level monitor (24A, 24B) to be able to be integrated with the temperature monitor (29) in order to use the information from the same oil temperature sensor (27A) at the top of the tank (1) and the same current transformer (31), permitting the  
20 integration of oil level monitor (24A) and transformer temperature monitor (29) functions in the same monitoring system (30).

11) **“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”** according to claim  
25 5 characterized by the oil level monitor (24A, 24B) using the temperature distribution along the height of the tank (1) continuously calculate the Standardized Level, which corresponds to the oil level that would exist in the expansion tank (4) if the oil was at a uniform temperature and equal to the reference temperature programmed by the user, generating a low oil level alarm if the Standardized Level is less than the lowest programmed limit, or a high oil level alarm if the  
30 Standardized Level is higher than the highest programmed limit.

12) **“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL**

**TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR**", according to claim 11, and characterized by the oil level monitor (24A, 24B) calculate the Average Standardized Level by a moving window average of the Standardized Level in a window of time that can be adjusted by the user, generating a low oil level alarm if the Average Standardized Level is less than the lowest programmed limit, or a high oil level alarm if the Average Standardized Level is higher than the programmed upper limit.

13) **"SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR"** according to claims

5, 6, 11 and 12 characterized by the oil level monitor (24A, 24B) calculate the tendencies for evolution by unit of time for the Level Error, Average Level Error, Standardized Level and Average Standardized Level parameters, and using these tendencies of evolution calculate the number of days remaining for each of these parameters to reach their own lower limit; the level monitor (24A, 24B) permits programming a lower limit, in days, for the number of days remaining calculated by the tendencies of evolution, generating an alarm for a tendency for reduction in oil level if any of the days remaining is less than or equal to the minimum limit.

14) **"SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR"** according to claims

1, 5, 6, 11, 12 and 13 characterized by the oil level monitor (24A, 24B) permit selecting which electric contacts (26) should be activated when there is an incident involving low oil level, high oil level or tendency for reduction in oil level alarms, and where this programming is done individually for each of the alarms listed.

15) **"SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR"** according to claims

1, 5, 6, 11, 12 and 13 characterized by the oil level monitor (24A, 24B) permit selecting which parameters from among the Oil Level, Level Error, Average Level Error, Standardized Level and Average Standardized Level options, as well as the tendencies for evolution of these same parameters, will be indicated for each of the analog outputs (26A); the oil level monitor (24A, 24B) allowing the programming of beginning and end of scale values for the analog outputs (26A), according to the parameter being indicated by the output.

16) **“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”** according to claim 1 characterized by the oil level monitor (24A, 24B), be equipped with an energy accumulator device (33), which may be a battery, a supercapacitor or other, with sufficient charge to permit the operation of pressure (21) and temperature (22) sensors, as well as the reading circuits for these sensors (34), for the microcontroller (35) and for the display (25), enabling the oil level measurement and indication to be available when the level monitor (24A, 24B) is without auxiliary power voltage (40).

17) **“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”** according to claim 16 characterized by the level monitor (24A) normally remain turned off and out of operation in order to maximize the duration of accumulated energy in the accumulator device (33), where the user can request a measurement of the level whenever necessary by activating a button (36) in the level monitor (24A); when this button (36) is activated it triggers a timing circuit (37), that sends power to the sensors (21, 22), the reading circuit (34), the microcontroller (35) and the display (25) just long enough for the reading to be made by the user, turning off these same elements automatically after a few seconds; the accumulator (33) is dimensioned so that its energy will be sufficient for a large number of level monitor readings (24A).

18) **“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”** according to claims 16 and 17 characterized by the activation button (36A) be able to be installed separately from the level monitor (24A), in a location that can be reached by the user at ground level.

19) **“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”** according to claims 16 and 17 characterized by the level monitor (24A) have a photo-detector (38) that points towards the ground, so that when excited by a beam of light sent by the user, it sends an electric signal to the timing circuit (37), which then begins to operate in an identical manner as when the button is activated (36), permitting remote activation, without contact.

20) **“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”** according to claims 16, 17 and 19 characterized by a light filter (39) to be installed in front of the photo-detector (38), that permits the photo-detector (38) to be hit only by light of a predetermined wavelength and blocking the passage of other wavelengths, thus avoiding improper activations of the timer (37).

21) **“SYSTEM FOR MONITORING OIL LEVEL AND DETECTING LEAKS IN POWER TRANSFORMERS, REACTORS, CURRENT AND POTENTIAL TRANSFORMERS, HIGH VOLTAGE BUSHINGS AND SIMILAR”** according to claims 16, 17, 19 and 20 characterized by permitting employment of other remote, no contact, activation systems to replace the photo-detector (38), including audible or inaudible sounds, radiofrequency waves, laser beams, visible or invisible light, among others, which will operate in a similar manner, permitting the user to send a request from a distance.

FIG 1

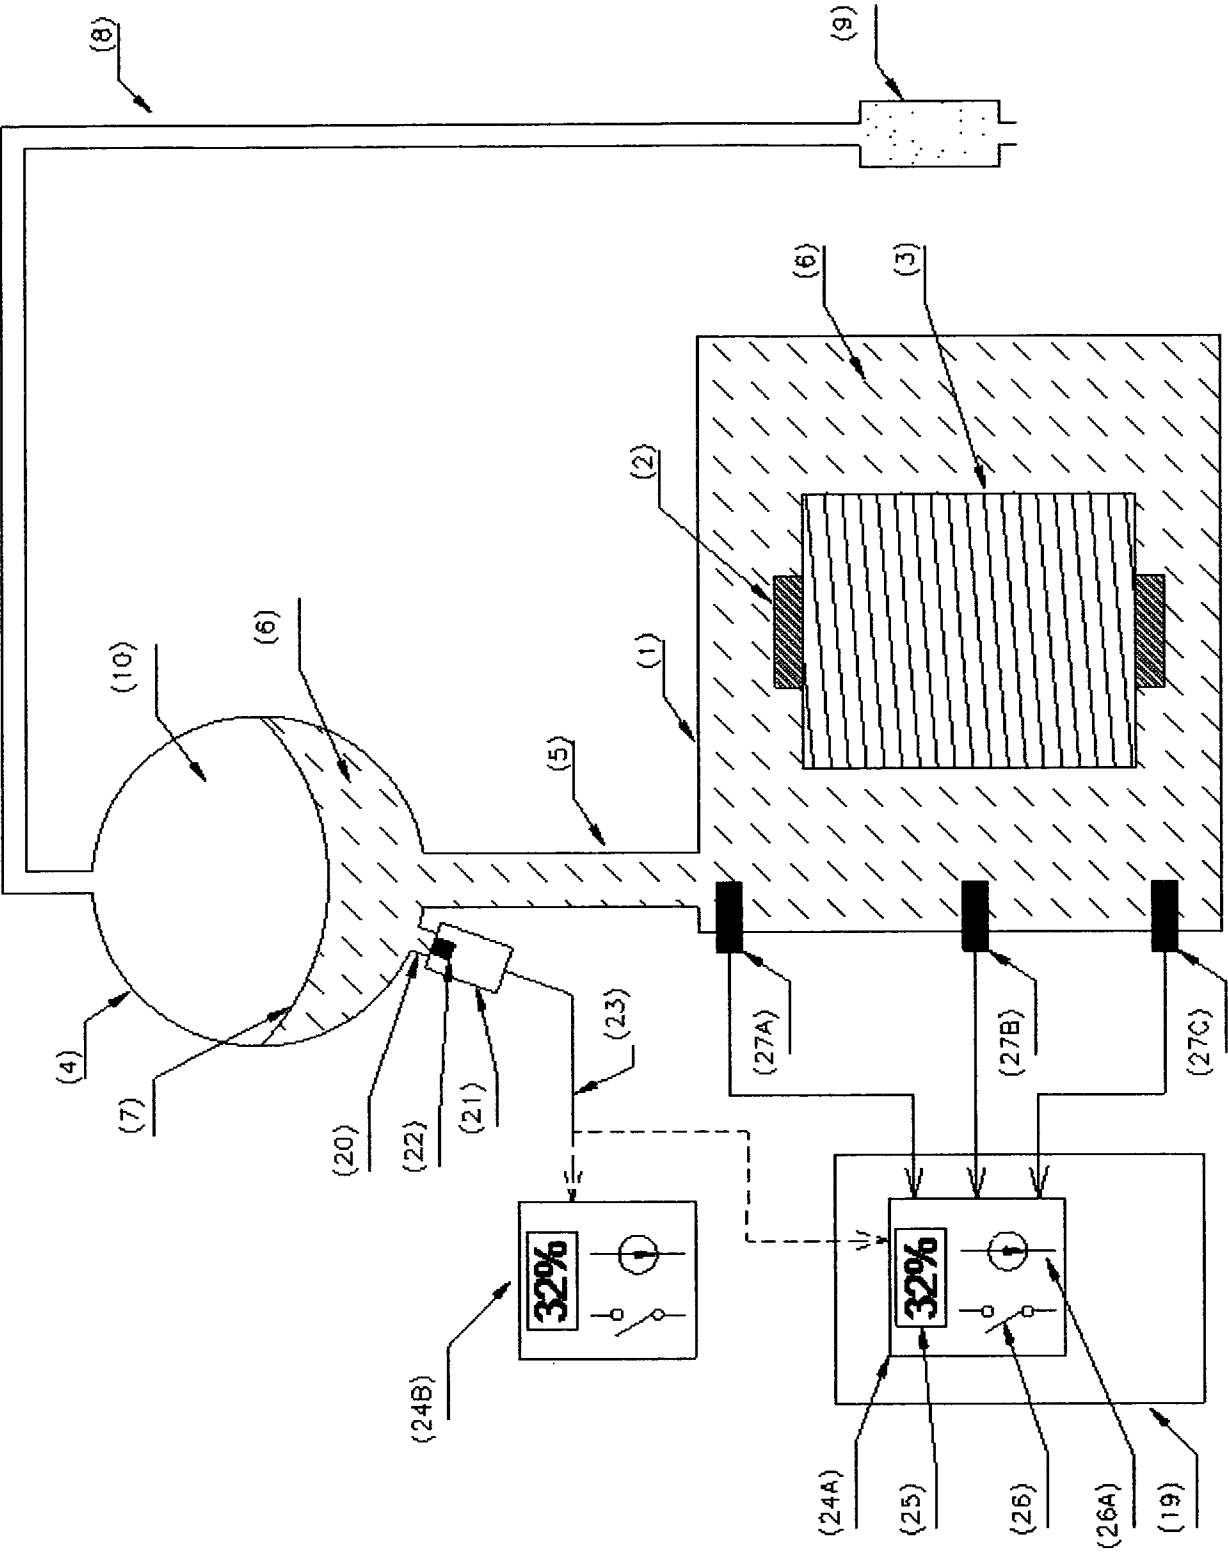


FIG 2

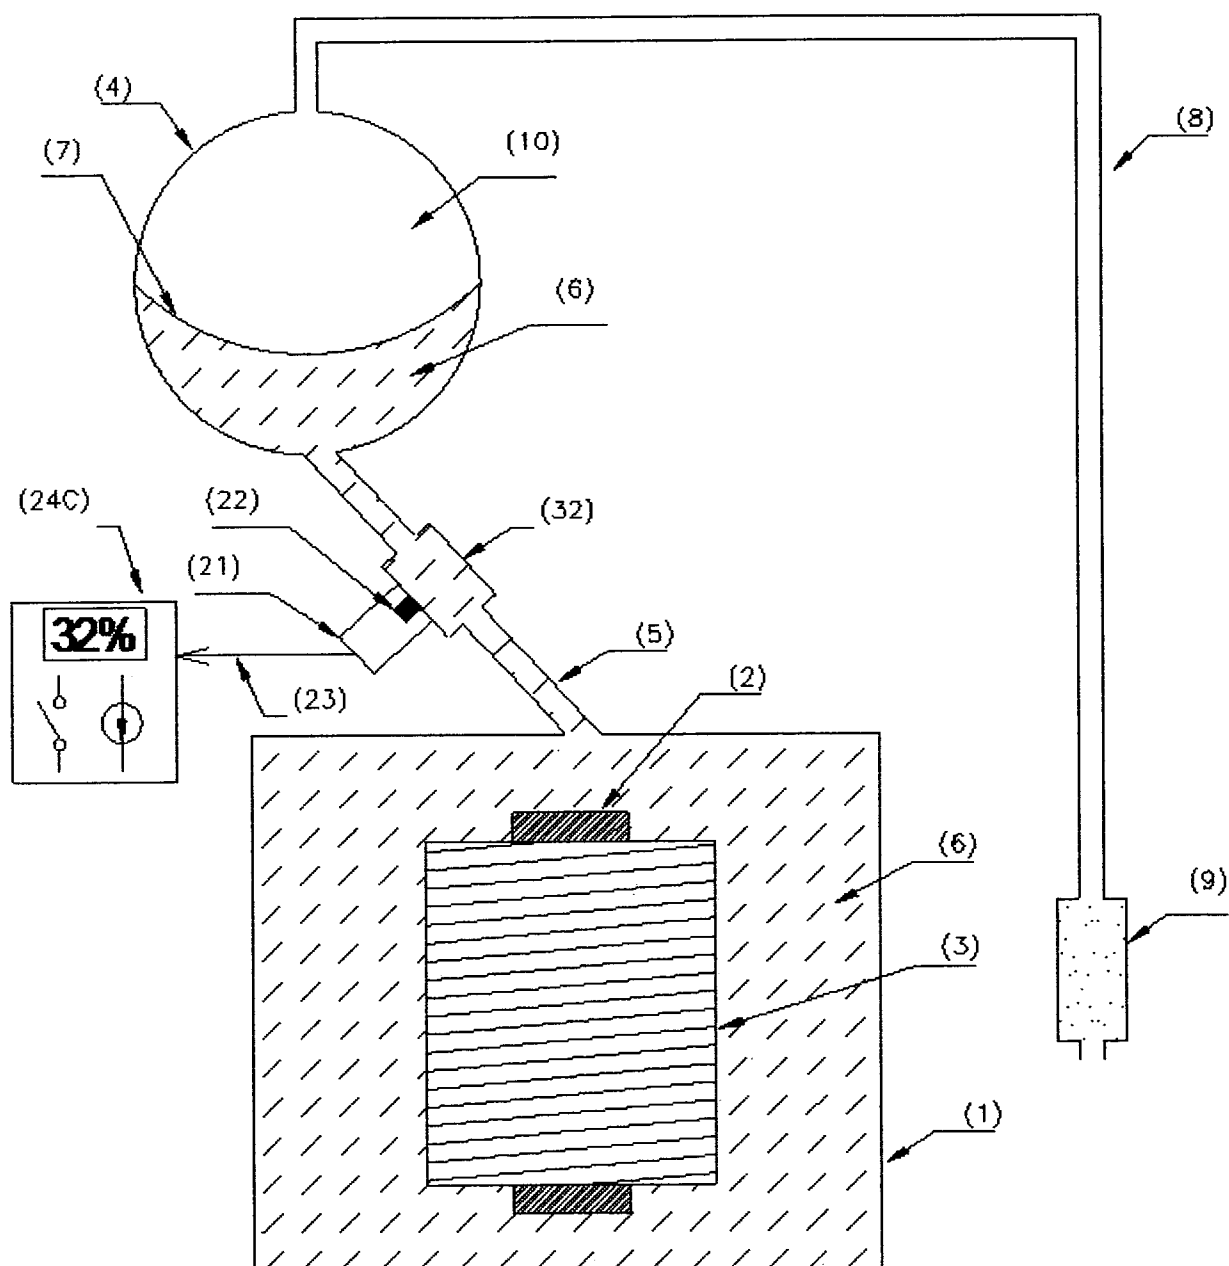


FIG 3


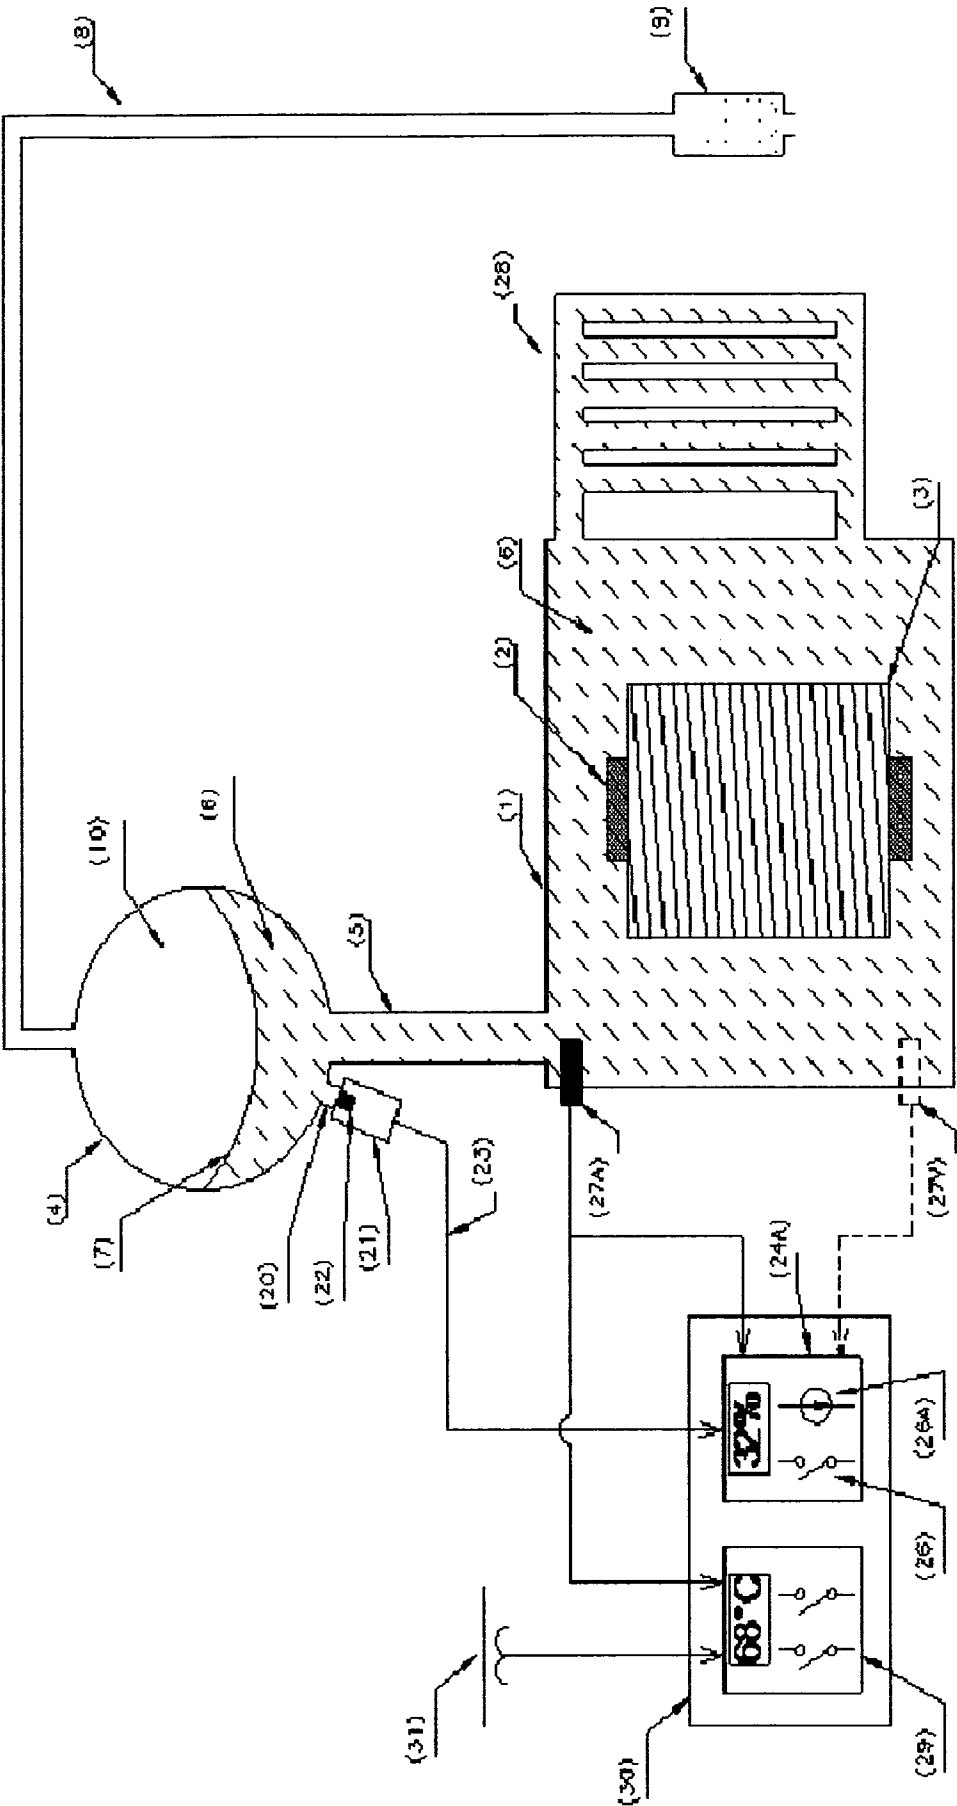


FIG 4

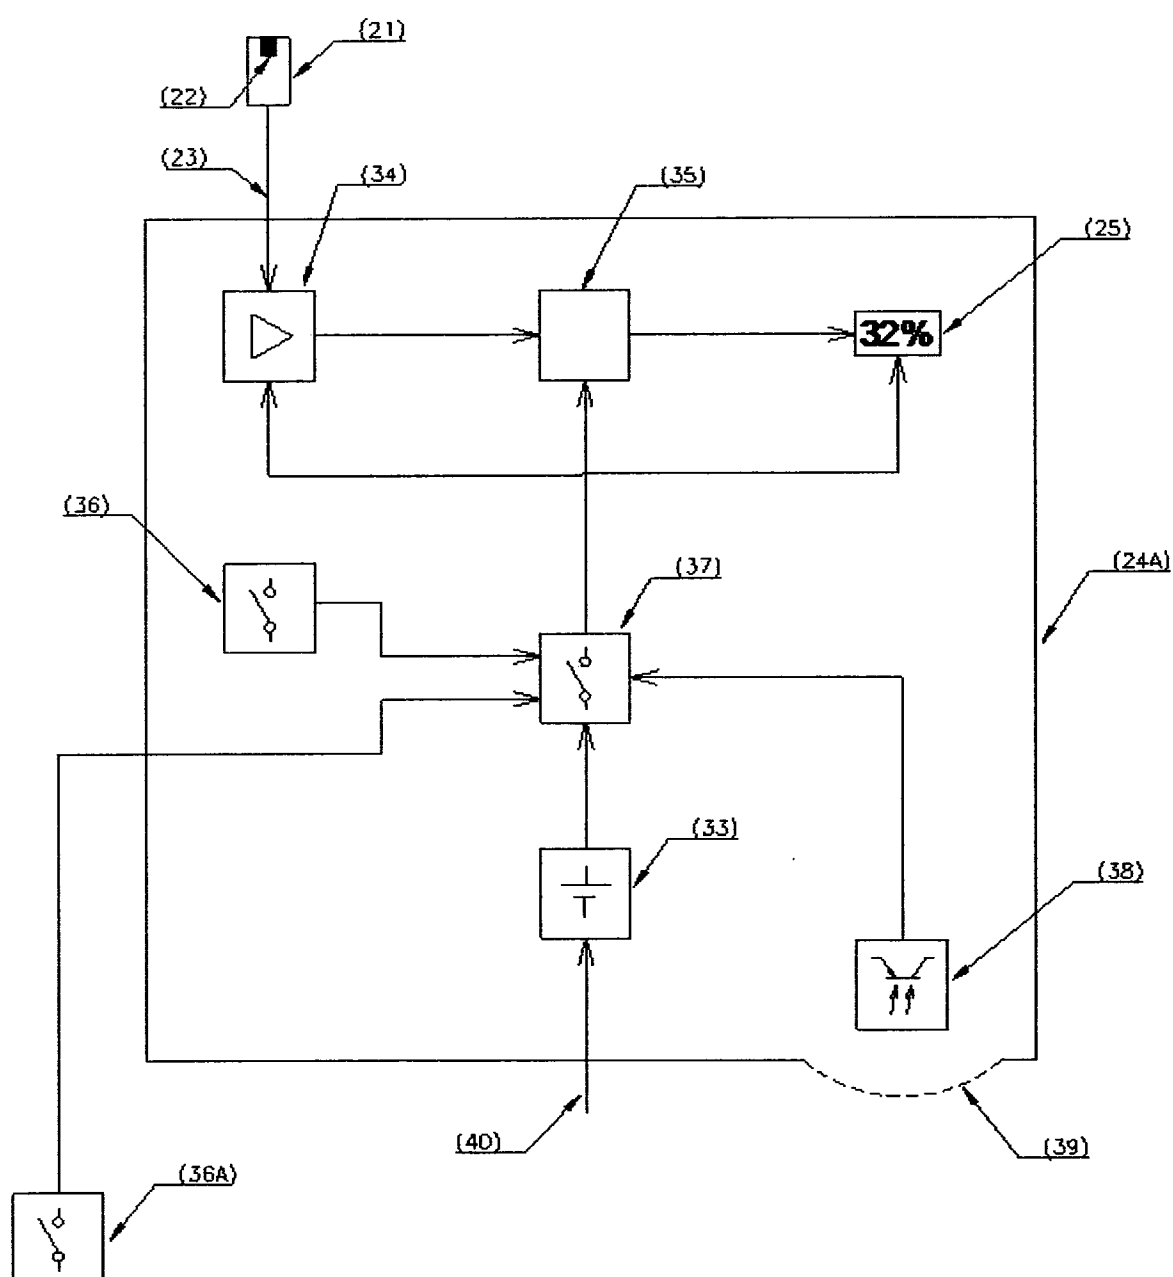

## INTERNATIONAL SEARCH REPORT

International application N°

PCT/BR2010/000422

## A. CLASSIFICATION OF SUBJECT MATTER

**H01F27/14 (20060101), H02H7/04 (20060101), H02H5/08 (20060101), H02H5/04 (20060101), G01M3/02**

According to International Patent Classification (IPC) or to both national classification and IPC

## B. FIELDS SEARCHED

Minimum documentation searched (classification system followed by classification symbols)

**H01F (20060101), H02H (20060101), H02H (20060101), H02H (20060101), G01M (20060101)**

Documentation searched other than minimum documentation to the extent that such documents are included in the fields searched

Electronic data base consulted during the international search (name of data base and, where practicable, search terms used)

**EPODOC, ESPACENET**

## C. DOCUMENTS CONSIDERED TO BE RELEVANT

| Category* | Citation of document, with indication, where appropriate, of the relevant passages                | Relevant to claims N° |
|-----------|---------------------------------------------------------------------------------------------------|-----------------------|
| X         | UA 61173 C2 (RASSALSKYI OLEKSANDR MYKOLAIOV [UA])<br>17 November 2003 (2003-11-17)<br>Abstract.   | 1-12, 15, 17-21       |
| X         | CN 101577173 A (SHANGHAI ZHIXING ELECTRIC AMOR [CN])<br>11 November 2009 (2009-11-11)<br>Abstract | 1-12, 15, 17-21       |
| A         | US 5898556 A (GEC ALSTHOM T D SA [FR])<br>27 April 1999 (1999-04-27)<br>Whole document.           | 1-12, 15, 17-21       |

☐ Further documents are listed in the continuation of Box C.☒ See patent family annex.

## \* Special categories of cited documents:

"A" document defining state of the art which is not considered to be of particular relevance

"E" earlier application or patent but published on or after the international filing date

"L" document which may throw doubts on priority claim(s) or which is cited to establish the publication date of another citation or other special reason (as specified)

"O" document referring to an oral disclosure, use, exhibition or other means

"P" document published prior to the international filing date but later than the priority claimed

"T" later document published after the international filing date or priority date and not in conflict with the application but cited to understand the principle or theory underlying the invention

"X" document of particular relevance; the claimed invention cannot be considered novel or cannot be considered to involve an inventive step when the document is taken alone

"Y" document of particular relevance; the claimed invention cannot be considered to involve an inventive step when the document is combined with one or more other such documents, such combination being obvious to a person skilled in the art

"&amp;" document member of the same patent family

Date of the actual completion of the international search

**29 March 2011**

Date of mailing of the international search report

**190411**

Name and mailing address of the ISA/BR



INSTITUTO NACIONAL DA  
PROPRIEDADE INDUSTRIAL  
Rua Marink Veiga nº 9, 18º andar  
cep: 20090-050, Centro - Rio de Janeiro/RJ  
+55 21 2139-3663

Facsimile N°:

Authorized officer

**Camilo Braga Gomes**

Telephone N°:

**+55 21 2139-3686/3742**

# INTERNATIONAL SEARCH REPORT

Information on patent family members

International application N°

PCT/BR2010/000422

| Patent documents<br>cited in search report | Publication date | Patent family members                                                                                           | Publication date                                                                               |
|--------------------------------------------|------------------|-----------------------------------------------------------------------------------------------------------------|------------------------------------------------------------------------------------------------|
| UA 61173 C2                                | 2003-11-17       | RU 2242830 C1<br>RU 2003120735 A                                                                                | 2004-12-20<br>2005-01-10                                                                       |
| -----                                      | -----            | -----                                                                                                           | -----                                                                                          |
| CN 101577173 A                             | 2009-11-11       | None                                                                                                            |                                                                                                |
| -----                                      | -----            | -----                                                                                                           | -----                                                                                          |
| US 5898556 A                               | 1999-04-27       | AT 257625 T<br>CA 2201770 A1<br>DE 69727093 D1<br>DK 800251 T3<br>ES 2213809 T3<br>FR 2747245 A1<br>PT 800251 E | 2004-01-15<br>1997-10-04<br>2004-02-12<br>2004-04-13<br>2004-09-01<br>1997-10-10<br>2004-06-30 |
| -----                                      | -----            | -----                                                                                                           | -----                                                                                          |